


Legend

Foundation 
 Pipe Pier 

Reference



Note


- Footings must be 16"x16"x10", 12" below grade.
- Girder: (3) 2"x8" or steel beam 6"x 2"x 1/4".
- Concrete must be 3000 PSI.
- Soil bearing capacity must be 2000 PSF.

7.30.21

 DEREK L. HARWOOD
 ENGINEER
 SEAL 26931

NOTICE TO CONTRACTOR
 All construction shall comply with current NC Building Codes and applicable to their jurisdiction and verification.
APPROVED
 Limited Building only review.
 Permit holder responsible for full compliance with the code.
 08/13/2021



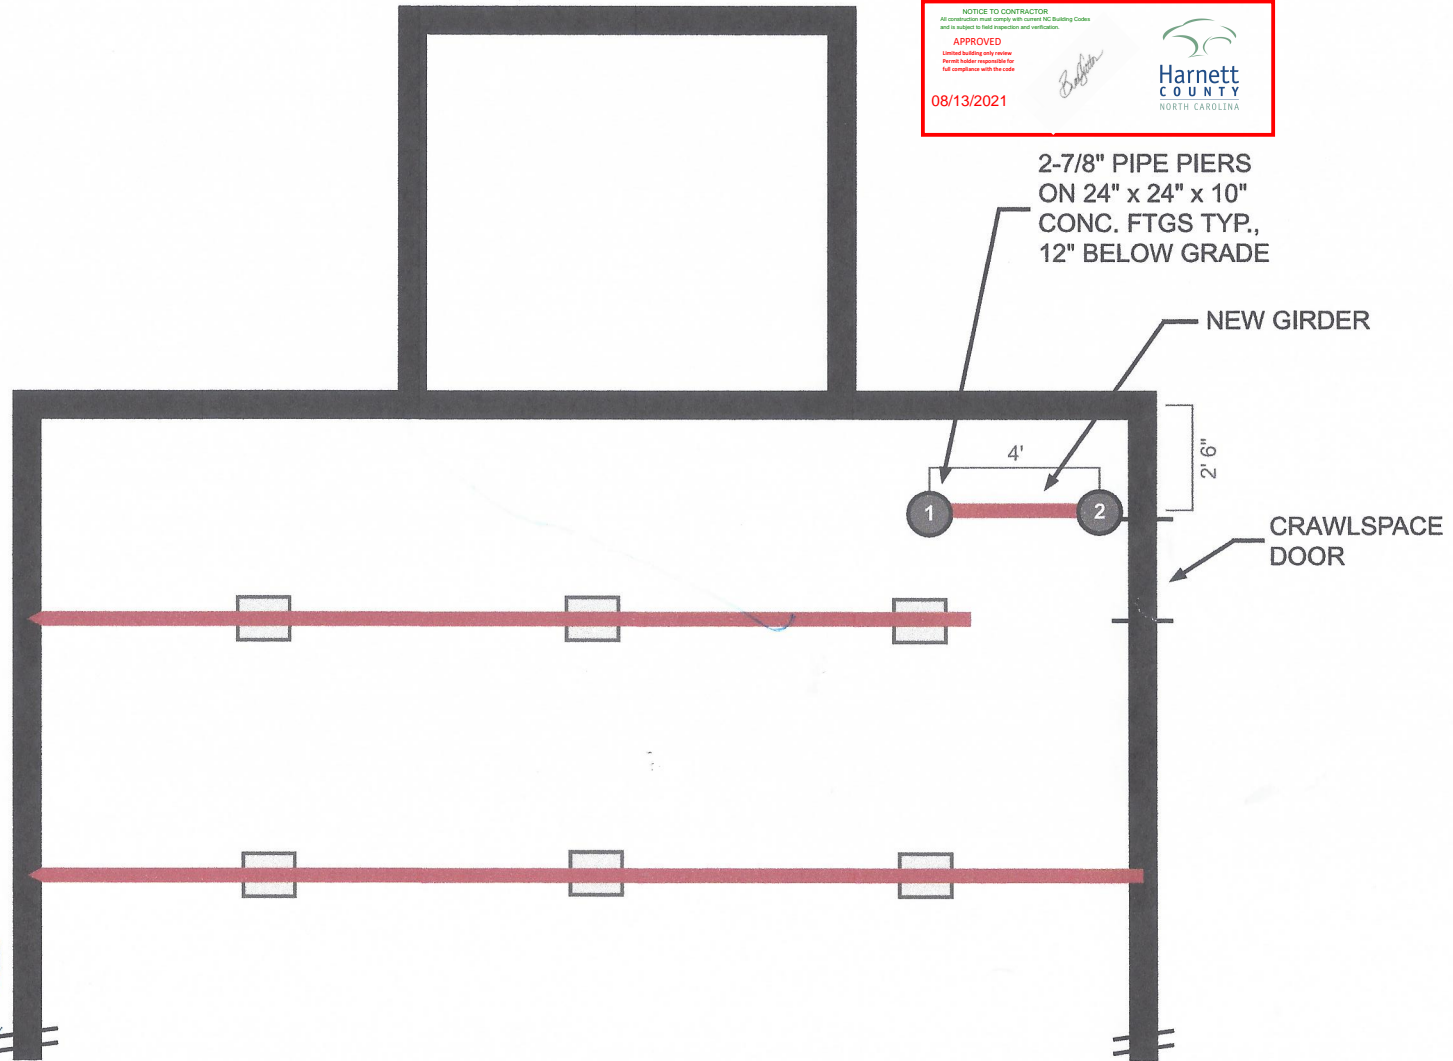

NOTE: ALL DIMENSIONS PROVIDED BY CONTRACTOR

Job Number: GFE-21-254

Wesley Tutor - 6560 Cokesbury Rd Fuquay-Varina, NC 27526



Ground Force Engineering, PLLC
 4122 Bennett Memorial Rd Suite 300
 Durham, NC 27705

Created By:
 Clay Wagner - Engineering Manager
 Phone: (984) 484-0495
 Date: 7-30-21

Client:
 Foundation Solutions LLC, dba Ram Jack
 4122 Bennett Memorial Rd Suite 304
 Durham, NC 27705