

Harnett County Department of Public Health

PERMIT # B76282109-0037

Operation Permit

- Relocation
- New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 104 LONNIE BETTS DR. (HWY 42)

Name: (owner) JEFF & GUSTY DOUGENDORF SUBDIVISION AUSTIN FARMS LOT # 7

System Installer: ADCOCK ESCAVATING


Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 2 1/2" VEZ FLOW SYSTEM IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

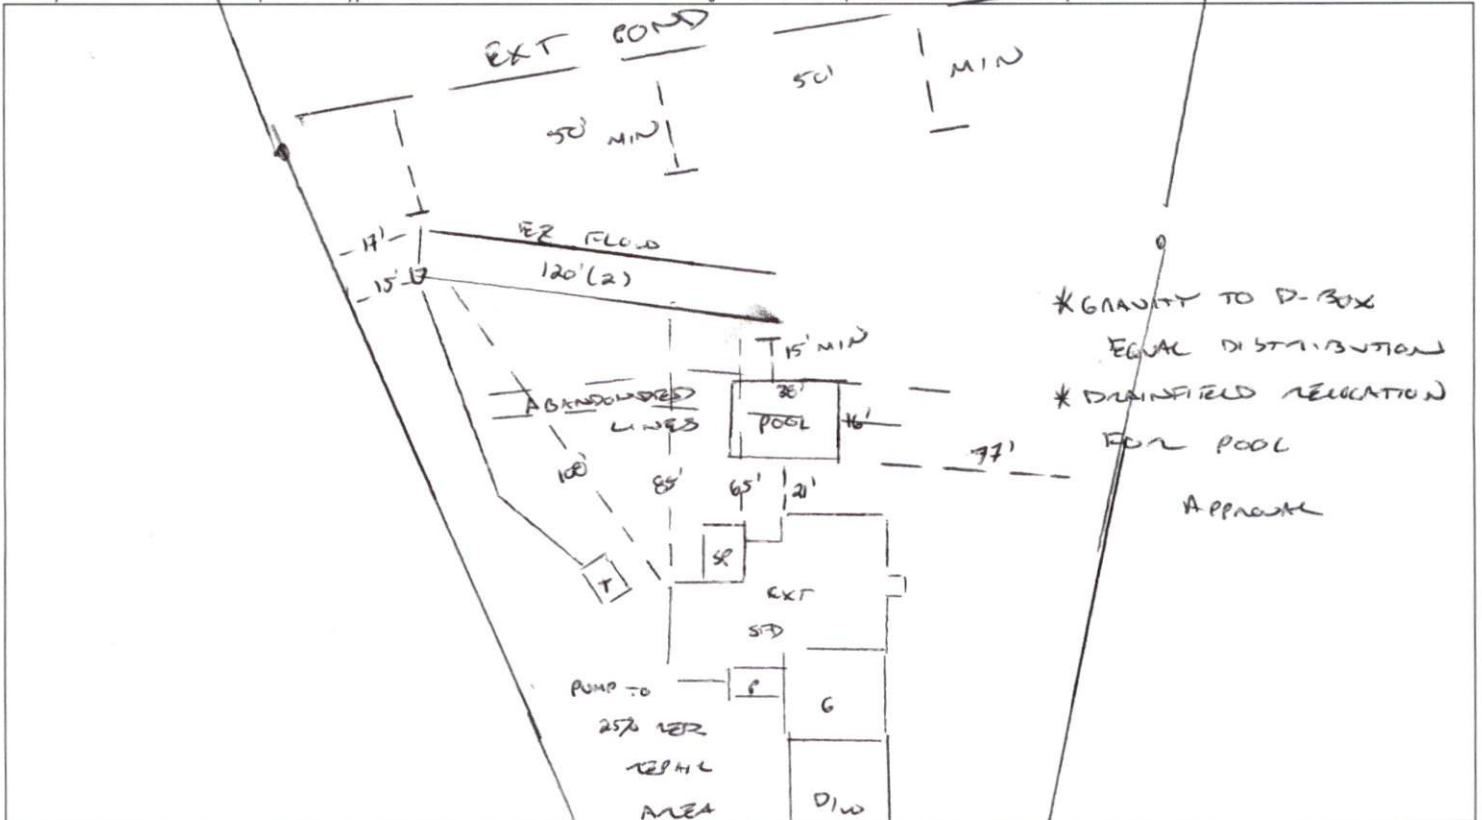

* GRAVITY TO D-BOX
EQUAL DISTRIBUTION
* DRAINFIELD RELOCATION
FOR POOL
APPROX

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: LONGIE BETTS DR.
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other VEZ FLOW IIIg Septic Tank: EXT [1000] gallons Pump Tank: _____ gallons
Subsurface No. of exact length width of depth of
Drainage Field ditches 2 of each ditch 120 feet ditches 3 feet ditches 18 inches
French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 11/05/2021