

Harnett County Department of Public Health

80 Tyne LN

PERMIT # BHS2110-0009

Operation Permit

- New Installation
- Septic Tank
- Nitrification Line
- Repair
- Expansion

PROPERTY LOCATION: 821560 Forests RD

Name: (owner) BALCAZA Blanca Gonzalez SUBDIVISION TEE TOP LOT # 23

System Installer: LARRY STAMPE

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: 2590 Reduction System Check Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.
02/20/23

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

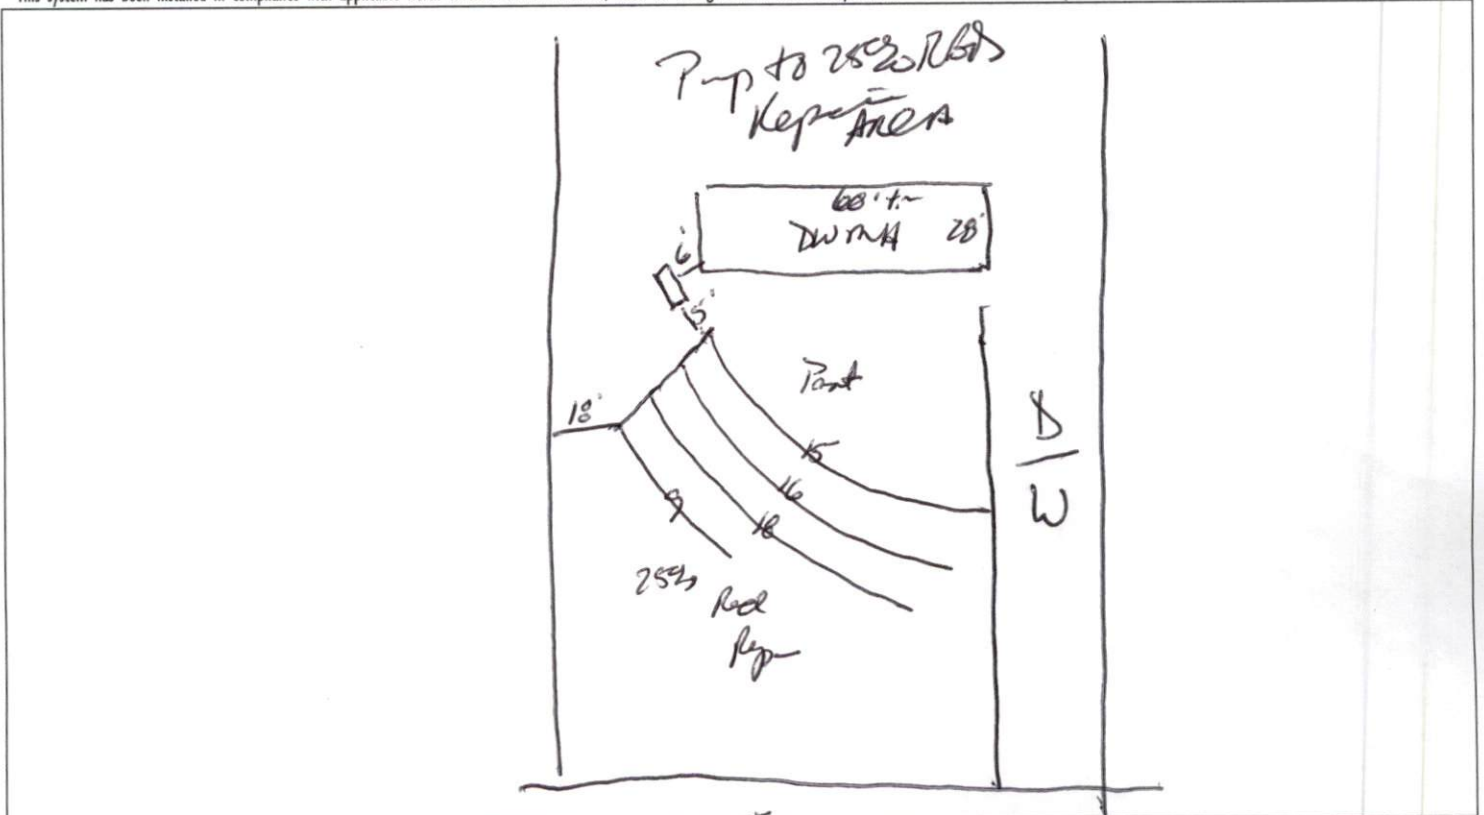

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

- D-Box
- Pump
- Alarm
- H2O Line
- PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 2590 RBS Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface drainage field: No. of ditches 1 exact length of each ditch 240 feet width of ditches 3 feet depth of ditches 22 inches
 French Drain Required: _____ Linear feet

Authorized State Agent James E. Markham Date 2-20-23