


REVISION TABLE	NUMBER	DATE	REVISOR	DESCRIPTION

**Will Crocker**  
74 OakRidge Duncan Road  
Fuquay Varina, NC 27526

**Home Work Services**  
3312 Black Stallion Court  
Zebulon, NC  
PH - 919-669-6987  
[www.hwsgarage.com](http://www.hwsgarage.com)

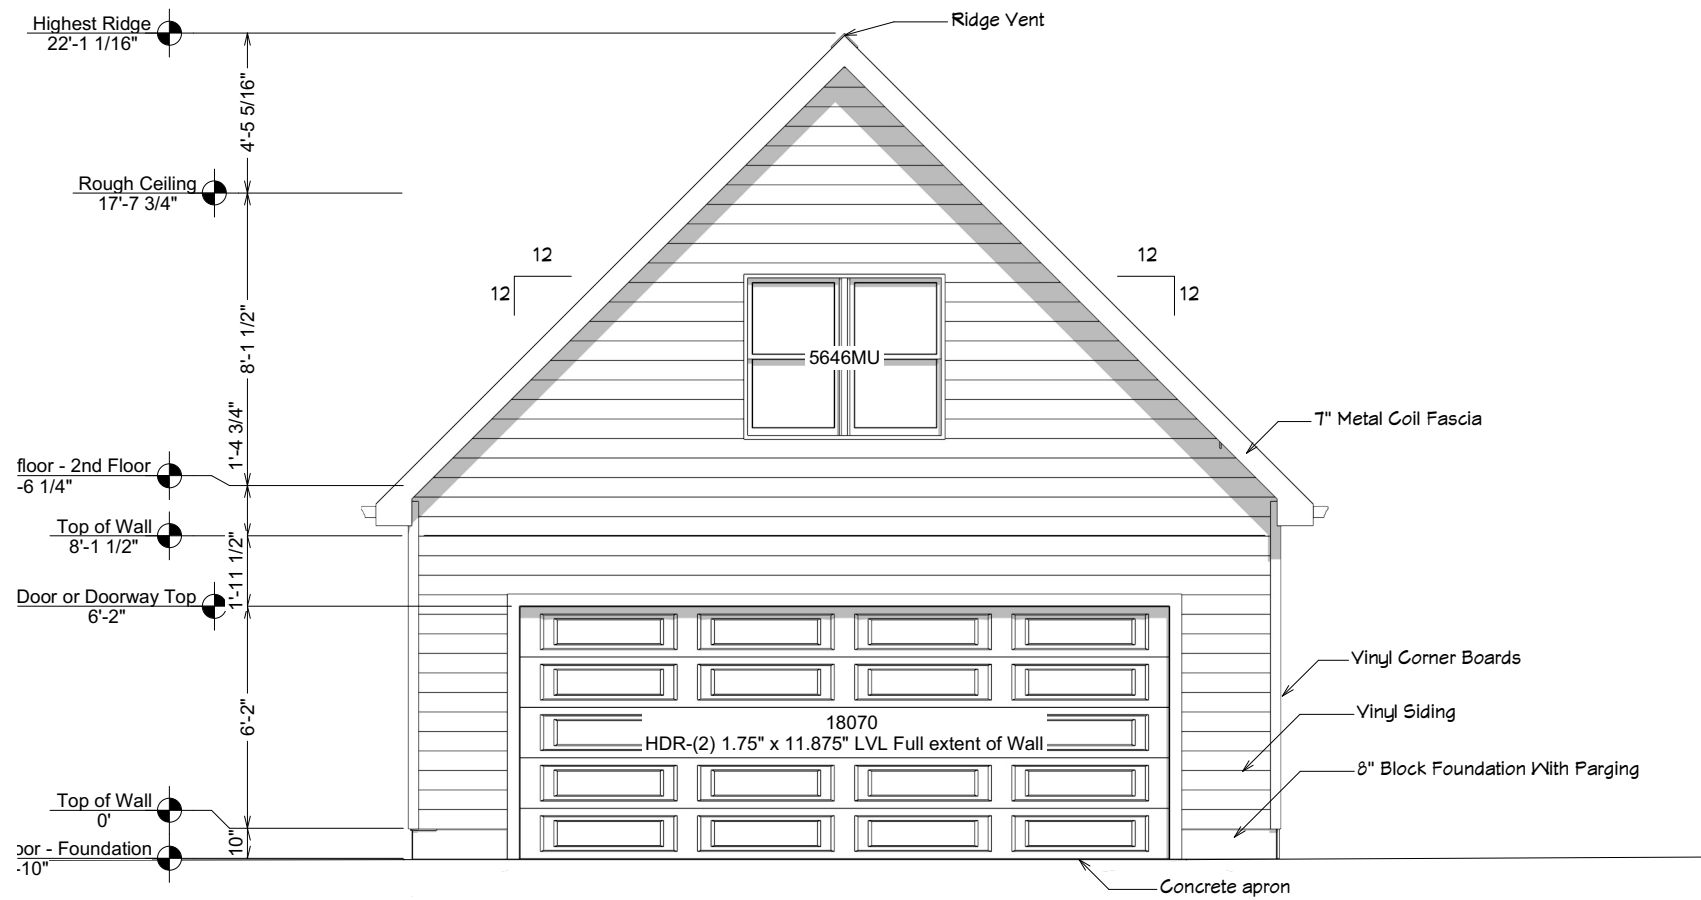

**EXTERIOR ELEVATION FRONT**  
SCALE: 3/16 in = 1 ft



**EXTERIOR ELEVATION RIGHT**

SCALE: 3/16 in = 1 ft

SHEET #

2

REVISION TABLE

NUMBER	DATE	REVISED BY	DESCRIPTION


Will Crocker  
 74 OakRidge Duncan Road  
 Fuquay Varina, NC 27526

Home Work Services  
 3312 Black Stallion Court  
 Zebulon, NC  
 PH - 919-669-6987  
[www.hwsgarage.com](http://www.hwsgarage.com)



**EXTERIOR ELEVATION BACK**

SCALE: 3/16 in = 1 ft

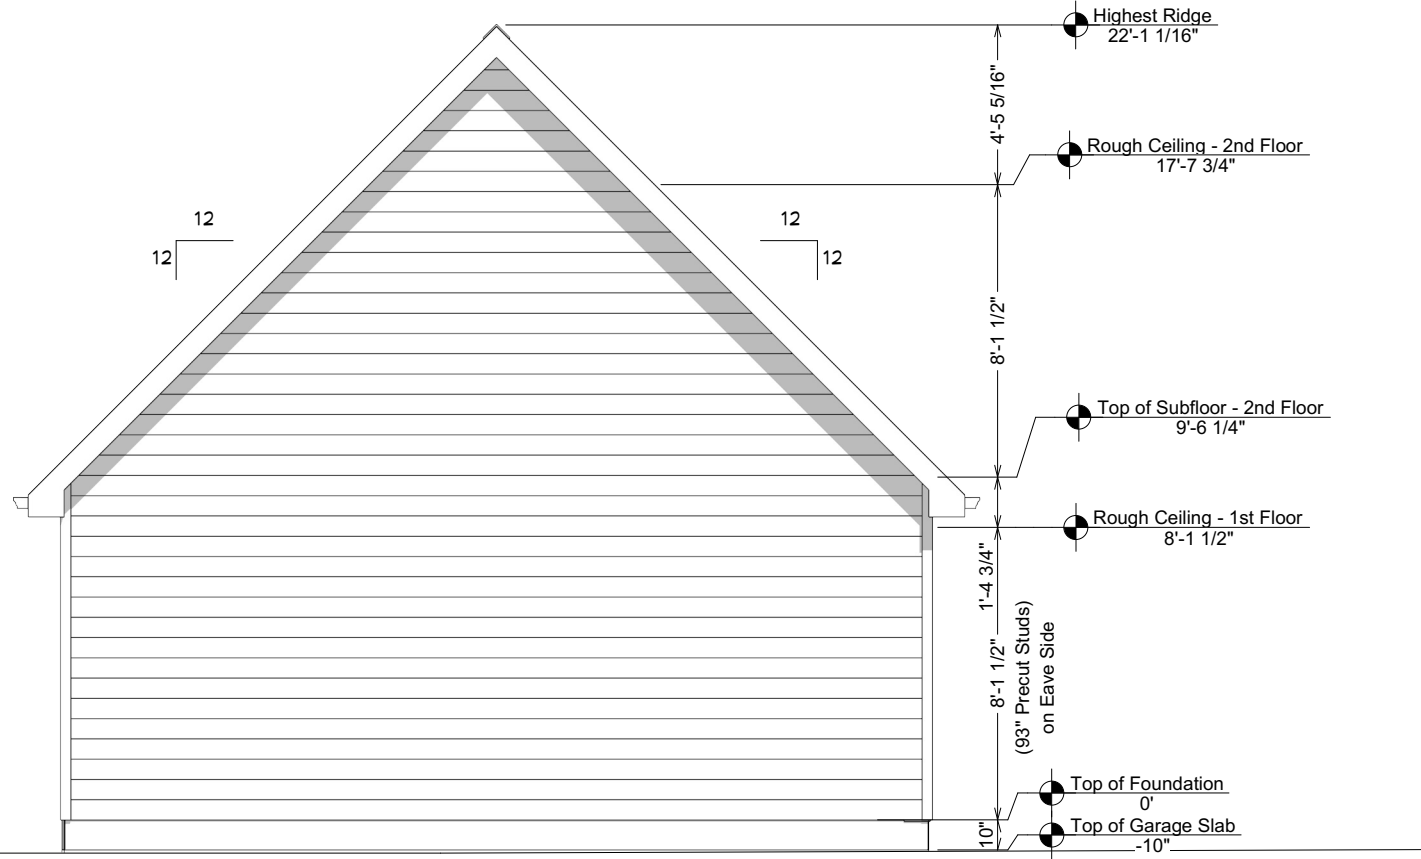


REVISION TABLE	NUMBER	DATE	REVISION BY	DESCRIPTION

Will Crocker  
 74 OakRidge Duncan Road  
 Fuquay Varina, NC 27526

Home Work Services  
 3312 Black Stallion Court  
 Zebulon, NC  
 PH - 919-669-6987  
[www.hwsgarage.com](http://www.hwsgarage.com)



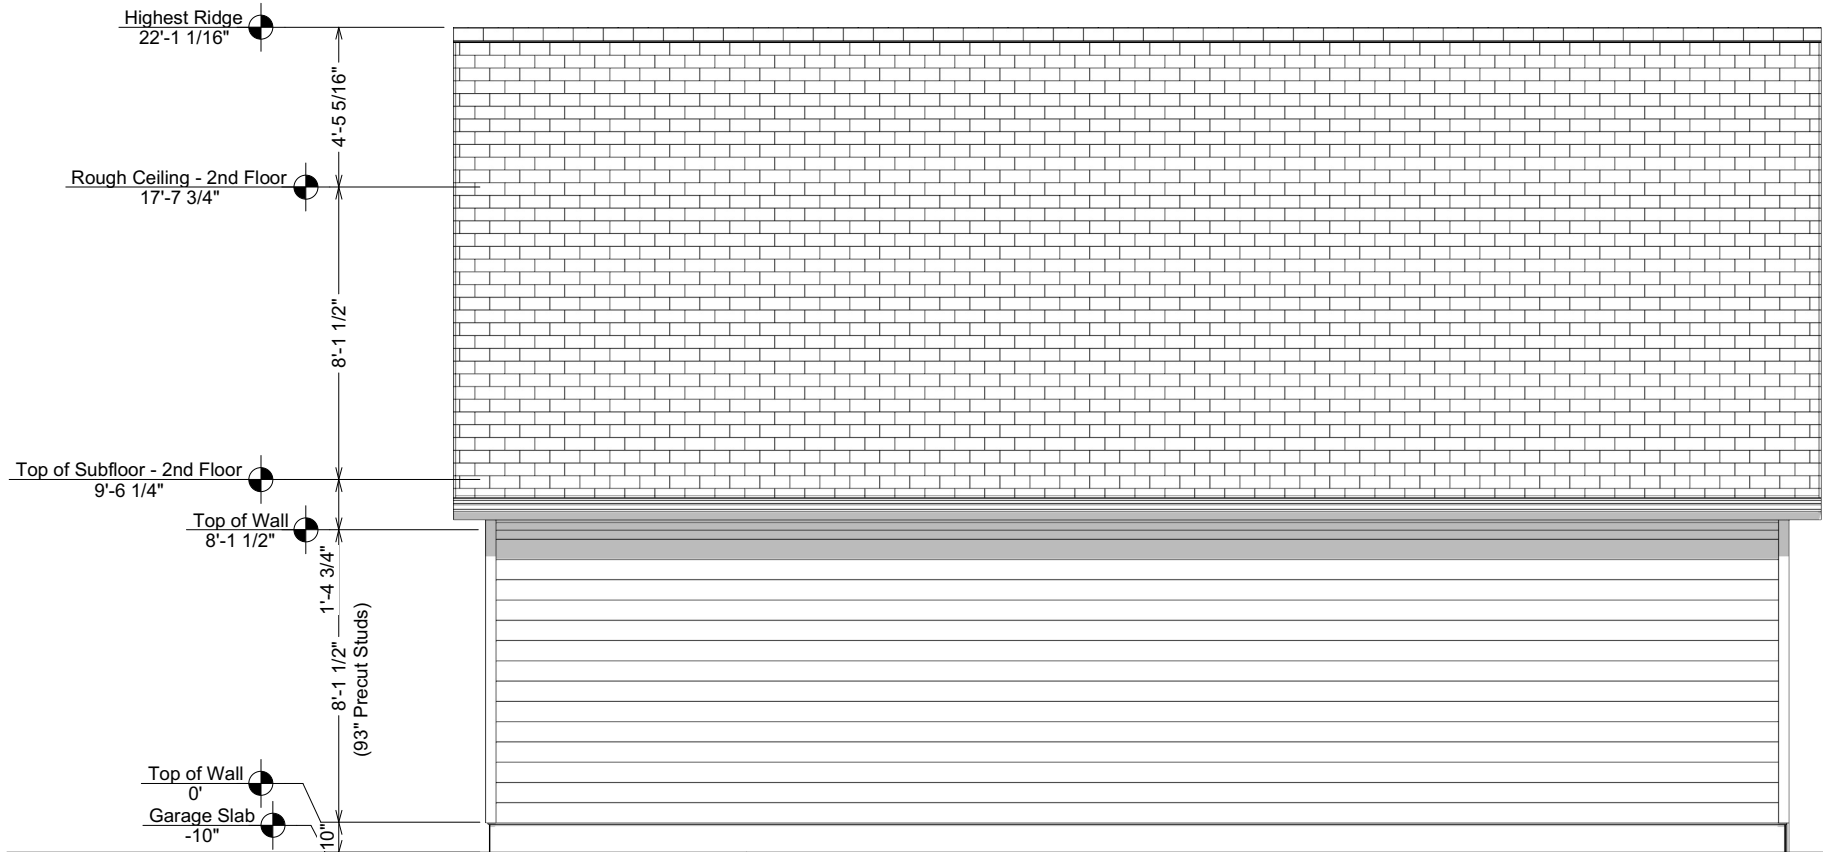

**EXTERIOR ELEVATION LEFT**

SCALE: 3/16 in = 1 ft

SHEET #


4

REVISION TABLE	
NUMBER	DATE

Will Crocker  
 74 OakRidge Duncan Road  
 Fuquay Varina, NC 27526

Home Work Services  
 3312 Black Stallion Court  
 Zebulon, NC  
 PH - 919-669-6987  
[www.hwsgarage.com](http://www.hwsgarage.com)



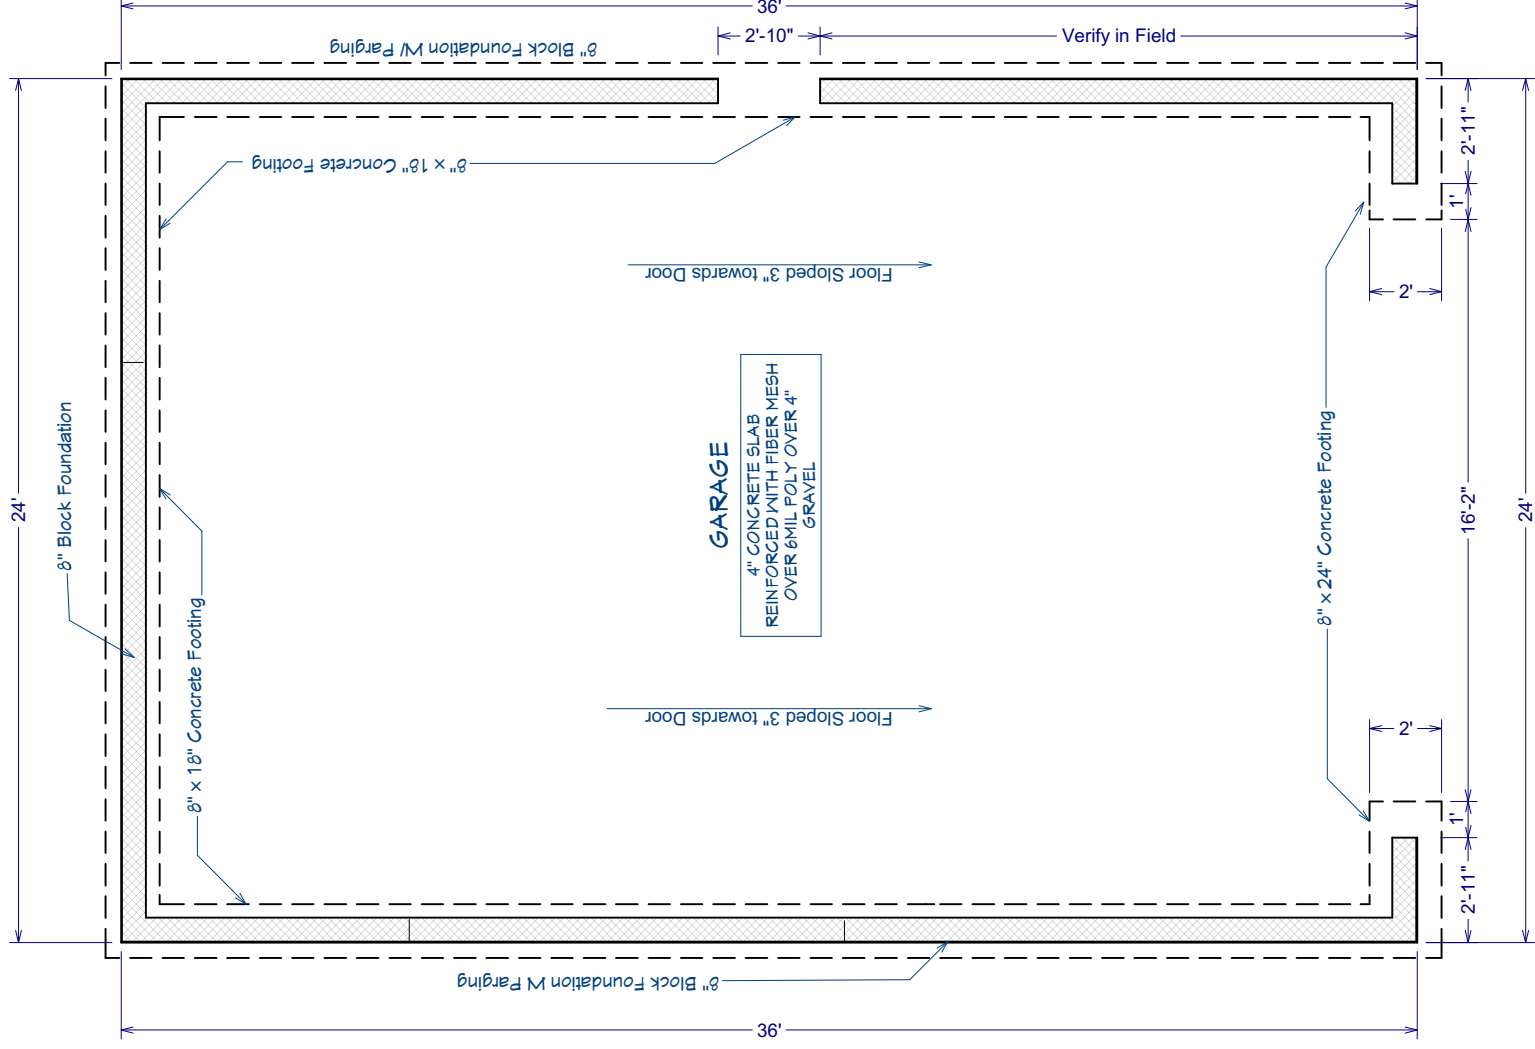

## FOUNDATION PLAN

SCALE: 3/16 in = 1 ft


Home Work Services  
3312 Black Stallion Court  
Zebulon, NC  
PH - 919-669-6987  
www.hwsgarage.com

Will Crocker  
74 OakRidge Duncan Road  
Fuquay Varina, NC 27526

REVISION TABLE	
NUMBER	DATE

SHEET #

5

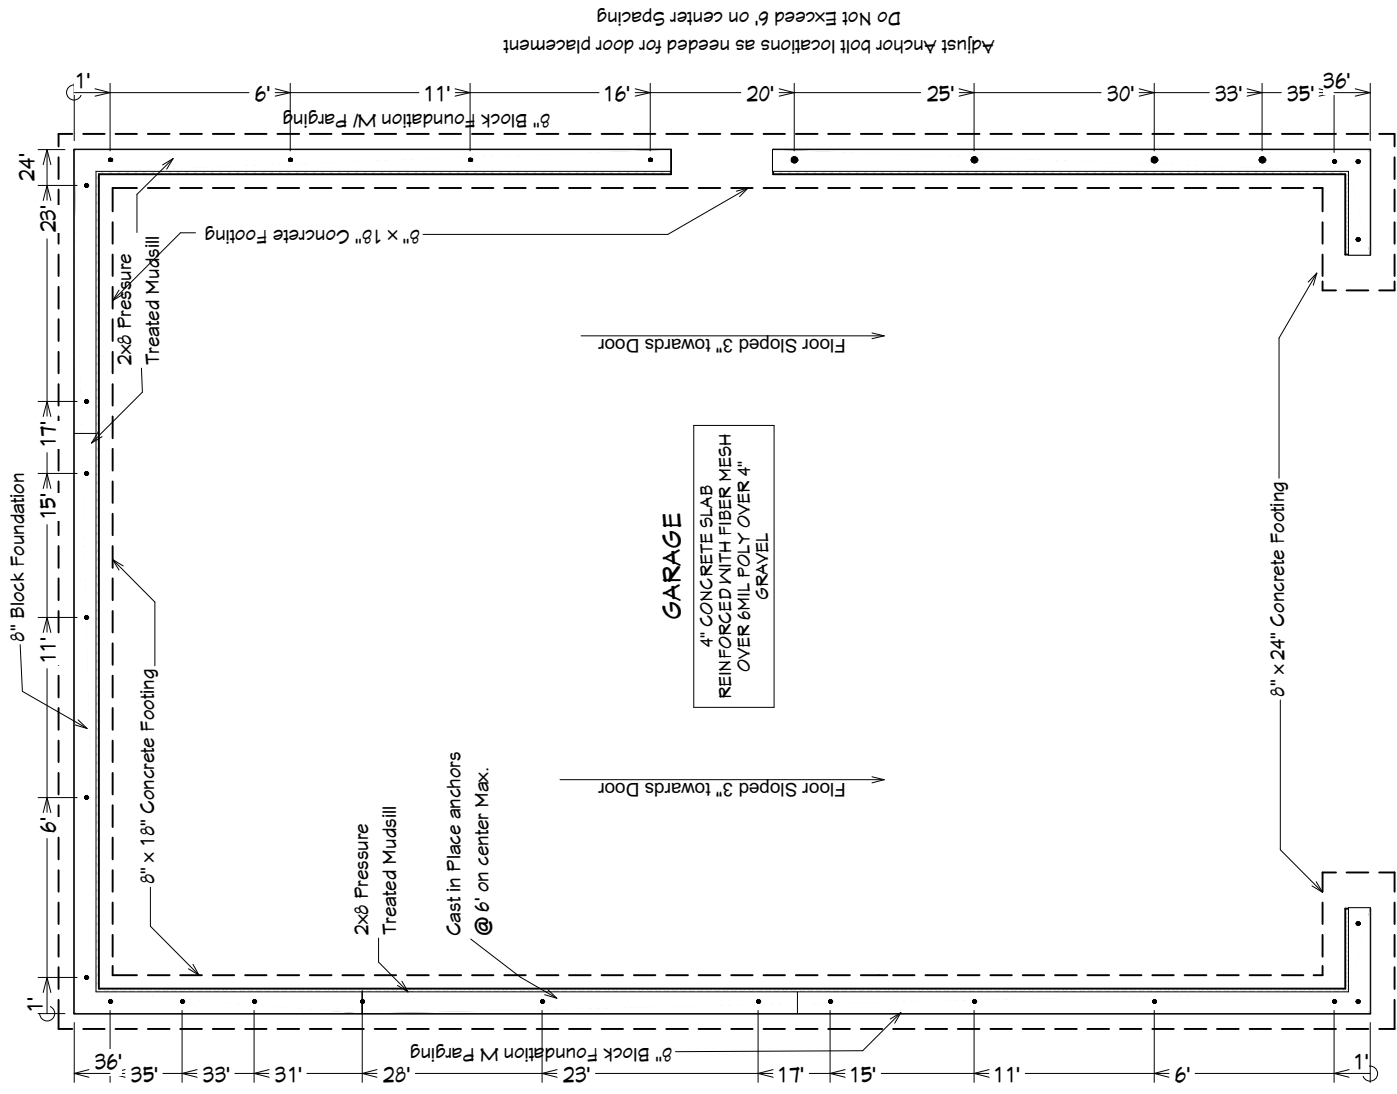

## ANCHOR BOLT PLAN


SCALE: 3/16 in = 1 ft

**Home Work Services**  
3312 Black Stallion Court  
Zebulon, NC  
PH - 919-669-6987  
www.hwsgarage.com

**Will Crocker**  
74 OakRidge Duncan Road  
Fuquay Varina, NC 27526

REVISION TABLE			
NUMBER	DATE	REVISOR	DESCRIPTION



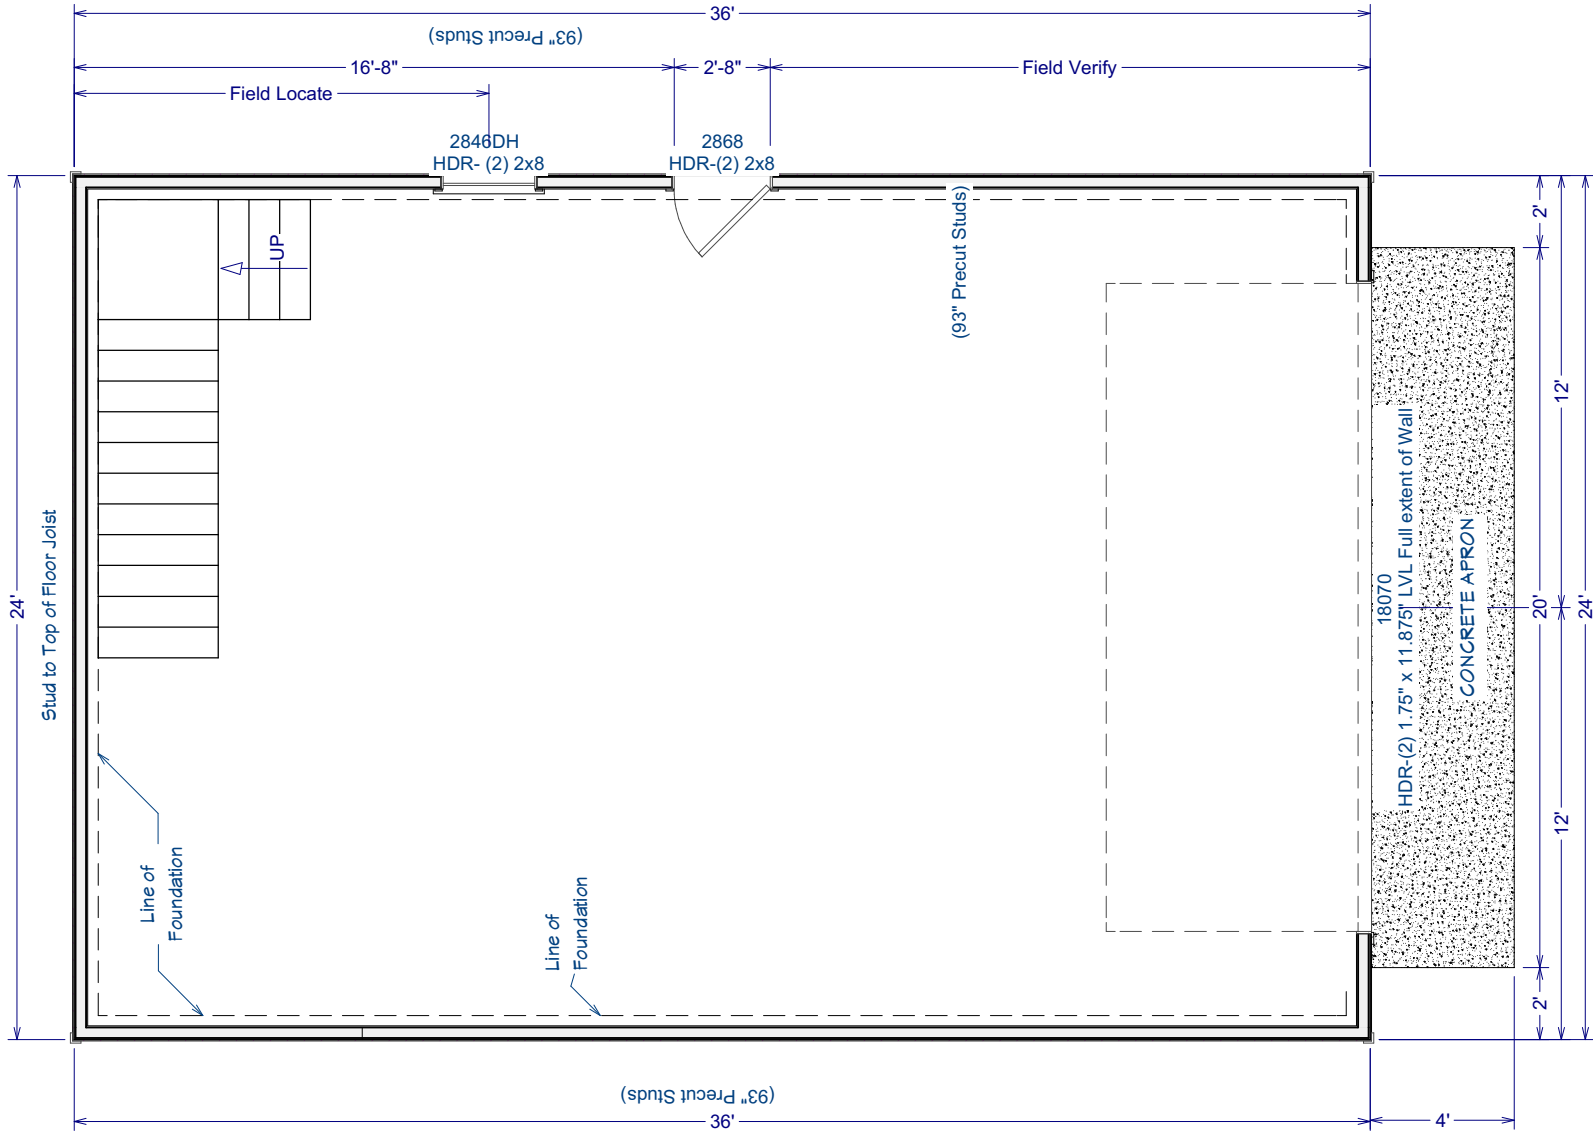

**MAIN FLOOR PLAN**

SCALE: 3/16 in = 1 ft




Home Work Services  
 3312 Black Stallion Court  
 Zebulon, NC  
 PH - 919-669-6987  
[www.hwsgarage.com](http://www.hwsgarage.com)

Will Crocker  
 74 OakRidge Duncan Road  
 Fuquay Varina, NC 27526

REVISION TABLE	
NUMBER	DATE
	REVISY BY
	DESCRIPTION

SHEET #  
**7**

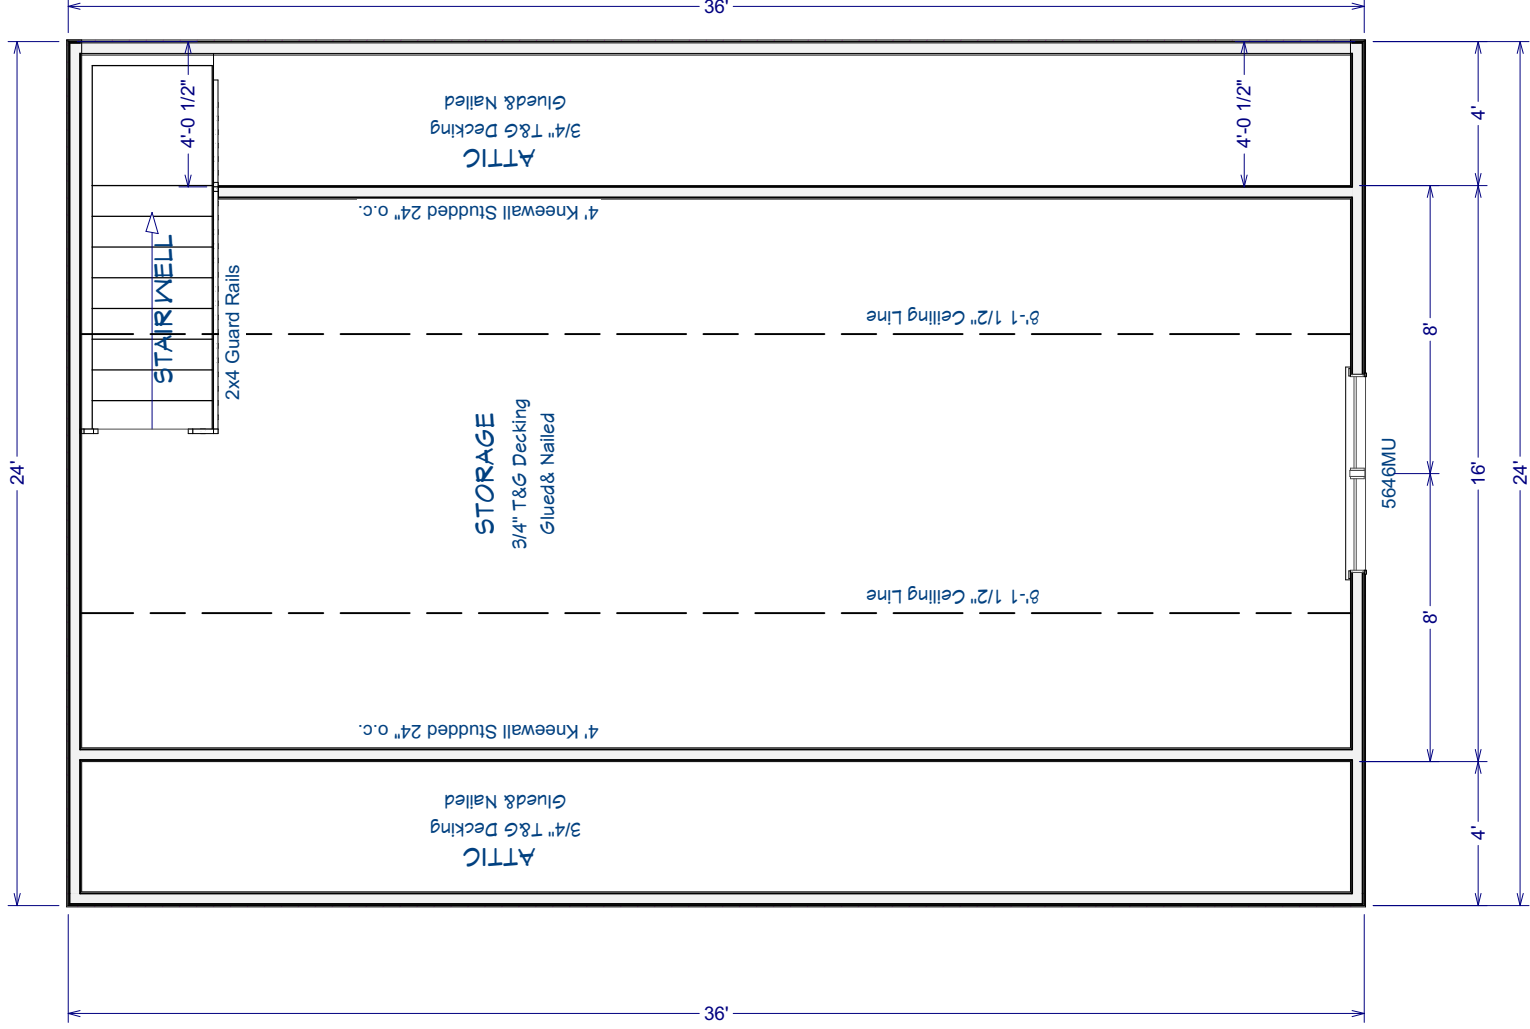

## UPPER FLOOR PLAN

SCALE: 3/16 in = 1 ft

Home Work Services  
 3312 Black Stallion Court  
 Zebulon, NC  
 PH - 919-669-6987  
[www.hwsgarage.com](http://www.hwsgarage.com)


Will Crocker  
 74 OakRidge Duncan Road  
 Fuquay Varina, NC 27526

REVISION TABLE	
NUMBER	DATE
	REVISOR
	DESCRIPTION

SHEET #

8



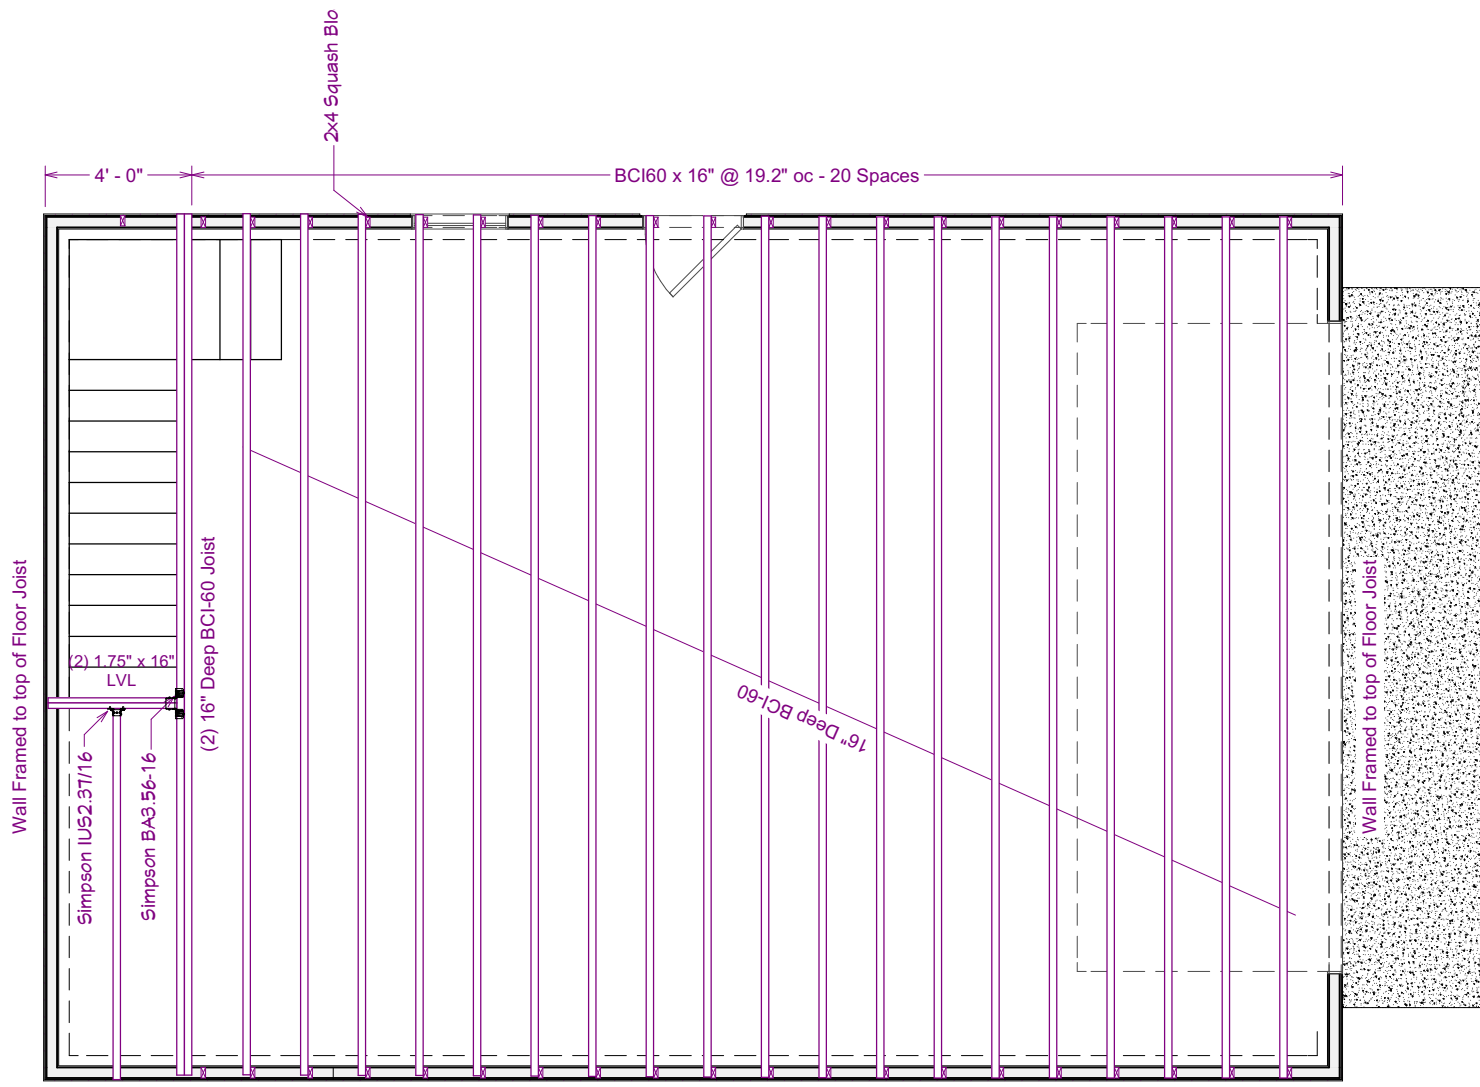

**FLOOR FRAMING PLAN**


SCALE: 3/16 in = 1 ft



Home Work Services  
 3312 Black Stallion Court  
 Zebulon, NC  
 PH - 919-669-6987  
[www.hwsgarage.com](http://www.hwsgarage.com)

Will Crocker  
 74 OakRidge Duncan Road  
 Fuquay Varina, NC 27526

REVISION TABLE	
NUMBER	DATE

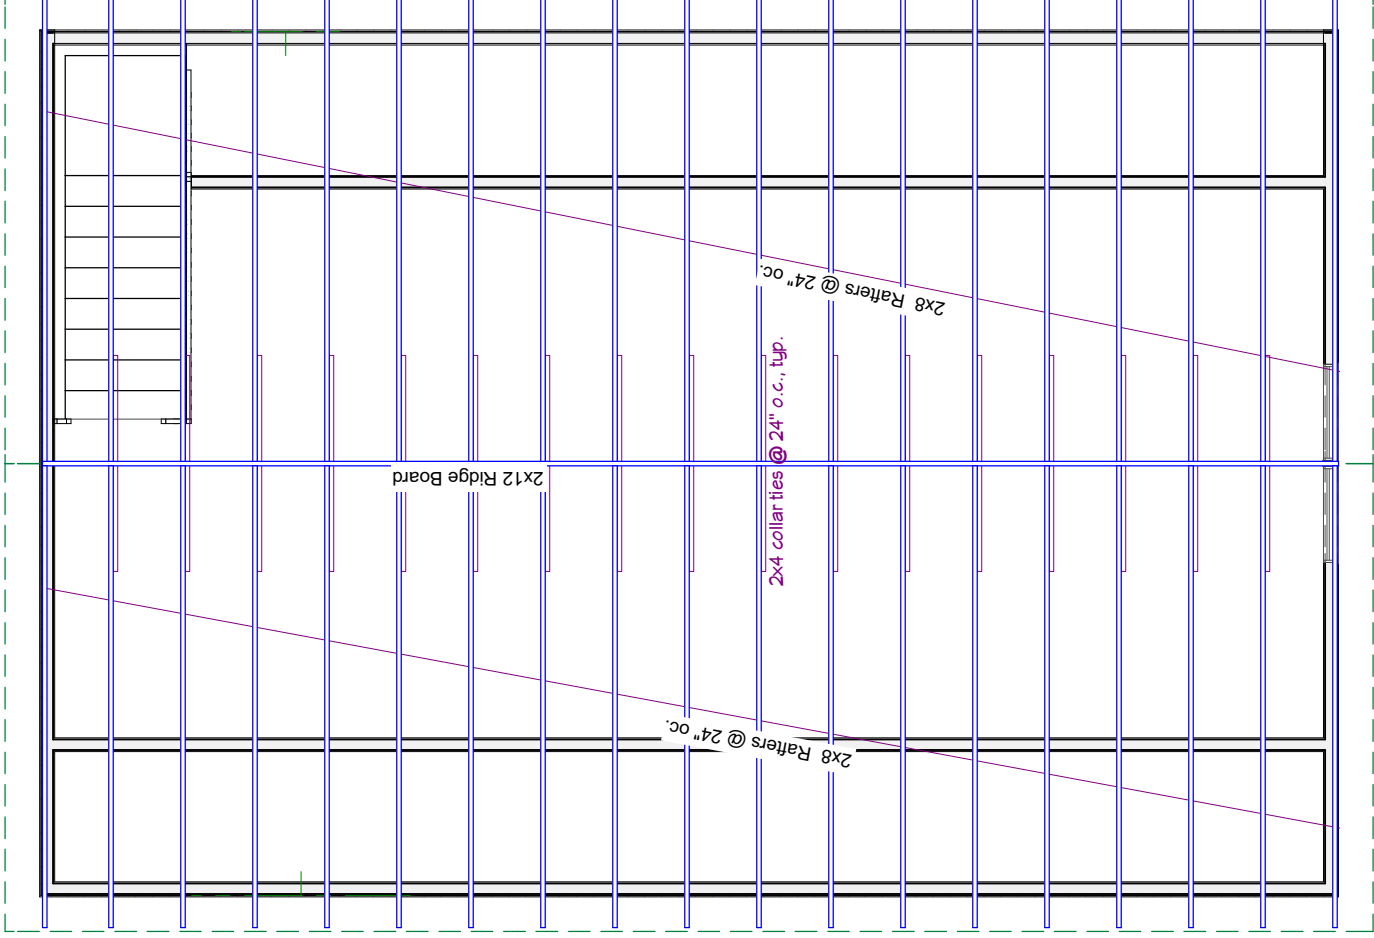

## ROOF FRAMING PLAN

SCALE: 3/16 in = 1 ft



Home Work Services  
 3312 Black Stallion Court  
 Zebulon, NC  
 PH - 919-669-6987  
[www.hwsgarage.com](http://www.hwsgarage.com)

Will Crocker  
 74 OakRidge Duncan Road  
 Fuquay Varina, NC 27526


REVISION TABLE			
NUMBER	DATE	REVISED BY	DESCRIPTION

SHEET #

10

Will Crocker  
74 OakRidge Duncan Road  
Fuquay Varina, NC 27526

Home Work Services  
3312 Black Stallion Court  
Zebulon, NC  
PH - 919-669-6987  
www.hwsgarage.com

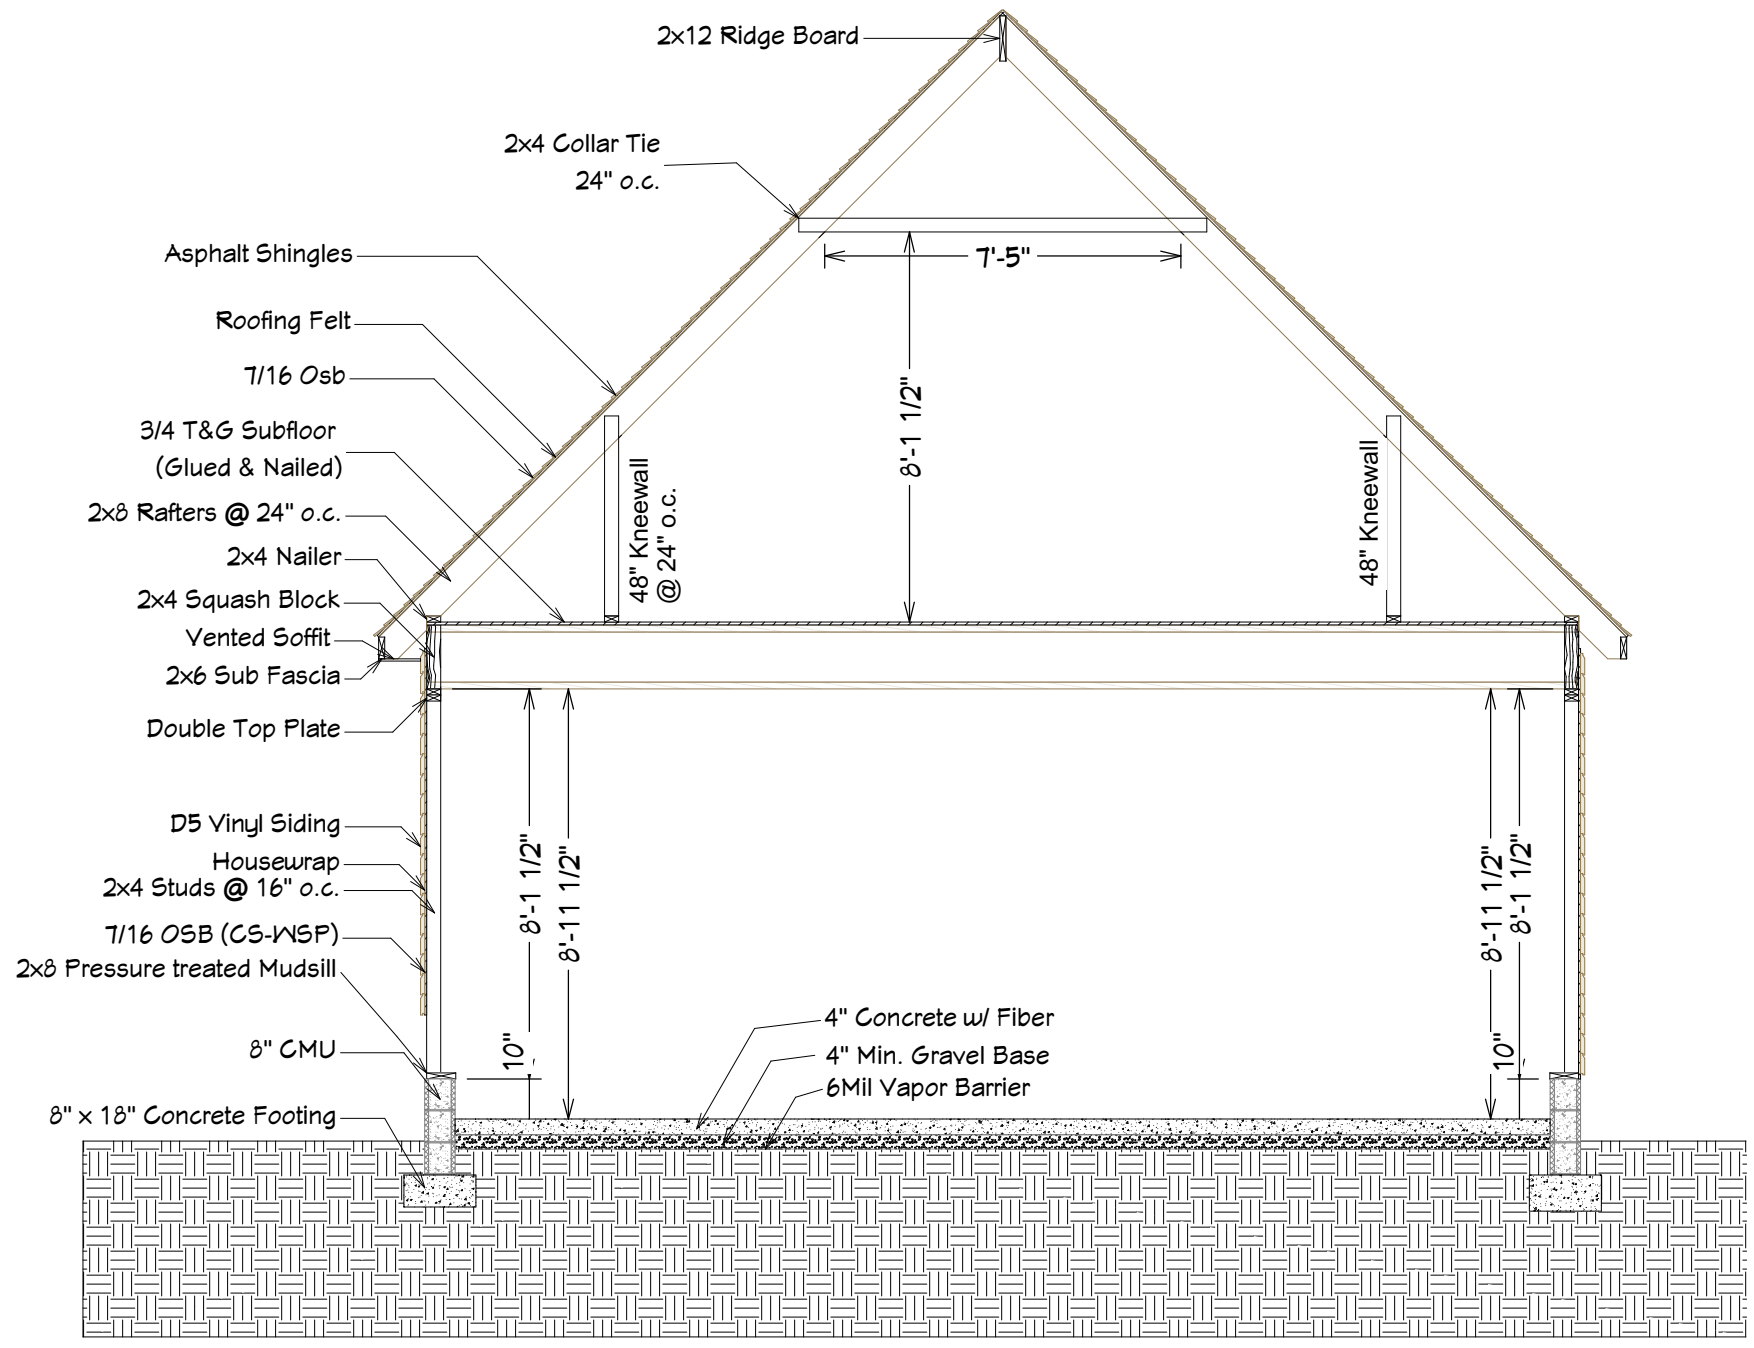

**FRONT SECTION**

SCALE: 1/4 in = 1 ft

**GENERAL STRUCTURAL NOTES:**

- CONSTRUCTION SHALL CONFORM TO THE 2018 NC Residential Code.
- CONTRACTOR SHALL VERIFY ALL DIMENSIONS. CONTRACTOR SHALL COMPLY WITH THE CONTENTS OF THE DRAWINGS FOR THIS SPECIFIC PROJECT. ENGINEER IS NOT RESPONSIBLE FOR ANY DEVIATIONS FROM THIS PLAN.
- CONTRACTOR IS RESPONSIBLE FOR PROVIDING TEMPORARY BRACING REQUIRED TO RESIST ALL FORCES ENCOUNTERED DURING ERECTION.
- THE FOLLOWING DESIGN LOADS ARE USED:

DESIGN LOADS	Live Load (PSF)	Dead Load (PSF)	Deflection (LL)
Usage			
Attics Without Storage	10	----	L/240
Attics With Limited Storage	20	10	L/360
Attics With Fixed Stairs	40	10	L/360
Balconies & Decks	40	10	L/360
Fire Escapes	40	10	L/360
Guardrails and Handrails	200	----	----
Guardrail In-fill components	50	----	----
Passenger vehicle garages	50	10	L/360
Rooms other than sleeping	40	10	L/360
Sleeping rooms	30	10	L/360
Stairs	40	----	----
Snow	20	----	----

- PROPERTIES USED IN THE DESIGN ARE AS FOLLOWS:  
MICROLLAM (LVL): F = 2600 PSI, E = 285 PSI, E = 190,000,000 PSI  
PARALLAM (PSL): F = 2900 PSI, F = 290 PSI, E = 125,000,000 PSI
- ALL WOOD MEMBERS SHALL BE #2 SPF UNLESS NOTED ON PLANS. ALL STUD COLUMNS AND JOISTS SHALL BE #2 SPF UNLESS NOTED OTHERWISE.
- ALL BEAMS SHALL BE SUPPORTED WITH A (2) 2X4 #2 SPF STUD COLUMN AT EACH END UNLESS NOTED OTHERWISE.
- ALL PARALLEL NON-LOAD BEARING WALLS SHALL BE SUPPORTED WITH A DOUBLE JOIST UNLESS NOTED OTHERWISE.
- COMPRESSIVE STRENGTH OF CONCRETE SHALL BE A MINIMUM OF 3000 PSI / 28-DAYS.
- SOIL BEARING CAPACITY TO BE A MINIMUM OF 2000 PSF
- ALL REINFORCING STEEL SHALL BE GRADE 60 BARS CONFORMING TO ASTM A615 AND SHALL HAVE A MINIMUM COVER OF 3".
- FOOTINGS AND PIERS SHALL BE CENTERED AROUND THEIR RESPECTIVE ELEMENTS. PROVIDE A MINIMUM OF 3" FOOTING PROJECTION FROM FACE OF MASONRY.
- MAXIMUM DEPTH OF UNBALANCED FILL AGAINST MASONRY WALLS TO BE AS SPECIFIED IN THE 2018 NC Residential Code TABLE R404.1.1(1).
- FOUNDATION ANCHORAGE SHALL BE CONSTRUCTED PER 2018 NC Residential Code SECTION 403.1.6. 1/2" DIA. BOLTS SPACED AT 6'-0" CENTERS WITH A 7" MINIMUM EMBEDMENT INTO MASONRY OR CONCRETE. ANCHOR BOLTS SHALL BE 12" FROM THE END OF EACH PLATE SECTION.
- COMPONENT & CLADDING DESIGNED FOR THE FOLLOWING LOADS: (IN PSF)

MEAN ROOF HT	UP TO 30'	30'-35'	35'-40'	40'-45'
ZONE 1	16.5, -18.0	17.3, -18.9	18.0, -19.6	18.5, -20.2
ZONE 2	16.5, -21.0	17.3, -22.1	18.0, -22.9	18.5, -23.5
ZONE 3	16.5, -21.0	17.3, -22.1	18.0, -22.9	18.5, -23.5
ZONE 4	18.0, -19.5	18.9, -20.5	19.6, -21.3	20.2, -21.8
ZONE 5	18.0, -24.1	18.9, -25.3	19.6, -26.3	20.2, -27.0


BASIC DESIGN WIND VELOCITY = 110 MPH, EXPOSURE B

- CONTRACTOR TO PROVIDE LOOKOUTS WHEN CEILING JOISTS SPAN PERPENDICULAR TO RAFTERS.
- FLITCH BEAMS AND 3- OR 4-PLY LVLS SHALL BE BOLTED TOGETHER W/ 1/2" THRU BOLTS SPACED @ 24" O.C. (MAX) STAGGERED. MINIMUM EDGE DISTANCE SHALL BE 2" AND (2) BOLTS SHALL BE LOCATED MINIMUM 6" FROM EACH END OF BEAM.
- ALL NON-LOAD BEARING INTERIOR DOOR HEADERS SHALL BE (2) FLAX 2" DROPPED, U.N.O.
- ALL LOAD BEARING HEADERS SHALL BE (2) 2X10 SPF UNO.

TS - TIMBER STRAND  
SC - STUD COLUMN  
EE - EACH END  
TJ - TRIPLE JOIST  
CL - CENTER LINE

DJ - DOUBLE JOIST  
DR - DOUBLE RAFTER  
TR - TRIPLE RAFTER  
OC - ON CENTER  
PL - POINT LOAD

**Method PFG (Portal Frame at Garage Door Openings)**

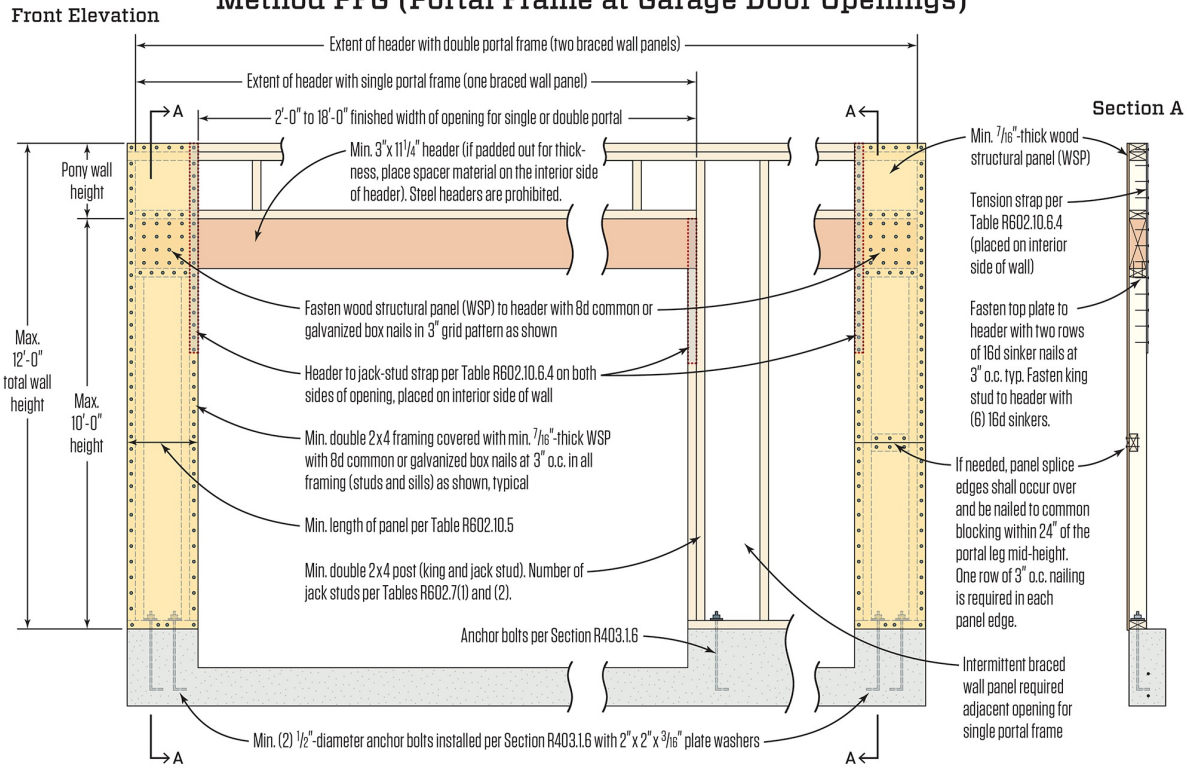

SHEET #  
**12**

REVISION TABLE	NUMBER	DATE	REVISION BY/DESCRIPTION

**Will Crocker**  
74 OakRidge Duncan Road  
Fuquay Varina, NC 27526

**Home Work Services**  
3312 Black Stallion Court  
Zebulon, NC  
PH - 919-669-6987  
www.hwsgarage.com

