ROOF VENTILATING REQUIREMENTS

$\frac{1176}{150}$ = 7.84 SQ. FT. REQ'D

ROOF VENTILATING REQUIREMENTS
(POWER ROOF VENTILATOR REQUIRED)

$\frac{1176}{300}$ = 3.92 SQ. FT. REQ'D

BUILDER TO PROVIDE APPROPRIATE VENTILATING AS REQUIRED.

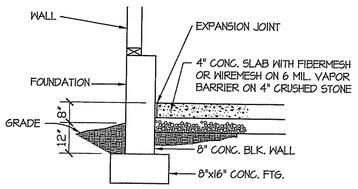

GARAGE SLAB
SCALE: NTS

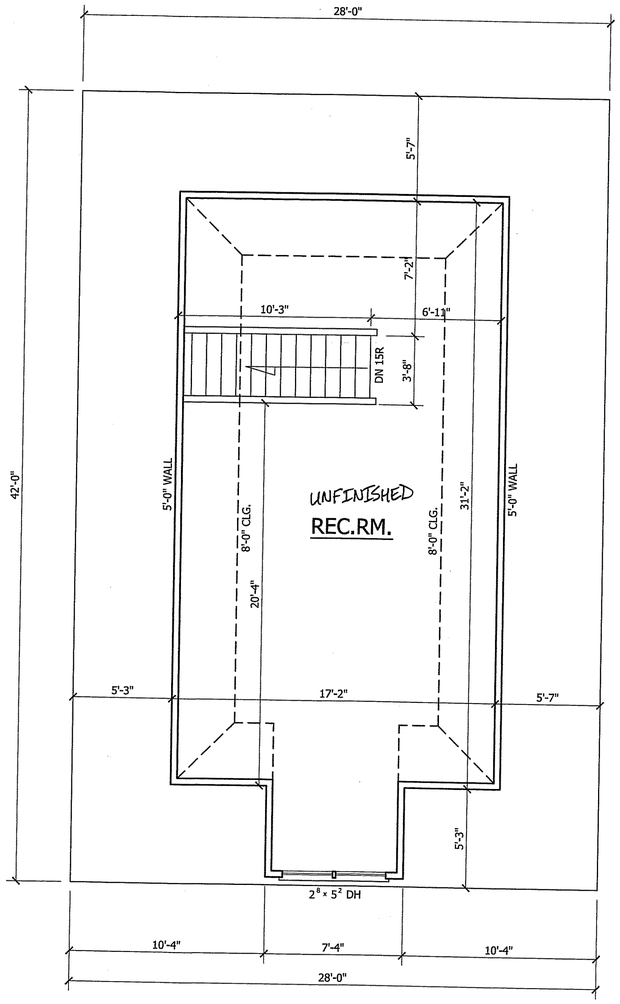

SECOND FLOOR PLAN
SCALE: 1/4"=1'-0"
8'-0" CLG. HGT.
SET WINDOWS AT 6'-8" A.F.F.

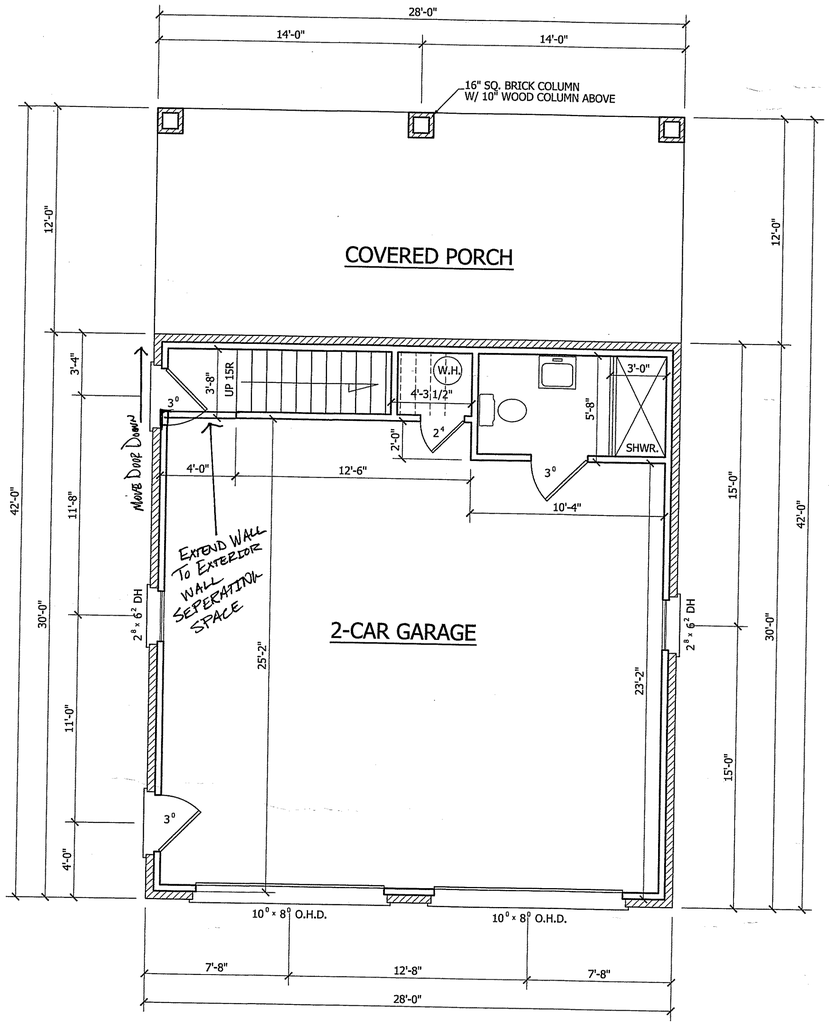

FIRST FLOOR PLAN
SCALE: 1/4"=1'-0"
9'-0" CLG. HGT.
SET WINDOWS AT 7'-10" A.F.F.

GARAGE SQ. FT.	= 840
PORCH SQ. FT.	= 336
REC. ROOM SQ. FT.	= 587

CENTRAL CONTRACTING GROUP, LLC

KADS CUSTOM HOME DESIGNS

ANGIER, NC
919-369-7181

DRAWN BY: D.W.O.

DATE: 9/29/17

PAGE NO 2 OF 2

PLAN NO. 28X42