

# Harnett County Department of Public Health

PERMIT # BRES2203-0057

## Operation Permit

New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: 1861 US401S

Name: (owner) GABRIEL CABRERA CRUZ SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: AVILA


Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

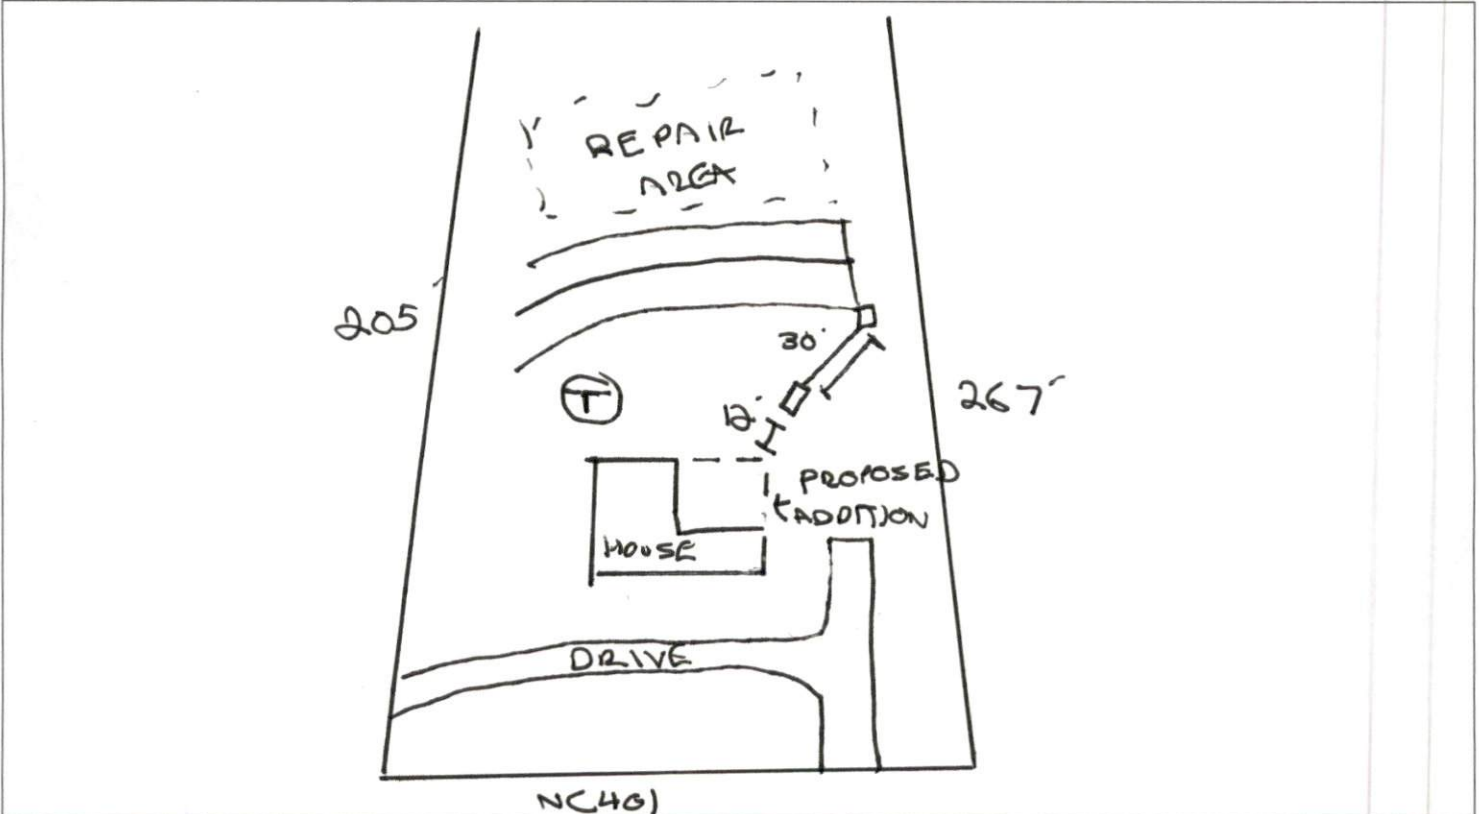

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box    Pump    Alarm    H2O Line    PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other EZ FLOW   Septic Tank: 1000 gallons   Pump Tank: \_\_\_\_\_ gallons  
 Subsurface Drainage Field: No. of ditches 3   exact length of each ditch 75 feet   width of ditches 3 feet   depth of ditches 12 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent: [Signature]   RENS   Date: 9/12/23