

# Harnett County Department of Public Health

PERMIT # BUES 2204-0018

## Operation Permit

relocation

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 276 STEWART RD (SL 1810)

Name: (owner) JUSTIN GAMBROTT SUBDIVISION WILLIAM G. GAMBROTT LOT # 1

System Installer: BOUY - CLINTON ROAD SEPTIC

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community  Public  Well Distance from well 50+ feet

System Type: 276 REDUCTION SYSTEM IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, ~~Rules for Sewage Treatment and Disposal~~, and all conditions of the Improvement Permit and Construction Authorization.

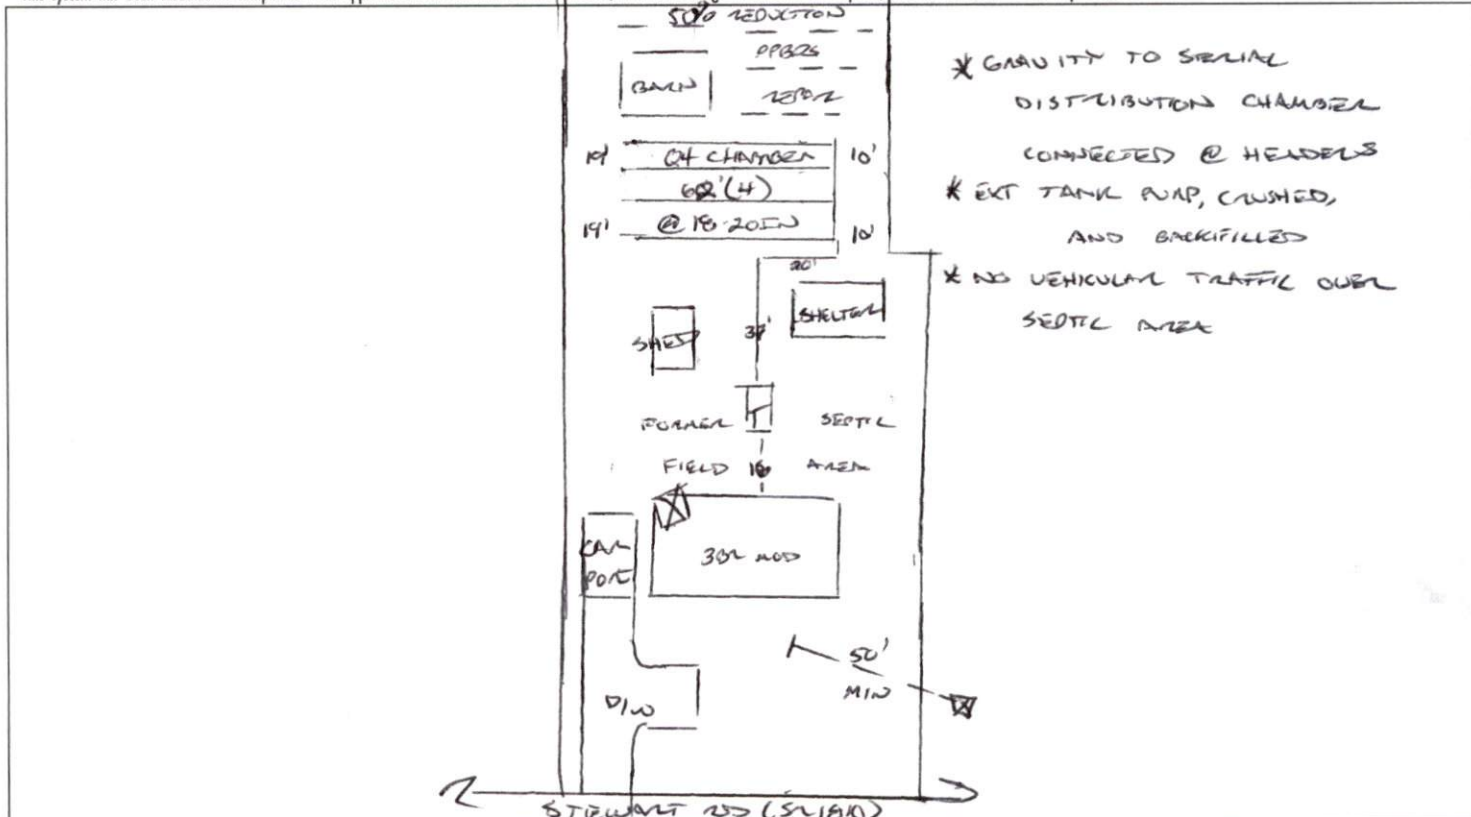

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other Q4 CHAMBER IIIg Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons  
Subsurface No. of exact length width of depth of  
Drainage Field ditches 4 of each ditch 62 feet ditches 3 feet ditches 18-20 inches  
French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] Date 06/24/2022