

Harnett County Department of Public Health

Operation Permit

PERMIT # SFD 2202-0028

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 770 NEELS CREEK RD (S15173)

Name: (owner) JAKE SCHLIEMAN SUBDIVISION PALMERS PLACE LOT # 1

System Installer: CLINT ADAMS


Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 25% REDUCTION SYSTEM III g Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

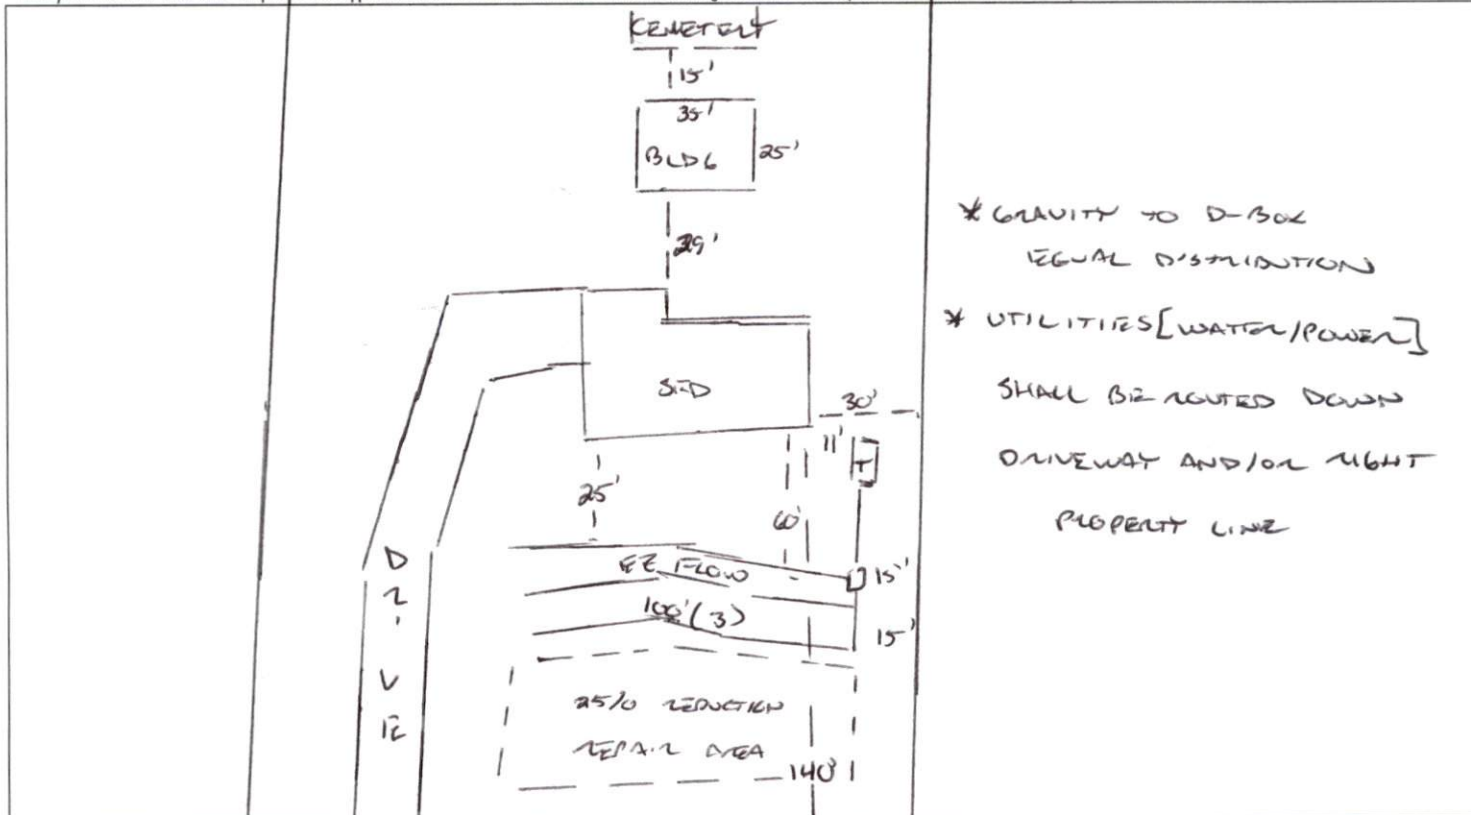

* GRAVITY TO D-BOX
EQUAL DISTRIBUTION

* UTILITIES [WATER/POWER]
SHALL BE ROUTED DOWN
DRIVEWAY AND/OR RIGHT
PROPERTY LINE

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: NEELS CREEK RD (S15173)
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other SE FLOW III g Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of depth of
Drainage Field ditches 3 of each ditch 100 feet ditches 3 feet ditches 24 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 06/21/2022