

July 27, 2022

Harnett County Government Complex  
307 W. Cornelius Harnett Boulevard  
Lillington, NC 27546

E&K Construction  
65 Glenn Road Suite 611  
Garner NC 27529

ph: 910-893-7547  
fax: 910-893-9371

**Re: Existing Tank Application: # BRES2207-0007**

To whom it may concern:

An attempt was made to evaluate your property for the purpose of issuing an existing tank permit. The evaluation could not be completed for one or more of the following reasons.

- 1. Uncover Outlet lid on septic tank and break seal. (\$25.00 fee incurred).
- 2. Have system pumped out
- 3. Replace Sanitary T

**4. Other – Disapproved – Septic Encroachment – Proposed addition encroaches on 5ft minimum septic setback. No proposed foundation approved greater than 8ft off dwelling. Revise paperwork and building plans accordingly and reconfirm if addition is required.**

Your application will be put on hold until the selected items above have been addressed. When completed, **please call Central Permitting at 910-893-7525 to confirm** that the items mentioned have been corrected. We will then reschedule your property for evaluation. If you have any questions or concerns, please call 910-893-7547.

Sincerely,



Andrew Currin, R. E. H. S.  
Environmental Health Program Specialist  
Harnett County Department of Public Health

AC/slc  
Copy - Central Permitting

HTE# 17-5-42297

# Harnett County Department of Public Health

24937

PERMIT # 29238

## Operation Permit

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 39 Madlin Ct. (Brick Mill Rd. SE 2008)

Name: (owner) Wade Terry Homes SUBDIVISION Cottlestone LOT # 16

System Installer: Thornton Plumbing Registration #


Basement with plumbing:  Garage  Number of Bedrooms 4

Type of Water Supply:  Community  Public  Well Distance from well NA feet

System Type: 25% Reduction Sys-III Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

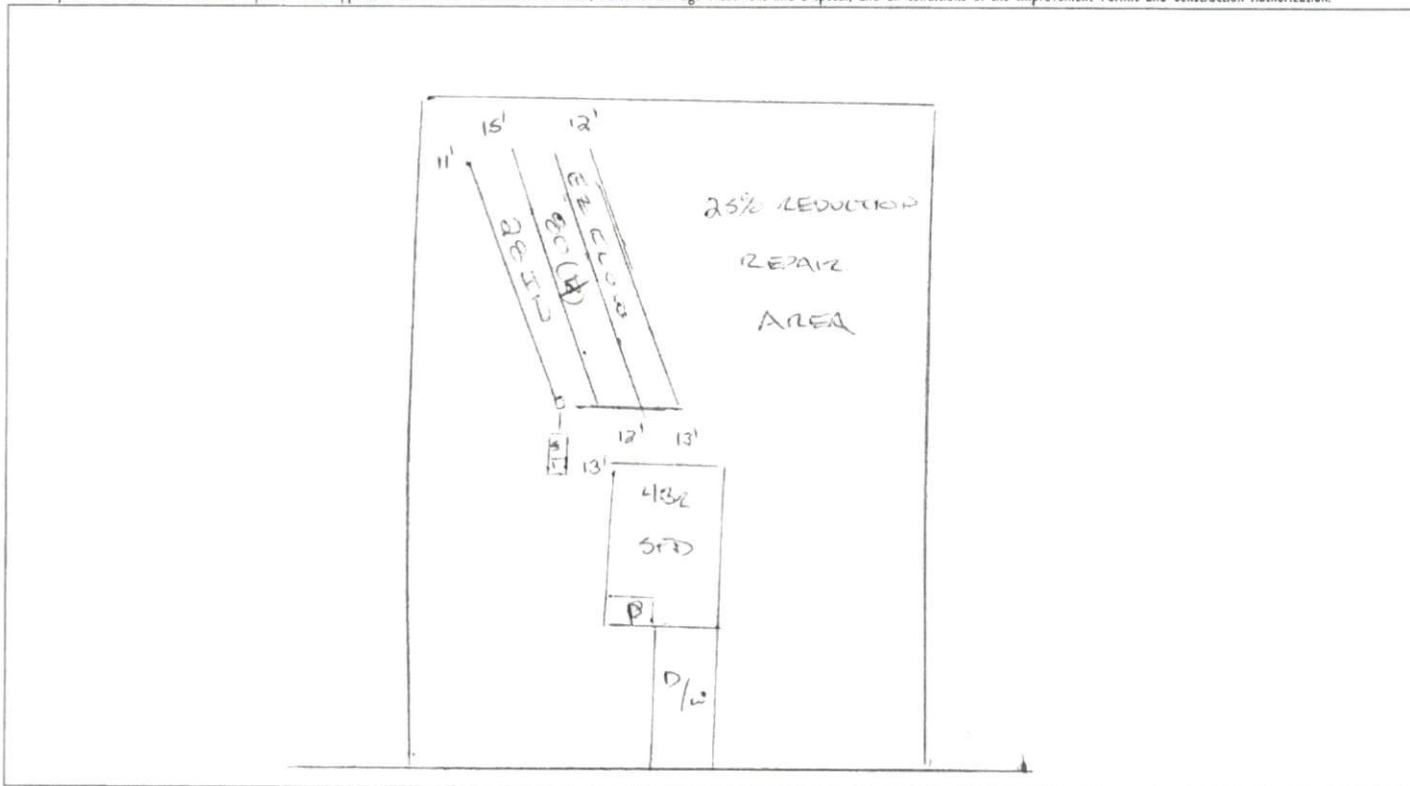

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other EE FLOW III Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons  
 Subsurface No. of exact length width of depth of  
 Drainage Field ditches 4 of each ditch 80 feet ditches 3 feet ditches 28 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] Date 03/28/2018