GARAGE UPFIT & ADDITION

490 KINSMAN COURT FUQUAY-VARINA, NORTH CAROLINA 27526

GENERAL NOTES

- 1. ALL WORK SHALL COMPLY WITH CITY, STATE OF NORTH CAROLINA, AND ALL OTHER MUNICIPAL CODES & APPLICABLE STANDARDS. IN CASE OF CONFLICT BETWEEN REQUIREMENTS, THE MOST RESTRICTIVE SHALL APPLY.
- 2. THE CONTRACTOR IS RESPONSIBLE TO ENSURE THE PROJECT BE IN CONFORMANCE WITH CODES AND REGULATIONS OF ALL APPLICABLE GOVERNING BUILDING AUTHORITIES, THE 2018 NORTH CAROLINA BUILDING CODE, AND INTERNATIONAL BUILDING CODE WITH NORTH CAROLINA AMENDMENTS, AND MANUFACTURER'S RECOMMENDATIONS.
- 3. THE PURPOSE OF THESE DRAWINGS IS TO SHOW THE INTENT OF THE DESIGN AND CONSTRUCTION PER THE OWNER'S SPECIFICATIONS. WHILE EVERY EFFORT HAS BEEN MADE IN THE PREPARATION OF THESE DOCUMENTS TO AVOID MISTAKES, THE MAKER CANNOT GUARANTEE AGAINST HUMAN ERROR. ANY CHANGES TO THESE DOCUMENTS AFTER THE DATE ON THESE DRAWINGS WILL BE DONE AT THE OWNER'S EXPENSE AND RESPONSIBILITY. IN CASE OF DISCREPANCIES, THE DESIGNER & ENGINEER SHALL BE IMMEDIATELY CONTACTED. K DYER DESIGN & A.A. TAKLA ENGINEERING IS NOT LIABLE FOR ERRORS ONCE CONSTRUCTION HAS BEGUN.
- 4. THE CONTRACTOR IS RESPONSIBLE FOR SECURING ALL REQUIRED APPROVALS AND PERMITS FROM THE APPROPRIATE AGENCY AND FOR COORDINATION AND COSTS ASSOCIATED WITH CONSTRUCTION AND INSPECTION. K DYER DESIGN DOES NOT ASSUME ANY RESPONSIBILITY FOR THE CONSTRUCTION OR FIELD SUPERVISION OF THE PROJECT AND FOR ANY SPECIAL INSPECTIONS REQUIRED DURING CONSTRUCTION.
- 5. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL CONDITIONS, DIMENSIONS, AND OTHER DETAILS PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL ASSUME ALL RESPONSIBILITY TO THE ACCURACY OF THE PLANS AND ANY CHANGES MADE DURING CONSTRUCTION, AND BE SOLELY RESPONSIBLE THEREAFTER. THE CONTRACTOR IS RESPONSIBLE TO ENSURE THAT PROVISIONS ARE MADE AND APPROVED METHODS USED FOR CONSTRUCTION.
- 6. THE CONTRACTOR SHALL ACCEPT RESPONSIBILITY FOR ANY UNSEEN CONFLICTS OR CONSTRUCTION COMPLEXITIES DISCOVERED DURING CONSTRUCTION NOT DESCRIBED IN THE CONSTRUCTION DOCUMENTS, NOTIFY THE ARCHITECT, AND COORDINATE NECESSARY MEANS AND METHODS TO PROCEED.

PROJECT NOTES

- 1. SECTIONS AND DETAILS SHOWN SHALL BE CONSIDERED TYPICAL FOR ALL SIMILAR CONDITIONS.
- 2. DO NOT SCALE DRAWINGS. REFER TO NOTED DIMENSIONS ON PLAN.
- 3. ALL ANGLED WALLS ARE 45 DEGREES U.O.N.
- 4. FLOOR PLAN NOTATIONS GOVERN OVER ELEVATION SCALE.
- 5. WHENEVER THE TERM "OR EQUAL" IS USED, IT SHALL MEAN EQUAL PRODUCT AS APPROVED BY OWNER.
- 6. VERIFY ALL WINDOW SIZES, RADIUS, AND DETAILS WITH CHOSEN MANUFACTURER.
- 7. CONTRACTOR TO COORDINATE ALL FLOOR COVERINGS & FINISHES TO ENSURE A SMOOTH TRANSITION BETWEEN SURFACES.
- 8. FINISHES FOR CLOSET SHELVING & ROD BY CONTRACTOR AND OWNER, TYP.
- 9. FINISHES OF ALL INTERIOR BASE BOARDS, TRIM, CASING, ETC BY CONTRACTOR & OWNER, TYP.
- 10. CONTRACTOR SHALL PROVIDE ALL NECESSARY BRACING TO STRUCTURE FOR INTERIOR PARTITIONS, CEILINGS, PLATFORMS, ETC. WHETHER SHOWN ON THE DRAWINGS OR NOT.
- 11. FOR CONSTRUCTION DETAILS NOT SHOWN, USE THE MANUF. STANDARD DETAILS OR APPROVED SHOP DRAWINGS & DATA SHEETS.
- 12. CONTRACTOR TO COORDINATE LOCATIONS & PROVIDE BLOCKING REQUIRED FOR BUILT-INS, WALL MOUNTED SHELVES, CABINETS & CASEWORK.
- 13. THE CONTRACTOR SHALL VERIFY ALL REINFORCING STEEL, ANCHOR BOLT SIZES, PATTERNS, & LOCATIONS BEFORE SETTING ANY STEEL AND BOLTS.
- 14. PLUMBING & FRAMING SHOULD COORDINATE SUCH THAT NO CONFLICT EXISTS PRODUCING NOTCHED JOINTS.
- 15. TEMPERED GLASS TO BE USED AT ALL SAFETY REQUIRED LOCATIONS ACCORDING TO 2018 NC RESIDENTIAL BUILDING CODE SECTION R308.4.
- 16. ALL HABITABLE ROOMS SHALL MEET LIGHT/VENTILATION & EGRESS AS REQUIRED IN 2018 NC RESIDENTIAL BUILDING CODE R303.1 AND R310.
- 17. ALL FENESTRATION TO HAVE A MAXIMUM U-FACTOR OF .35 MAX. & GLAZED FENESTRATION FACTOR OF .30 MAX.
- 18. DWELLING/GARAGE FIRE SEPARATION SHALL BE PER TABLE 302.6 OF 2018 NCRC.



ITLITIES NOTES

- 1. CONTRACTOR SHALL COORDINATE AND BE RESPONSIBLE FOR ALL UTILITIES, AS REQUIRED, (ELECTRIC, MECHANICAL, PLUMBING, GAS) TO CONSTRUCT THIS PROJECT.
- 2. CONTRACTOR SHALL INVESTIGATE AND ASSESS THE CONDITION AND CAPABILITIES OF EXISTING UTILITY SERVICES FOR MEETING OR EXCEEDING THE NEEDS OF THIS PROJECT.
- 3. CONTRACTOR SHALL PROPOSE MOST ENERGY EFFICIENT SYSTEMS, PROPOSE EXISTING SYSTEM UPGRADES AND MODIFICATIONS, AND SERVICE LOCATIONS AND RUNS PRIOR TO CONSTRUCTION FOR REVIEW BY THE OWNER (AND/OR OWNERS REPRESENTATIVES).

DRAWING INDEX

C1.0 COVER

- A1.0 EXISTING & PROPOSED SITE PLANS
- A2.0 EXISTING FLOOR PLAN
- A2.1 EXISTING ELEVATIONS & SECTION
- A2.2 EXISTING ELEVATIONS
- A3.0 PROPOSED FLOOR PLAN
- A.3.1 PROPOSED ROOF PLAN
- A3.2 ARCHITECTURAL NOTES
- A4.0 PROPOSED ELEVATIONS A4.1 PROPOSED ELEVATIONS
- A5.0 PROPOSED SECTIONS
- S1.0 STRUCTURAL NOTES S2.0 FRAMING PLANS

PIN: 0644-45-3908

ZONE: RA-30

PARTITIONS.

PARCEL ID: 080653 0115 17

ABBREVIATIONS

ABV ABOVE MANUF. MANUFACTURER A.F.F. ABOVE FINISHED NTS. NOT TO SCALE FLOOR 0.C. ON CENTER BOTTOM OF P.T. PRESSURE TREATED B.O. B.E. BOTH ENDS R.O. ROUGH OPENING B/N BETWEEN SC STUD COLUMN CONC. CONCRETE SH SINGLE-HUNG CONT. CONTINUOUS SHWR SHOWER **CEILING JOIST** SIM. SIMILAR C.J. DIA. DIAMETER S.F. SQUARE FOOT DBL. DOUBLE SQ SQUARE DH DOUBLE-HUNG SP STUD POCKET SST DN DOWN STAINLESS STEEL EQ. EQUAL STL STEEL STD STANDARD EA. EACH TBR TO BE REOMOVED F.F.E. FINISHED FLOOR ELEVATION T.O. TOP OF F.J. FLOOR JOIST TYP. TYPICAL U.O.N. UNLESS OTHERWISE NOTED FLR. FLOOR FND. FOUNDATION FTG. FOOTING GALV GALVINIZED HGR. HANGER

USE: SINGLE FAMILY RESIDENTIAL CODE ENFORCEMENT: HARNETT COUNTY CODE: NC RESIDENTIAL BUILDING CODE 2018 BUILDING DATA: CONSTRUCTION TYPE: VB, SIDING ON WOOD STUD FRAMING W/ WOOD STUD FRAMING

SUMMARY

SQUARE FOOTAGE, GROSS: EXISTING HEATED: 1,346 SF (TAX RECORDS) HEATED ADDITION: 191 SF NEW TOTAL HEATED: 1,537 SF



DESIGN & DRAFTING K DYER DESIGN Katie Dyer 336-707-8173 katieironsdyer@gmail.com

ENGINEERING A.A. TAKLA ENGINEERING, PLLC. Andy Takla 919-423-0470 andytaklaengr.com

ADDITION

 ∞

┣---

Π

Δ

 \supset

Ш

Ċ

ARA

Ċ

U

N N

S

ш

C

U

I


C

PRINT ON 18" X 24" FOR ACCURATE DRAWING SCALE

490

03.10.22EXISTING CONDITIONS03.18.22CONCEPT DESIGNS04.07.22DESIGN DEVELOPMENT05.06.22DESIGN DEVELOPMENT05.06.22DESIGN DEVELOPMENT05.08.22STRUCTURAL REVIEW06.08.22STRUCTURAL REVIEW06.24.22STRUCTURAL REVIEW07.18.22PERMIT	DATE	ISSUE
	03.10.22	EXISTING CONDITIONS
	03.18.22	CONCEPT DESIGNS
	04.07.22	DESIGN DEVELOPMENT
	05.06.22	DESIGN DEVELOPMENT
	05.12.22	DESIGN DEVELOPMENT
	06.08.22	STRUCTURAL REVIEW
	06.24.22	STRUCTURAL REVIEW 2
	07.18.22	PERMIT

COVER

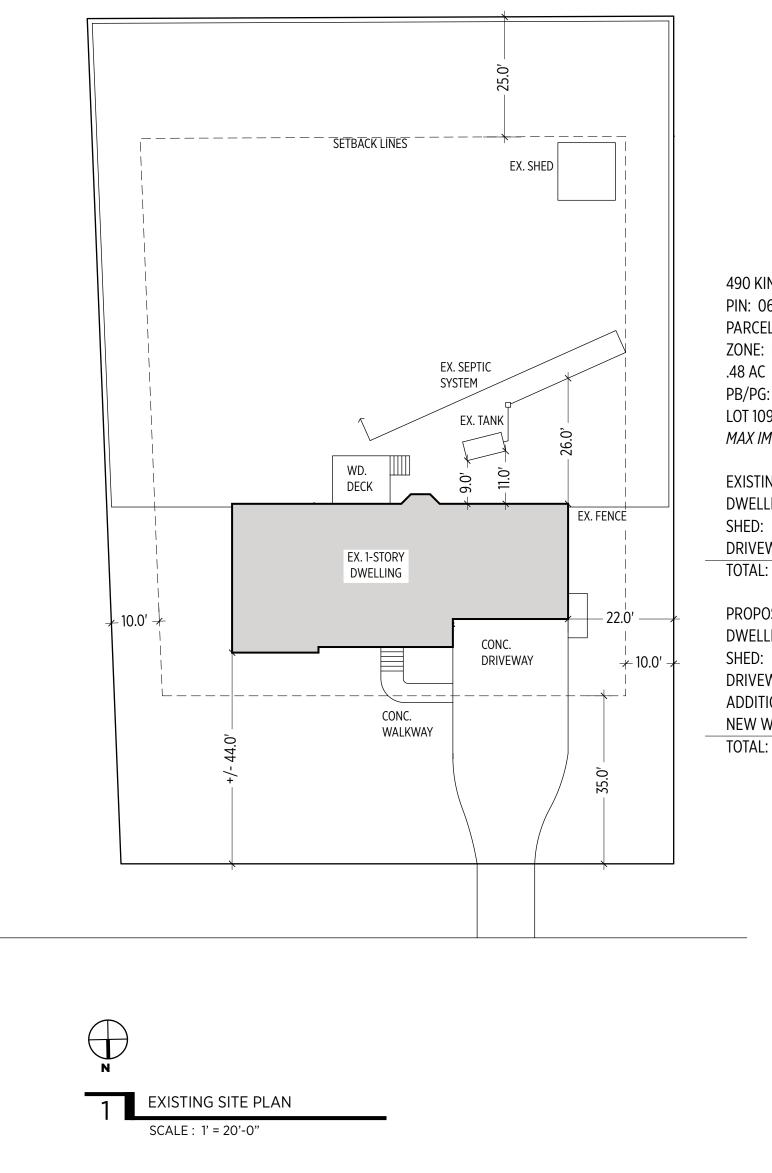


490 KINSMAN COURT PIN: 0644-45-3908 PARCEL ID: 080653 0115 17 ZONE: RA-30, HARNETT COUNTY .48 AC PER RECORD PLAT PB/PG: 2008 / 409 LOT 109 FOREST TARILS PHASE 3 *MAX IMPERVIOUS 5,386 SF*

EXISTING IMPERVIOUS	S CALC:
DWELLING:	1,982 S
SHED:	144 S
DRIVEWAY & WALKS:	1,401 S
TOTAL:	3,527 S
PROPOSED IMPERVIO	US CALC
DWELLING:	1,982 S
SHED:	144 S
DRIVEWAY & WALKS:	1,401 SF
ADDITION:	191 S
NEW WALKS:	64 SI



DESIGN & DRAFTING K DYER DESIGN Katie Dyer 336-707-8173 katieironsdyer@gmail.com

ENGINEERING A.A. TAKLA ENGINEERING, PLLC. Andy Takla 919-423-0470 andytaklaengr.com

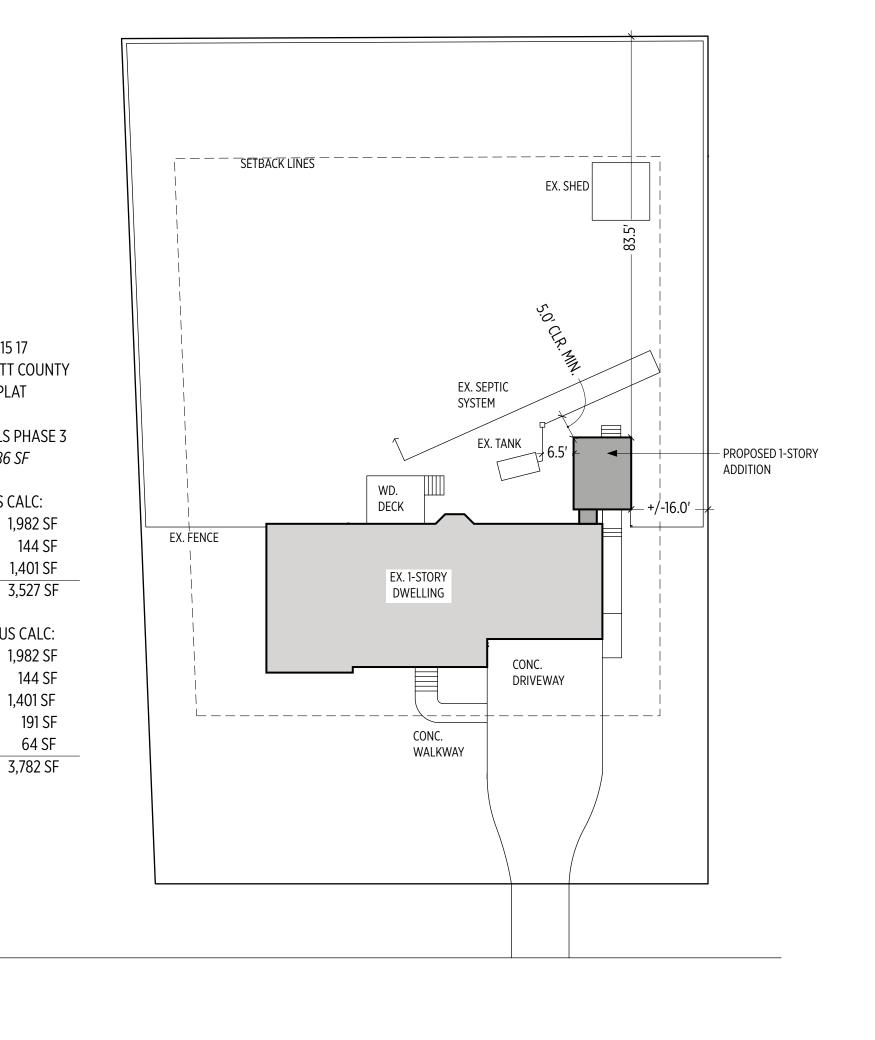

PROPOSED SITE PLAN

SCALE : 1' = 20'-0"

2





490 Kinsman Ct. Fuquay-Varina, NC, 27526

PRINT ON 18" X 24" FOR ACCURATE DRAWING SCALE

03.10.22 03.18.22	EXISTING CONDITIONS
03.18.22	
	CONCEPT DESIGNS
04.07.22	DESIGN DEVELOPMENT
05.06.22	DESIGN DEVELOPMENT
05.12.22	DESIGN DEVELOPMENT
06.08.22	STRUCTURAL REVIEW
06.24.22	STRUCTURAL REVIEW 2
07.18.22	PERMIT

EXISTING FLOOR PLANS

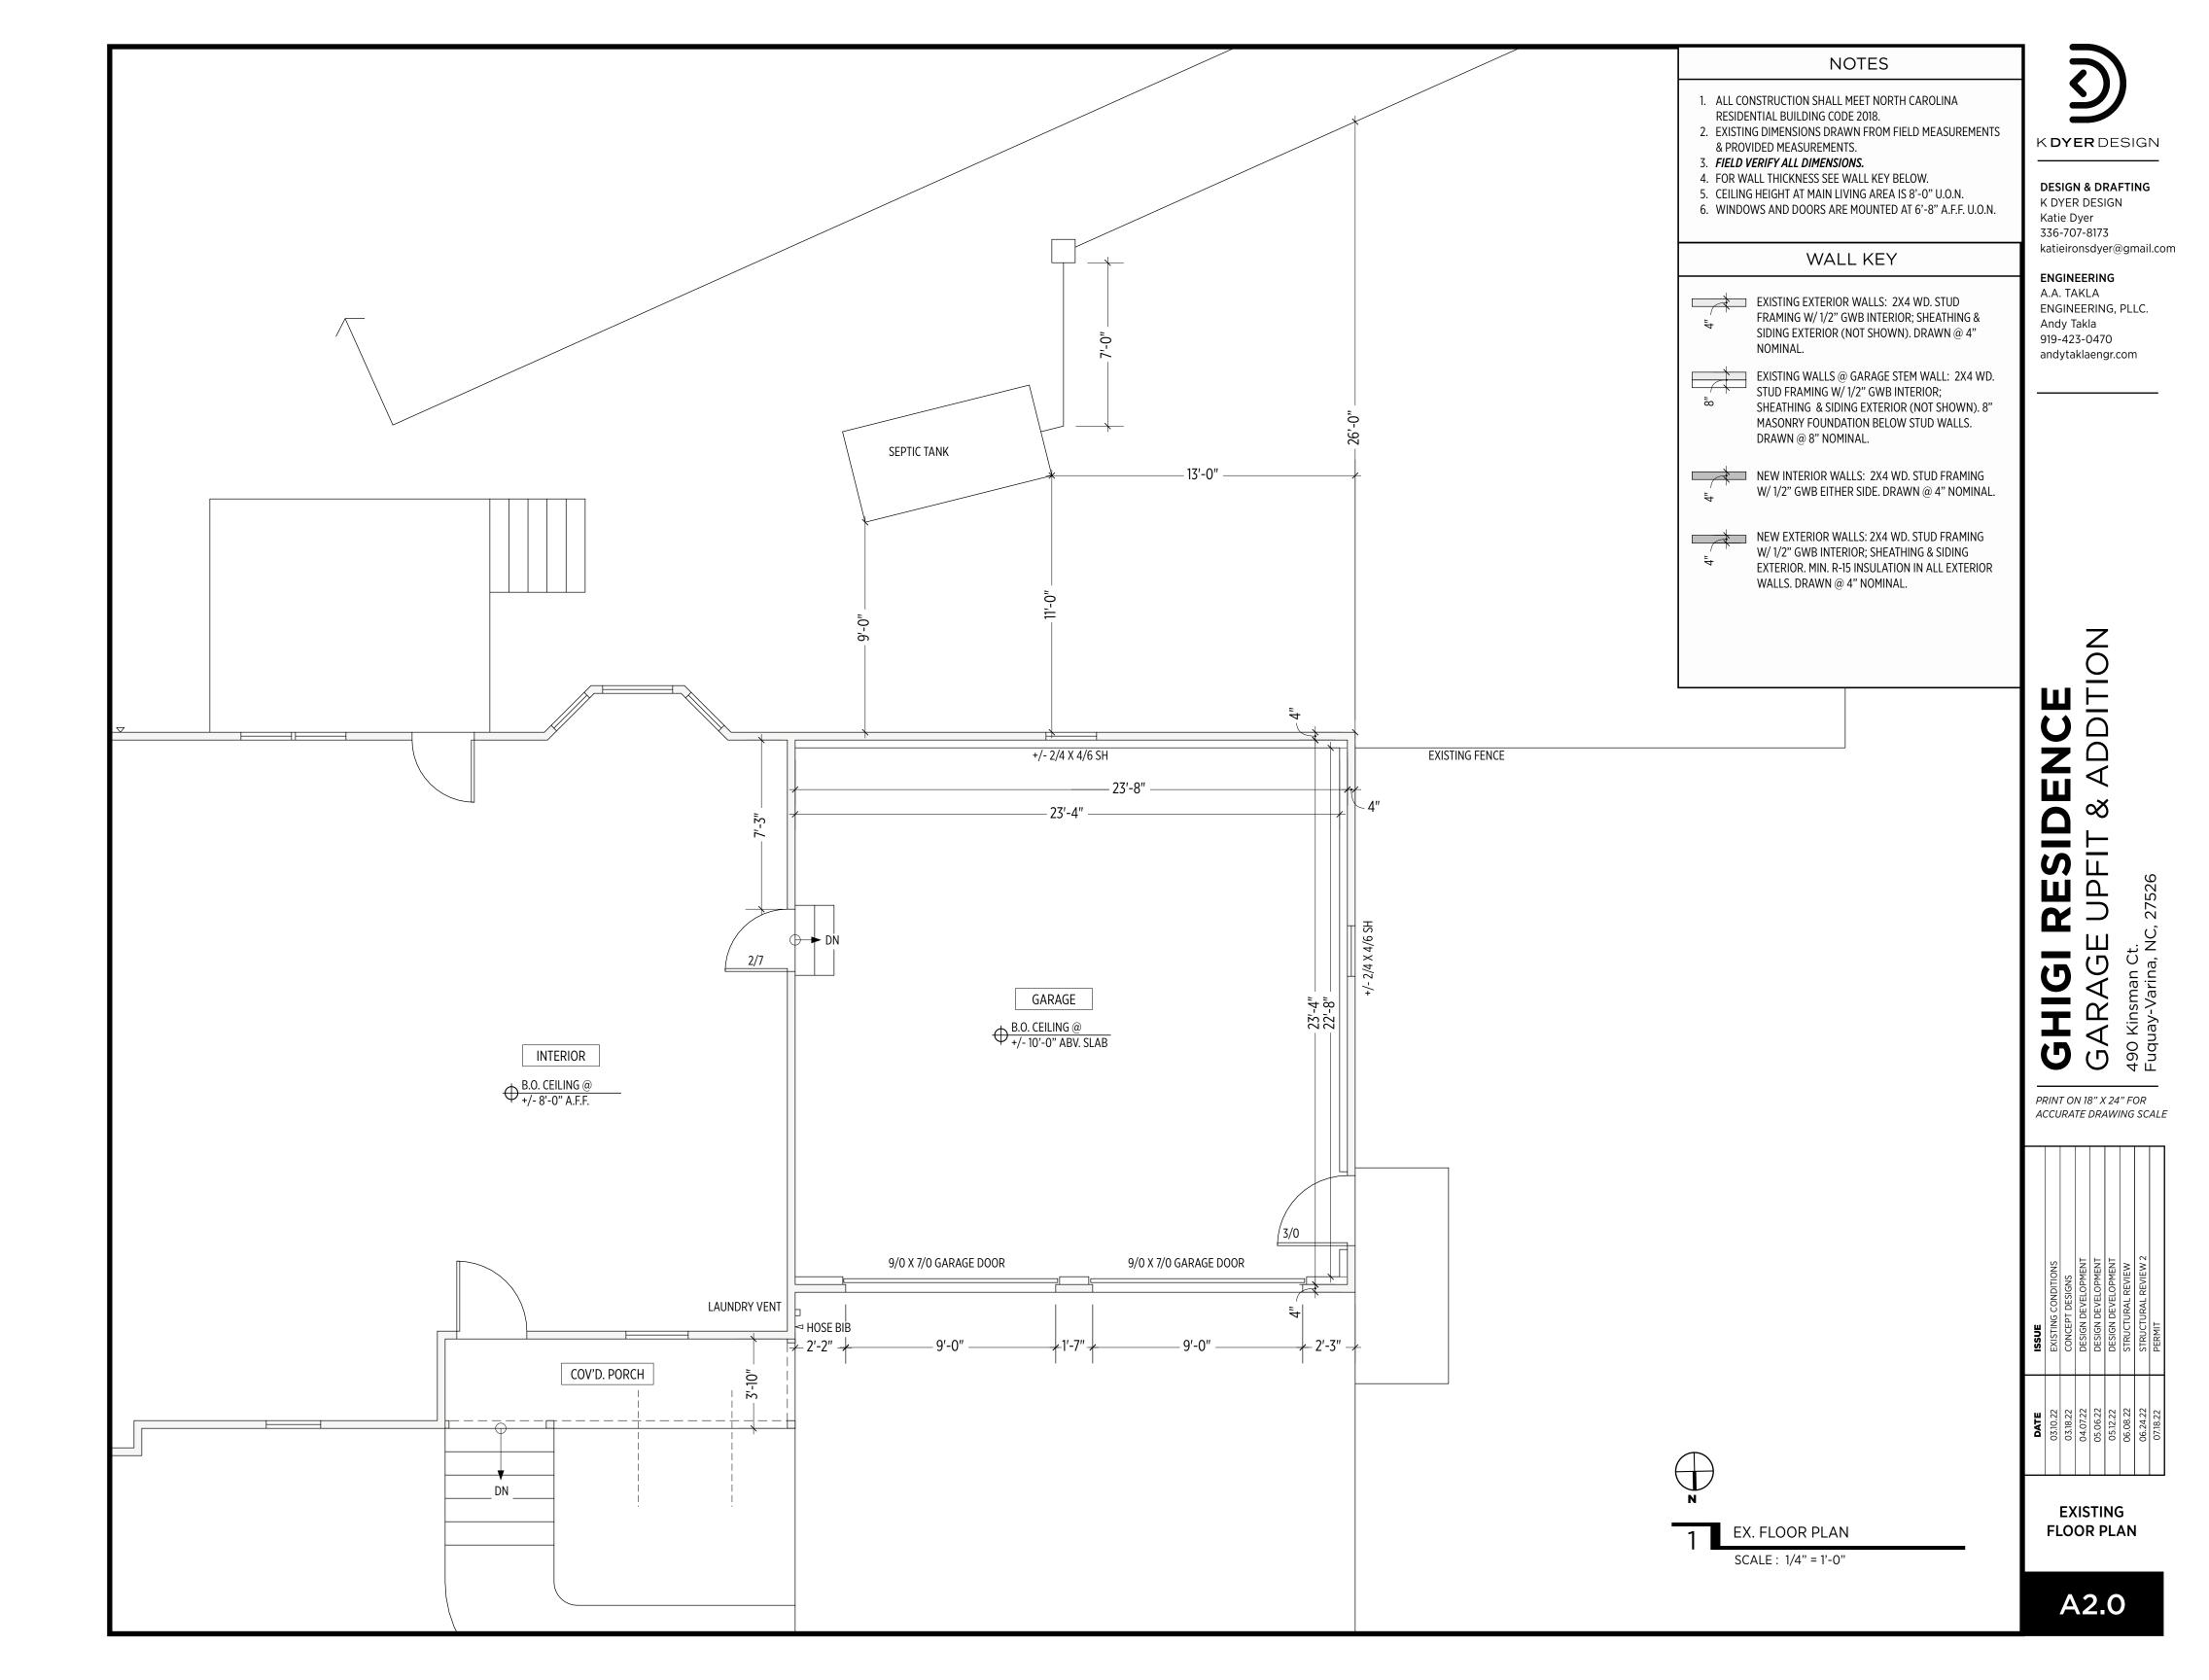

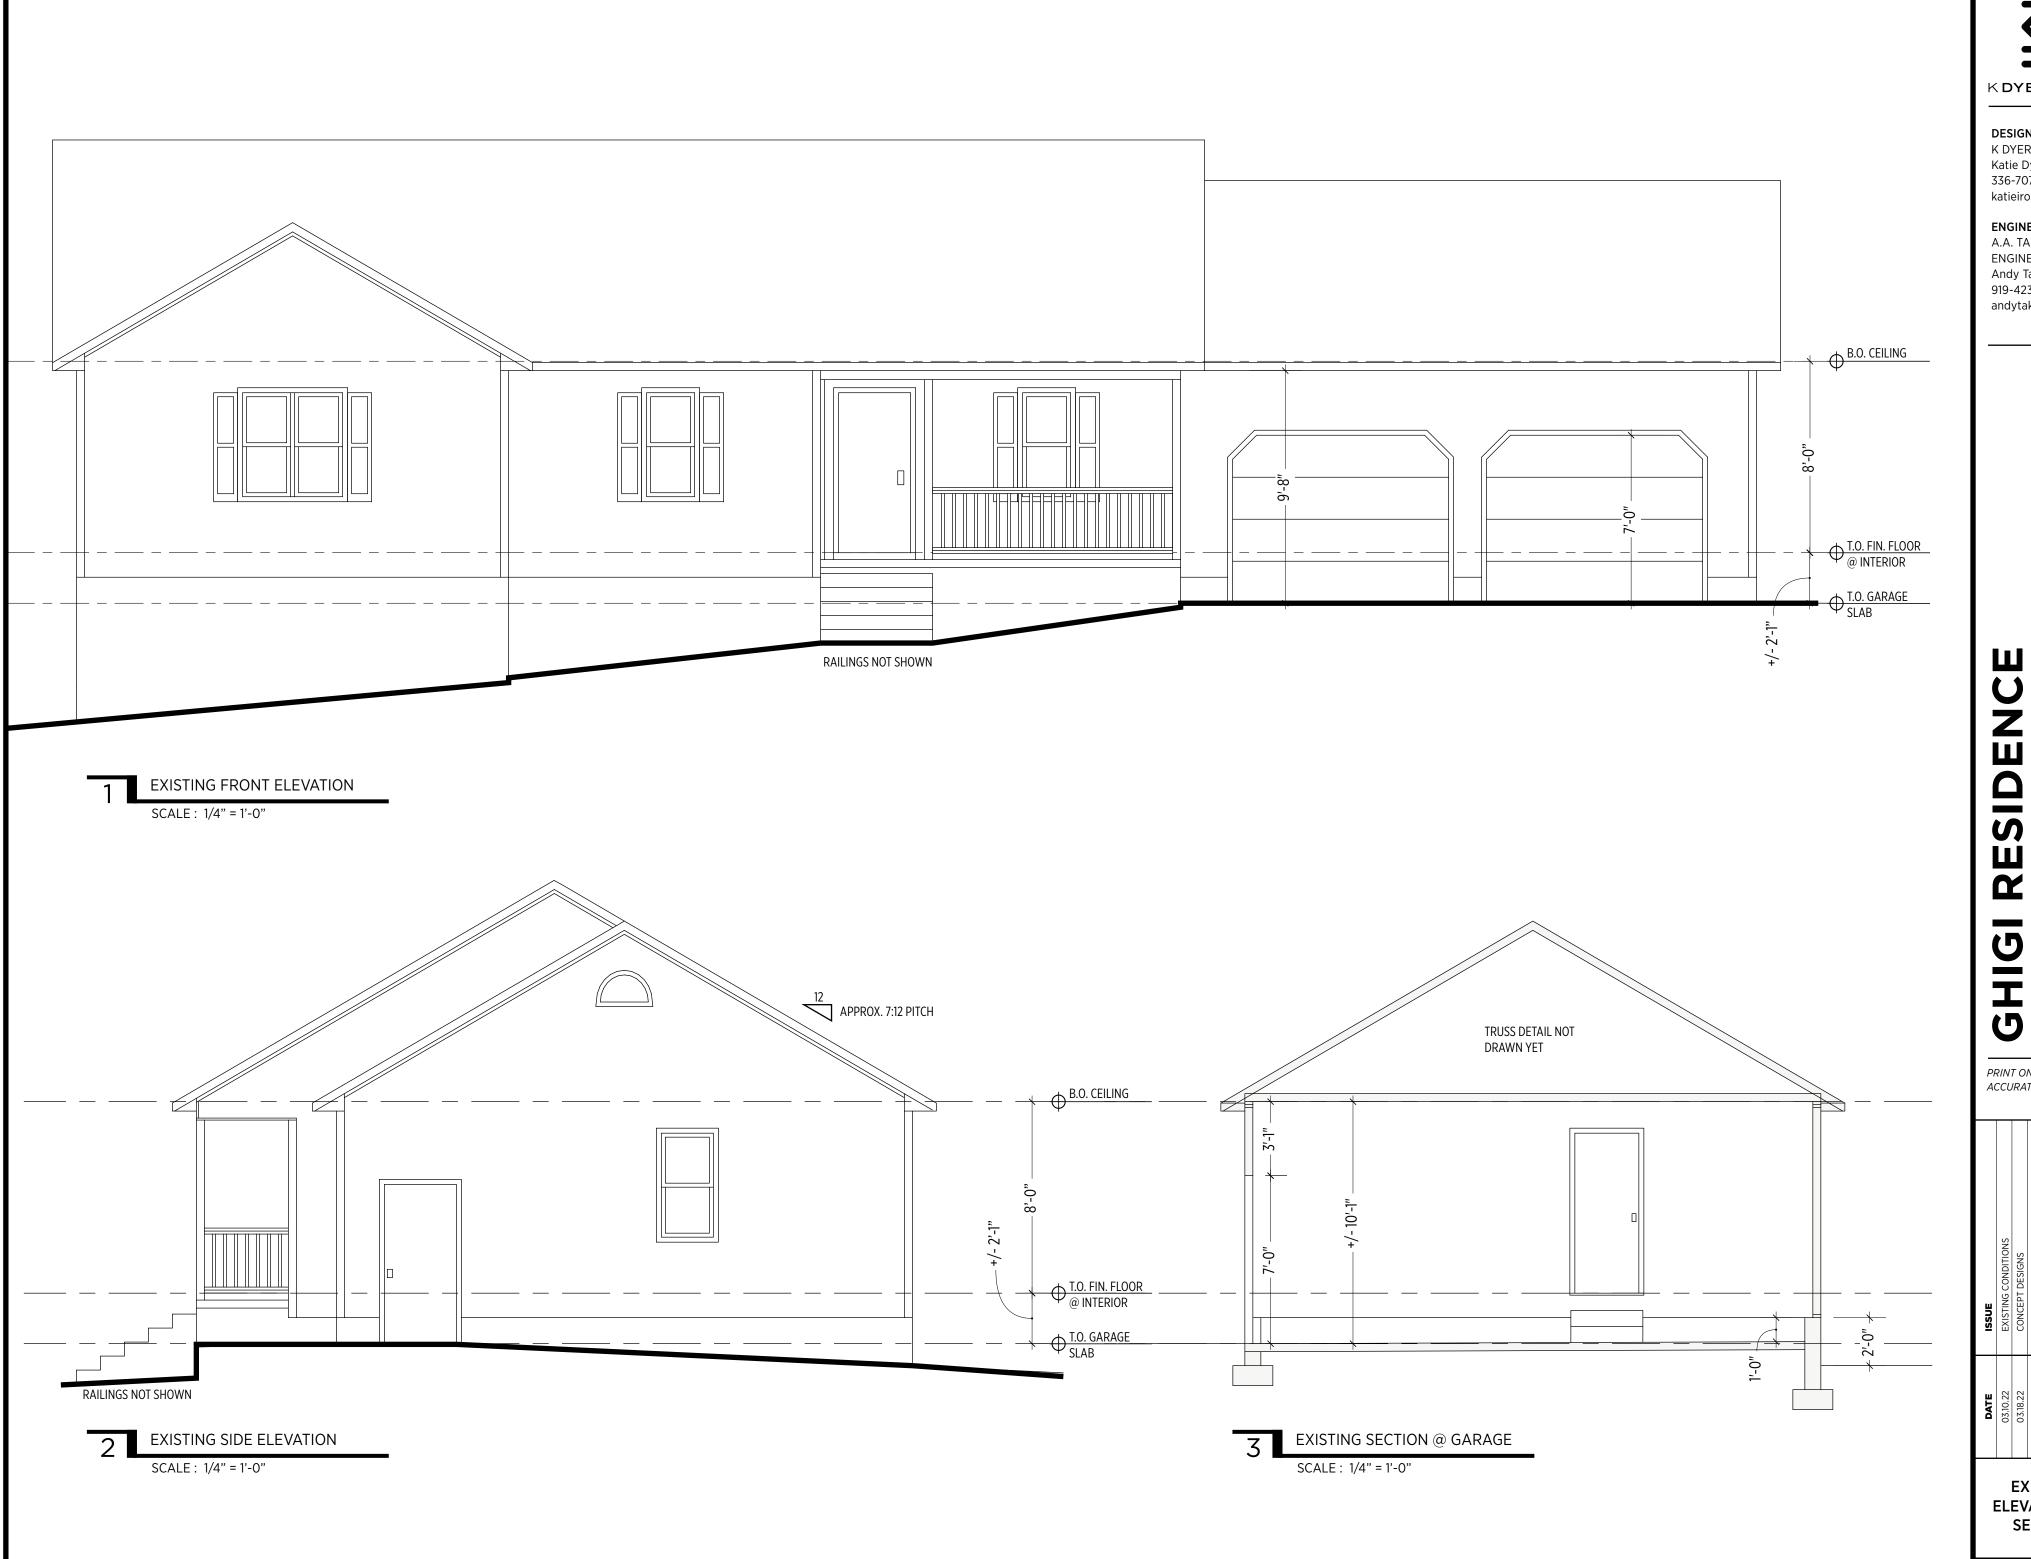

B K **DYER** DESIGN

DESIGN & DRAFTING K DYER DESIGN Katie Dyer 336-707-8173 katieironsdyer@gmail.com

ENGINEERING A.A. TAKLA ENGINEERING, PLLC. Andy Takla 919-423-0470 andytaklaengr.com

ADDITION

 ∞


GARAGE UPFIT

490 Kinsman Ct. Fuquay-Varina, NC, 27526

PRINT ON 18" X 24" FOR ACCURATE DRAWING SCALE

DATEISSUE03.10.22EXISTING CONDITIONS03.18.22EXISTING CONDITIONS03.18.22CONCEPT DESIGNS04.07.22DESIGN DEVELOPMENT05.06.22DESIGN DEVELOPMENT05.12.22DESIGN DEVELOPMENT05.08.22STRUCTURAL REVIEW06.08.22STRUCTURAL REVIEW07.18.22PERMIT07.18.22PERMIT

EXISTING ELEVATIONS & SECTION

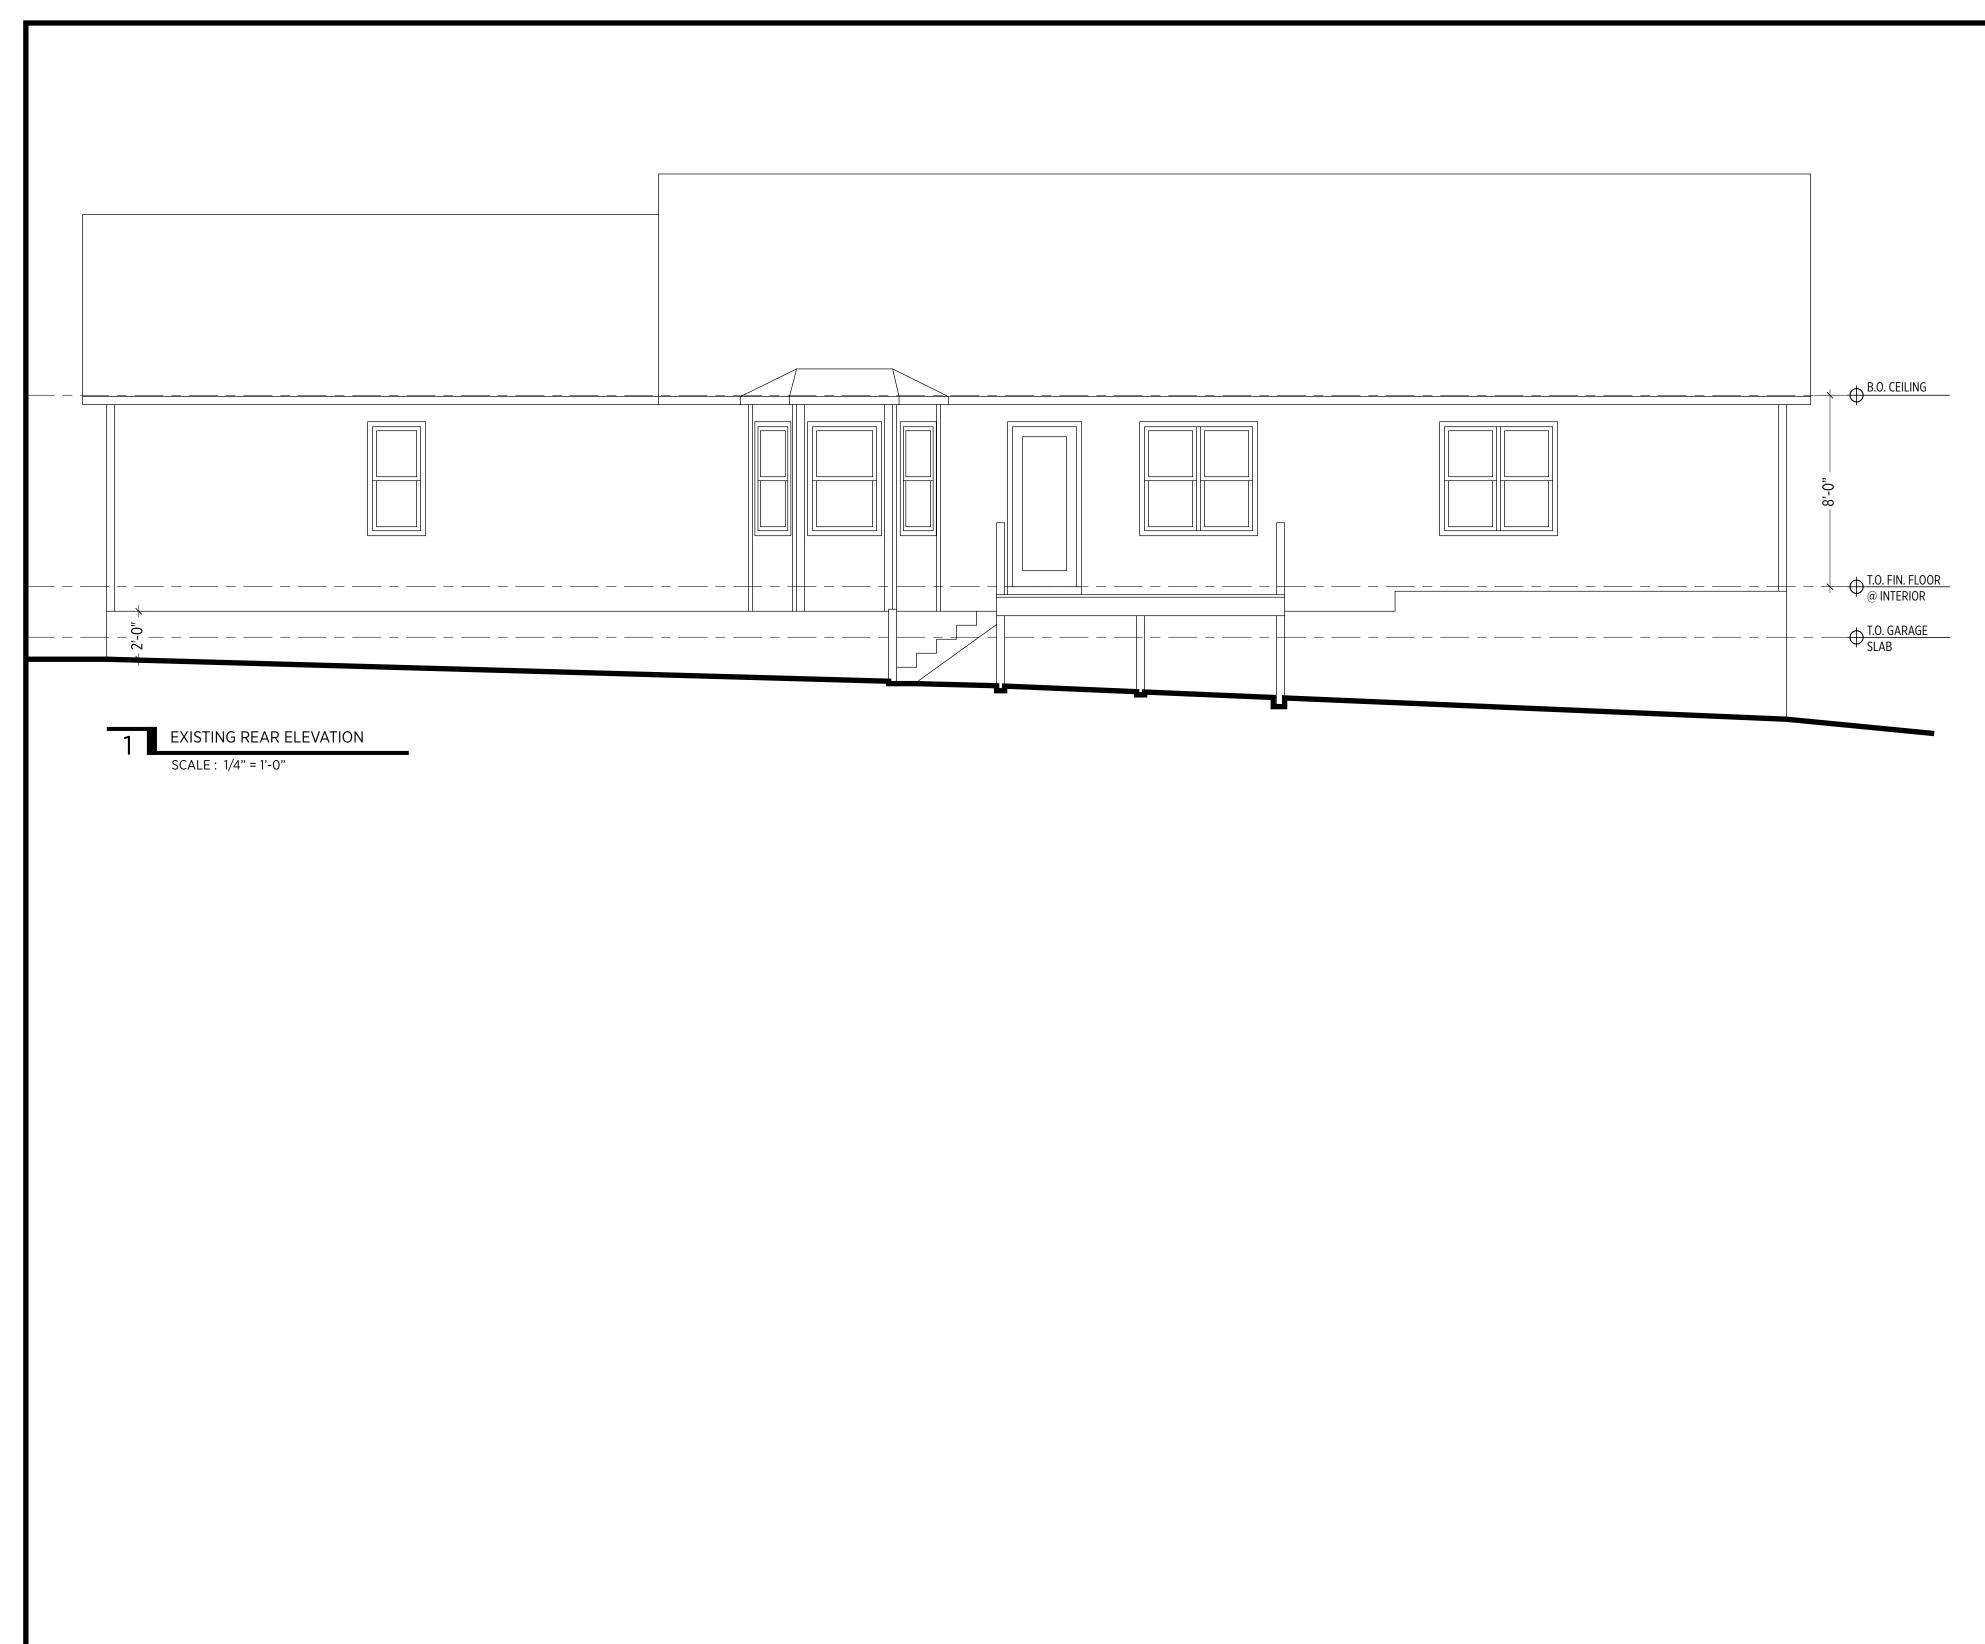



DESIGN & DRAFTING K DYER DESIGN Katie Dyer 336-707-8173 katieironsdyer@gmail.com


ENGINEERING A.A. TAKLA ENGINEERING, PLLC. Andy Takla 919-423-0470 andytaklaengr.com


GHIGI RESIDENCE GARAGE UPFIT & ADDITION 490 Kinsman Ct. Fuquay-Varina, NC, 27526


PRINT ON 18" X 24" FOR ACCURATE DRAWING SCALE

ISSUE	EXISTING CONDITIONS	CONCEPT DESIGNS	DESIGN DEVELOPMENT	DESIGN DEVELOPMENT	DESIGN DEVELOPMENT	STRUCTURAL REVIEW	STRUCTURAL REVIEW 2	PERMIT
DATE	03.10.22	03.18.22	04.07.22	05.06.22	05.12.22	06.08.22	06.24.22	07.18.22

EXISTING ELEVATIONS

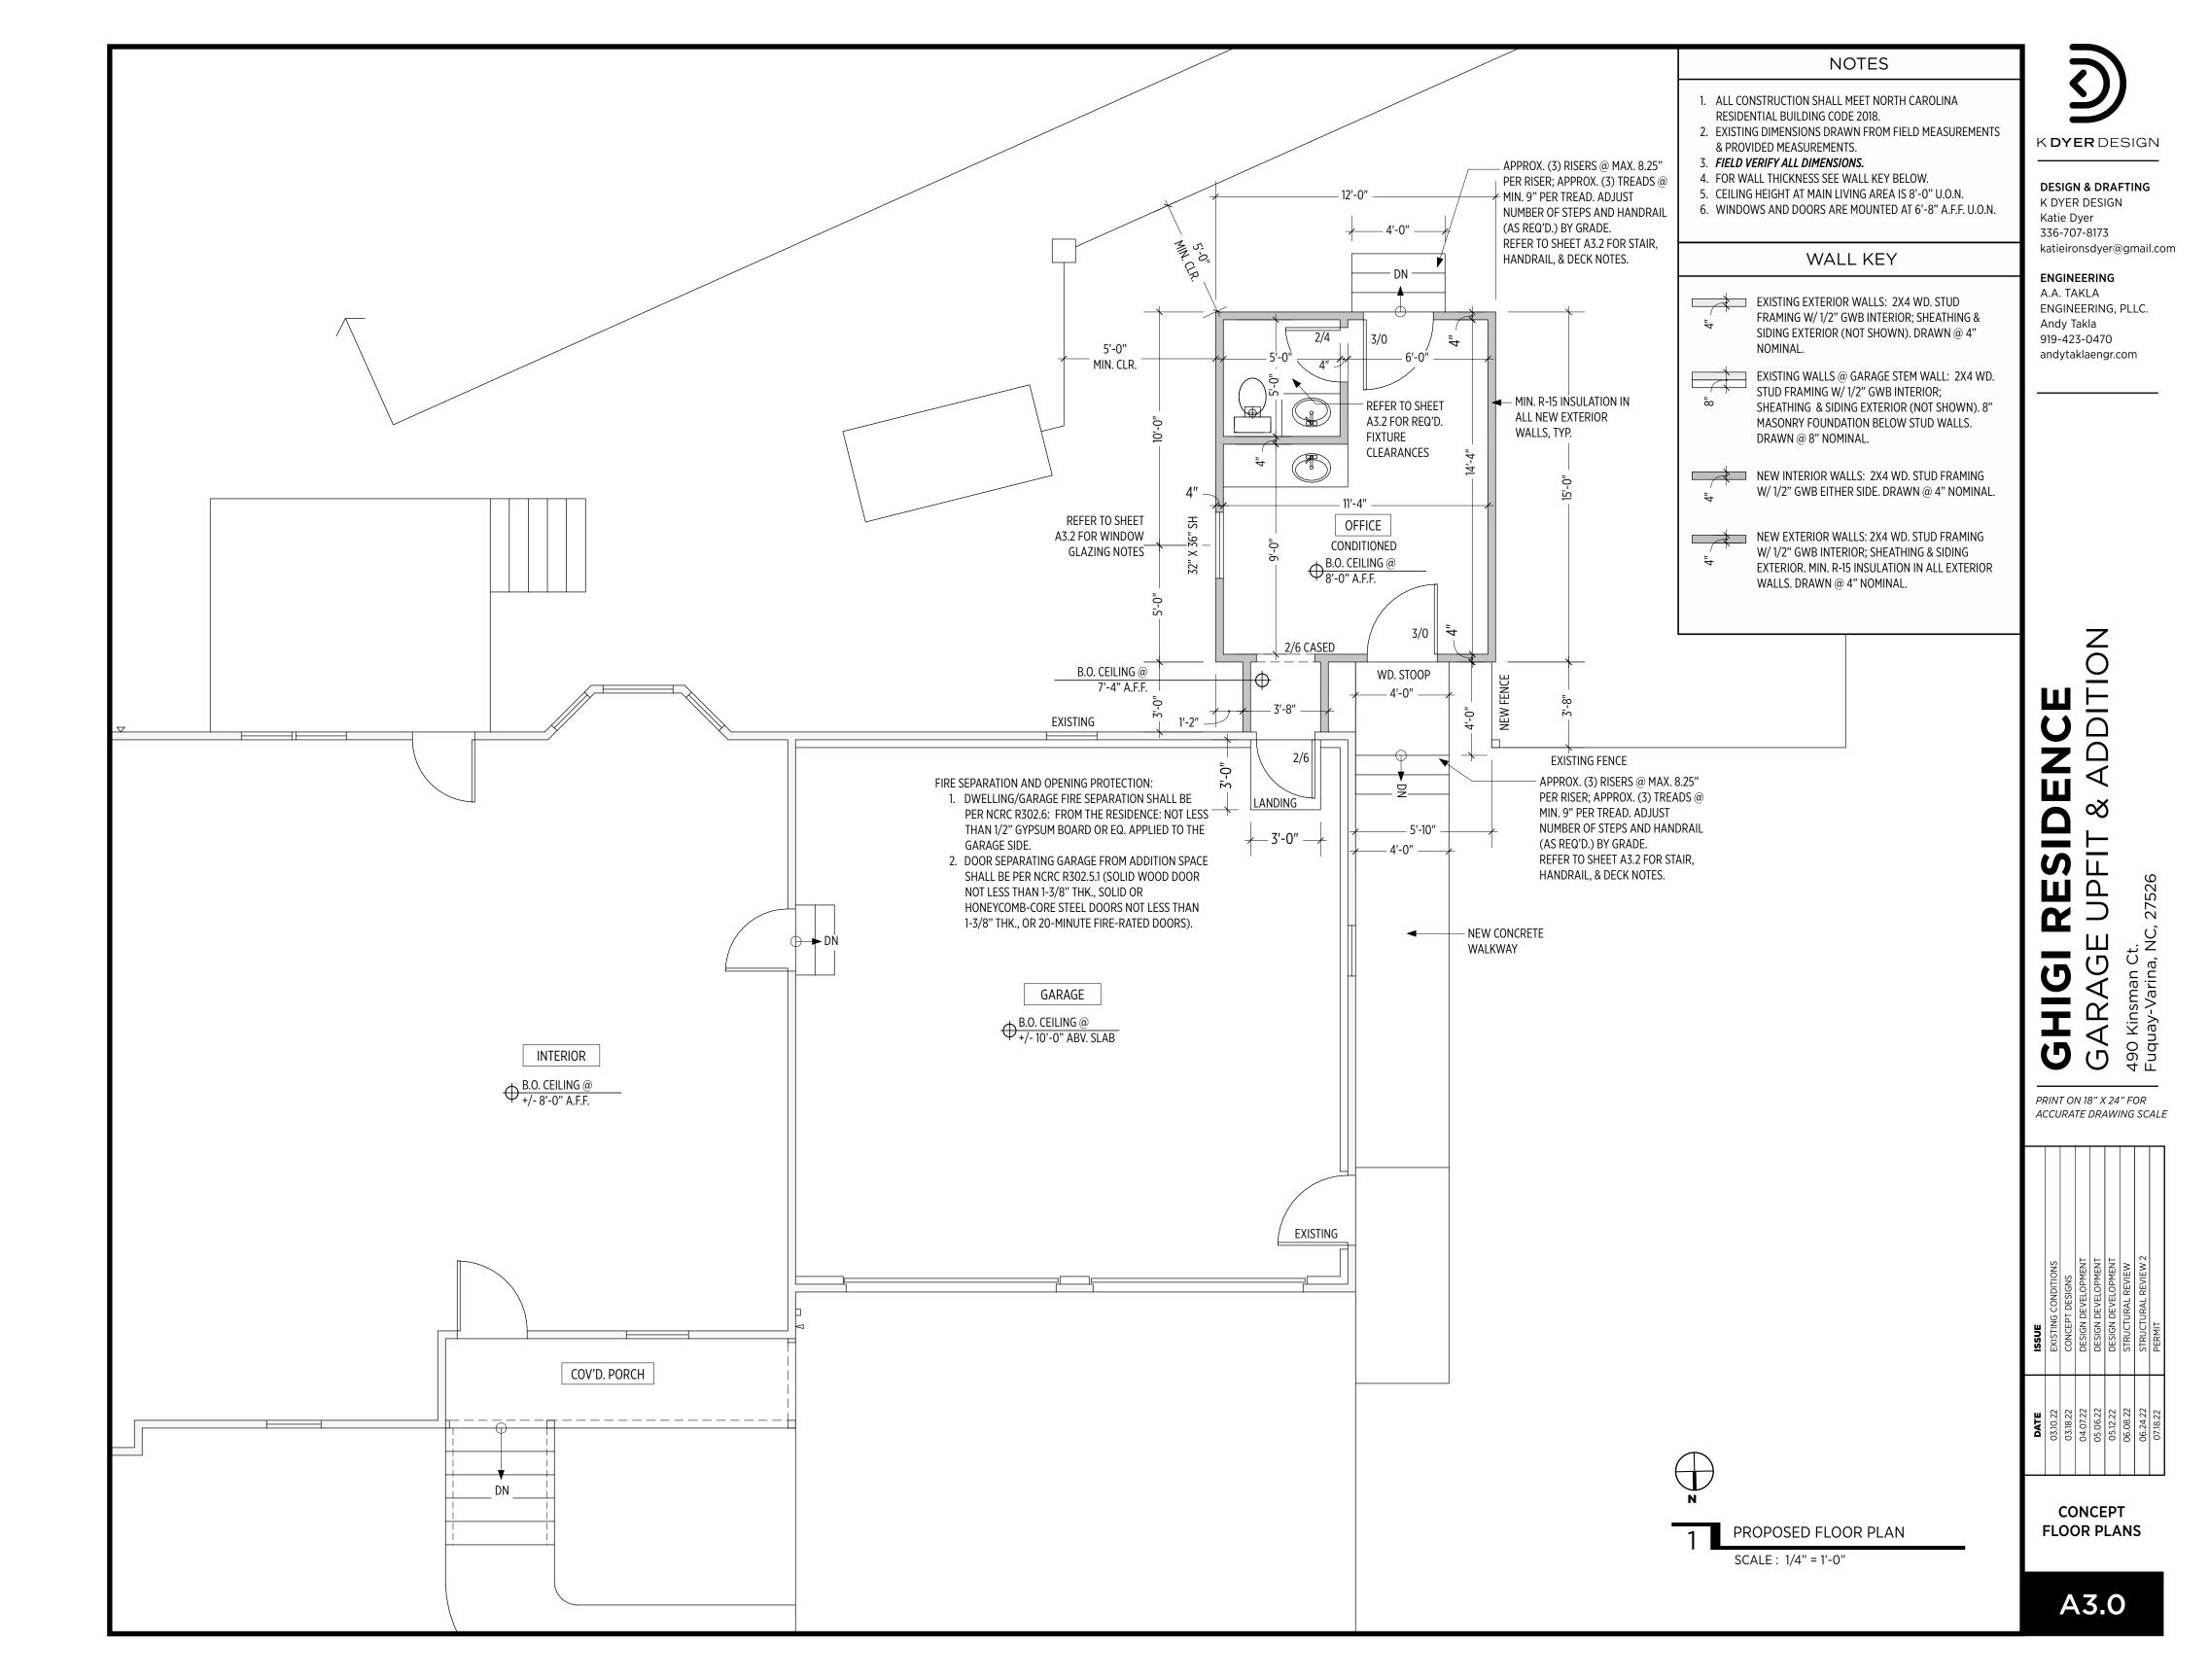

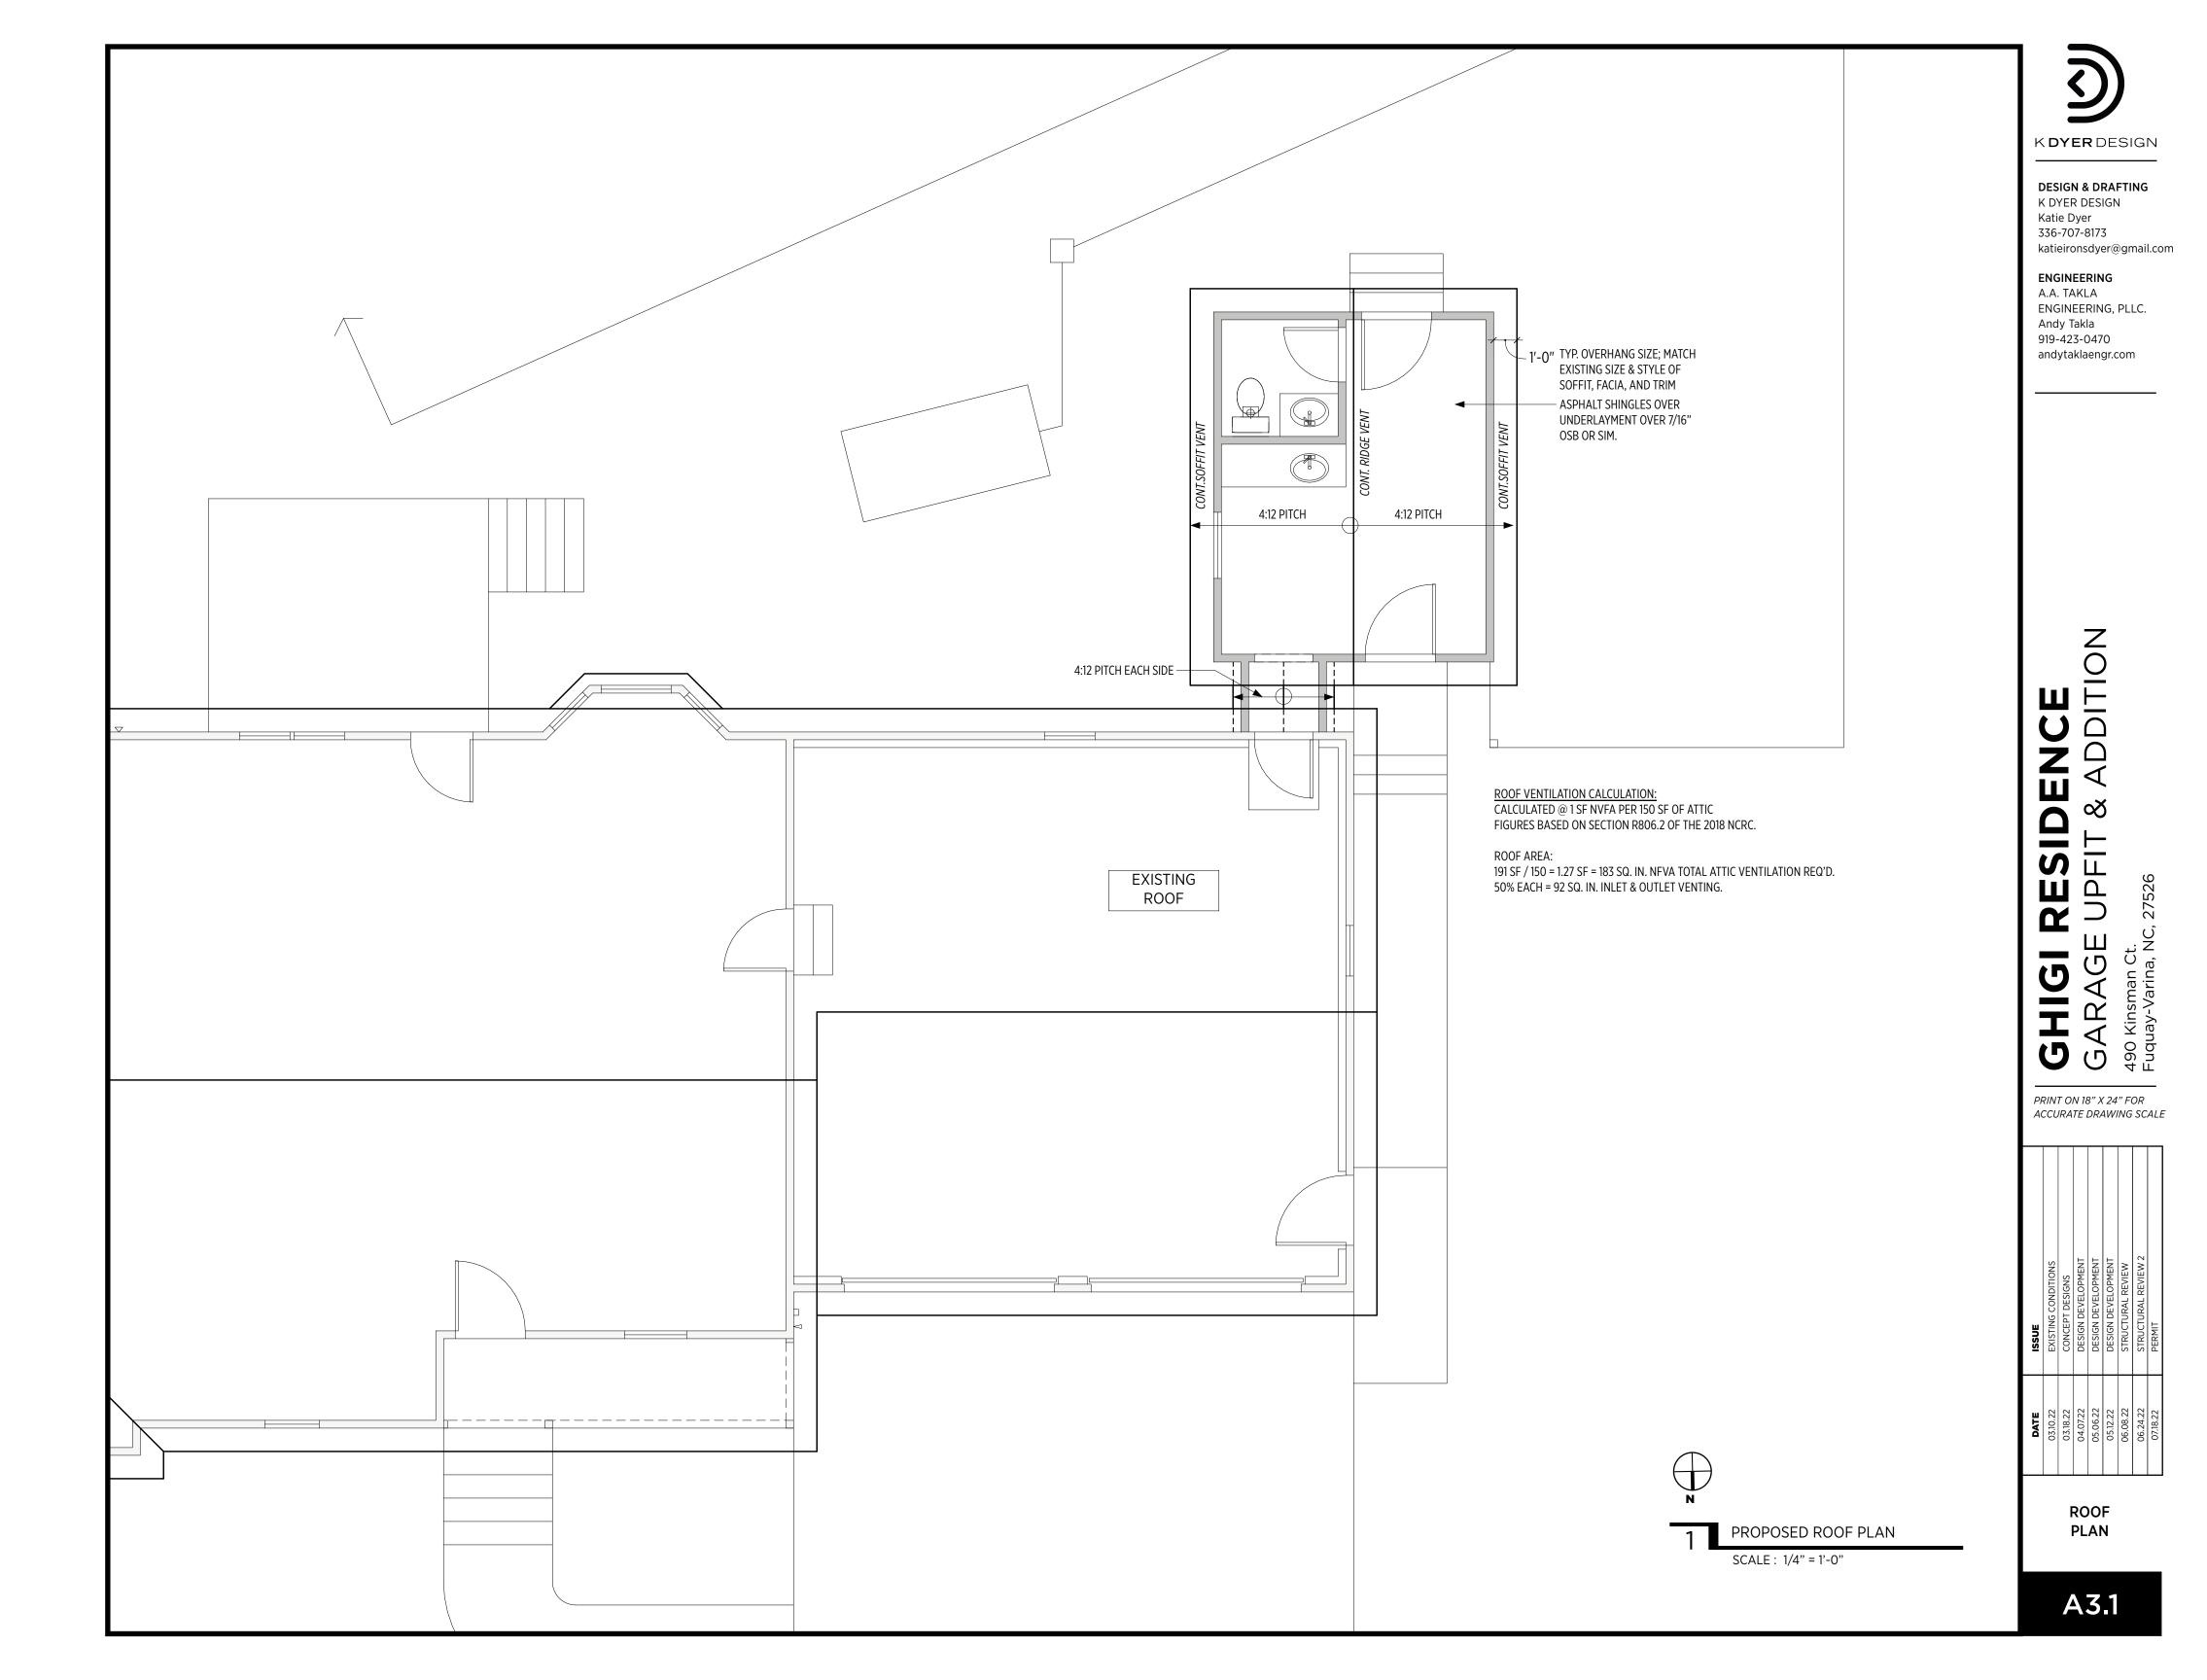

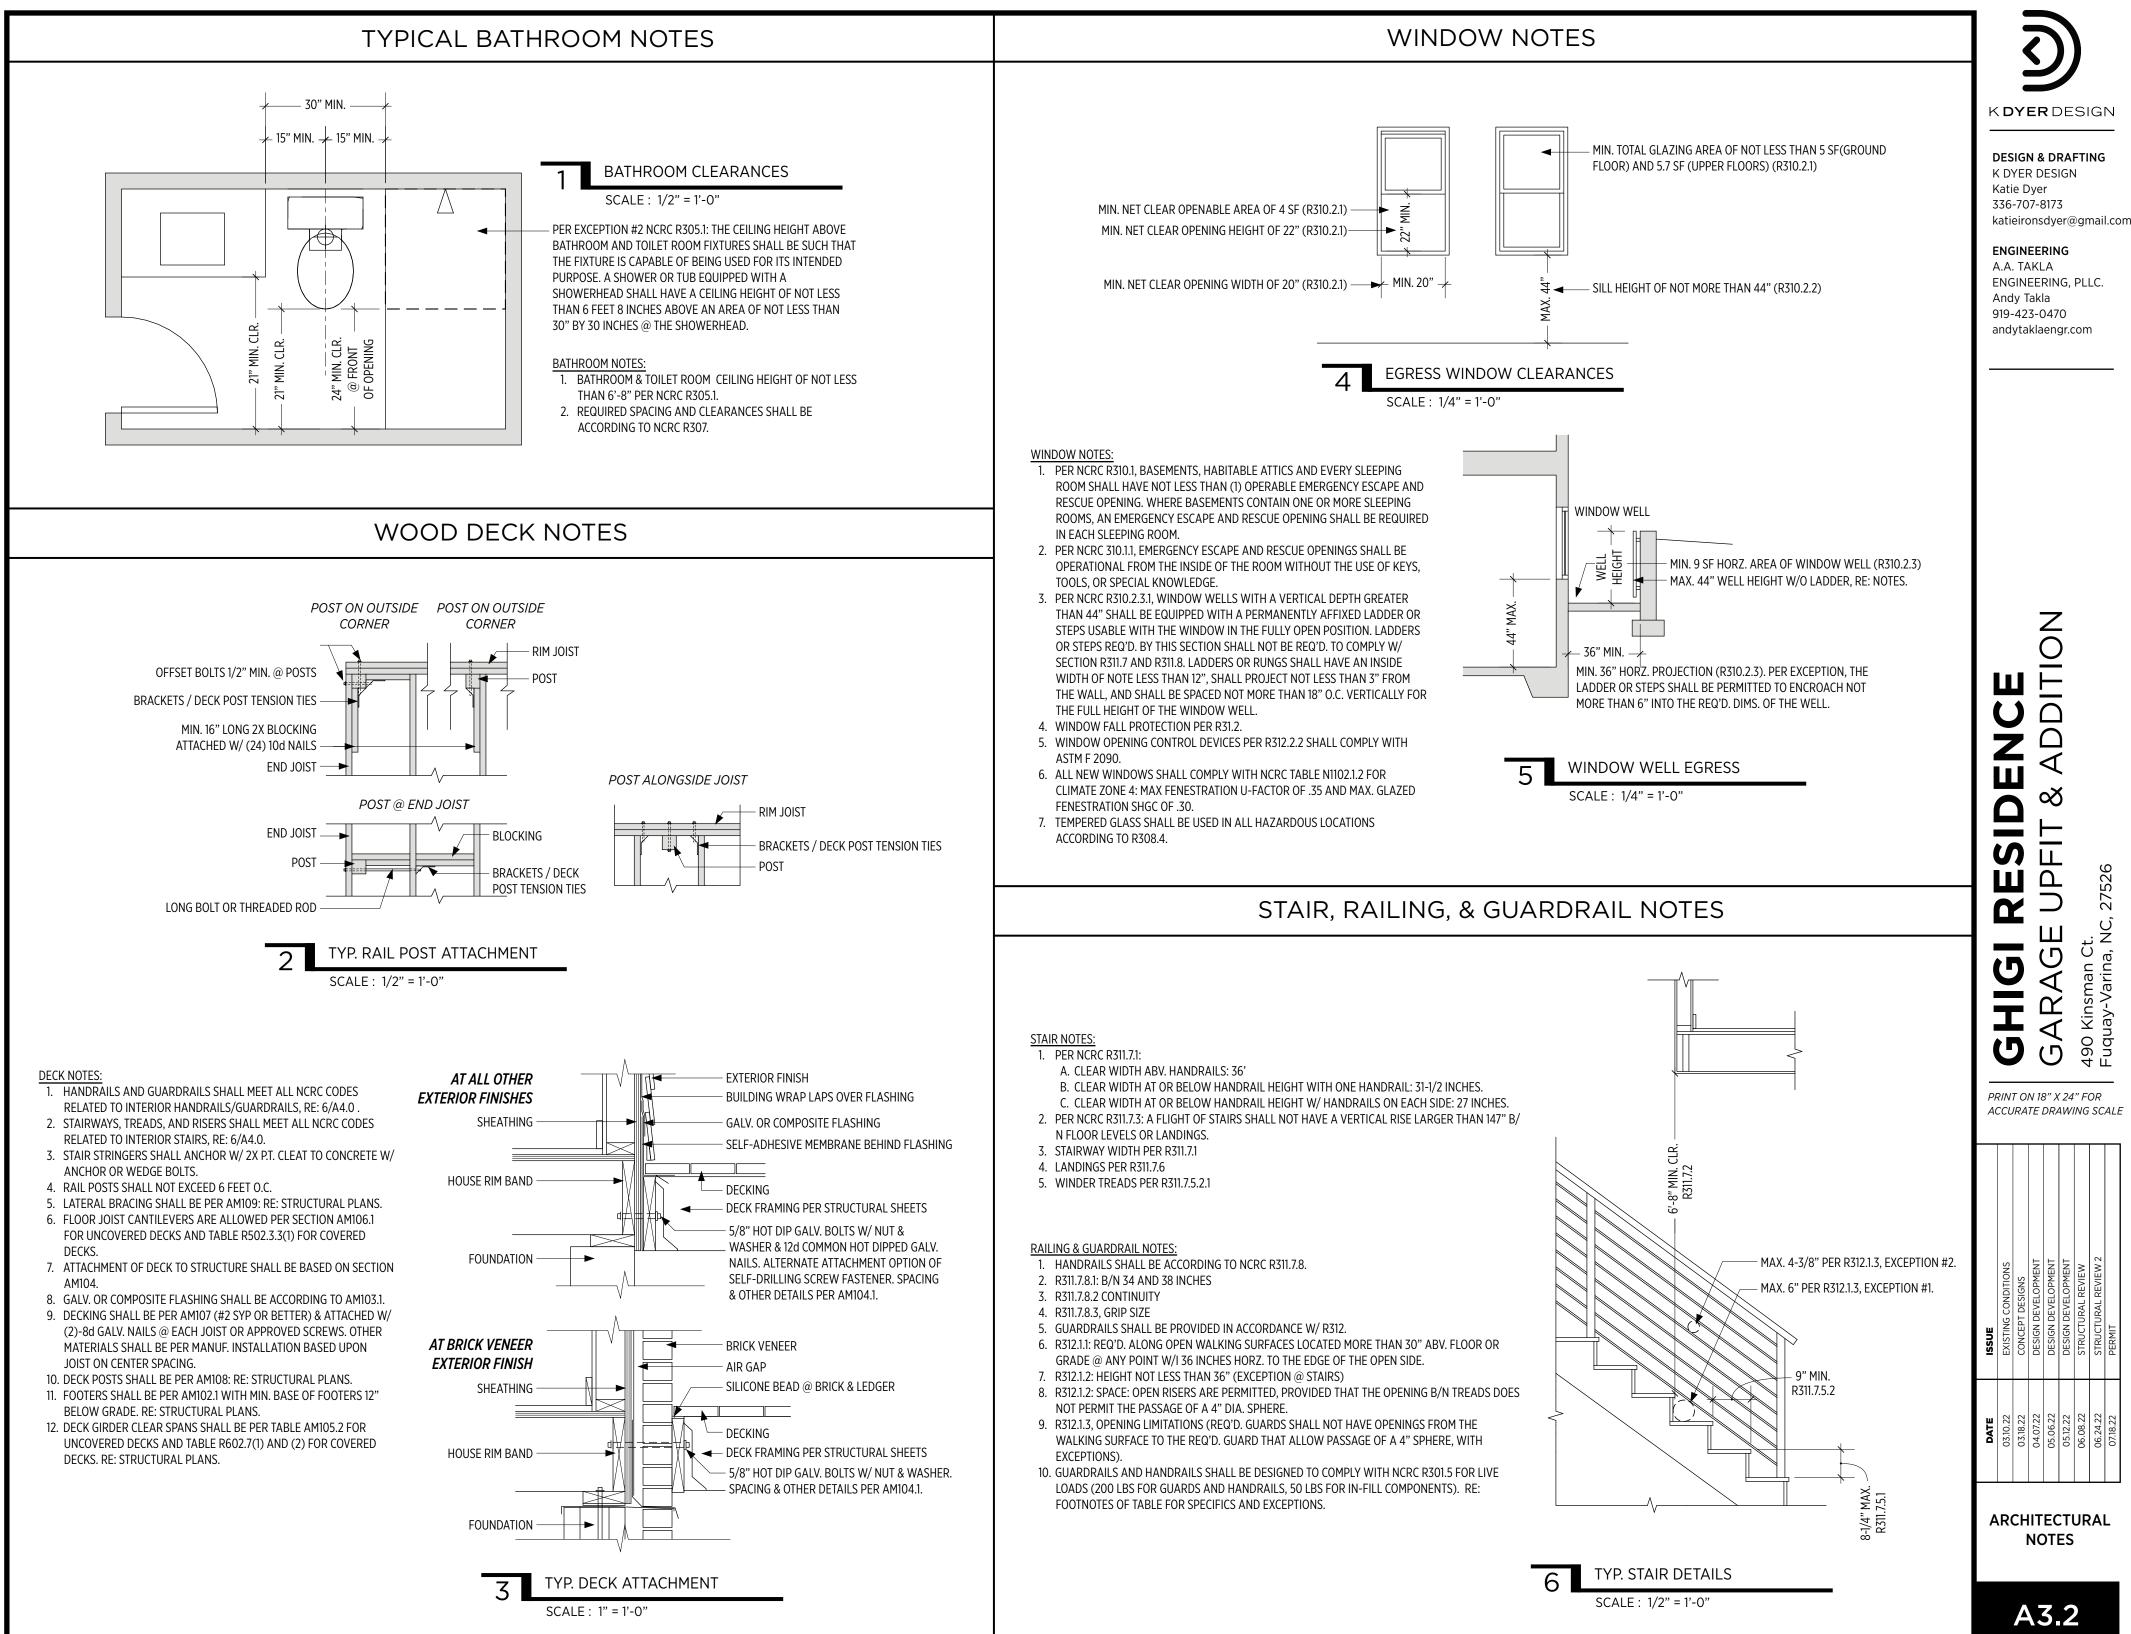

ADDITION U **IDEN** ∞ Ш S Δ ш \supset Ŷ ப U 4 A R

06

PRINT ON 18" X 24" FOR ACCURATE DRAWING SCALE

(7)

DATE	ISSUE
03.10.22	EXISTING CONDITIONS
03.18.22	CONCEPT DESIGNS
04.07.22	DESIGN DEVELOPMENT
05.06.22	DESIGN DEVELOPMENT
05.12.22	DESIGN DEVELOPMENT
06.08.22	STRUCTURAL REVIEW
06.24.22	STRUCTURAL REVIEW 2
07.18.22	PERMIT

ARCHITECTURAL NOTES



3 K **DYER** DESIGN

DESIGN & DRAFTING K DYER DESIGN Katie Dyer 336-707-8173 katieironsdyer@gmail.com


ENGINEERING A.A. TAKLA ENGINEERING, PLLC. Andy Takla 919-423-0470 andytaklaengr.com


> ADDITION ∞ GARAGE UPFIT 490 Kinsman Ct. Fuquay-Varina, NC, 27526

PRINT ON 18" X 24" FOR ACCURATE DRAWING SCALE

DATE 03.10.22 03.18.22 04.07.22 04.07.22 05.06.22 05.06.22 05.12.22 05.08.22 06.28.22 06.28.22	ISSUE EXISTING CONDITIONS CONCEPT DESIGNS DESIGN DEVELOPMENT DESIGN DEVELOPMENT DESIGN DEVELOPMENT DESIGN DEVELOPMENT STRUCTURAL REVIEW 2 PERMIT
--	--

PROPOSED ELEVATIONS

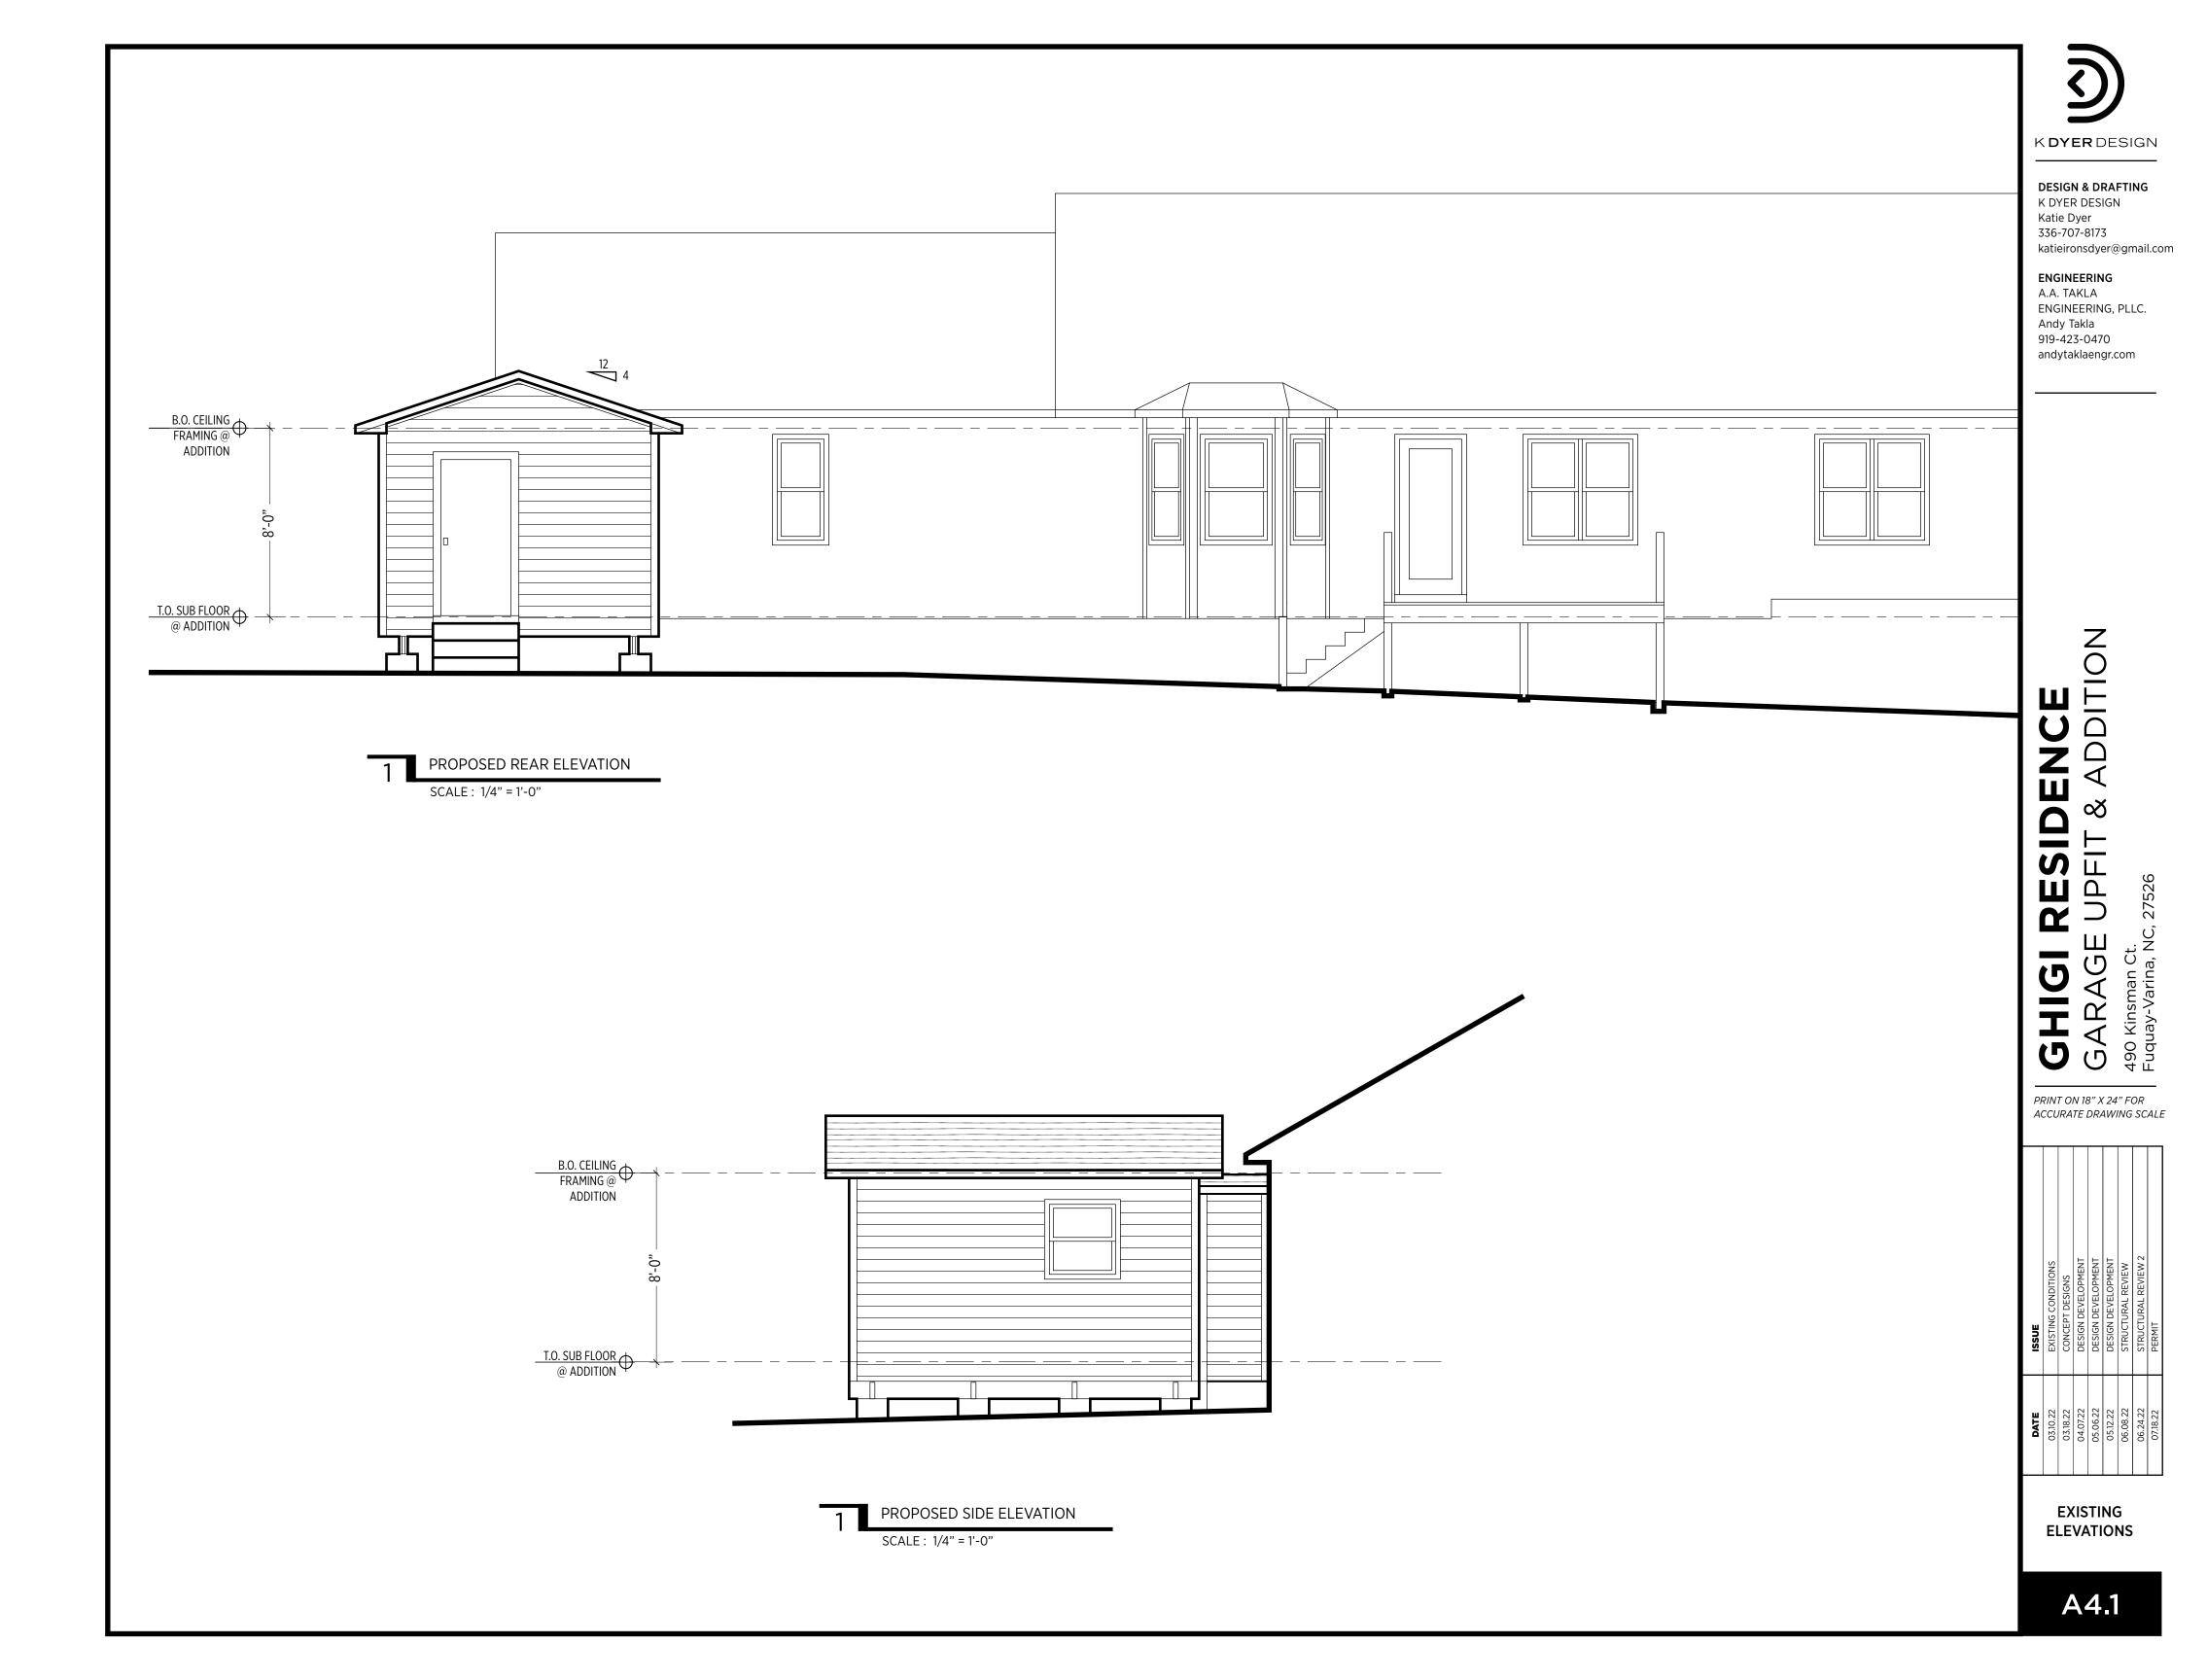

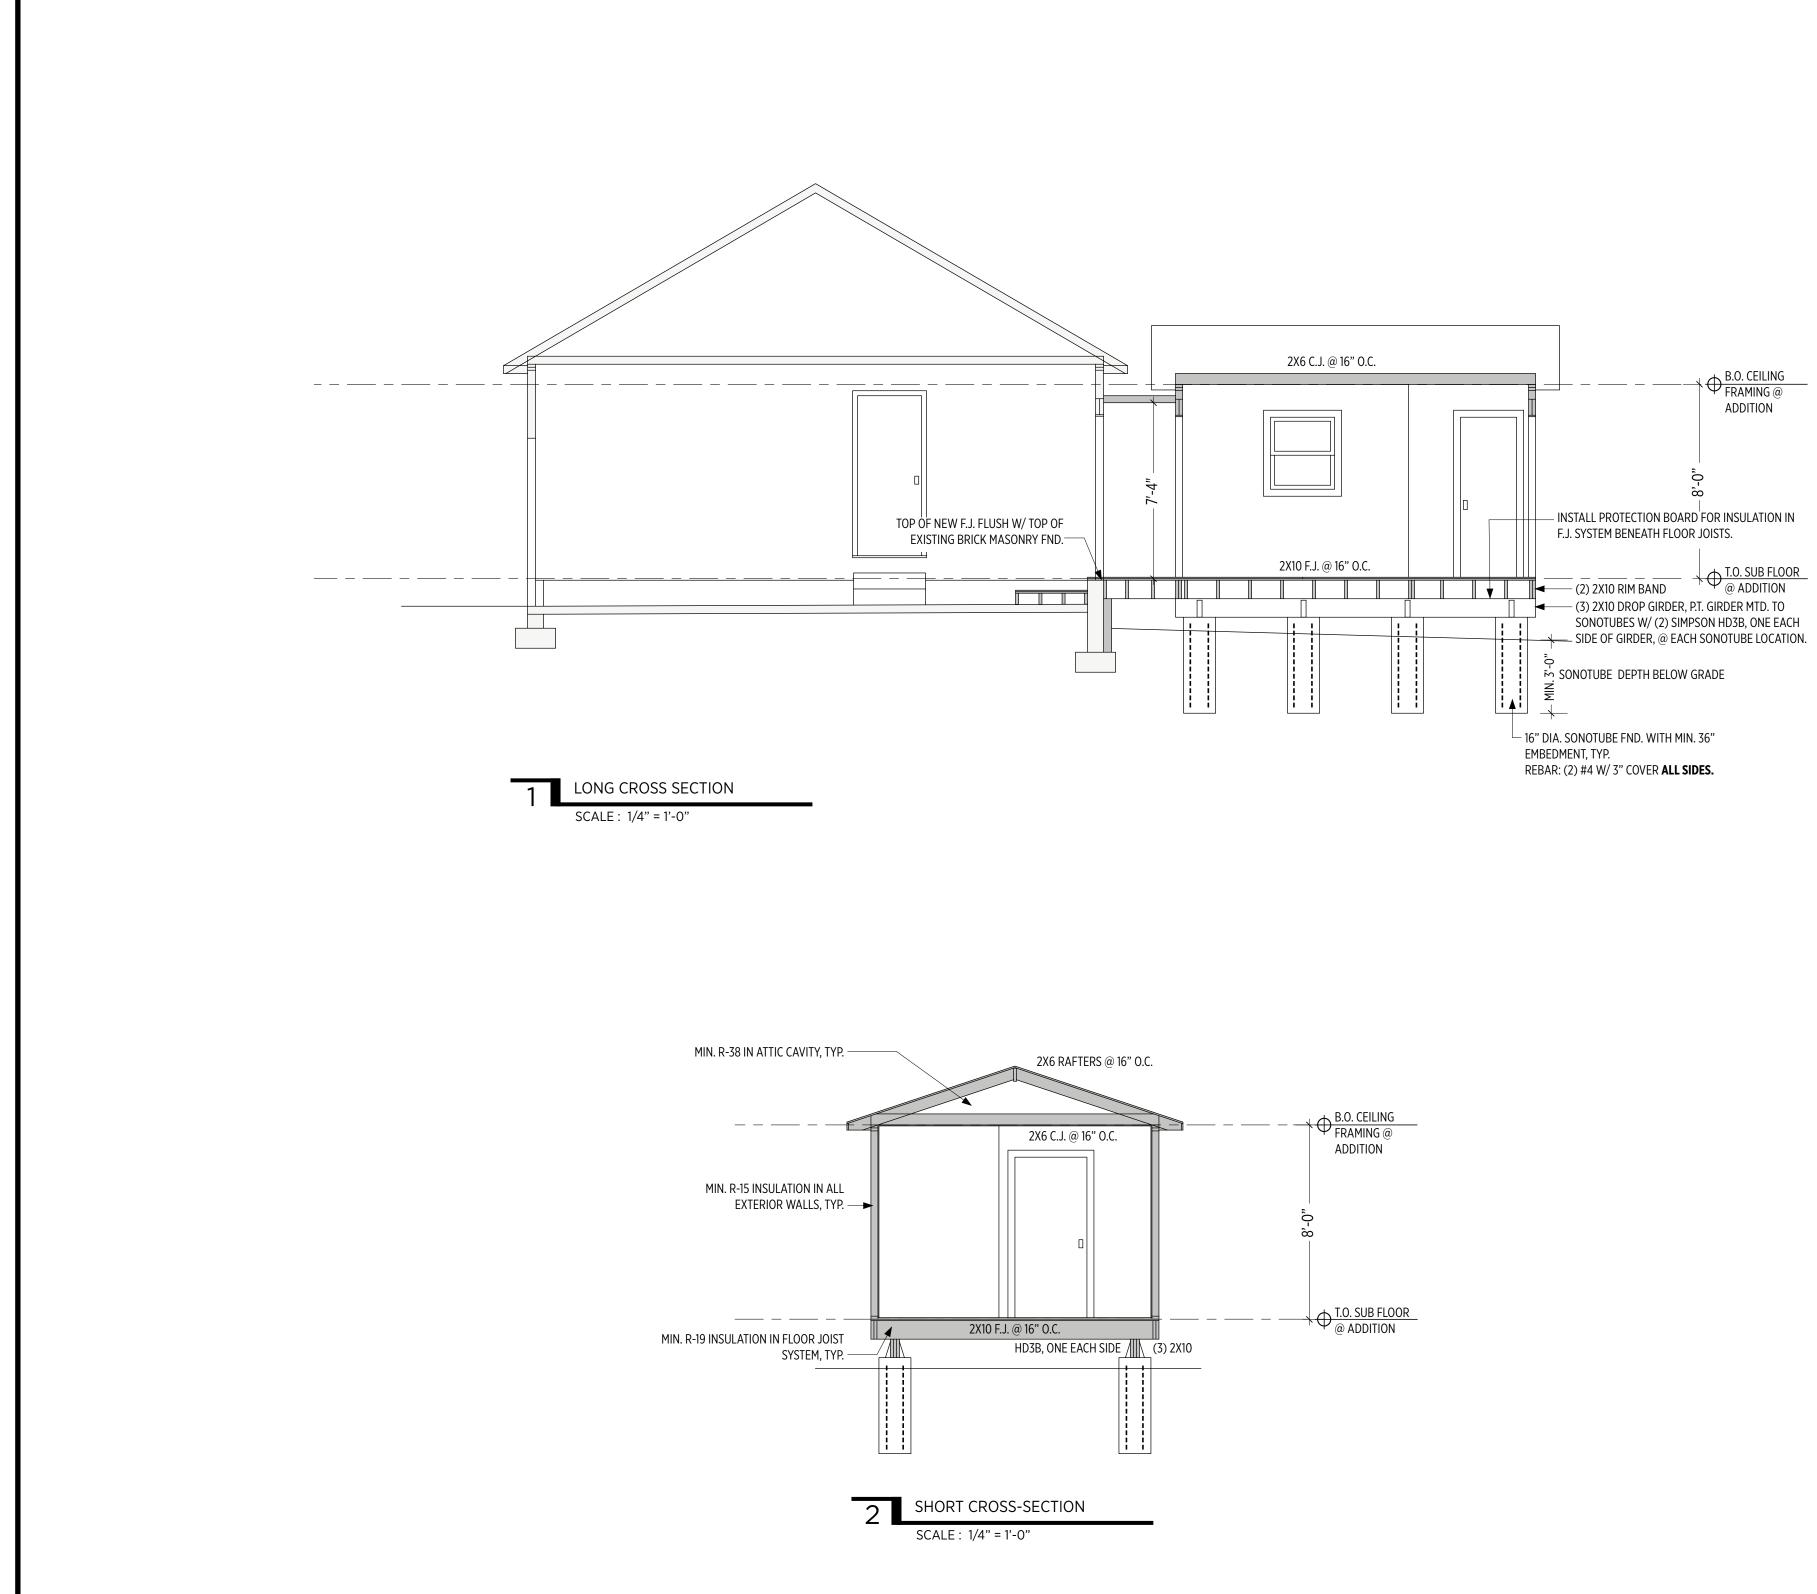



DESIGN & DRAFTING K DYER DESIGN Katie Dyer 336-707-8173 katieironsdyer@gmail.com

ENGINEERING A.A. TAKLA ENGINEERING, PLLC. Andy Takla 919-423-0470 andytaklaengr.com

ADDITION SIDENCE ∞ UPFIT Ц Ш Ц 490 Kinsman Ct. Fuquay-Varina, NC, GARAGE **GHIGI**

27526

PRINT ON 18" X 24" FOR ACCURATE DRAWING SCALE

03.10.22 EXISTING 03.10.22 EXISTING 03.18.22 CONCEP 04.07.22 DESIGN I 05.06.22 DESIGN I 05.12.22 DESIGN I	EXISTING CONDITIONS CONCEPT DESIGNS DESIGN DEVELOPMENT
	T DESIGNS DEVELOPMENT
	DEVELOPMENT
	UESIGN DEVELOPMENI
	DESIGN DEVELOPMENT
06.08.22 STRUCTL	STRUCTURAL REVIEW
06.24.22 STRUCTU	STRUCTURAL REVIEW 2
07.18.22 PERMIT	

PROPOSED SECTIONS

	DESIG	N LOADS	
	LIVE LOAD (PSF)	DEAD LOAD (PSF)	DEFLECTION (DL & LL)
ALL FLOORS	40	10	L/360
ATTIC PLATFORMS	25	10	L/360
CEILING	10	10	L/360
DECKS/BALCONIES	60	10	L/240
ROOF	20	15	L/240
WIND LOAD	115 MPH (U.O.N.)	115 MPH (U.O.N.)	L/240

GENERAL CONSTRUCTION

- 1. ALL TEMPORARY SHORING, MEANS & METHODS ARE THE RESPONSIBILITY OF THE CONTRACTOR.
- ALL DIMENSIONS TO BE VERIFIED BY THE CONTRACTOR IN THE FIELD.
- ENGINEER ASSUMES NO RESPONSIBILITY FOR THE SAFETY OF PROJECT DELIVERY.
- 4. ANY QUESTIONS PERTAINING TO STRUCTURAL COMPONENTS SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE ENGINEER.
- 5. LIMITATIONS: SERVICES PROVIDED ARE IN ACCORDANCE WITH THE STANDARD OF PRACTICE FOR STRUCTURAL ENGINEERING AND WITHIN THE LIMITS IMPOSED BY SCOPE, SCHEDULE, & BUDGET. THE DETERMINATIONS CONTAINED IN THIS REPORT ARE BASED ON CONDITIONS OBSERVED AT THE TIME OF THE EVALUATION. NO GUARANTEES OR WARRANTIES, EXPRESSED OR IMPLIED, UNDER THIS AGREEMENT OR OTHERWISE, SHALL BE CONSTRUED IN CONNECTION WITH SERVICES PROVIDED. SEQUENCING. SHORING. MEANS AND METHODS OF CONSTRUCTION ARE CONSIDERED BEYOND THE SCOPE OF THIS DESIGN.
- 6. UNLESS OTHERWISE NOTED, CODE REFERENCES BELOW PERTAIN TO THE NORTH CAROLINA RESIDENTIAL BUILDING CODE VERSION 2018 (NCRC).

FOUNDATION

- ASSUMED SOIL LOAD BEARING CAPACITY = 2,000 SF PSF.
- 2. MINIMUM 28 DAY F'C OF CONCRETE = 3,000 PSI.
- 3. FOUNDATIONS TO BE BUILT IN ACCORDANCE W/ NCRC 209, CHAPTER 4.
- FOOTING "TIE-IN" (IF APPLICABLE) SHALL BE (2) 16" LONG #4 EPOXY BONDED DOWELS 4 HALF EMBEDDED MID-DEPTH INTO EXISTING FOOTINGS.
- 5. INSTALL ANCHOR BOLTS PER NCRC 403.1.6.
- 6. ALL SLABS SHALL BE 4" THICK, 3,000 PSI CONCRETE SLAB ON 4" OF #57 SUB-BASE W/ A 6 MIL VAPOR BARRIER (IF USED IN AN INTERIOR OR GARAGE APPLICATION) W/ 10-10 6X6 WELDED WIRE FABRIC U.O.N.
- 7. ALL SUSPENDED SLABS ON MTL. PANS SHALL UTLIZE 16GA TYPE B U.O.N.
- MAX. UNREINFORCED, UNBALANCED CONDITION OF ANY CMU WALL SHALL BE 36". ANY 8. FOUNDATION WALL SUBJECT TO 24" OF UNBALANCED FILL OR MORE SHALL BE FULLY GROUTED.
- TOP COURSE OF ALL FOUNDATION WALLS SHALL BE FULLY GROUTED. 9.
- ALL PIERS SHALL BE IN THE MIDDLE 1/3 OF THE FOOTING. MIN. 2" FOOTING PROJECTION EACH SIDE U.O.N. MAX PROJECTION SHALL BE THE DEPTH OF THE FOOTING.

FOOTING SCHEDULE

A = 16" X 16" X 8"

- B = 20" X 20" X 8"
- C = 24" X 24" X 10"
- D = 30" X 30" X 12"
- E = 36" X 36" X 12"
- F = 40" X 40" X 12" W/ (3) #4 REBAR E.W.*
- G = 48" X 48" X 12" W/ (4) #4 REBAR E.W.*

ALL REBAR IN FOOTINGS TO HAVE 3" COVER FROM SIDES, BOTTOMS, & OTHER PARALLEL REBAR.

LATERAL BRACING

- 1. UNLESS OTHERWISE NOTED, LATERAL BRACING IS FOUND SUFFICIENT & COMPLIANT WITH MINIMUM REQUIREMENTS SET FORTH IN NCRC TABLE R602.10.2, PROVIDED ALL EXTERIOR WALLS AREA SHEATHED AT THE EXTERIOR PER CS-WSP, R602.10.3, WHICH INCLUDES 2X4 (MIN.) STUDS @ 16" O.C. SHEATHED W/ 7/16" OSB W/ (1)8d NAIL @ 6" O.C. EDGE & (1)8d NAIL @ 12" O.C. FIELD.
- 2. TYPICALLY, REQ'D, LENGTH OF CS-WSP @ EACH DESIGNATED SHEAR WALLS ARE SHOWN ON PLANS.
- 3. ALL NOTED PORTAL FRAME (P-F) SHALL BE COMPLIANT W/ R602.10.1.
- 4. ALL LOCATIONS NOTED W/ "H/D" SHALL BE 800 LBS MIN. CAPACITY. OPTIONS INCLUDE CS16 STRAPS FULLY POPULATED W/ 10d NAILS, CENTERED @ BOTTOM OF STUD, EXTENDING TO BOTTOM OF BAND BELOW. BUILDER MAY INSTALL STRAPS ON EXTERIOR OF THE WALLS. SEVERAL OTHER HARDWARE TYPES ARE AVAILABLE FOR USE.
- 5. WALLS NOTED AS GB SHALL BE FRAMED IN ACCORDANCE W/ R602.10.2.

FLOOR FRAMING

- ALL DIMENSIONAL LUMBER TO BE SPRUCE PINE FIR NO. 2 OR BETTER.
- 2. (X) SC = NUMBER OF 2X4/2X6 STUDS SUPPORTING BEAMS. SIZE OF STUDS TO MATCH STUD SCHEDULE IN REMAINDER OF WALL U.O.N. STRAP ALL SUTD COLUMNS OF (4) OR MORE WITH (3) HORZ. CS22 STRAPS.
- ENGINEERED BEAMS SHALL BE 1.75" WIDE PER PLY. BENDING STRESS (Fb) OF LVL = 2,600 PSI; LSL 3 = 2,325 PSI. PSL (COLUMNS) SHALL BE 3.5" WIDE W/ F'b = 1,344 PSI.
- ALL FLOOR FRAMING SHALL BE PER NCRC 2018 CHAPTER 5.
- 5. ALL WALL FRAMING SHALL BE PER NCRC 2018 CHAPTER 6. 6. ALL I-JOISTS AND FLOOR TRUSS FRAMING SHALL BE PER SUPPLIER'S SPECIFICATIONS AND
- LAYOUT PLANS.
- ALL STRUCTURAL STEEL SHALL BE ASTM A-36; Fy = 36 KSI. 7.
- ALL WELD MATERIAL SHALL BE 70 KSI MATERIAL 8.
- INSTALL DBL. JOIST UNDER ALL WALLS PARALLEL W/ JOISTS. 9. TYPICALLY, LOAD BEARING WALLS (LBW) ARE SHOWN HATCHED IN RED. NEARBY GIRDERS AND 10. BEAMS SHOULD BE ASSUMED TO BE DIRECTLY SUPPORTING THESE LBWS, U.O.N.
- 11. ALL SIDE LOADED STEEL BEAMS SHOULD BE PACKED OUT W/ DBL. 2X MATERIAL & BOLTED THRU TO WEB W/ 1/2" DIA. THRU BOLTS @ 24" O.C. STAGGERED.
- 12. ALL BEAM BEARINGS SHALL BE NO LESS THAN 3". ALL OTHER BEARING TO BE 2" MIN.
- 13. ALL HANGERS SHALL BE STANDARD, APPROPRIATELY SIZED FACE MOUNTED U.ON. CONSULT SIMPSON CATALOG OR LOCAL SUPPLIER. HIGH CAPACITY HANGERS WILL BE LOAD-RATED ON PLANS. INSTALL HARDWARE PER MANUF. GUIDELINES.

HEADER SCHEDULE

- A = (2) 2X6 W/ (1) 2X4 JACK @ EE
- B = (2) 2X8 W/ (2) 2X4 JACK @ EE
- C = (2) 2X10 W/ (2) 2X4 JACK @ EE
- D = (2) 2X12 W/(3) 2X4 JACK @ EE
- E = (2) 9-1/4" X 1.75" LVL W/ (3) 2X4 JACK @ EE
- * IF WALL IS A 2X6 WALL, ALL JACKS SHALL BE 2X6 & ALL HEADERS SHALL BE 3-PLY

KING SCHEDULE

- 0-3' WIDE = (1) 2X4 KING @ EE
- 3'-6' WIDE = (2) 2X4 KING @ EE
- 6'-9' WIDE = (3) 2X4 KING @ EE
- * IF WALL IS A 2X6 WALL, ALL KING STUDS SHALL BE 2X6.

WOOD DECK NOTES

- 1. ALL LUMBER TO BE PRESSURE TREATED SYP OR SPF NO. 2., OR BETTER.
- 2. BAND ATTACHMENTS TO BE INSTALLED PER NCRC APPENDIX M (AM 104.1 (1).
- 3. INSTALL LATERAL BRACING PER NCRC AM 109.1.
- 4. INSTALL HANDRAILS PER AM111.1.; NOTE: 4X4 HANDRAILS SHALL NOT BE NOTCHED.
- 5. MAX POST HEIGHTS PER AM 108.1
- 6. STAIR STRINGERS PER AM 110.1.

SCREENED IN AND COVERED PORCH NOTES

- 1. ALL WOOD DECK NOTES TO APPLY.
- 2. POSTS TO BE ATTACHED TO FOOTINGS, SLAB OR CMU PIERS USING ABU44 OR ABU66 POST BASE (OR APPLICABLE SIZE) OR (2) RPBZ BASE CONNECTOR.
- 3. UPLIFT FOR POST FOR POSTS TO HEADERS MAY BE EITHER (2) SIMPSON LCE4, (2) SIMPSON GA1 CLIPS W/ 3" LONG #9 SCREWS OR (4) 1/4" DIA. 4.5" LONG LEDGERLOKS DRIVEN @ A 45 DEG. ANGLE TO EACH SIDE OF POSTS OR NOTCHED 50% WIDTH W/ (2) LEDGERLOKS.
- 4. UPLIFT FOR POSTS TO FLOOR FRAMING MAY BE EITHER (2) SIMPOSN GA1 CLIPS W/ 3" LONG #9 SCREWS OR (4) 1/4" DIA., 4.5" LONG LEDGERLOKS DRIVEN @ A 45 DEG. ANGLE TO EACH SIDE OF POSTS.

ROOF FRAMING NOTES:

- 1. ALL ROOF FRAMING SHALL COMPLY W/ NCRC 2018 CHAPTER 9. 2. ALL DIMENSIONAL LUMBER TO BE SYP OR SPF NO. 2 OR BETTER. SHEATHE W/ 7/16" OSB W/ 8d
- NAILS @ 6" O.C. EDGE & 12" O.C. FIELD.
- 3. ALL RAFTER TIES TO BE INSTALLED NO HIGHER THAN 1/3RD HEIGHT EAVE TO RIDGE UP FROM EAVE NAILED W/ (5) 10d NAILS @ EACH END, U.O.N.
- 4. ROOF TRUSSES PER OTHERS; INSTALLATION PER SUPPLIER GUIDELINES.
- 5. WHEN STRUCTURAL RIDGE IS USED, COLLAR TIES MAY BE OMITTED W/ 24" LONG RIDGE STRAPPING (CS22) IS APPLIED @ 32" O.C.

DRAINAGE

- 1. CONNECT ALL DOWNSPOUTS TO LEADER LINES THAT SLOPE AWAY FROM THE HOUSE FOR A MIN. OF 5'-0", TYP. @ ALL DOWNSPOUTS.
- 2. DAYLIGHT ALL FOOTER DRAINS MIN. 10'-0" AWAY FROM HOUSE, TYP. 3. GRADE TO DRAIN SURFACE WATER AWAY FROM FOUNDATION WALLS W/ A MIN. RATIO OF 6"
- WITHIN THE FIRST 10'-0", ALL SIDES, TYP.



DESIGN & DRAFTING K DYER DESIGN Katie Dyer 336-707-8173 katieironsdyer@gmail.com

ENGINEERING A.A. TAKLA ENGINEERING, PLLC. Andy Takla 919-423-0470 andytaklaengr.com



PRINT ON 18" X 24" FOR

06

ACCURATE DRAWING SCALE

DATE	ISSUE
03.10.22	EXISTING CONDITIONS
03.18.22	CONCEPT DESIGNS
04.07.22	DESIGN DEVELOPMENT
05.06.22	DESIGN DEVELOPMENT
05.12.22	DESIGN DEVELOPMENT
06.08.22	STRUCTURAL REVIEW
06.24.22	STRUCTURAL REVIEW 2
07.18.22	PERMIT

STRUCTURAL NOTES

