

Harnett County Department of Public Health

Operation Permit

PERMIT # SFD 2105-0020

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 145 Brown Rd (SR 1264)

Name: (owner) Dylan Koerner SUBDIVISION _____ LOT # _____

System Installer: Yellow Dog


Basement with plumbing: Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Type III Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

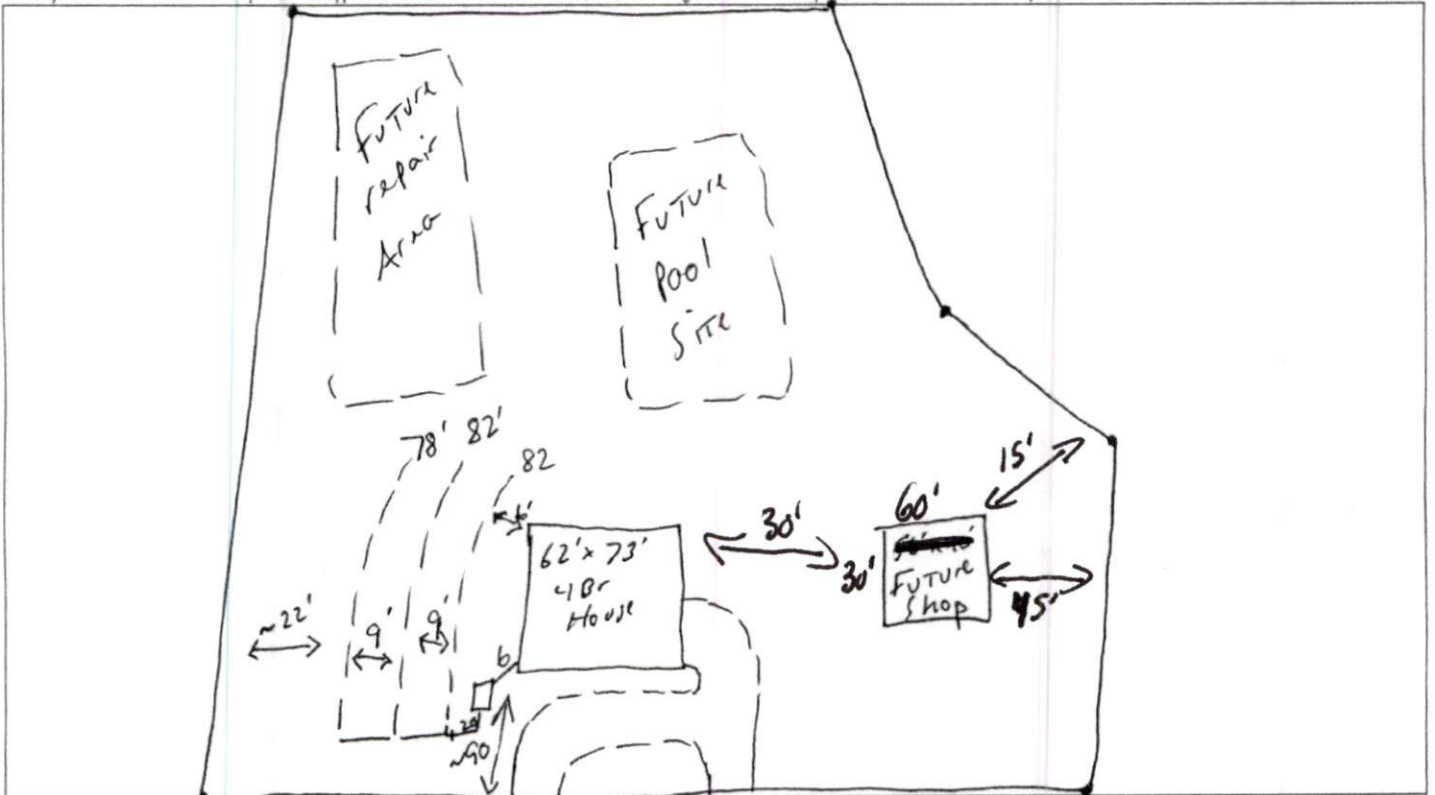

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

_____ D-Box _____ Pump _____ Alarm _____ H2O Line _____ PWR Line


Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% reduction (IQU) Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of depth of
 Drainage Field ditches 1 of each ditch 242 feet ditches 3 feet ditches 24 inches

French Drain Required: _____ Linear feet

Authorized State Agent Mark A. REH Date 5-11-22

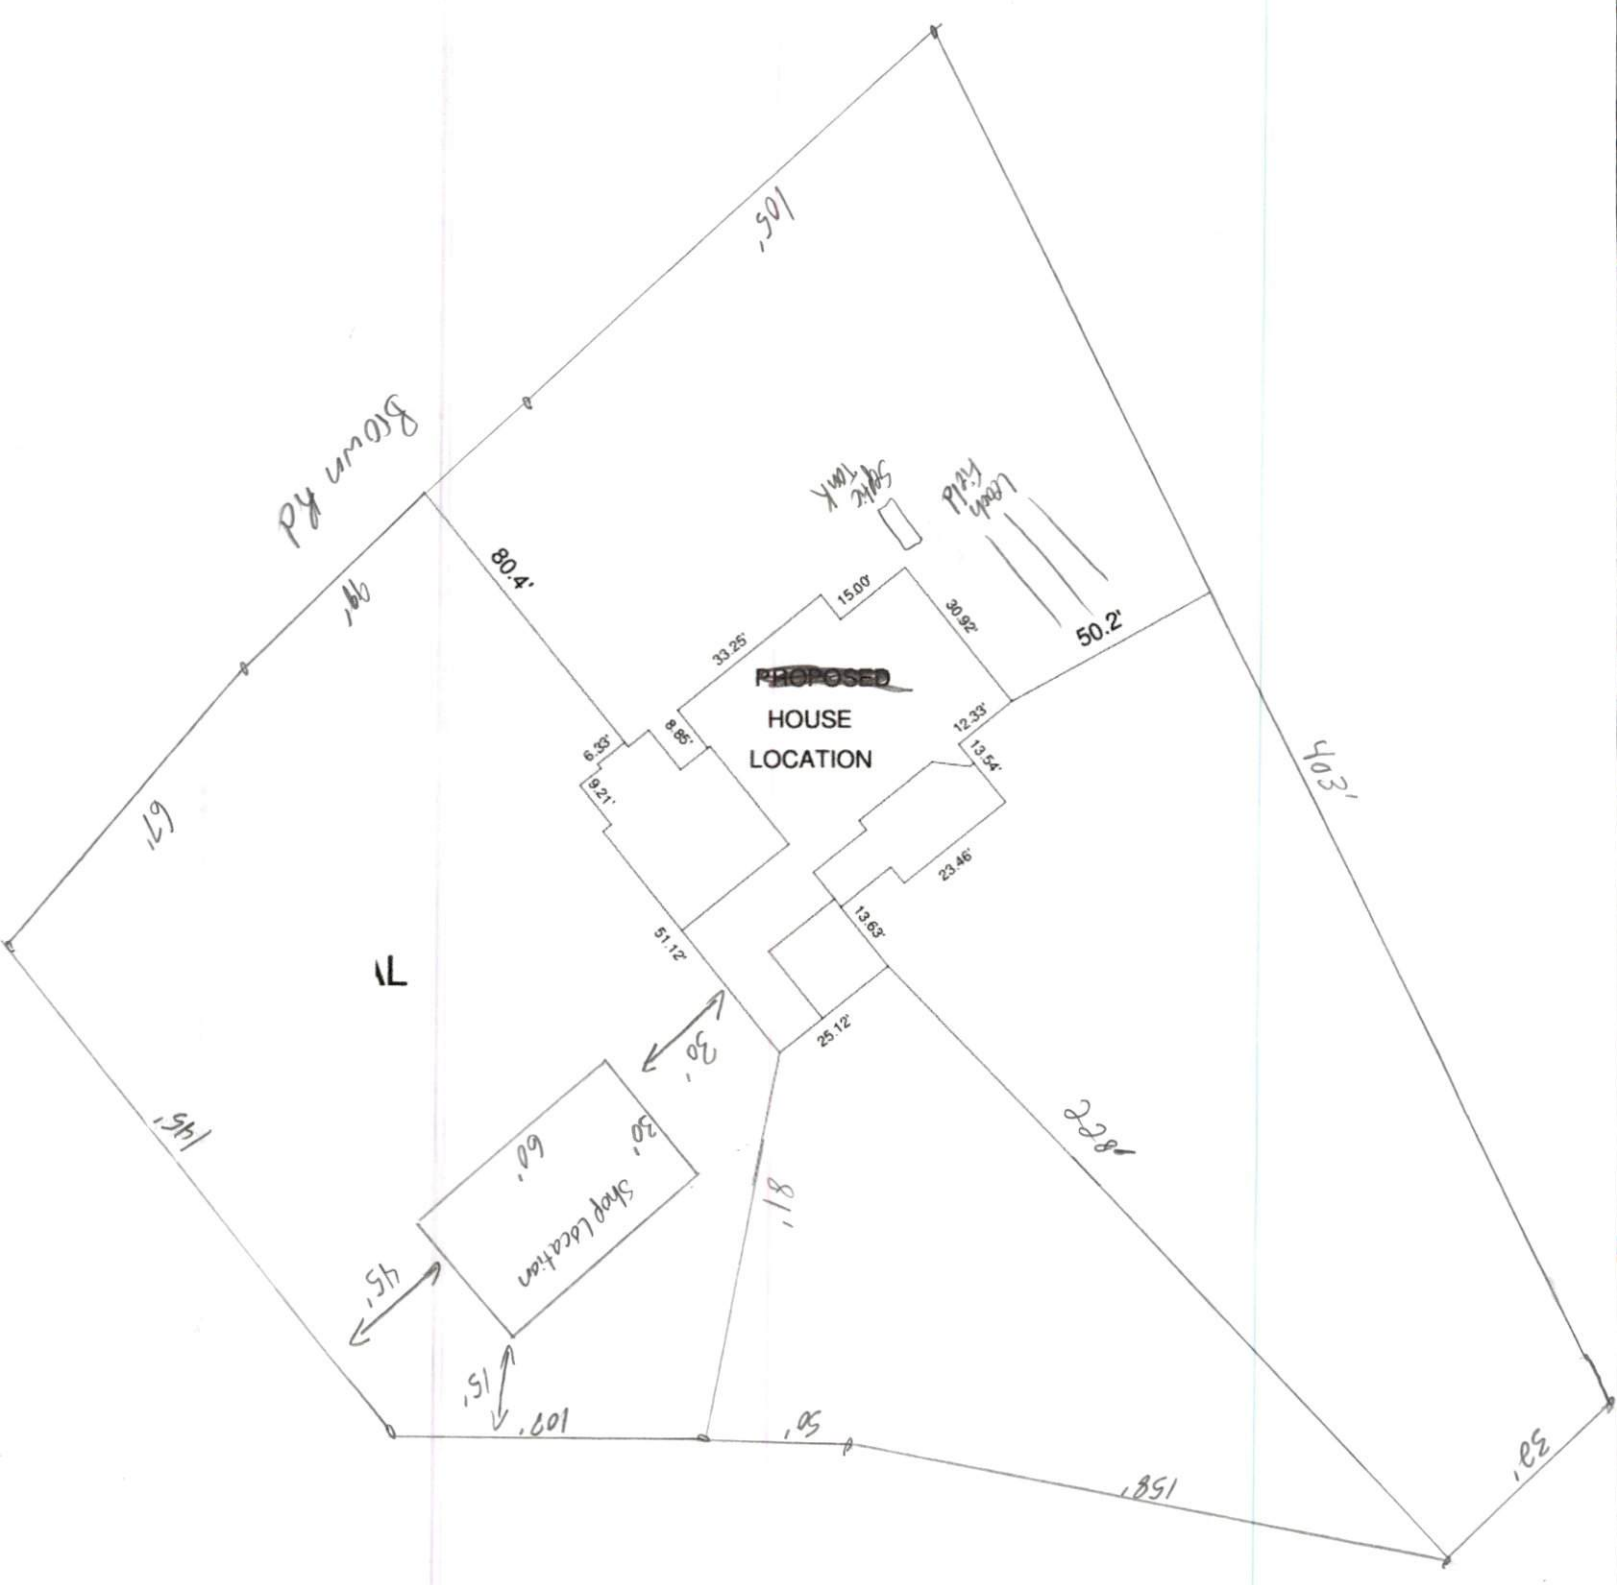

145 Brown Rd Lillington, NC