

Harnett County Department of Public Health 412 BLUE MONARCH

PERMIT # SFD2201-0014

Operation Permit

LAWZ

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 51142 Christian Light Rd

Name: (owner) Davidsen Homes LLC SUBDIVISION Prince Place LOT # 16

System Installer: Full Circle Environmental

Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well _____ feet


System Type: 25% Porous System Type IFCG Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

Chamber Quick-11

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

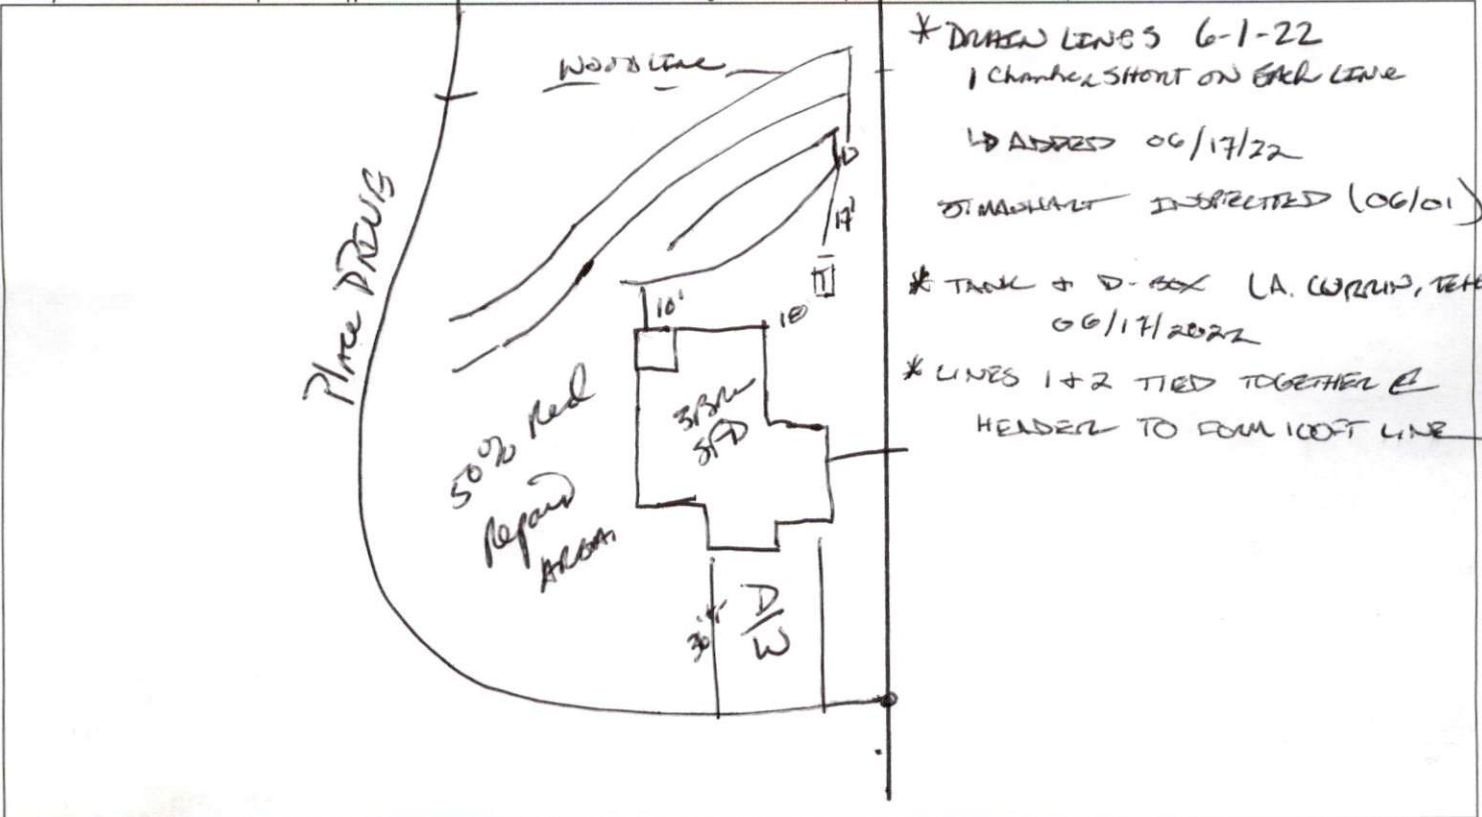

* DRAWN LINES 6-1-22
1 Chamber SHORT ON EACH LINE
↳ ADDED 06/17/22
DIMENSION INSPECTED (06/01)
* TANK + D-BOX (A. CORRUP, TANKS)
06/17/2022
* LINES 1 + 2 TIED TOGETHER &
HEADER TO FROM 100FT LINE

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

_____ D-Box _____ Pump _____ Alarm _____ H2O Line _____ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% Porous Septic Tank: 1000 gallons Pump Tank: _____ gallons
Subsurface No. of exact length width of depth of
Drainage Field ditches 3 of each ditch 102 feet ditches 3 feet ditches 20" inches
French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 06/20/2022