

HTE# SFD1901-0025

Harnett County Department of Public Health

25789

PERMIT # _____

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 3941 Rosser Pittman Rd (SR 1215)

Name: (owner) Brittany Pope SUBDIVISION _____ LOT # _____

System Installer: Lamy Sharpe Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: 25% Reduction (tire chip agg) Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

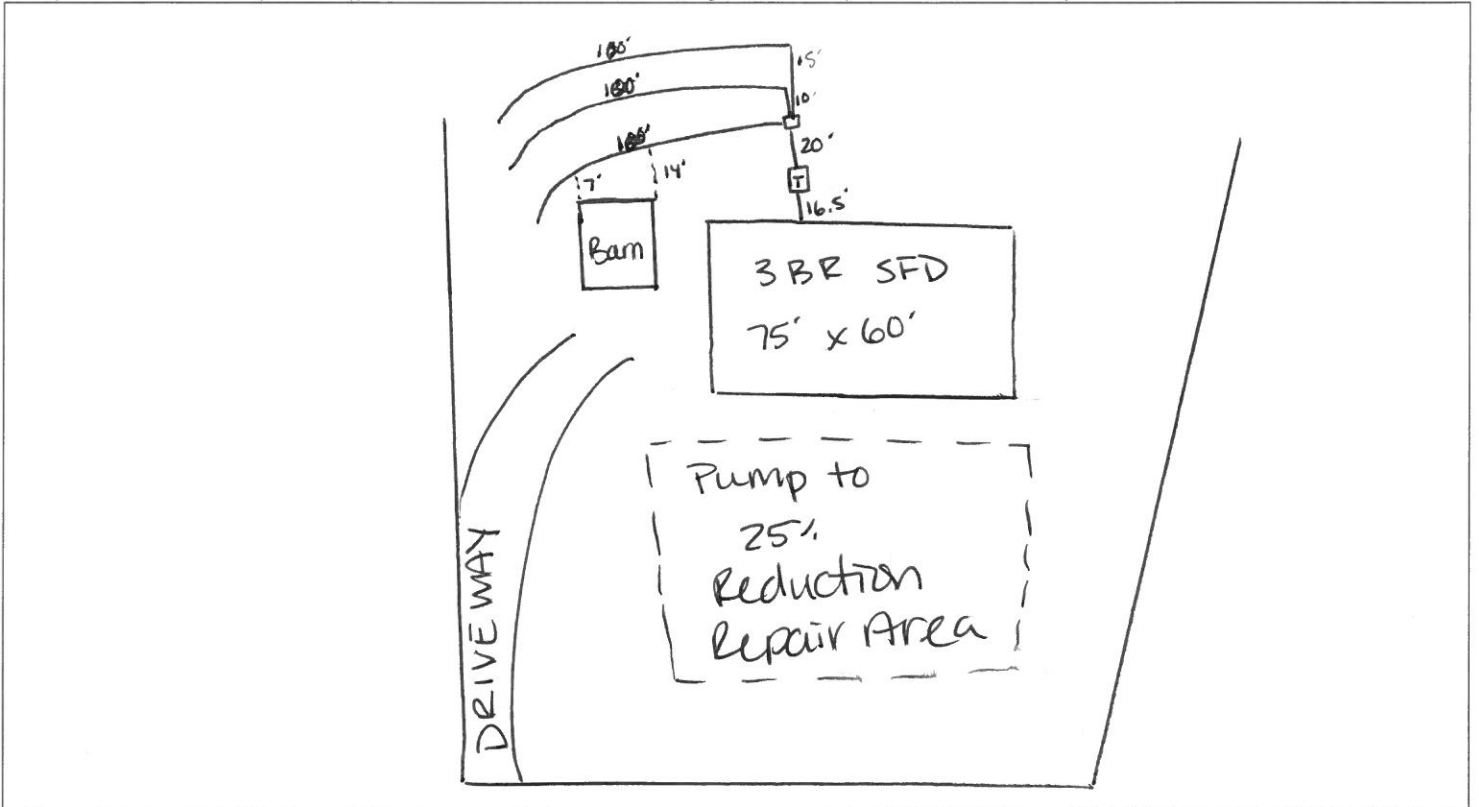

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% Reduction (tire chip agg) Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 3 exact length of each ditch 100 feet width of ditches 3 feet depth of ditches 18 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] REHS Date 11/19/19

Customer: 0369650001 / Larry Sharpes

Scale
Gross: 44180 LBS Out Manual Wt
Tare: 22080 LBS In Manual Wt
Net: 22100 LBS

Generator: NA / Not Applicable
Dest: DEST: CUSTOMER / Customer
Truck: LARRY SHAR

Comment:

Origin	Wastes & Services	Quantity Unit	Rate/Unit	Amount
NA / Not Applicable	DFMT116/Drain Fill Material	11.05 TON	\$25.00/TN	\$276.25
			Total Taxes:	\$19.34
			Total Amount:	\$295.59

Driver: _____

Deputy Weighmaster: Elizabeth Nipper

This load of tire chips is from the Fuel Grade location and meets the Nc specification as stated in Innovative Wastewater system approval IWWS-2002-03R for tire chip Substitution for Rock Aggregate in Nitrification Fields.