

Job	Truss	Truss Type	Qty	Ply	AMERICAS HOME PLACE/JOHNSON RES
72521976REP2	B2	Truss	8	1	Job Reference (optional)

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, c/m

Run: 8.83 S Apr 11 2025 Print: 8.830 S Apr 11 2025 MiTek Industries, Inc. Thu Oct 09 07:44:26

Page: 1

ID:SBD77HdgY19ONUfgrCXilzDT4F-IV2XutZs5bZNYuQQFSXGkpARGIRtR5pVhEVVYcyVDIb

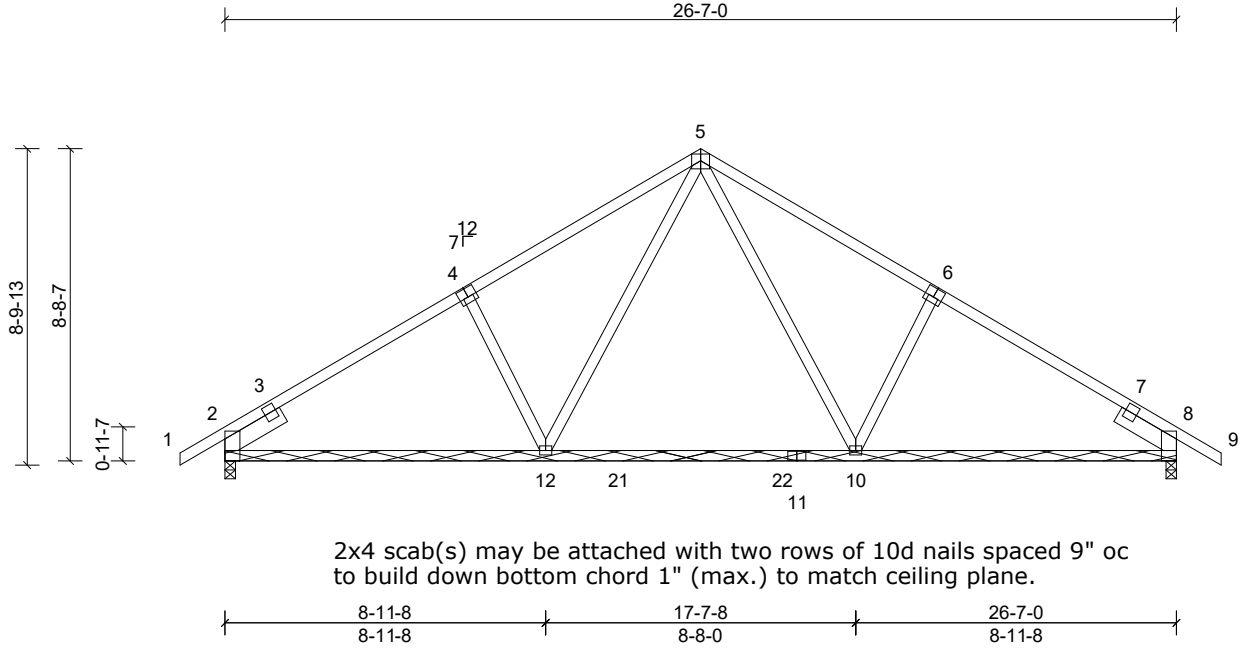


Plate Offsets (X, Y):		[4.0-3.0,0.3-0], [6.0-3.0,0.3-0]										
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.90	Vert(LL)	-0.33	10-12	>967	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.87	Vert(CT)	-0.50	10-12	>643	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.23	Horz(CT)	0.08	8	n/a	n/a		
BCDL	10.0	Code	IRC2015/TP12014	Matrix-MSH							Weight: 141 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2		
SLIDER	Left 2x6 SP No.2 -- 1-11-0, Right 2x6 SP No.2 -- 1-11-0		
REACTIONS			
	(lb/size)	2=1138/0-3-8, (min. 0-1-8), 8=1138/0-3-8, (min. 0-1-8)	
	Max Horiz	2=219 (LC 9)	
	Max Uplift	2=165 (LC 10), 8=165 (LC 11)	
FORCES			
	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	2-3=485/98, 3-4=1470/310, 4-5=1351/365, 5-6=1351/365, 6-7=1470/310, 7-8=350/98		
BOT CHORD	2-12=257/1332, 12-21=33/913, 21-22=33/913, 11-22=33/913, 10-11=33/913, 8-10=128/1191		
WEBS	5-10=147/601, 6-10=332/257, 5-12=147/601, 4-12=332/257		

- NOTES (7)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 165 lb uplift at joint 2 and 165 lb uplift at joint 8.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TP1 1.
 - This repair has been prepared based on information and use conditions supplied by client. Designer has made a good faith effort to outline damage and repair conditions as reported by client. When actual field conditions do not approximate those indicated on this drawing, client shall immediately inform the engineer and refrain from applying the repair.

