

HTE# REPAIR

Harris County Department of Public Health 19325

PERMIT # 23484

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: 70 SWAN LANE

Name: (owner) WILLIAM R. POPE SUBDIVISION POPE LAKE LOT # _____

System Installer: LARRY SHARPE Registration # _____

Basement with plumbing: Garage Number of Bedrooms 4


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

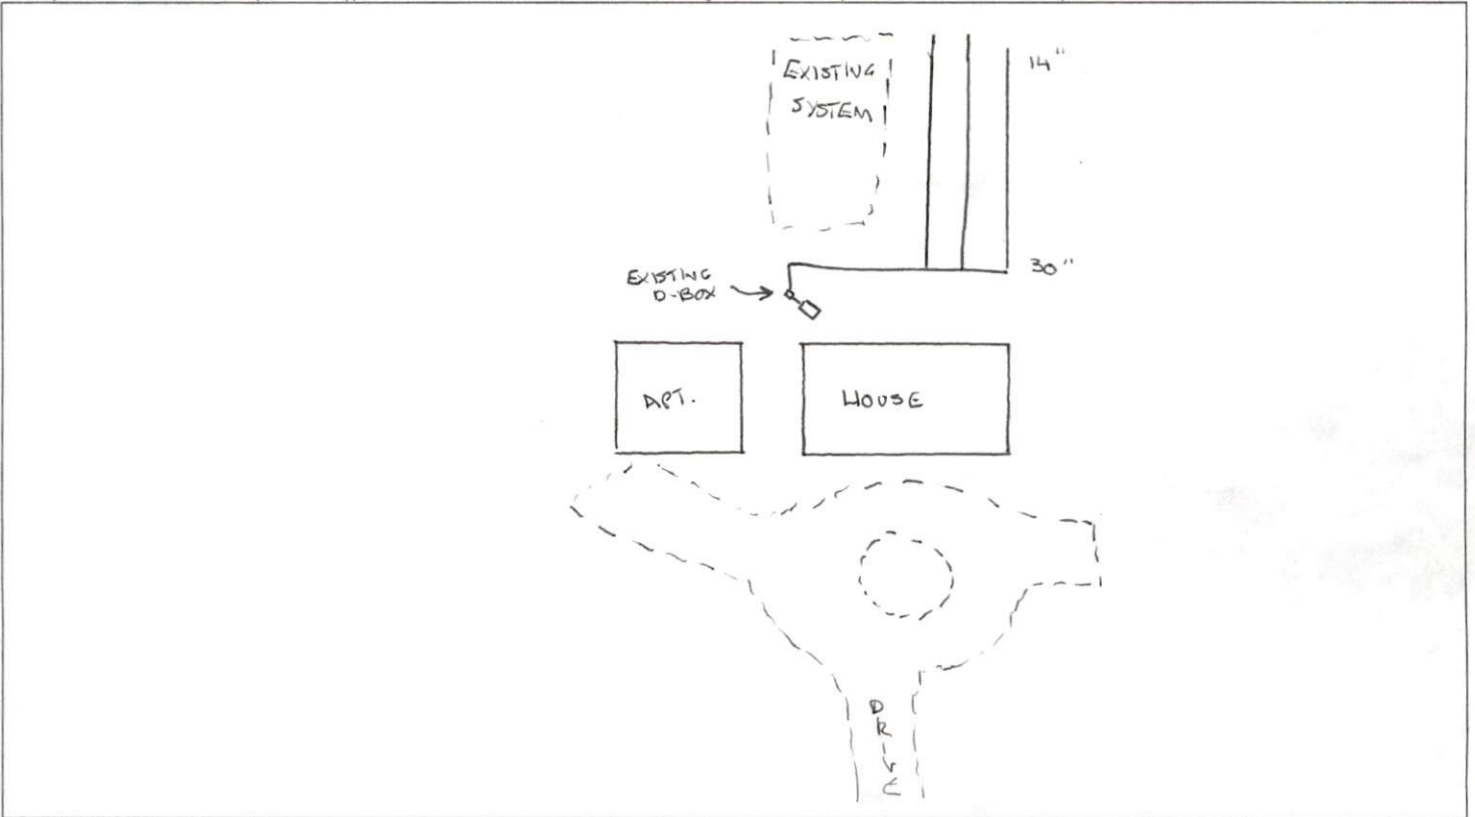

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other QUICK 4 CHAMBER Size of tank: Septic Tank: EXISTING gallons Pump Tank: _____ gallons

Subsurface No. of exact length 25 100 width of depth of
Drainage Field ditches 3 of each ditch 24 100 feet ditches 3 feet ditches 30-14 inches
French Drain Required: _____ Linear feet 2 PANELS

Authorized State Agent [Signature] RS Date 8/5/07