

# Harnett County Department of Public Health

PERMIT # BRES 2308-0002

## Operation Permit

New Installation    Septic Tank    Nitrification Line    Repair    Expansion

PROPERTY LOCATION: SR 1443 Lafayette Rd

Name: (owner) Jeffrey Johnson      SUBDIVISION \_\_\_\_\_      LOT # \_\_\_\_\_

System Installer: Brian Keith Davis complete Repair


Basement with plumbing:     Garage     Number of Bedrooms 3

Type of Water Supply:  Community    Public    Well    Distance from well \_\_\_\_\_ feet

System Type: 25% Reduction Chambers      Types V and VI Systems expire in 5 years.

(In accordance with Table V a)      Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

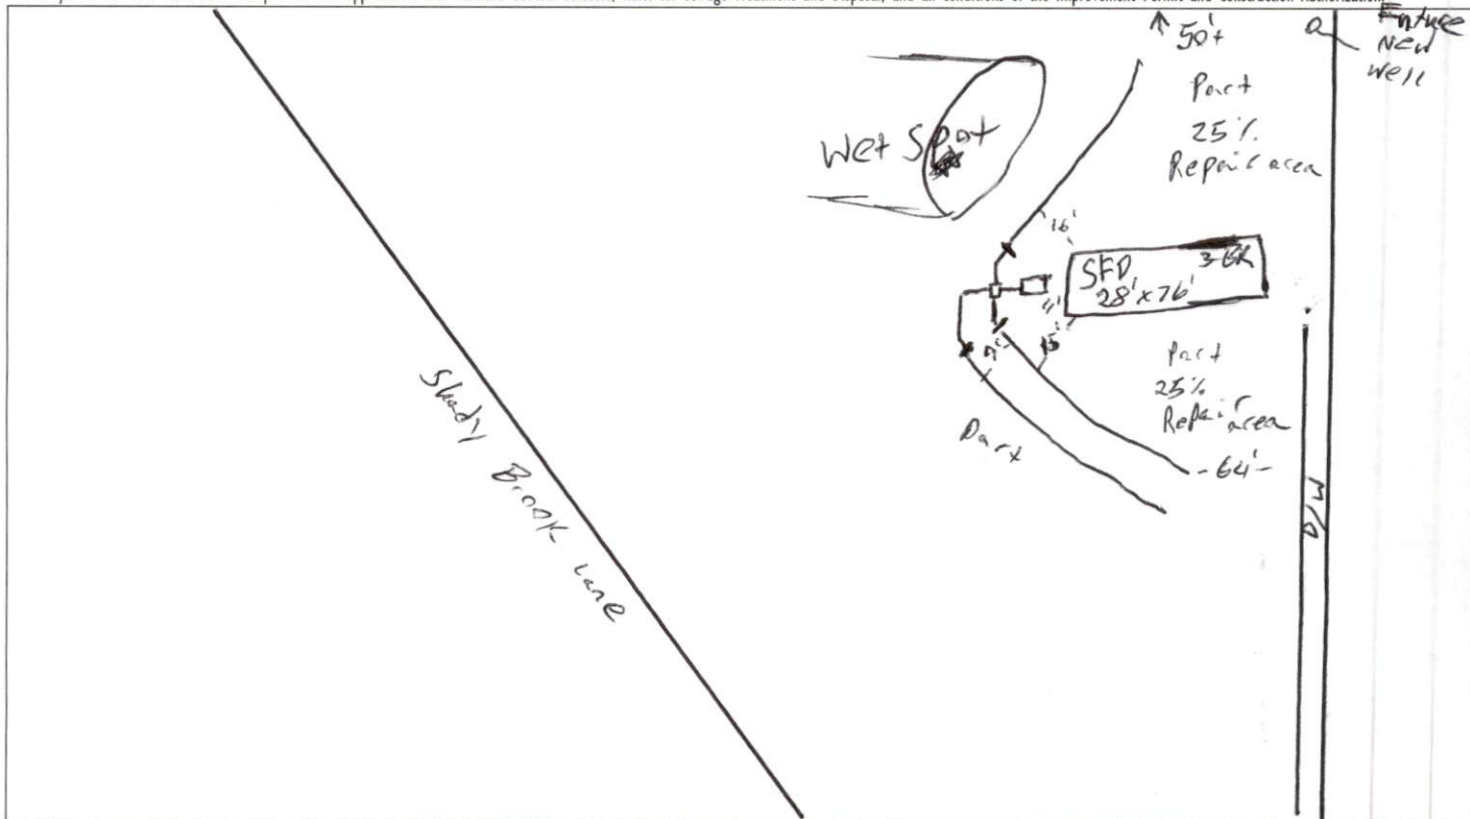

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

\_\_\_\_\_ D-Box    \_\_\_\_\_ Pump    \_\_\_\_\_ Alarm    \_\_\_\_\_ H2O Line    \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other 25% Reduction    Septic Tank: 1,000 gallons    Pump Tank: \_\_\_\_\_ gallons  
Subsurface    No. of    exact length    width of    depth of  
Drainage Field    ditches 3    of each ditch 80 feet    ditches 3 feet    ditches 22 inches  
French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent: James E. Marshall III PHS      Date: 9-12-23