- NOTES

 1. EXISTING PLANS DRAWN FROM AVAILABLE DATA.
 2. FIELD VERIFY ALL DIMENSIONS. SEE BELOW FOR WALL ASSEMBLIES.
 ALL PROPOSED DOORS & WINDOWS ARE
- MOUNTED AT 6'-8" A.F.F. U.O.N.
 PROPOSED WALL HIEGHT IS 9'-0" A.F.F.


DRAWN @ 5" NOMINAL. W/ VARIABLE INTERIOR FINISH, SHEATHING, EXT. SIDING. W/ VARIABLE FINISH EITHER SIDE. DRAV/N @ 5" NOMINAL EXISTING EXTERIOR: 2X4 (ACTUAL) STUD FRAMING WALL CONSTRUCTION
EXISTING INTERIOR: 2X4 (ACTUAL) STUD FRAMING

- 1. ALL NEW WINDOWS TO HAVE A MAX. FENESTRATION UFACTOR OF 0.35 & MAX. GLAZED FENESTRATION FACTOR OF 0.30. ALL BEDROOM WINDOWS SHALL MEET 2018 NC RES
- CODE 310 FOR EGRESS.

 3. WINDOW FALL PROTECTION SHALL BE IN ACCORDANCE WITH 2018 NORC R312.2, INCLUDING R312.2 2 FOR WINDOW OPENING CONTROL DEVICES.

WINDOW SCHEDULE:

70"x60" SLINDING WINDOWS

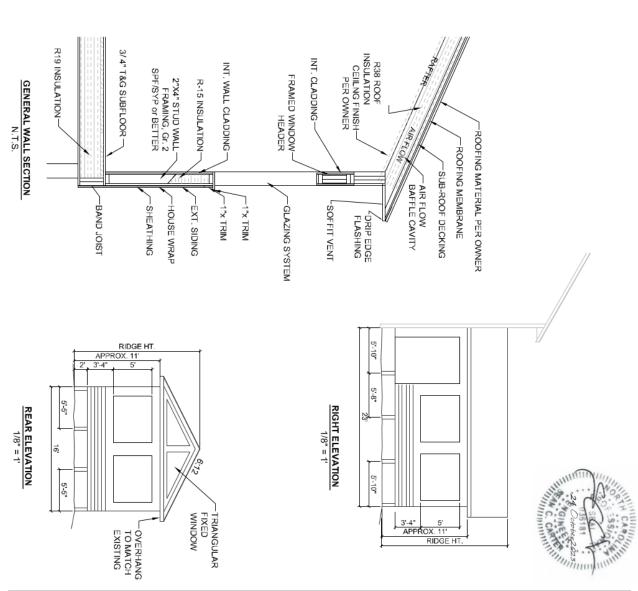

CONTRACTOR

RODAS CONSTRUCTION, LLC

1100 Logger Ct. Ste. E-100 Raleigh, NC 27609

919.926.1488

CARTER ENGINEERING & CONSULTING


STRUCTURAL + CIVIL

www.CarterEandC.com 919.349.9648

RESIDENTIAL ADDITION ELEVATION SIDE & REAR SHEET: 1 of 3 CEC Prj. No. 231001FC DATE: October 2023

SUNROOM ADDITION

485 Tylerstone Drive, Fuquay-Varina, NC 27526

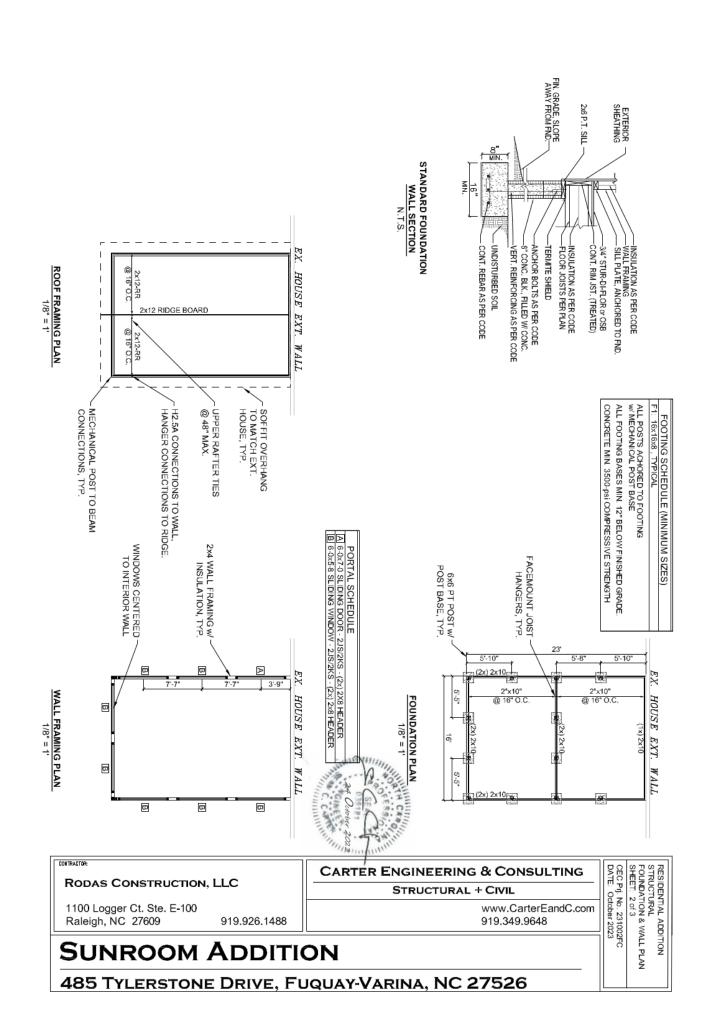

- OWNER'S EXPENCE AND RESPONSIBILITY. IN CASE OF DISCREPANCIES, CHANGES MADE DURING CONSTRUCTION. ANY CHANGES TO THESE THE PREPARATION OF THESE DOCUMENTS TO AVOID MISTAKES, THE MAKER CAN NOT GUARANTEE AGAINST HUMAN ERROR. THE OWNER SHALL OWNER SHALL THAT THE CONTRACTOR HAS VERIFIED ALL CONDITIONS THE PURPOSE OF THESE DRAWINGS IS TO SHOW THE INTENT OF THE DESIGN AND CONSTRUCTION PER THE OWNERS SPECIFICATIONS. THE THE ENGINEERS SHALL BE IMMEDIATELY CONTACTED.

 THE DESIGN SHOWN ON THIS PLAN BY CEC HAS BEEN PREPARED TO DOCUMENTS AFTER THE DATE ON THESE DRAWINGS WILL BE DONE AT THE ASSUME ALL RESPONSIBILITY TO THE ACCURACY OF THE PLANS AND ANY CONSTRUCTION HAS BEGUN. WHILE EVERY EFFORT HAS BEEN MADE IN CONSULTING, PLLC (CEC) IS NOT LIABLE FOR ERRORS ONCE SOLELY RESPONSIBLE THEREAFTER. CARTER ENGINEERING AND DIMENSIONS, AND OTHER DETAILS PRIOR TO CONSTRUCTION AND BE
- METHODS FOR ALL CONSTRUCTION. BEYOND THE DESIGN PROVIDED, CEC DOES NOT ASSUME ANY RESPONSIBILTY FOR THE CONSTRUCTION OR FIELD SUPERVISION OF THE PROJECT, FOR ANY INSPECTIONS REQUIRED AND INSPECTION. OR FOR COORDINATION AND COSTS ASSOCIATED WITH CONSTRUCTION DURING CONSTRUCTION, FOR SECURING ANY APPROVALS AND PERMITS, STATE, AND LOCAL REGULATIONS, INCLUDING PROVISIONS AND APPROVED ALL WORK SHALL BE PERFORMED IN ACCORDANCE TO ALL FEDERAL, COMPLY WITH THE 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE.
- STANDARD CONSTRUCTION NORTH CAROLINA RESIDENTIAL CODE, INTERNATIONAL BUILDING CODE REGULATIONS. CONTRACTOR SHALL REFERENCE THESE CODES FOR WITH NORTH CAROLINA AMENDMENTS, AND LOCAL CODES AND ALL WORK SHALL BE CONSTRUCTED IN CONFORMANCE WITH THE 2018
- SIMILAR CONDITIONS SECTIONS AND DETAILS SHOWN SHALL BE CONSIDERED TYPICAL FOR ALL
- THE CONTRACTOR SHALL VERIFY ALL CONDITIONS IN THE FIELD AND TAKE THE CONTRACTOR SHALL VERIFY ALL REINFORCING STEEL, ANCHOR BOLT ALL NECESSARY FIELD MEASUREMENTS.
- BOLTS SIZES, PATTERNS AND LOCATIONS BEFORE SETTING ANY STEEL AND ONLY IN ITS COMPLETED FORM. THE CONTRACTOR SHALL PROVIDE ALL THE STRUCTURE SHOWN ON THESE DRAWINGS IS STRUCTURALLY SOUND
- NECESSARY PROVISIONS FOR COMPLIANT CONSTRUCTION.

 NOTES AND DETAILS MAY NOT BE ON THE SAME SHEET AS THE PLAN. THOROUGHLY REVIEW AND READ THE FULL PLAN [INCLUDING NOTES]

STRUCTURAL CODES AND MANUALS

INTERNATIONAL BUILDING CODE, 2018 EDITION

MISC. STRUCTURAL NOTES NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION, 2015 EDITION

ACI BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE, ACI 318
ACI BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE, ACI 530 NORTH CAROLINA BUILDING CODE, 2018 EDITION + APPENDIX M

DESIGN LOADS (R301.4) LISTED AS LIVE LOAD, DEAD LOAD, DEFLECTION LIMIT WIND SPEED (3-SE GUST) / EXPOSURE: SEISMIC SITE CLASS / DESIGN CAT: GUARDRAILS / HANDRAILS: ROOF (SNOW LOAD): FLOORS 200-lbs LOCAL @ 120mph / C 20psf / 20psf / L/240 15psf / 20psf / L/240 40psf / 12psf / ⊔/360

ROOF

. THE POSITIVE/NEGATIVE DESIGN PRESSURES REQUIRED FOR ANY ROOF OR WALL CLADDING APPLICATION NOT SPECIFICALLY ADDRESSED IN THE MOST RECENT NORC SHALL BE AS FOLLOWS:

OCCUPANCY CATEGORY

А З

ROOF 45.4psf - 2.25:12 PITCH OR LESS 34.8psf - 2.25:12 TO 7:12 PITCH

WALLS

24.1psf

ROOF/FLOOR FRAMING:

FLOOR SHEATHING SHALL HAVE TONGUE AND GROOVE JOINTS OR BE SUPPORTED BY SOLID BLOCKING. ALLOW 1/8" SPACING AT ALL PANEL SHALL BE LAID FACE GRAIN PERPENDICULAR TO FRAMING MEMBERS EDGES AND ENDS OF ROOF/FLOOR SHEATHING. ROOF/FLOOR SHEATHING CENTERED BETWEEN FRAMING AT UNBLOCKED PLYWOOD EDGES. ALL OPENINGS. UNO, MULTI-JOISTS/RAFTERS SHALL BE STITCH-NAILED BEARING POINTS. PROVIDE DOUBLE JOISTS AROUND ALL ROOF/FLOOR UNLESS OTHERWISE NOTED, PROVIDE DOUBLE JOISTS/RAFTERS UNDER ALL PARALLEL BEARING PARTITIONS AND SOLID BLOCKING AT ALL TOGETHER WITH (2)10d @ 12"OC. PROVIDE ROOF SHEATHING EDGE CLIPS

ROOF FRAMING NOTES:

- CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE CODES.
- ALL LUMBER TO BE SYP #2 OR BETTER.
- CONTRACTOR TO VERIFY ALL ROOF PITCHES WITH EXTERIOR ELEVATIONS CONTRACTOR SHALL WATERPROOF, MOISTURE SEAL, FLASH, ETC., PER CODE
- PRIOR TO CONSTRUCTION THE STRUCTURAL PLAN IS NOT RESPONSIBLE FOR ROOFING MATERIAL.

SITE AND BEARING SURFACE (FOUNDATION SOILS):

CONTACT A GEOTECHNICAL ENGINEER FOR SOIL EVALUATIONS.
ASSUMED SOIL BEARING CAPACITY AS 2000-psf. THE CONTRACTOR MUST CONTACT A GEOTECHNICAL ENGINEER AND THE STRUCTURAL ENGINEER GRADED TO DRAIN SURFACE WATER AWAY FROM THE FOUNDATION. IF ANY UNSATISFACTORY SUBSURFACE CONDITIONS ARE ENCOUNTERED. PLACE ALL STRUCTURAL FILL IN APPROXIMATELY HORIZONTAL LAYERS SOILS AND FOUNDATION SHALL CONFORM TO IBC CHAPTER 18 SOILS AND FOUNDATIONS AND THE NORTH CAROLINA BUILDING CODE. PROVIDED WITH APPROPRIATE DRAINAGE MEASURES, AND SHALL BE THE SURFACE AREA ADJACENT TO THE FOUNDATION WALL SHALL BE CONTENT AND COMPACT TO 95 % DENSITY NOT GREATER THAN 12" IN THICKNESS, MOISTEN TO OPTIMUM MOISTURE

WOOD DECKS AND PORCHES

NORTH CAROLINA BUILDING CODE, APPENDIX M, WOOD DECKS, AND ALL ADDITIONAL AMENDMENTS, AND MEET OR EXCEED THE MINIMUM WOOD DECK AND PORCH CONSTRUCTION SHALL COMPLY WITH THE _OADING, BRACING, LEDGER ATTACHMENTS, AND FLASHING. REQUIREMENTS INCLUDING BUT NOT LIMITED TO JOIST LOADING, RAIL



RODAS CONSTRUCTION, LLC

1100 Logger Ct. Ste. E-100 Raleigh, NC 27609

CONTRACTOR

CARTER ENGINEERING & CONSULTING

STRUCTURAL + CIVIL

www.CarterEandC.com 919.349.9648

SUNROOM ADDITION

485 Tylerstone Drive, Fuquay-Varina, NC 27526

919.926.1488

STRUCTURAL NOTES & DETAILS SHEET: 3 of 3 RESIDENTIAL ADDITION

DATE CEC Prj. No. 231001FC DATE: October 2023