

Joe E Godwin Sr. , P.E., P.L.S.

Jason E Godwin , P.L.S.



1403 NC Highway 50 South
Benson, North Carolina 27504
919.894.7765

Email: general@enochengineers.com

www.enochengineers.com

MATERIALS & TEST DIVISION

FIELD REPORT

PROJECT

CLIENT:	GAMMON CONST	DATE:	3.12.25
PROJECT:	RESI FOOTINGS	CONTRACTOR:	D. GAMMON
ADDRESS:	211 ROLLING ACRES LN	TECHNICIAN:	BLH
LOT #:	COATS NC		

TEST SUMMARY

PERFORMED SOIL BEARING CAPACITY EVALUATION OF SITE NOTED ABOVE.
RECOMMEND 8" UNDERCUT, ADD 8" OF WASHED #57 STONE THROUGHOUT
MARKED UNDERCUT AREAS AT REAR FOOTING.
SOILS CONFIRMED A MINIMUM 2000PSF ONCE STONE IS PLACED.

TESTING RESULTS

SERVICE PERFORMED	TEST NO.	COMP %	WD PCF	DD PCF	MOISTURE %
----------------------	----------	--------	--------	--------	------------

RETURN VISIT REQUIRED

YES


☐

NO

☒

TECHNICIAN:

A handwritten signature in black ink, appearing to read "Joe E. Godwin Sr.", is written over a blue horizontal line.

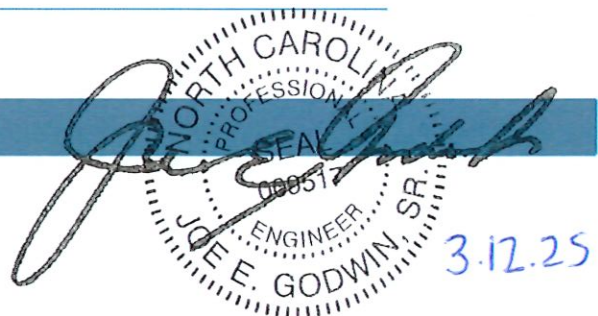

Disclaimer:

Soils & Material inspections, testing results and on-site determinations contained in this report become void after 30 days of non-use of this report and/or following any inclement weather which causes structural soil or material deterioration. Additional testing will be required following a voided report determined by a North Carolina Building Code enforcement official or Enoch Engineers P.A. The client/contractor is responsible for notifying Enoch Engineers P.A. of any soil & material condition changes which could void this report.

Joe E Godwin Sr. , P.E., P.L.S.

Jason E Godwin , P.L.S.

ENOCH
ENGINEERS, P.A.
1403 NC Highway 50 South
Benson, North Carolina 27504
919.894.7765

Email: general@enochengineers.com

www.enochengineers.com

MATERIALS & TEST DIVISION

FIELD REPORT

PROJECT

CLIENT: GAMMON CONST

DATE: 2.6.25

PROJECT: RESI FOOTINGS

CONTRACTOR: D. GAMMON

ADDRESS: 1008 PEEDIN RD

TECHNICIAN: BLH

LOT #: SELMA

TEST SUMMARY

PERFORMED SOIL BEARING CAPACITY EVALUATION OF SITE NOTED ABOVE.
RECOMMEND 24"X24" FOOTING. ADD 8" OF WASHED #57 STONE THROUGHOUT
ENTIRE FOOTING.

INSTALL (2)- #4 REBAR CONNECTED 2'OC.

SOIL CONFIRMED A MINIMUM ALLOWABLE BEARING CAPACITY OF 2000PSF AT 24" DEPTH

TESTING RESULTS

SERVICE PERFORMED	TEST NO.	COMP %	WD PCF	DD PCF	MOISTURE %

RETURN VISIT REQUIRED

YES ☐
NO ☒

TECHNICIAN:

BLH

Disclaimer:

Soils & Material inspections, testing results and on-site determinations contained in this report become void after 30 days of non-use of this report and/or following any inclement weather which causes structural soil or material deterioration. Additional testing will be required following a voided report determined by a North Carolina Building Code enforcement official or Enoch Engineers P.A. The client/contractor is responsible for notifying Enoch Engineers P.A. of any soil & material condition changes which could void this report.

