

ABBREVIATIONS

- ACC. = ACCESS
- BRCL. = BRACED WALL LINE
- BRP. = BRACED WALL PANEL
- C.O. = CASSET OPENING
- C.L. = CEILING JOIST
- CLOS. = CLOSET
- COL. = COLUMN
- COMP. = COMPOSITION
- CONC. = CONCRETE
- CONT. = CONTINUOUS
- C.M.A. = CARBON MONOXIDE ALARM
- C.M.U. = CONCRETE MASONRY UNIT
- D.H. = DOUBLE HUNG
- DI. = DIAMETER
- D.J. = DOUBLE JOIST
- DN. = DOWN
- DN-H. = DN-HAUST
- EXT. = EXTERIOR
- F.L.J. = FLOOR JOIST
- FTG. = FOOTING
- G.F.I. = GROUND FAULT INTERRUPTER
- H.B. = HOSE BIB
- L.V.L. = LAMINATED VENEER LUMBER
- M.O. = MASONRY OPENING
- MAS. = MASONRY
- MAX. = MAXIMUM
- M.C. = MEDICINE CABINET
- MTL. = METAL
- MIN. = MINIMUM
- O.C. = ON CENTER
- OSB. = ORIENTED STRAND BOARD
- PERF. = PERFORATED
- REC. = RECESSED
- REINF. = REINFORCED
- SCR. = SCREENED
- S.D. = SMOKE DETECTOR
- SEC. = SECOND
- SHWR. = SHOWER
- S.Y.P. = SOUTHERN YELLOW PINE
- S.P.F. = SPRUCE/PINE/FIR
- SUSP. = SUSPENDED
- TYP. = TYPICAL
- U.O.N. = UNLESS OTHERWISE NOTED
- WASH. = WASHER
- W.H. = WATER HEATER
- W.P. = WEATHER PROOF
- W.W.M. = WELDED WIRE MESH
- WOW. HT. = WINDOW HEIGHT
- WD. = WOOD

SYMBOLS

- o- = HOSE BIB
- = SWITCH
- 3 = 3-WAY SWITCH
- ◇ = LIGHT FIXTURE
- ⊞ = EXHAUST FAN & LIGHT
- ⊞ = SMOKE DETECTOR
- △ = SHOWER HEAD
- ◀ = TELEPHONE JACK
- ⊕ = CONVENIENCE OUTLET
- = 220 VOLT OUTLET
- ⊕ = GROUND FAULT INTERRUPTER
- ⊗ = CEILING FAN
- ⊗ = CARBON MONOXIDE ALARM

GENERAL NOTES AND SPECIFICATIONS

COPYRIGHT

THIS PLAN IS PROTECTED UNDER THE FEDERAL COPYRIGHT ACT. REPRODUCTION IN WHOLE OR IN PART, INCLUDING DIRECT COPYING AND/OR PREPARATION OF DERIVATIVE WORKS, FOR ANY REASON WITHOUT THE PRIOR WRITTEN CONSENT FROM STANDARD HOMES PLAN SERVICE, INC. IS STRICTLY PROHIBITED.

ORIGINAL PURCHASE AGREEMENT

SEE ATTACHED CONSTRUCTION LICENSE FOR INVOICE NUMBER 12982.

BUILDING CODE INFORMATION

THIS PLAN HAS BEEN DRAWN TO CONFORM TO THE NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION (2018 INTERNATIONAL RESIDENTIAL CODE FOR ONE- AND TWO-FAMILY DWELLINGS, CURRENT EDITION) WITH AMENDMENTS UNLESS OTHERWISE NOTED. (SEE ATTACHMENTS)

PRIOR TO CONSTRUCTION

THE CONTRACTOR SHALL REVIEW THE PLANS FOR THIS PARTICULAR BUILDING PROJECT TO ENSURE COMPLIANCE WITH ALL NATIONAL, STATE AND LOCAL CODES, CLIMATIC GEOGRAPHIC DESIGN CRITERIA, AND ANY OTHER PROVISIONS THAT MAY BE REQUIRED BY VA/PA/MD.

THE CONTRACTOR SHALL VERIFY PLAN DIMENSIONS, STRUCTURAL COMPONENTS, AND GENERAL SPECIFICATIONS CONTAINED IN THIS SET OF PLANS AND REPORT ANY DISCREPANCIES TO STANDARD HOMES PLAN SERVICE, INC. FOR JUSTIFICATION OR CORRECTION BEFORE PROCEEDING WITH WORK ON SITE.

THE CONTRACTOR SHALL DETERMINE ROUGH OPENING SIZES FOR ALL BUILT-IN EQUIPMENT AND/OR FACILITIES AND ADJUST PLAN DIMENSIONS AS REQUIRED.

DO NOT SCALE FROM BLUEPRINTS. REFER TO THE LABELED DIMENSIONS FOR ACTUAL MEASUREMENTS.

IT SHALL BE THE RESPONSIBILITY OF THE OWNER/BUILDER TO PROVIDE FOR THE SERVICES OF A PROFESSIONAL ENGINEER IF REQUIRED BY THE BUILDING CODE OFFICIAL.

SHIPPING DATE : 05/25/2022

STAMP MUST APPEAR IN RED. PLANS FOR WHICH A BUILDING PERMIT HAS NOT BEEN OBTAINED ONE YEAR FROM THE ABOVE DATE IS SUBJECT TO REVIEW BY STANDARD HOMES PLAN SERVICE, INC. A FEE MAY BE CHARGED FOR THIS SERVICE.



EXCAVATION

EXCAVATE TO UNDISTURBED SOIL. BOTTOM OF FOOTING SHALL EXTEND BELOW LOCAL FROST LINE AND TO A MINIMUM DEPTH OF 12" BELOW ADJACENT GRADE. (PRESUMED 2000 PSF SOIL BEARING CAPACITY).

EXPANSIVE, COMPRESSIVE OR SHIFTING SOILS SHALL BE REMOVED TO A DEPTH AND WIDTH SUFFICIENT TO ASSUME A STABLE MOISTURE CONTENT IN EACH ACTIVE ZONE.

FOUNDATION

PROVIDE 1/2" DIA. STEEL ANCHOR BOLTS 6"-0" O.C., 1'-0" MAX. FROM CORNERS AND 1'-0" MAX. FROM ENDS OF EACH PLATE SECTION, WITH 7" MIN. EMBEDMENT.

PROVIDE FOUNDATION WATERPROOFING AND DRAIN WITH POSITIVE SLOPE TO OUTLET AS REQUIRED BY SITE CONDITIONS.

SLOPE GRADE AWAY FROM FOUNDATION WALLS 6" MINIMUM WITHIN THE FIRST 10 FEET.

PROVIDE PRESSURE TREATED LUMBER FOR SILLS, PLATES, BANDS AND ANY LUMBER IN CONTACT WITH MASONRY.

PROVIDE APPROVED AND BONDED CHEMICAL SOIL TREATMENT AGAINST FUNGUS, TERMITES AND OTHER HARMFUL INSECTS.

CRAWL SPACE

ALL GIRDER JOINTS AND ENDS OF GIRDERS SHALL REST ON SOLID BEARINGS. FILL CORES OF HOLLOW MASONRY TO FOOTING WITH CONCRETE. FILL TOP COURSE CORES OF EXTERIOR FOUNDATION WALL WITH CONCRETE.

FOOTINGS SHALL EXTEND 6" AND SHALL BE 12" THICK UNDER GIRDER PIERS.

CHIMNEY FOOTING SHALL EXTEND 12" MINIMUM BEYOND EACH SIDE AND SHALL BE AT LEAST 12" THICK.

BASEMENT

ALL GIRDER JOINTS SHALL BREAK ON COLUMN CENTER LINES (STAGGERED) AND ENDS OF GIRDERS SHALL REST ON SOLID MASONRY.

DOUBLE SILL AND USE LEDGER OVER ALL BASEMENT OPENINGS.

ALL BASE SASH SHALL BE 18/20 2-LT. 3"-3 7/8" X 1'-11 13/16" 3420 HB.

FRAMING

ALL FLOOR JOISTS, CEILING JOISTS, RAFTERS, GIRDERS, HEADERS, SILLS AND BEAMS SHALL BE NO. 2 SPRUCE/PINE/FIR (S.P.F.) UNLESS OTHERWISE INDICATED.

ALL LOAD BEARING WALLS SHALL BE STUD GRADE SPRUCE/PINE/FIR (S.P.F.) UNLESS OTHERWISE INDICATED.

DESIGN SPECIFICATIONS FOR LAMINATED VENEER LUMBER (L.V.L.) BEAMS AND HEADERS :

- GRADE : 2900Fb-2.0E
- BENDING Fb : 2850
- MOE : 2.0 X 10⁶
- SHEAR Fv : 290

SUPPORT FOR HEADERS:
HEADERS SHALL BE SUPPORTED ON EACH END WITH ONE OR MORE JACK STUDS OR WITH APPROVED FRAMING ANCHORS IN ACCORDANCE WITH BUILDING CODE (SEE PLAN). THE FULL-HEIGHT STUD ADJACENT TO EACH END OF THE HEADER SHALL BE END NAILED TO EACH END OF THE HEADER WITH FOUR-180 NAILS. SEE TABLE BELOW.

MINIMUM NUMBER OF FULL HEIGHT STUDS AT EACH END OF HEADERS IN EXTERIOR WALLS:

HEADER SPAN (FEET)	MAXIMUM STUD SPACING (INCHES)	
	18	24
3 FEET OR LESS	1	1
4 FT.	2	1
8 FT.	3	2
12 FT.	8	3
16 FT.	8	4

CLIMATIC AND GEOGRAPHICAL DESIGN CRITERIA

ROOF LIVE LOAD (POUNDS PER SQUARE FOOT) : 20 PSF
 ULTIMATE DESIGN WIND SPEED (MILES PER HOUR) : 120 MPH
 NOMINAL DESIGN WIND SPEED : 93 MPH
 EXPOSURE CATEGORY "B" UNLESS OTHERWISE NOTED
 WINDOW DESIGN PRESSURE RATING : DP 25
 COMPONENT AND CLADDING LOADS FOR A BUILDING WITH A MEAN ROOF HEIGHT OF 30 FEET OR LESS:

PRESSURE ZONE	ULTIMATE DESIGN WIND SPEED (MPH)			
	115	120	130	140
ZONE 1	13.1, -14.0	14.2, -15.0	16.7, -18.0	19.4, -21.0
ZONE 2	13.1, -18.0	14.2, -18.0	16.7, -21.0	18.4, -24.0
ZONE 3	13.1, -18.0	14.2, -18.0	16.7, -21.0	19.4, -24.0
ZONE 4	14.3, -15.0	15.5, -18.0	18.2, -19.0	21.2, -22.0
ZONE 5	14.3, -18.0	15.5, -20.0	18.2, -24.0	21.2, -28.0

ASSUMED MEAN ROOF HEIGHT: 25'-4"

SEISMIC CONDITION BY ZONE : ZONES A AND B
 SUBJECT TO DAMAGE FROM WEATHERING : MODERATE
 CLIMATE ZONES (UNLESS OTHERWISE NOTED): ZONES 3 AND 4
 MINIMUM VALUES FOR ENERGY COMPLIANCE:
 CEILING R-38; EXTERIOR WALLS R-18; FLOORS R-19
 WINDOW U-FACTOR ≤ 0.35; RECOMMENDED SHGC ≤ 0.30

MISCELLANEOUS

LOCATE ALL CONVENIENCE OUTLETS ABOVE KITCHEN BASE CABINETS 42" ABOVE FINISHED FLOOR.

EMERGENCY EGRESS REQUIREMENTS

IT SHALL BE THE RESPONSIBILITY OF THE OWNER/BUILDER TO VERIFY CONFORMITY WITH EGRESS REQUIREMENTS BASED ON SPECIFICATIONS PROVIDED BY WINDOW MANUFACTURER.

2018 NORTH CAROLINA RESIDENTIAL CODE

THE REQUIRED EGRESS WINDOW FROM EVERY SLEEPING ROOM SHALL HAVE A SILL HEIGHT OF NOT MORE THAN 44 INCHES ABOVE FINISHED FLOOR. THE NET CLEAR OPENING SHALL NOT BE LESS THAN 4.0 SQUARE FEET WHERE THE NET CLEAR OPENING HEIGHT SHALL BE AT LEAST 22 INCHES AND THE NET CLEAR OPENING WIDTH SHALL BE AT LEAST 20 INCHES. IN ADDITION THE MINIMUM TOTAL GLASS AREA SHALL NOT BE LESS THAN 5.0 SQUARE FEET IN THE CASE OF A GROUND STORY WINDOW AND NOT LESS THAN 0.7 SQUARE FEET IN THE CASE OF A SECOND STORY WINDOW.

2015 INTERNATIONAL RESIDENTIAL CODE

THE REQUIRED EGRESS WINDOW FROM EVERY SLEEPING ROOM SHALL HAVE A SILL HEIGHT OF NOT MORE THAN 44 INCHES ABOVE FINISHED FLOOR. ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE FEET EXCEPT GRADE FLOOR OPENINGS SHALL HAVE A MINIMUM NET OPENING OF 5 SQUARE FEET. THE MINIMUM NET CLEAR OPENING HEIGHT SHALL BE 24 INCHES. THE MINIMUM NET CLEAR OPENING WIDTH SHALL BE 20 INCHES.

REVISED 05-13-22




Standard Homes Plan Service, Inc.

7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27526 (919)552-8677

SEE HOME DESIGN PROGRAMS ONLINE AT WWW.STANDARDHOMES.COM



DESIGNED FOR	PLAN	NO.	MT'L. SHOWN	SHEET
MATT TAYLOR	HORIZON	2	SID.	1 OF 9

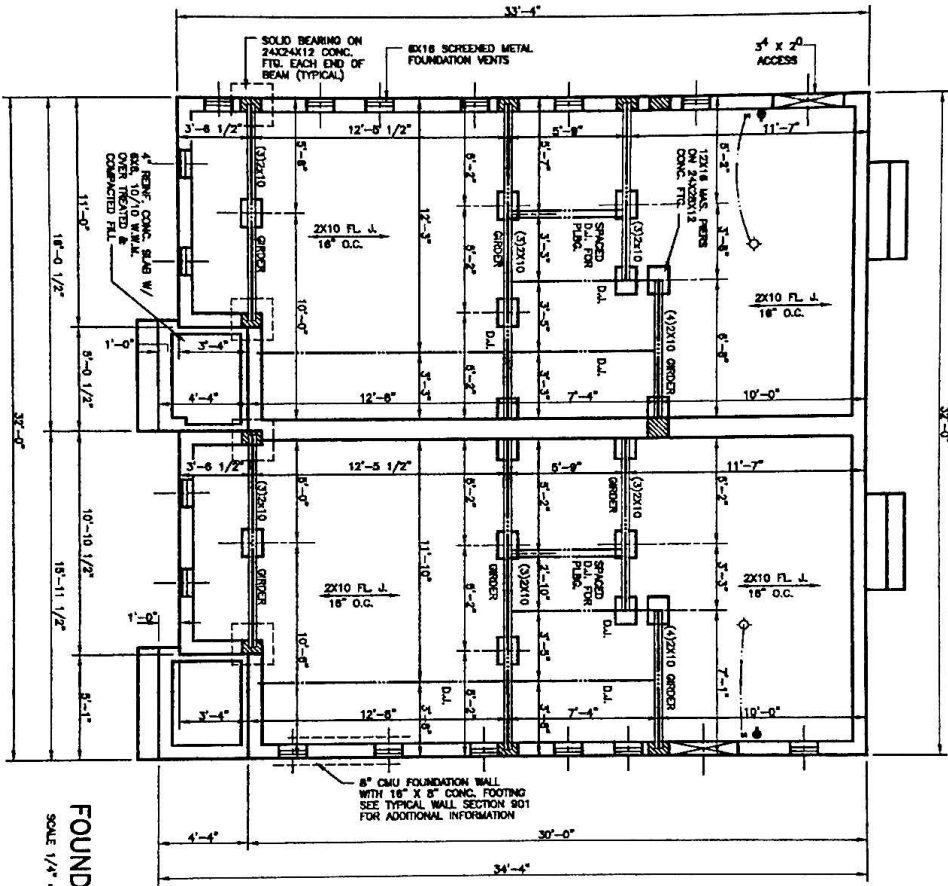

FOUNDATION VENTILATION REQUIREMENTS :
 100% SOL. FT. + 100% SLAG SOL. FT. NET
 PROVIDE 1/8 VENTS WITH A MINIMUM OF 64
 SQUARE INCHES NET FREE AREA FOR VENT.

FOUNDATION PLAN
 SCALE 1/4" = 1'-0"





Standard Homes Plan Service, Inc.
 7200 SUNSET LAKE ROAD FLOUJAY-VARIANA, NC 27526
 (919)552-6677




DESIGNED FOR	PLAN	NO.	DATE
WALT TAYLOR	HORIZON	2	SID.
			2 OF 9

REVISIONS 06-23-22
 © 1998 STANDARD HOMES PLAN SERVICE, INC.

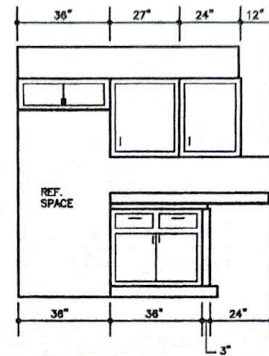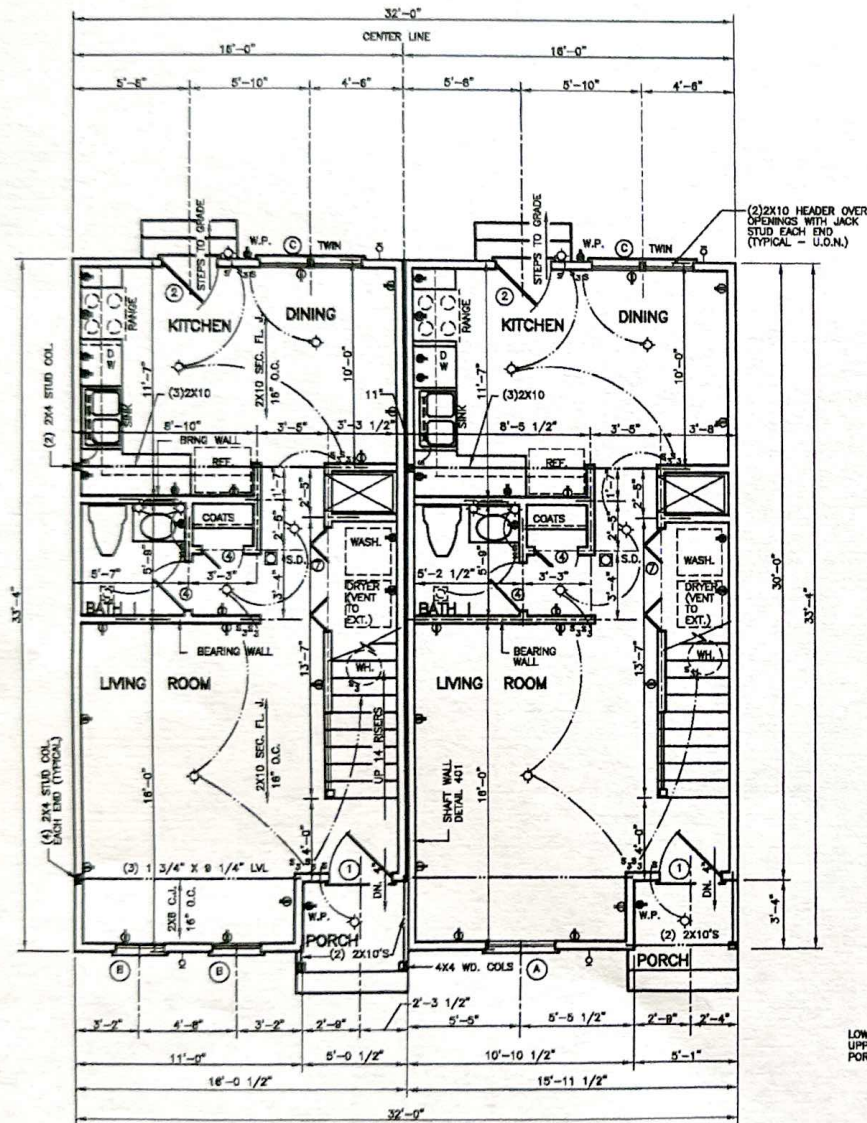


REF. SIDE

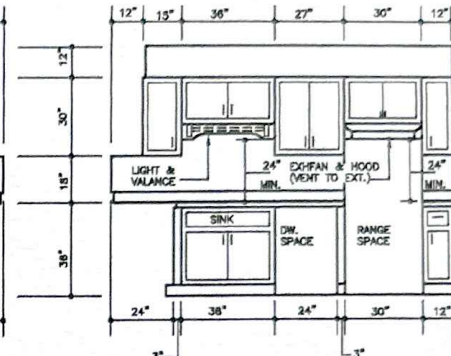

SINK SIDE

KITCHEN CABINET ELEVATIONS
SCALE 3/8" = 1'-0"
FOR SECTION THRU CABINETS, SEE DETAIL ON COVER SHEET.

VANITY DETAILS
SCALE 3/8" = 1'-0"



ELEV.

SECT.

LOWER LEVEL HEATED AREA: 617 SQ. FT. PER UNIT
UPPER LEVEL HEATED AREA: 480 SQ. FT. PER UNIT
PORCH: 22 SQ. FT. PER UNIT

FIRST FLOOR PLAN
SCALE 1/4" = 1'-0"

REVISED 05-23-22

WINDOW SCHEDULE

A	3'-0" X 6'-2" WD.D.H.	D	3'0" X 5'3" DH	G		L
B	2'-4" X 5'-2" WD.D.H.	E		H		M
C	2'4" X 5'2" DH	F		K		N

DOOR SCHEDULE

1	3'-0" X 6'-8" X 1 3/4"	4	2'-4" X 6'-8" X 1 3/8"	7	6'-0" X 6'-8" X 1 3/8"
2	2'-8" X 6'-8" X 1 3/4"	5	2'-0" X 6'-8" X 1 3/8"	8	4'-0" X 6'-8" X 1 3/8"
3	2'-6" X 6'-8" X 1 3/8"	6	1'-6" X 6'-8" X 1 3/8"	9	2'-0" X 6'-8" X 1 3/8"

Standard Homes Plan Service, Inc.
7200 SUNSET LAKE ROAD FLOUQUAY-VARINA, N.C. 27526 (919)552-5677

DESIGNED FOR	MATT TAYLOR	SHEET	3 of 9
PLAN	HORIZON	NO.	2
		NATURAL SID	


**DENSGLOSS SHAFTLINER AREA SEPARATION WALL
BY GEORGIA-PACIFIC GYPSUM**

FIRE TEST : U.A. DESIGN U373 ON U372


2 HOUR RS TO 69 STC
FIRE SOUND

TWO LAYERS 1" DENSGLOSS SHAFTLINER INSERTED IN N-STUDS 24" O.C. MINIMUM 3/4" AIRSPACE ON BOTH SIDES MUST BE MAINTAINED BETWEEN LINER PANELS AND ADJACENT FRAMING.

DO NOT DEVIATE FROM THIS IN THE FIELD

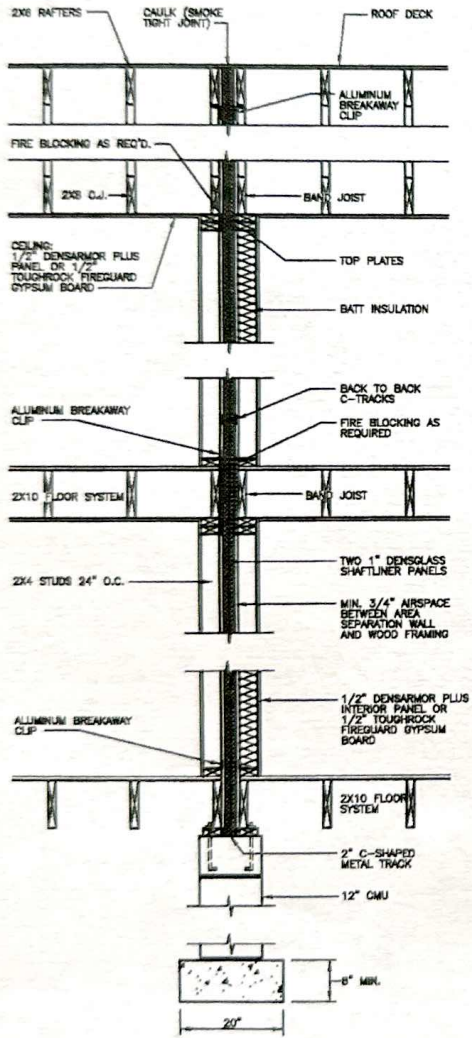

XXX TWO-STORY SHAFT WALL DETAIL
SCALE : 3/4" = 1'-0"

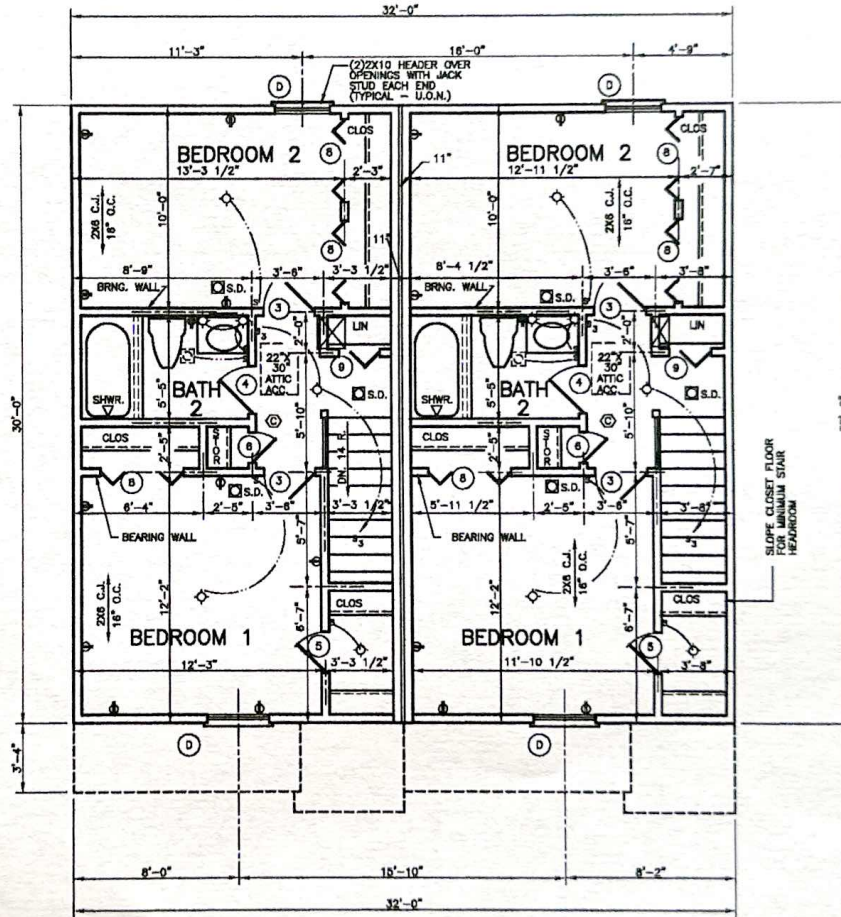

SECOND FLOOR PLAN
SCALE 1/4" = 1'-0"

REVISED 05-23-22




Standard Homes Plan Service, Inc.

7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27526 (919)552-5677

SEE HOME DESIGN PROVIDED ONLINE AT WWW.STANDARDHOMES.COM



DESIGNED FOR	PLAN	NO.	MAT'L	SHOWN	SHEET
	HORIZON	2	SID.		4 of 9

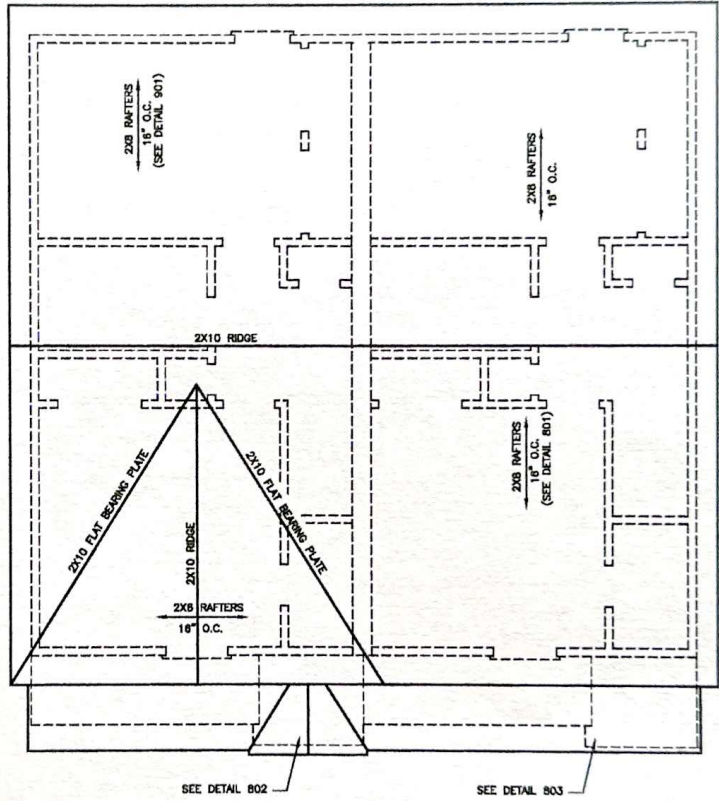

ROOF PLAN
SCALE 1/4" = 1'-0"

ATTIC VENTILATION REQUIREMENTS :
1077 SQ. FT. → 150 = 7.18 SQ. FT. NET
FREE AREA REQUIRED


REVISED 05-23-22



Standard Homes Plan Service, Inc.
7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27526 (919)552-5877
SEE HOME DESIGN PROGRAM ONLINE AT WWW.STANDARDHOMES.COM



DESIGNED FOR	PLAN	NO.	MATL.	SHOWN	SHEET
MATT TAYLOR	HORIZON	2	SID.		5 of 9

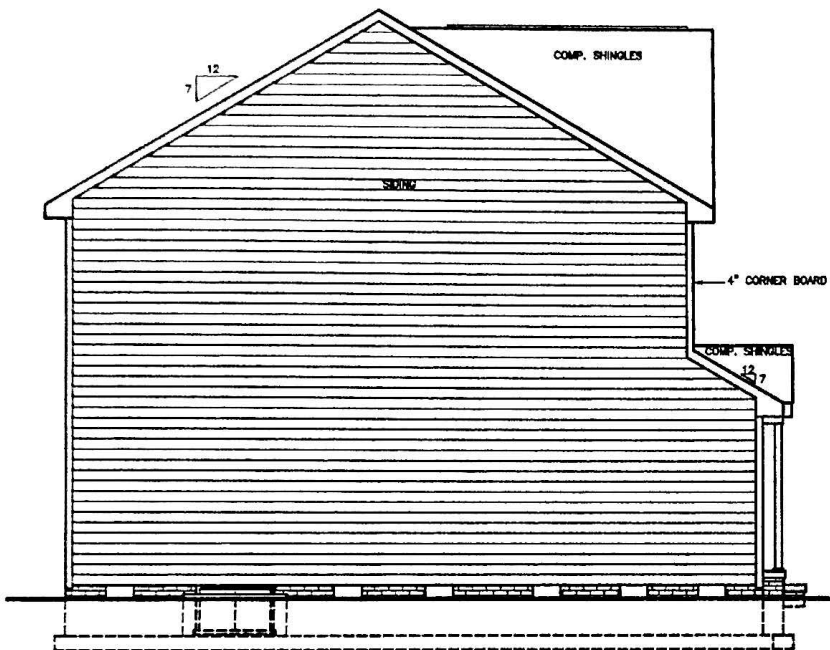


LEFT SIDE ELEVATION

PROVIDE GUTTERS, DOWNSPOUTS AND SPLASHPADS
ACCORDING TO LOCAL CODE AND RAINFALL CONDITIONS.
ALL SPLASHPADS SHALL CARRY WATER 80"
FROM BUILDING.



FRONT ELEVATION
SCALE 1/4" = 1'-0"

REVISED 05-23-82




Standard Homes Plan Service, Inc.

7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27626 (919)552-5677




DESIGNED FOR	PLAN	NO.	MAT'L.	SHOWN	SHEET
MATT TAYLOR	HORIZON	2	SID		8 of 9

©1981 STANDARD HOMES PLAN SERVICE, INC.

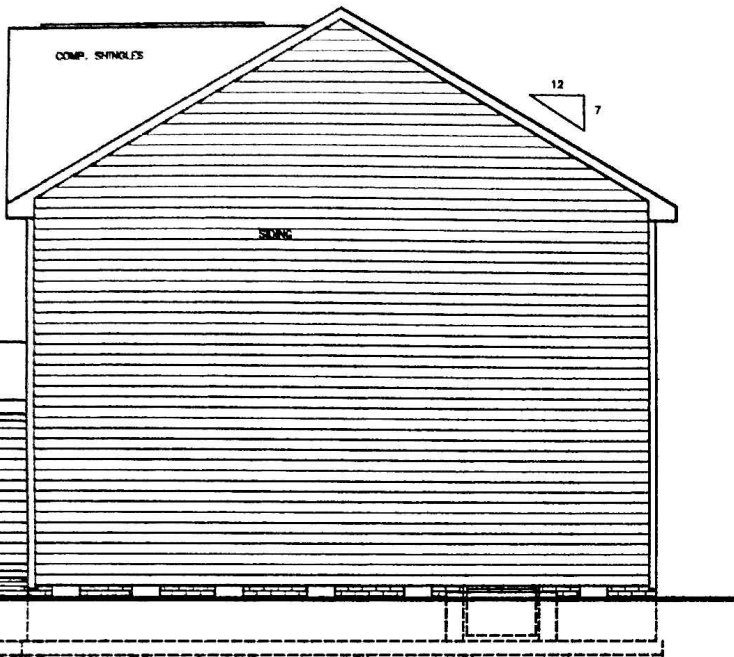

RIGHT SIDE ELEVATION

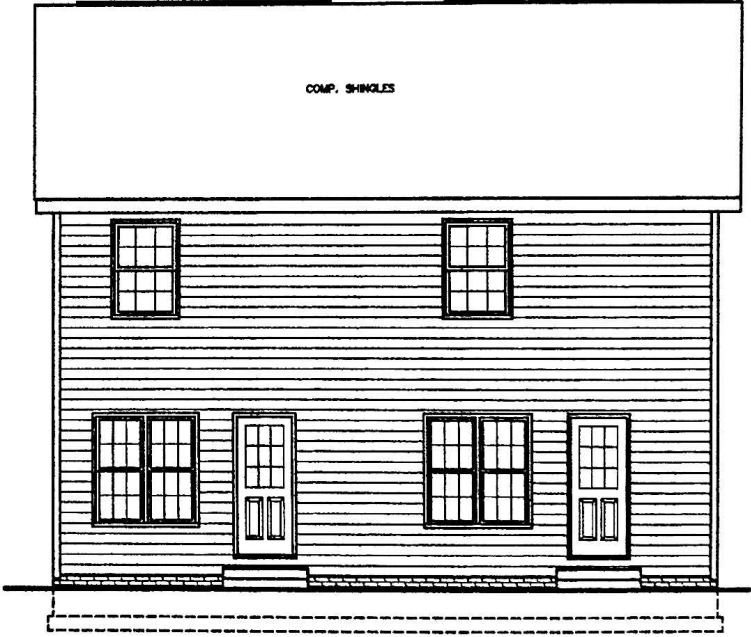

REAR ELEVATION
SCALE 1/4" = 1'-0"

REVISED 06-23-22




Standard Homes Plan Service, Inc.
7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27526 (919)552-5677




DESIGNED FOR	PLAN	NO.	MAT'L	SHOWN	SHEET
MATT TAYLOR	HORIZON	2	SID		7 OF 9


© 2018 STANDARD HOMES PLAN SERVICE, INC.

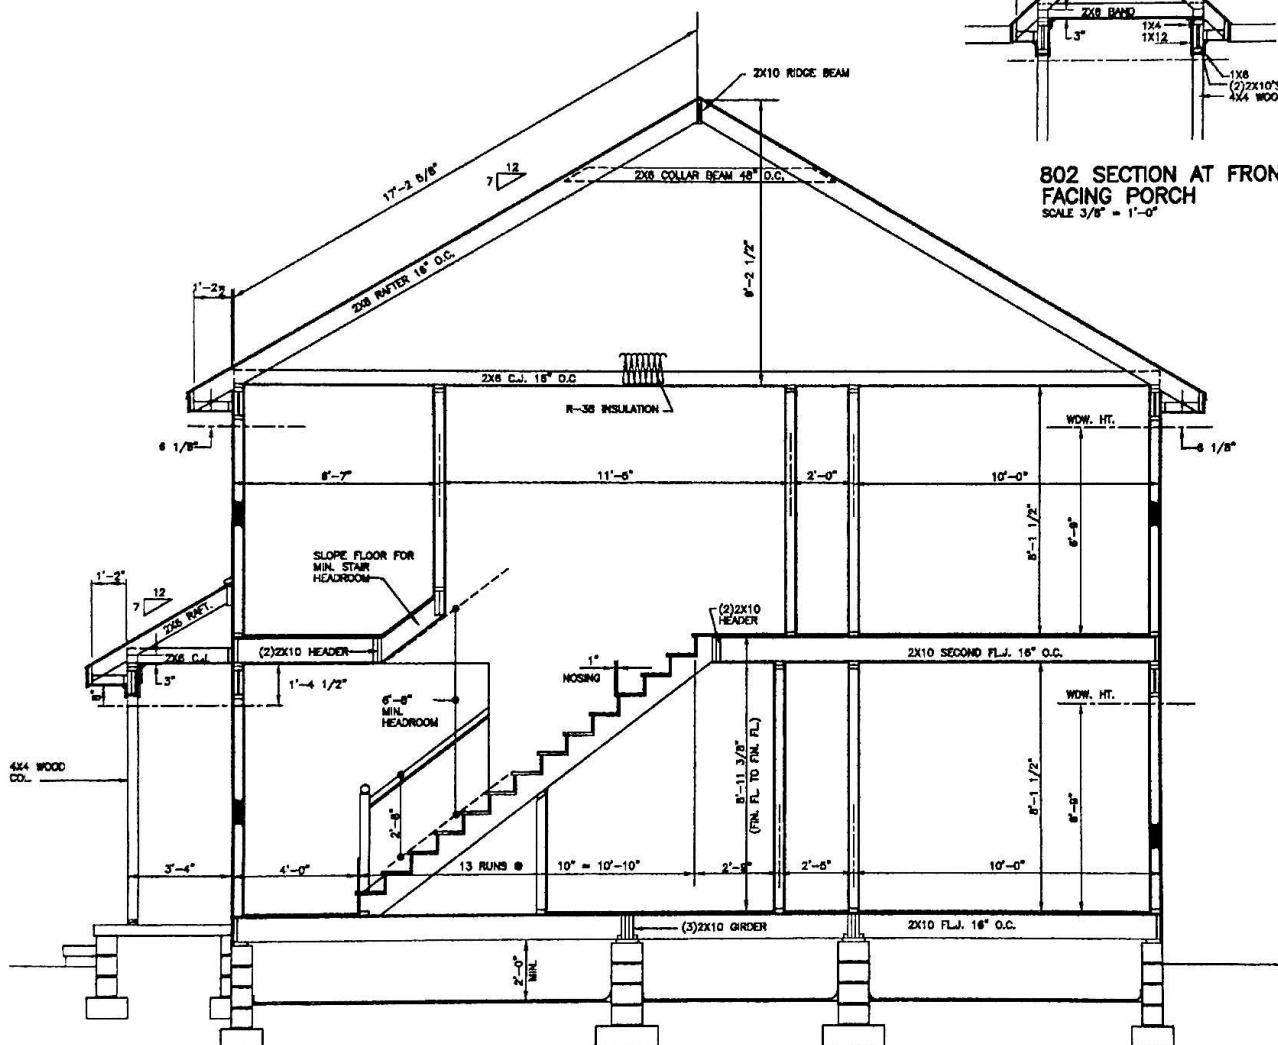

801 TRANSVERSE SECTION
SCALE 3/8" = 1'-0"

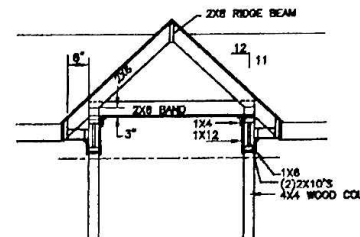


802 SECTION AT FRONT FACING PORCH
SCALE 3/8" = 1'-0"

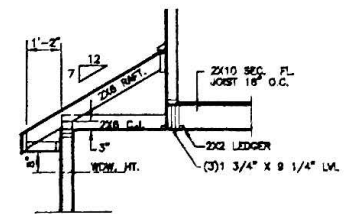

803 SECTION THRU FRONT SHED ROOF
SCALE 3/8" = 1'-0"



FOR MORE INFORMATION SEE SHEET 8 OF 9.



Standard Homes Plan Service, Inc.
7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27526 (919)552-5877



DESIGNED FOR	PLAN	NO.	MAT'L.	SHOWN	SHEET
MATT TAYLOR	HORIZON	2	SID		8 OF 9

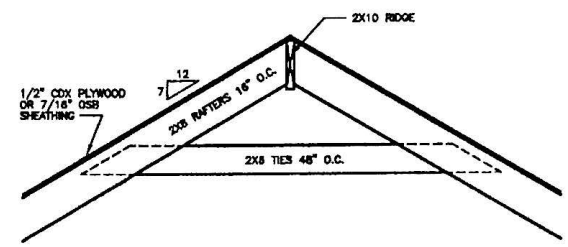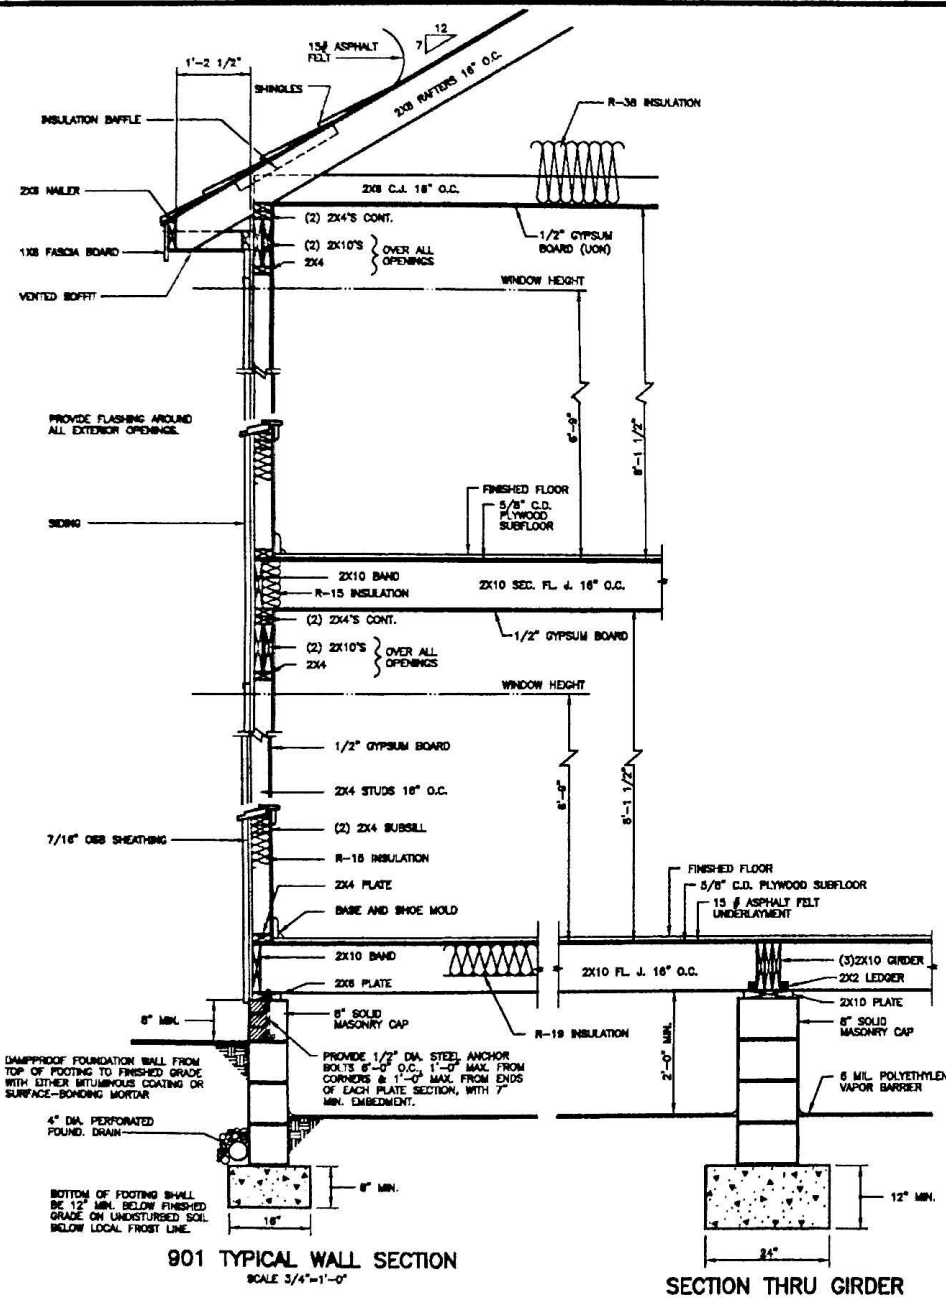

Standard Homes Plan Service, Inc.
 7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27626 (919)552-5677



DESIGNED FOR	PLAN	NO.	MAT'L.	SHOWING	SHEET
MATT TAYLOR	HORIZON	2	SID		9 of 9

REVISED 06-23-22


© 2011 STANDARD HOMES PLAN SERVICE, INC.

CONNECTION OF MULTIPLE PLY BEAMS



(INSTALLATION & CONNECTION OF BEAMS SHALL BE ACCORDING TO MANUFACTURERS SPECIFICATIONS)

MINIMUM UNIFORMLY DISTRIBUTED LIVE LOADS (PSF)	
USE	LIVE LOAD
UNINHABITABLE ATTICS WITHOUT STORAGE	10
UNINHABITABLE ATTICS WITH LIMITED STORAGE	20
HABITABLE ATTICS AND ATTICS SERVED WITH FIXED STAIRS	30
BALCONIES AND DECKS	40
ROOMS OTHER THAN SLEEPING ROOMS	40
SLEEPING ROOMS	30
STAIRS	40



ALLOWABLE DEFLECTION OF STRUCTURAL MEMBERS (NOTE: L = SPAN LENGTH)	
STRUCTURAL MEMBER	ALLOWABLE DEFLECTION
RAFTERS HAVING SLOPES GREATER THAN 3:12 WITH FINISHED CEILING NOT ATTACHED TO RAFTERS	L/180
FLOORS	L/360
CEILING WITH BRITTLE FINISHES (INCLUDING PLASTER AND STUCCO)	L/360
CEILING WITH FLEXIBLE FINISHES (INCLUDING GYPSUM BOARD)	L/240
ALL OTHER STRUCTURAL MEMBERS	L/240
LINTELS SUPPORTING MASONRY VENEER WALLS	L/500





SECTION
D001
TOP LOADED (4 PILES)

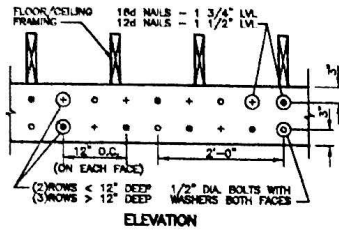


SECTION
D002
TOP LOADED (3 PILES MAXIMUM)

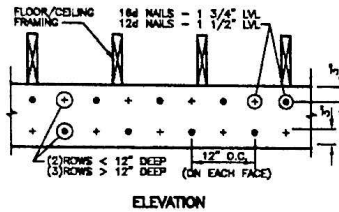


SECTION
D003
SIDE LOADED

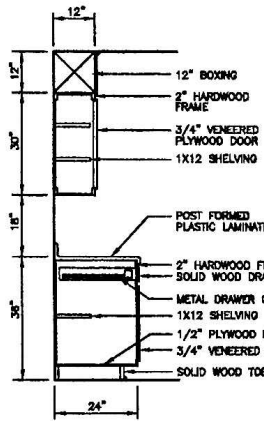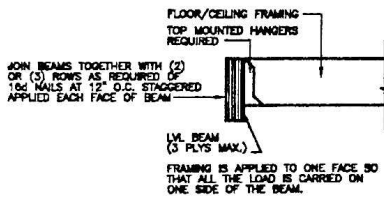


SECTION THRU
KITCHEN CABINETS

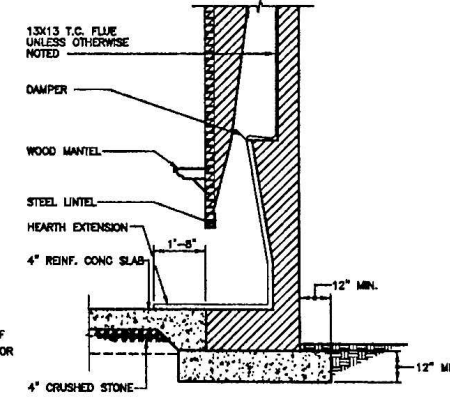


D005
SECT. THRU FIREPLACE ON CONCRETE SLAB

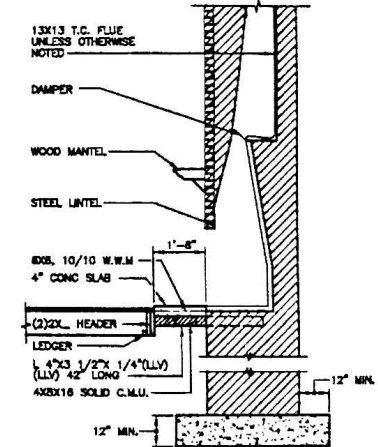


D006
SECT. THRU FIREPLACE ON WOOD FLOOR

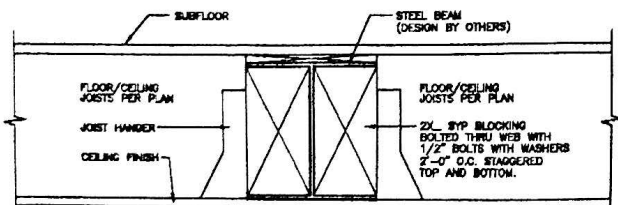


D004
SECTION THRU STEEL BEAM

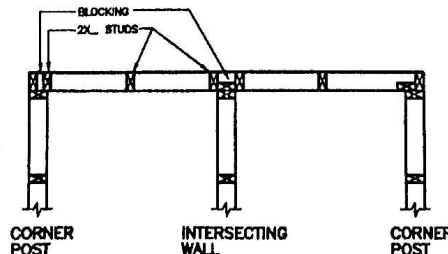


D007
DETAIL BASIC WALL FRAMING

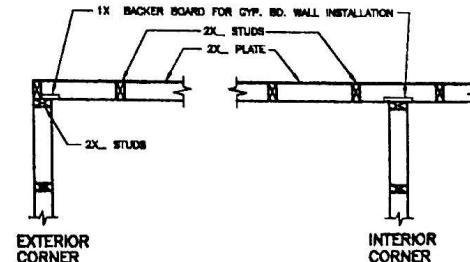

D008
DETAIL ADVANCED WALL FRAMING



PLAN VIEW
OF SUSPENDED HEARTH



Standard Homes Plan Service, Inc.

7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27528 (919)552-5877

SEE HOW OUR DESIGN PROCESS ONLINE AT WWW.STANDARDHOMES.COM



STANDARD CONSTRUCTION DETAILS

D

© 2014 STANDARD HOMES PLAN SERVICE, INC.