

**ABBREVIATIONS**

- ACC. = ACCESS
- BRL. = BRACED WALL LINE
- BWP. = BRACED WALL PANEL
- C.O. = CASSET OPENING
- C.L. = CEILING JOIST
- CLOS. = CLOSET
- COL. = COLUMN
- COMP. = COMPOSITION
- CONC. = CONCRETE
- CONT. = CONTINUOUS
- C.M.A. = CARBON MONOXIDE ALARM
- C.M.U. = CONCRETE MASONRY UNIT
- D.H. = DOUBLE HUNG
- DI. = DIAMETER
- D.J. = DOUBLE JOIST
- DN. = DOWN
- DN-H. = EXHAUST
- EXT. = EXTERIOR
- F.L.J. = FLOOR JOIST
- FTG. = FOOTING
- G.F.I. = GROUND FAULT INTERRUPTER
- H.B. = HOSE BIB
- L.V.L. = LAMINATED VENEER LUMBER
- M.O. = MASONRY OPENING
- MAS. = MASONRY
- MAX. = MAXIMUM
- M.C. = MEDICINE CABINET
- MTL. = METAL
- MIN. = MINIMUM
- O.C. = ON CENTER
- OSB. = ORIENTED STRAND BOARD
- PERF. = PERFORATED
- REC. = RECESSED
- REINF. = REINFORCED
- SCR. = SCREENED
- S.D. = SMOKE DETECTOR
- SEC. = SECOND
- SHWR. = SHOWER
- S.Y.P. = SOUTHERN YELLOW PINE
- S.P.F. = SPRUCE/PINE/FIR
- SUSP. = SUSPENDED
- TYP. = TYPICAL
- U.O.N. = UNLESS OTHERWISE NOTED
- WASH. = WASHER
- W.H. = WATER HEATER
- W.P. = WEATHER PROOF
- W.W.M. = WELDED WIRE MESH
- WIN. HT. = WINDOW HEIGHT
- WD. = WOOD

**SYMBOLS**

- = HOSE BIB
- = SWITCH
- 3 = 3-WAY SWITCH
- ◇ = LIGHT FIXTURE
- ⊞ = EXHAUST FAN & LIGHT
- ⊞ = SMOKE DETECTOR
- △ = SHOWER HEAD
- ◀ = TELEPHONE JACK
- ⊕ = CONVENIENCE OUTLET
- = 220 VOLT OUTLET
- ⊕ = GROUND FAULT INTERRUPTER
- ⊗ = CEILING FAN
- ⊗ = CARBON MONOXIDE ALARM

**GENERAL NOTES AND SPECIFICATIONS**

**COPYRIGHT**

THIS PLAN IS PROTECTED UNDER THE FEDERAL COPYRIGHT ACT. REPRODUCTION IN WHOLE OR IN PART, INCLUDING DIRECT COPYING AND/OR PREPARATION OF DERIVATIVE WORKS, FOR ANY REASON WITHOUT THE PRIOR WRITTEN CONSENT FROM STANDARD HOMES PLAN SERVICE, INC. IS STRICTLY PROHIBITED.

**ORIGINAL PURCHASE AGREEMENT**

SEE ATTACHED CONSTRUCTION LICENSE FOR INVOICE NUMBER 12982.

**BUILDING CODE INFORMATION**

THIS PLAN HAS BEEN DRAWN TO CONFORM TO THE NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION (2018 INTERNATIONAL RESIDENTIAL CODE FOR ONE- AND TWO-FAMILY DWELLINGS, CURRENT EDITION) WITH AMENDMENTS UNLESS OTHERWISE NOTED. (SEE ATTACHMENTS)

**PRIOR TO CONSTRUCTION**

THE CONTRACTOR SHALL REVIEW THE PLAN(S) FOR THIS PARTICULAR BUILDING PROJECT TO ENSURE COMPLIANCE WITH ALL NATIONAL, STATE AND LOCAL CODES, CLIMATIC GEOGRAPHIC DESIGN CRITERIA, AND ANY OTHER PROVISIONS THAT MAY BE REQUIRED BY VA/PA/MD.

THE CONTRACTOR SHALL VERIFY PLAN DIMENSIONS, STRUCTURAL COMPONENTS, AND GENERAL SPECIFICATIONS CONTAINED IN THIS SET OF PLANS AND REPORT ANY DISCREPANCIES TO STANDARD HOMES PLAN SERVICE, INC. FOR JUSTIFICATION OR CORRECTION BEFORE PROCEEDING WITH WORK ON HOUSE.

THE CONTRACTOR SHALL DETERMINE ROUGH OPENING SIZES FOR ALL BUILT-IN EQUIPMENT AND/OR FACILITIES AND ADJUST PLAN DIMENSIONS AS REQUIRED.

DO NOT SCALE FROM BLUEPRINTS. REFER TO THE LABELED DIMENSIONS FOR ACTUAL MEASUREMENTS.

IT SHALL BE THE RESPONSIBILITY OF THE OWNER/BUILDER TO PROVIDE FOR THE SERVICES OF A PROFESSIONAL ENGINEER IF REQUIRED BY THE BUILDING CODE OFFICIAL.

**SHIPPING DATE : 05/25/2022**

STAMP MUST APPEAR IN RED. PLANS FOR WHICH A BUILDING PERMIT HAS NOT BEEN OBTAINED ONE YEAR FROM THE ABOVE DATE IS SUBJECT TO REVIEW BY STANDARD HOMES PLAN SERVICE, INC. A FEE MAY BE CHARGED FOR THIS SERVICE.

**EXCAVATION**

EXCAVATE TO UNDISTURBED SOIL. BOTTOM OF FOOTING SHALL EXTEND BELOW LOCAL FROST LINE AND TO A MINIMUM DEPTH OF 12" BELOW ADJACENT GRADE. (PRESUMED 2000 PSF SOIL BEARING CAPACITY).

EXPANSIVE, COMPRESSIVE OR SHIFTING SOILS SHALL BE REMOVED TO A DEPTH AND WIDTH SUFFICIENT TO ASSUME A STABLE MOISTURE CONTENT IN EACH ACTIVE ZONE.

**FOUNDATION**

PROVIDE 1/2" DIA. STEEL ANCHOR BOLTS 6"-0" O.C., 1'-0" MAX. FROM CORNERS AND 1'-0" MAX. FROM ENDS OF EACH PLATE SECTION, WITH 7" MIN. EMBEDMENT.

PROVIDE FOUNDATION WATERPROOFING AND DRAIN WITH POSITIVE SLOPE TO OUTLET AS REQUIRED BY SITE CONDITIONS.

SLOPE GRADE AWAY FROM FOUNDATION WALLS 6" MINIMUM WITHIN THE FIRST 10 FEET.

PROVIDE PRESSURE TREATED LUMBER FOR SILLS, PLATES, BANDS AND ANY LUMBER IN CONTACT WITH MASONRY.

PROVIDE APPROVED AND BONDED CHEMICAL SOIL TREATMENT AGAINST FUNGUS, TERMITES AND OTHER HARMFUL INSECTS.

**CRAWL SPACE**

ALL GIRDER JOINTS AND ENDS OF GIRDERS SHALL REST ON SOLID BEARINGS. FILL CORES OF HOLLOW MASONRY TO FOOTING WITH CONCRETE. FILL TOP COURSE CORES OF EXTERIOR FOUNDATION WALL WITH CONCRETE.

FOOTINGS SHALL EXTEND 6" AND SHALL BE 12" THICK UNDER GIRDER PIERS.

CHIMNEY FOOTING SHALL EXTEND 12" MINIMUM BEYOND EACH SIDE AND SHALL BE AT LEAST 12" THICK.

**BASEMENT**

ALL GIRDER JOINTS SHALL BREAK ON COLUMN CENTER LINES (STAGGERED) AND ENDS OF GIRDERS SHALL REST ON SOLID MASONRY.

DOUBLE SILL AND USE LEDGER OVER ALL BASEMENT OPENINGS.

ALL BASE SASH SHALL BE 16/20 2-LT. 3"-3 7/8" X 1'-11 15/16" 3420 HB.

**FRAMING**

ALL FLOOR JOISTS, CEILING JOISTS, RAFTERS, GIRDERS, HEADERS, SILLS AND BEAMS SHALL BE NO. 2 SPRUCE/PINE/FIR (S.P.F.) UNLESS OTHERWISE INDICATED.

ALL LOAD BEARING WALLS SHALL BE STUD GRADE SPRUCE/PINE/FIR (S.P.F.) UNLESS OTHERWISE INDICATED.

DESIGN SPECIFICATIONS FOR LAMINATED VENEER LUMBER (L.V.L.) BEAMS AND HEADERS :

GRADE : 2900Fb-2.0E  
BENDING Fb : 2850  
MOE : 2.0 X 10<sup>6</sup>  
SHEAR Fv : 290

**SUPPORT FOR HEADERS:**

HEADERS SHALL BE SUPPORTED ON EACH END WITH ONE OR MORE JACK STUDS OR WITH APPROVED FRAMING ANCHORS IN ACCORDANCE WITH BUILDING CODE (SEE PLAN). THE FULL-HEIGHT STUD ADJACENT TO EACH END OF THE HEADER SHALL BE END NAILED TO EACH END OF THE HEADER WITH FOUR-16D NAILS. SEE TABLE BELOW.

MINIMUM NUMBER OF FULL HEIGHT STUDS AT EACH END OF HEADERS IN EXTERIOR WALLS:

HEADER SPAN (FEET)	MAXIMUM STUD SPACING (INCHES)	
	16	24
3 FEET OR LESS	1	1
4 FT.	2	1
8 FT.	3	2
12 FT.	8	3
16 FT.	8	4

**CLIMATIC AND GEOGRAPHICAL DESIGN CRITERIA**

ROOF LIVE LOAD (POUNDS PER SQUARE FOOT) : 20 PSF  
ULTIMATE DESIGN WIND SPEED (MILES PER HOUR) : 120 MPH  
NOMINAL DESIGN WIND SPEED : 93 MPH  
EXPOSURE CATEGORY "B" UNLESS OTHERWISE NOTED  
WINDOW DESIGN PRESSURE RATING : DP 25  
COMPONENT AND CLADDING LOADS FOR A BUILDING WITH A MEAN ROOF HEIGHT OF 30 FEET OR LESS:

PRESSURE ZONE	ULTIMATE DESIGN WIND SPEED (MPH)			
	115	120	130	140
ZONE 1	13.1, -14.0	14.2, -15.0	16.7, -18.0	19.4, -21.0
ZONE 2	13.1, -18.0	14.2, -18.0	16.7, -21.0	18.4, -24.0
ZONE 3	13.1, -16.0	14.2, -16.0	16.7, -21.0	19.4, -24.0
ZONE 4	14.3, -15.0	15.5, -18.0	18.2, -19.0	21.2, -22.0
ZONE 5	14.3, -18.0	15.5, -20.0	18.2, -24.0	21.2, -28.0

ASSUMED MEAN ROOF HEIGHT: 25'-4"

SEISMIC CONDITION BY ZONE : ZONES A AND B  
SUBJECT TO DAMAGE FROM WEATHERING : MODERATE  
CLIMATE ZONES (UNLESS OTHERWISE NOTED): ZONES 3 AND 4  
MINIMUM VALUES FOR ENERGY COMPLIANCE:  
CEILING R-38; EXTERIOR WALLS R-18; FLOORS R-19  
WINDOW U-FACTOR ≤ 0.35; RECOMMENDED SHGC ≤ 0.30

**MISCELLANEOUS**

LOCATE ALL CONVENIENCE OUTLETS ABOVE KITCHEN BASE CABINETS 42" ABOVE FINISHED FLOOR.

**EMERGENCY EGRESS REQUIREMENTS**

IT SHALL BE THE RESPONSIBILITY OF THE OWNER/BUILDER TO VERIFY CONFORMITY WITH EGRESS REQUIREMENTS BASED ON SPECIFICATIONS PROVIDED BY WINDOW MANUFACTURER.

**2018 NORTH CAROLINA RESIDENTIAL CODE**

THE REQUIRED EGRESS WINDOW FROM EVERY SLEEPING ROOM SHALL HAVE A SILL HEIGHT OF NOT MORE THAN 44 INCHES ABOVE FINISHED FLOOR. THE NET CLEAR OPENING SHALL NOT BE LESS THAN 4.0 SQUARE FEET WHERE THE NET CLEAR OPENING HEIGHT SHALL BE AT LEAST 22 INCHES AND THE NET CLEAR OPENING WIDTH SHALL BE AT LEAST 20 INCHES. IN ADDITION THE MINIMUM TOTAL GLASS AREA SHALL NOT BE LESS THAN 5.0 SQUARE FEET IN THE CASE OF A GROUND STORY WINDOW AND NOT LESS THAN 0.7 SQUARE FEET IN THE CASE OF A SECOND STORY WINDOW.

**2015 INTERNATIONAL RESIDENTIAL CODE**

THE REQUIRED EGRESS WINDOW FROM EVERY SLEEPING ROOM SHALL HAVE A SILL HEIGHT OF NOT MORE THAN 44 INCHES ABOVE FINISHED FLOOR. ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE FEET EXCEPT GRADE FLOOR OPENINGS SHALL HAVE A MINIMUM NET OPENING OF 3 SQUARE FEET. THE MINIMUM NET CLEAR OPENING HEIGHT SHALL BE 24 INCHES. THE MINIMUM NET CLEAR OPENING WIDTH SHALL BE 20 INCHES.

REVISED 05-13-22



**Standard Homes Plan Service, Inc.**

7200 SUNSET LAKE ROAD FLOUQUAY-VARINA, NC 27526 (919)552-8677

SEE HOME DESIGN PROGRAMS ONLINE AT WWW.STANDARDHOMES.COM



DESIGNED FOR	PLAN	NO.	MT'L. SHOWN	SHEET
MATT TAYLOR	HORIZON	2	SID.	1 OF 9



**Standard Homes Plan Service, Inc.**  
 7200 SUNSET LAKE ROAD FLOUJAY-VARINA, NC 27526  
 (919)552-6677



DESIGNED FOR  
 WALT TAYLOR


PLAN  
 HORIZON

NO.  
 2



WALL  
 SID.

REVISIONS  
 06-23-82  
 SHEET  
 2 OF 9

FOUNDATION VENTILATION REQUIREMENTS:  
 100% SOL. FL. ± 100 = 5.88 SQ. FT. NET  
 PROVIDE 18 VENTS WITH A MINIMUM OF 64  
 SQUARE INCHES NET FREE AREA FOR VENT.

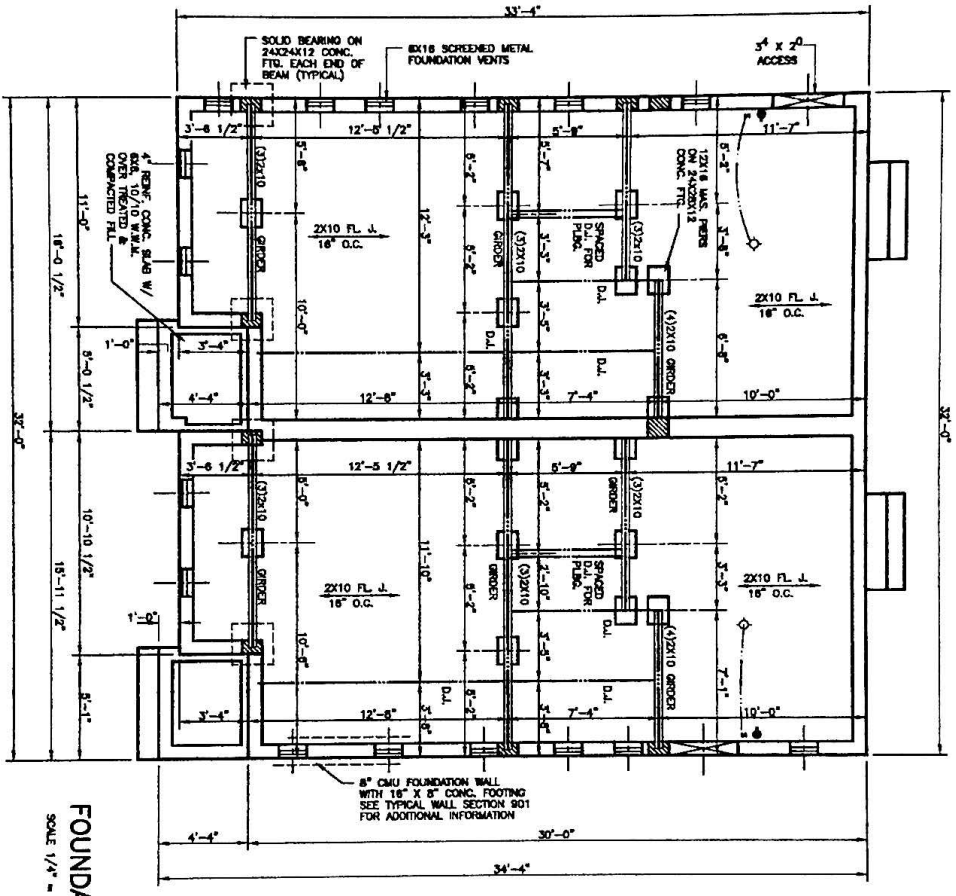


**FOUNDATION PLAN**  
 SCALE 1/4" = 1'-0"

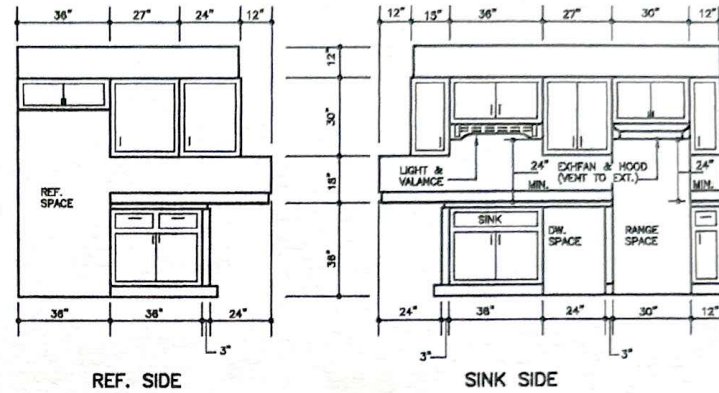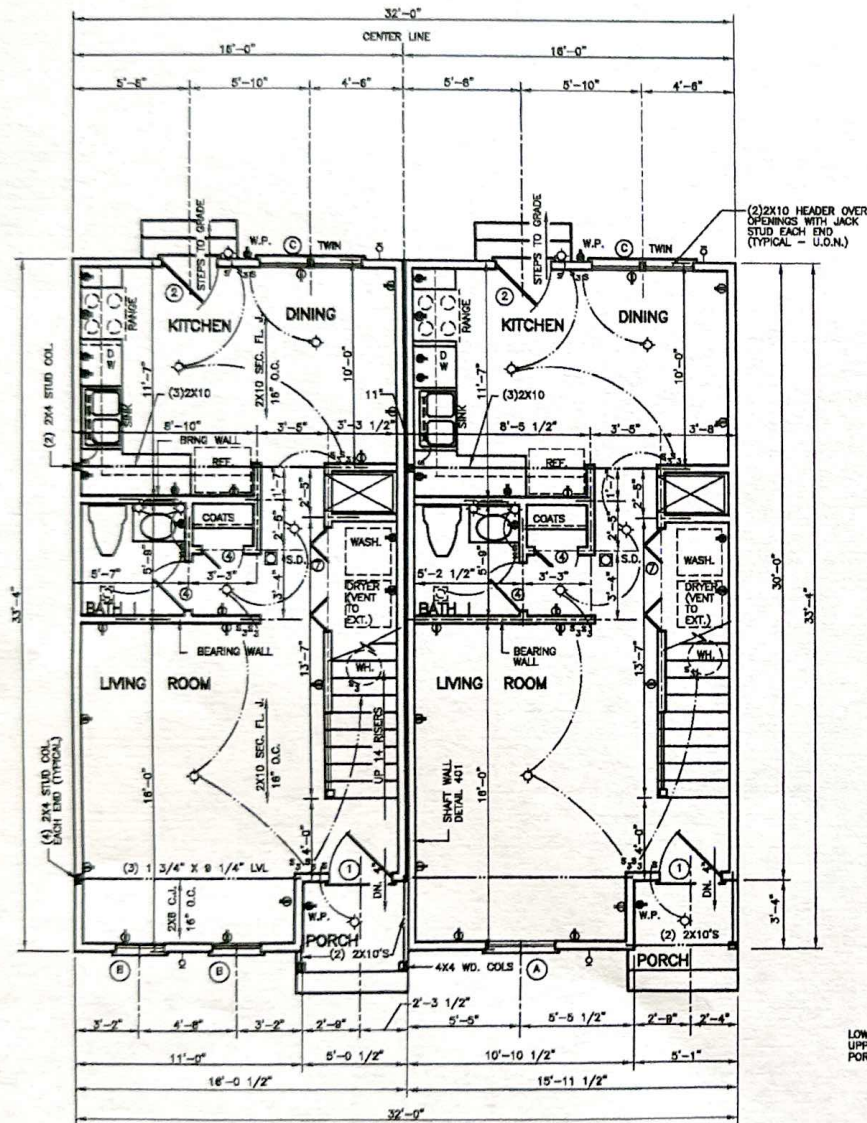

REF. SIDE  
KITCHEN CABINET ELEVATIONS  
SCALE 3/8" = 1'-0"

VANITY DETAILS  
SCALE 3/8" = 1'-0"



LOWER LEVEL HEATED AREA: 617 SQ. FT. PER UNIT  
UPPER LEVEL HEATED AREA: 480 SQ. FT. PER UNIT  
PORCH: 22 SQ. FT. PER UNIT

FIRST FLOOR PLAN  
SCALE 1/4" = 1'-0"

REVISED 05-23-22

WINDOW SCHEDULE				DOOR SCHEDULE			
A	3'-0" X 6'-2" WD.D.H.	D	3'0" x 5'3" DH	1	3'-0" X 6'-8" X 1 3/4"	4	2'-4" X 6'-8" X 1 3/8"
B	2'-4" X 5'-2" WD.D.H.	E		2	2'-8" X 6'-8" X 1 3/4"	5	2'-0" X 6'-8" X 1 3/8"
C	2'4" x 5'2" DH	F		3	2'-6" X 6'-8" X 1 3/8"	6	1'-6" X 6'-8" X 1 3/8"
		G				7	6'-0" X 6'-8" X 1 3/8" BIFOLD
		H				8	4'-0" X 6'-8" X 1 3/8" BIFOLD
		K				9	2'-0" X 6'-8" X 1 3/8" BIFOLD LOUVER
		L					
		M					
		N					

Standard Homes Plan Service, Inc.  
7200 SUNSET LAKE ROAD FUQUAY-VARINA, N.C. 27326 (919)552-3677

DESIGNED FOR: MATT TAYLOR

PLAN: HORIZON NO. 2 MATERIAL: SID

SHEET: 3 of 9


© 1999 STANDARD HOMES PLAN SERVICE, INC.

**DENSGLOSS SHAFTLINER AREA SEPARATION WALL  
BY GEORGINA-PACIFIC GYPSUM**


FIRE TEST : UL DESIGN U373 OR U378

**2 HOUR 85 TO 69 STC**  
FIRE SOUND

TWO LAYERS 1" DENSGLOSS SHAFTLINER INSERTED IN H-STUDS 24" O.C. MINIMUM 3/4" AIRSPACE ON BOTH SIDES MUST BE MAINTAINED BETWEEN LINER PANELS AND ADJACENT FRAMING.

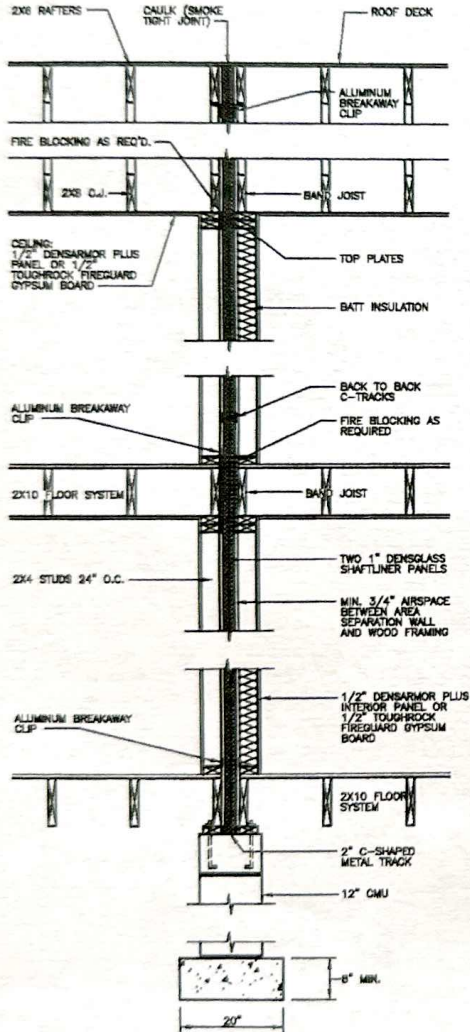

**XXX TWO-STORY SHAFT WALL DETAIL**  
SCALE : 3/4" = 1'-0"

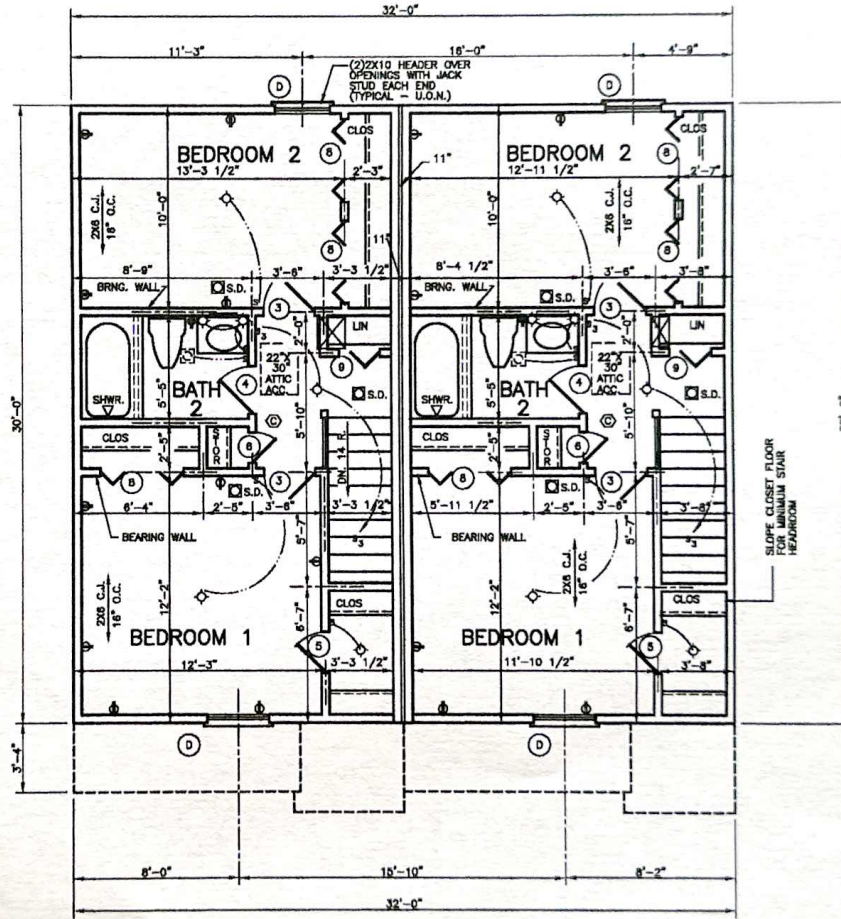

**SECOND FLOOR PLAN**  
SCALE 1/4" = 1'-0"

REVISED 05-23-22




**Standard Homes Plan Service, Inc.**

7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27526 (919)552-5677

SEE HOME DESIGN PROVIDED ONLINE AT WWW.STANDARDHOMES.COM



DESIGNED FOR	PLAN	NO.	MAT'L	SHOWN	SHEET
	HORIZON	2	SID.		4 of 9

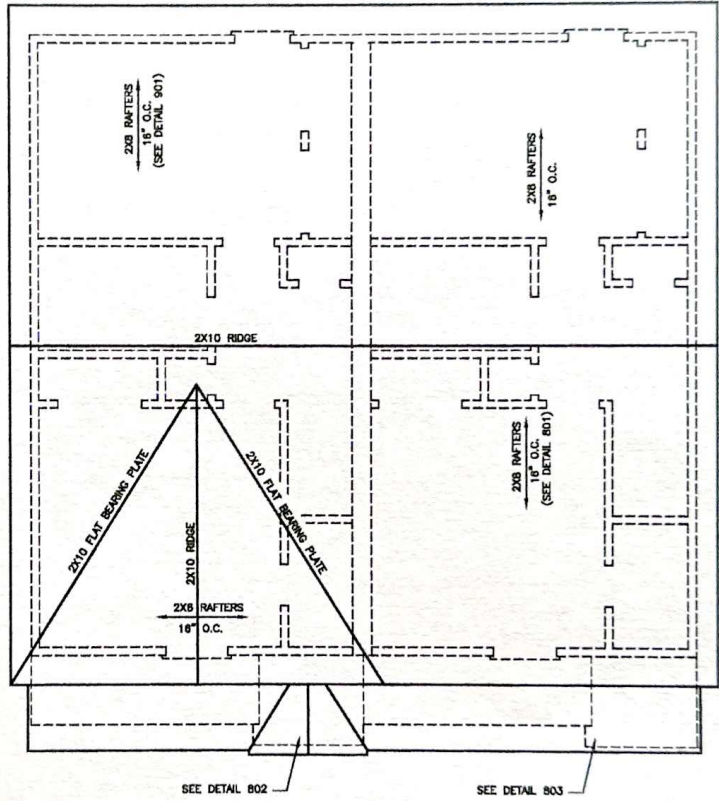

**ROOF PLAN**  
SCALE 1/4" = 1'-0"

ATTIC VENTILATION REQUIREMENTS :  
1077 SQ. FT. → 150 = 7.18 SQ. FT. NET  
FREE AREA REQUIRED


REVISED 05-23-22



**Standard Homes Plan Service, Inc.**  
7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27526 (919)552-5877  
SEE HOME DESIGN PROGRAM ONLINE AT WWW.STANDARDHOMES.COM



DESIGNED FOR	PLAN	NO.	MATL.	SHOWN	SHEET
MATT TAYLOR	HORIZON	2	SID.		5 of 9

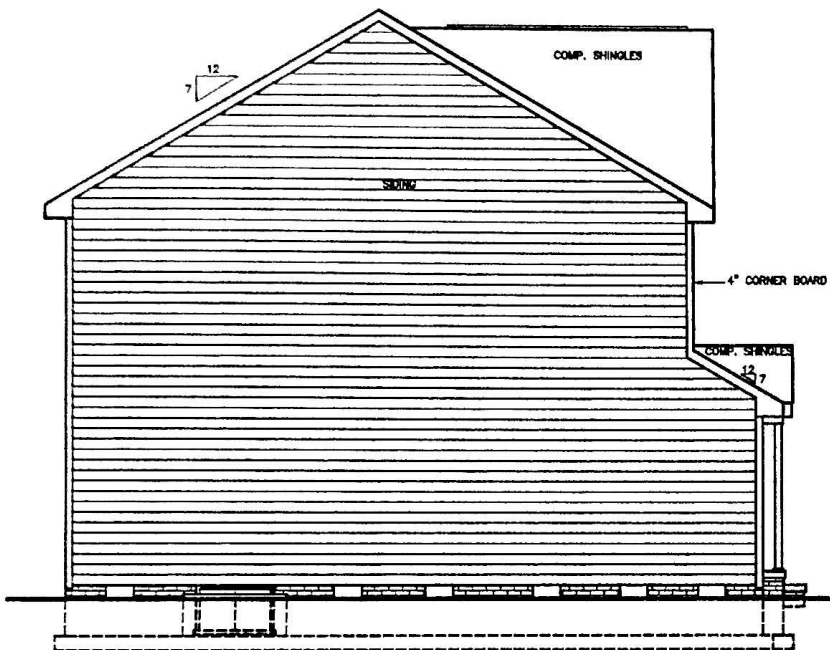


LEFT SIDE ELEVATION

PROVIDE GUTTERS, DOWNSPOUTS AND SPLASHPADS  
ACCORDING TO LOCAL CODE AND RAINFALL CONDITIONS.  
ALL SPLASHPADS SHALL CARRY WATER 80"  
FROM BUILDING.



FRONT ELEVATION  
SCALE 1/4" = 1'-0"

REVISED 05-23-82




Standard Homes Plan Service, Inc.

7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27626 (919)552-5677




DESIGNED FOR	PLAN	NO.	MAT'L.	SHOWN	SHEET
MATT TAYLOR	HORIZON	2	SID		8 of 9

©1988 STANDARD HOMES PLAN SERVICE, INC.

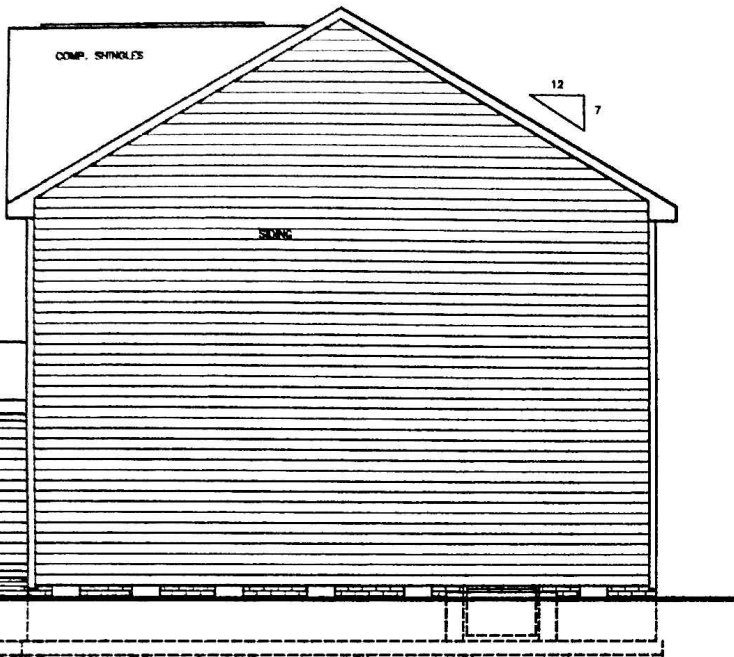

RIGHT SIDE ELEVATION

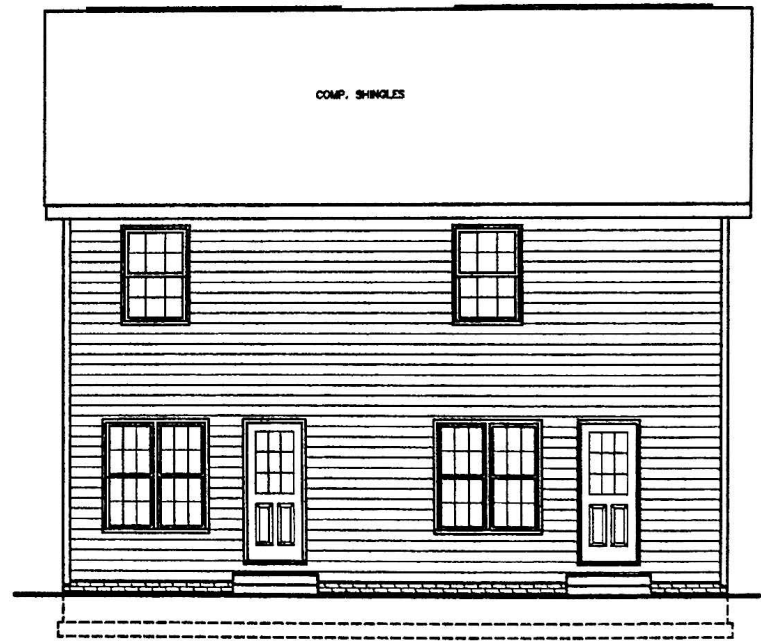

REAR ELEVATION  
SCALE 1/4" = 1'-0"

REVISED 06-23-22




**Standard Homes Plan Service, Inc.**

7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27526 (919)552-5677




DESIGNED FOR	PLAN	NO.	MAT'L	SHOWN	SHEET
MATT TAYLOR	HORIZON	2	SID		7 OF 9


© 2008 STANDARD HOMES PLAN SERVICE, INC.

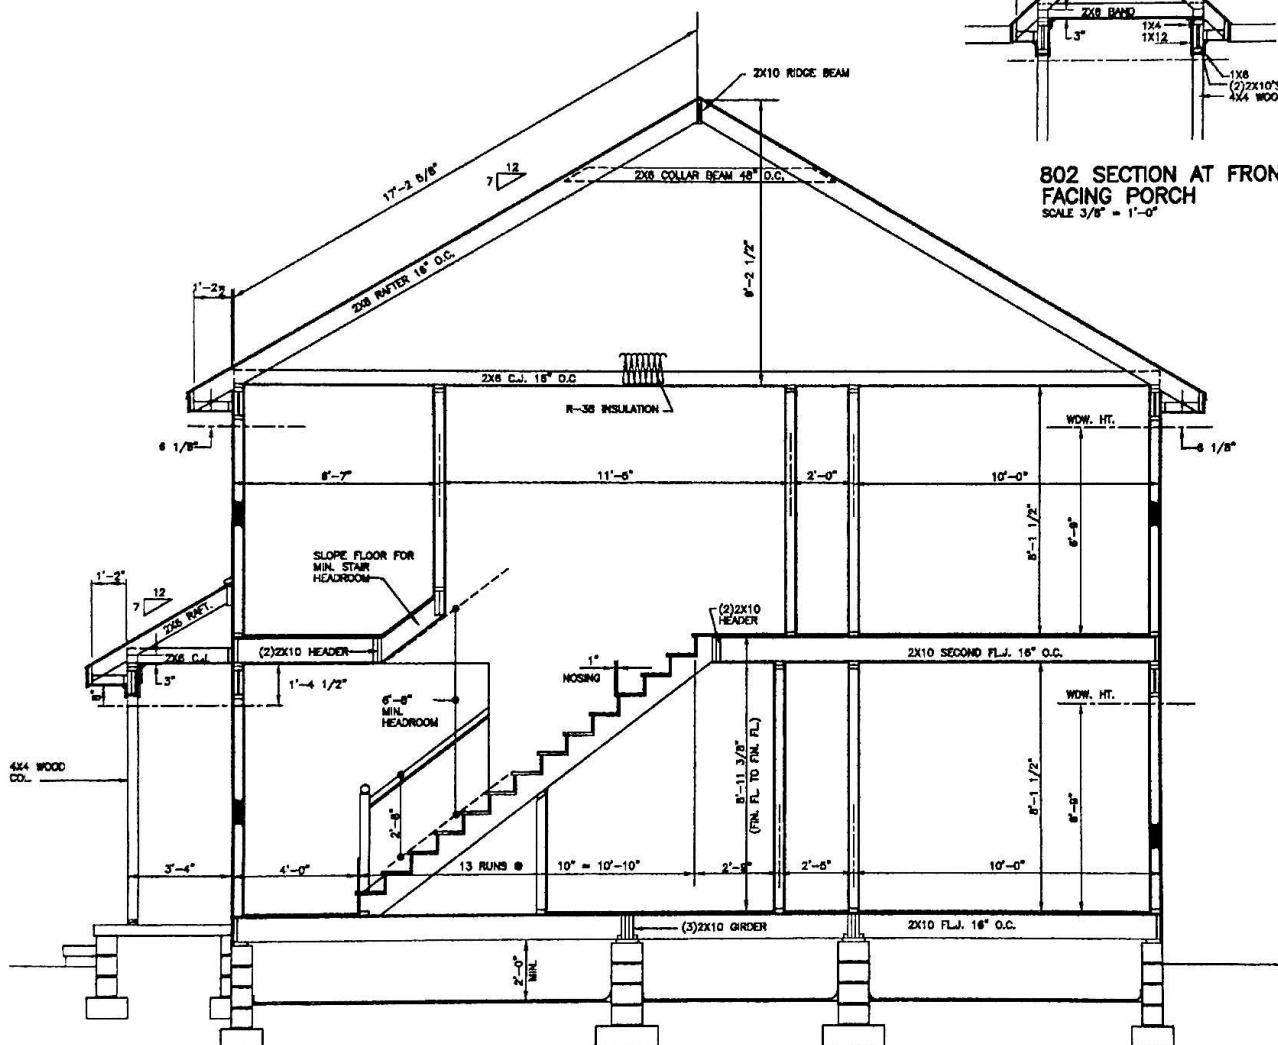

801 TRANSVERSE SECTION  
SCALE 3/8" = 1'-0"

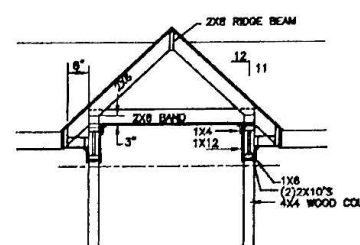


802 SECTION AT FRONT FACING PORCH  
SCALE 3/8" = 1'-0"

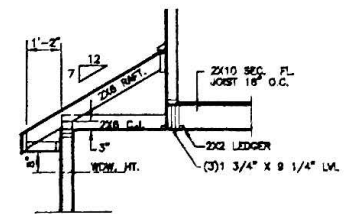

803 SECTION THRU FRONT SHED ROOF  
SCALE 3/8" = 1'-0"

FOR MORE INFORMATION SEE SHEET 8 OF 9.



**Standard Homes Plan Service, Inc.**  
7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27526 (919)552-5877





DESIGNED FOR	PLAN	NO.	MAT'L.	SHOWN	SHEET
MATT TAYLOR	HORIZON	2	SID		8 OF 9

REVISED 05-23-22

© 1998 STANDARD HOMES PLAN SERVICE, INC.



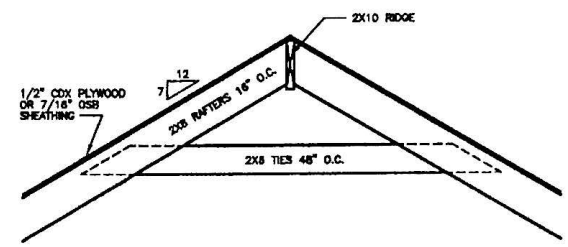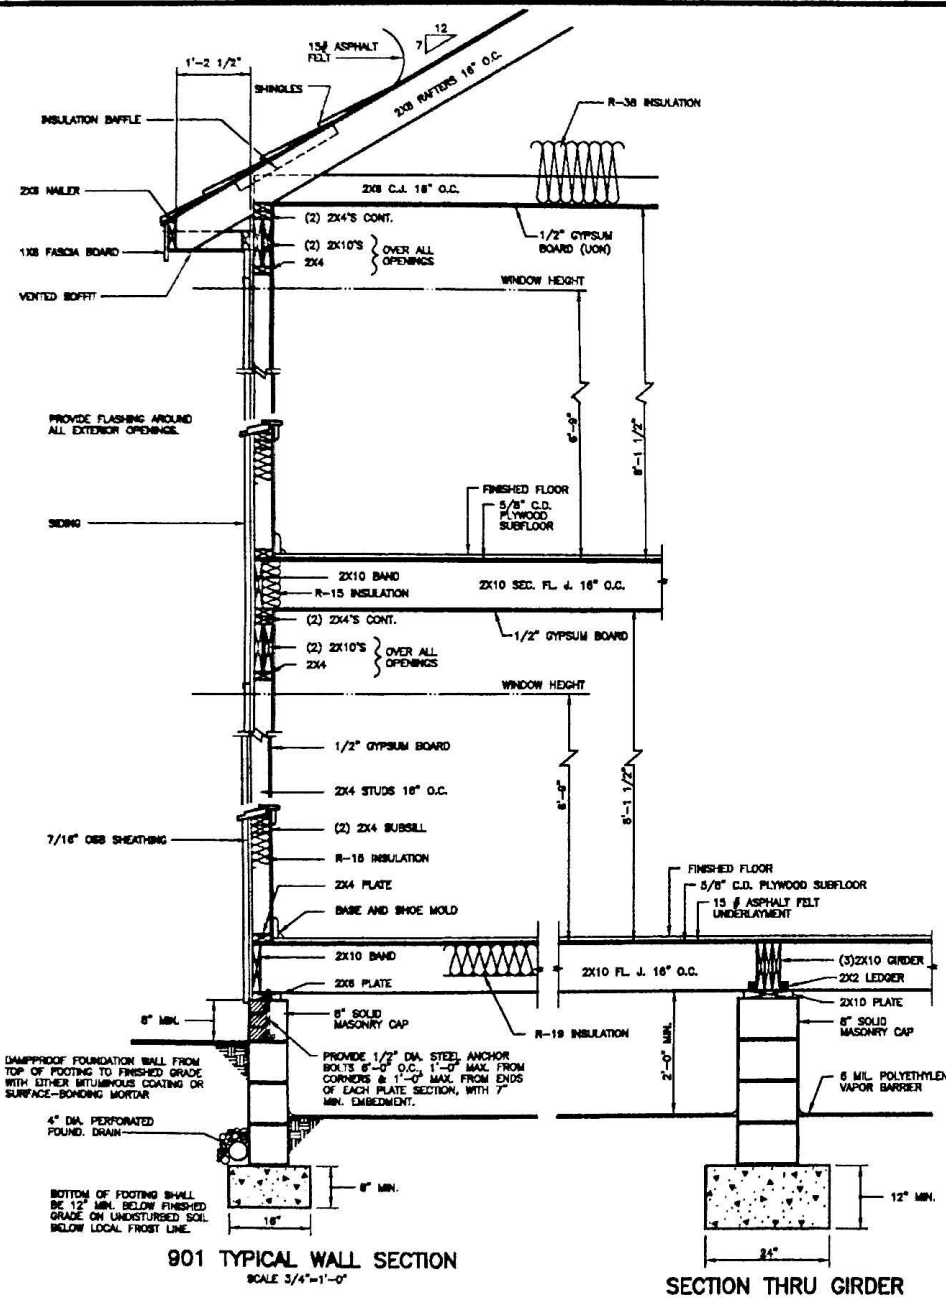

**Standard Homes Plan Service, Inc.**  
 7200 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27626 (919)552-5677



DESIGNED FOR	PLAN	NO.	MAT'L.	SHOWING	SHEET
MATT TAYLOR	HORIZON	2	SID		9 of 9

REVISED 06-23-22


© 2011 STANDARD HOMES PLAN SERVICE, INC.

### CONNECTION OF MULTIPLE PLY BEAMS



(INSTALLATION & CONNECTION OF BEAMS SHALL BE ACCORDING TO MANUFACTURERS SPECIFICATIONS)

MINIMUM UNIFORMLY DISTRIBUTED LIVE LOADS (PSF)	
USE	LIVE LOAD
UNINHABITABLE ATTICS WITHOUT STORAGE	10
UNINHABITABLE ATTICS WITH LIMITED STORAGE	20
HABITABLE ATTICS AND ATTICS SERVED WITH FIXED STAIRS	30
BALCONIES AND DECKS	40
ROOMS OTHER THAN SLEEPING ROOMS	40
SLEEPING ROOMS	30
STAIRS	40



ALLOWABLE DEFLECTION OF STRUCTURAL MEMBERS (NOTE: L = SPAN LENGTH)	
STRUCTURAL MEMBER	ALLOWABLE DEFLECTION
RAFTERS HAVING SLOPES GREATER THAN 3:12 WITH FINISHED CEILING NOT ATTACHED TO RAFTERS	L/180
FLOORS	L/360
CEILING WITH BRITTLE FINISHES (INCLUDING PLASTER AND STUCCO)	L/360
CEILING WITH FLEXIBLE FINISHES (INCLUDING GYPSUM BOARD)	L/240
ALL OTHER STRUCTURAL MEMBERS	L/240
LINTELS SUPPORTING MASONRY VENEER WALLS	L/500





SECTION  
D001  
TOP LOADED (4 PILES)

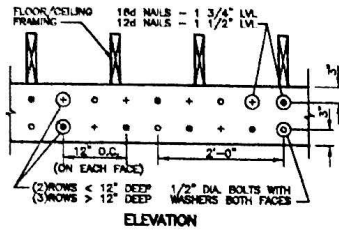


SECTION  
D002  
TOP LOADED (3 PILES MAXIMUM)

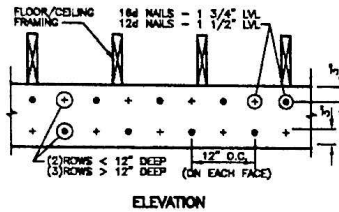


SECTION  
D003  
SIDE LOADED

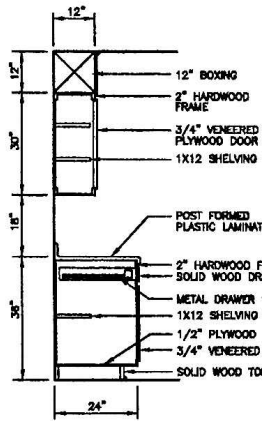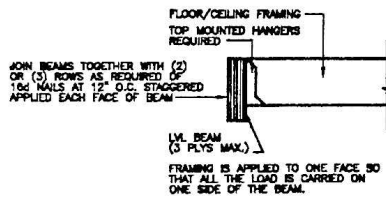


SECTION THRU  
KITCHEN CABINETS

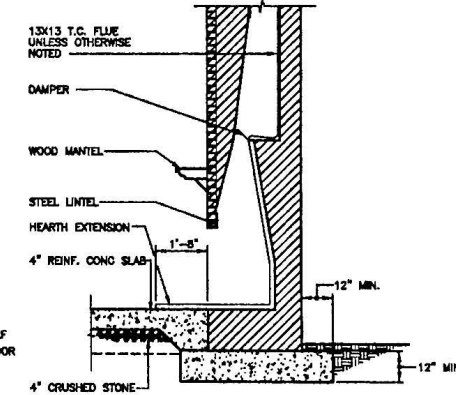


D005  
SECT. THRU FIREPLACE ON CONCRETE SLAB

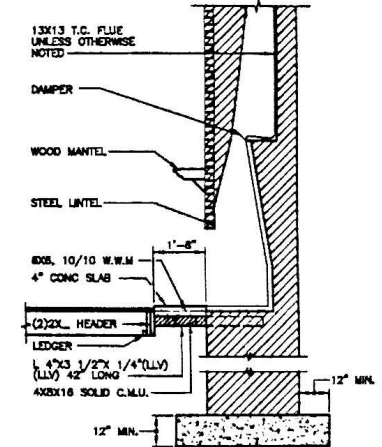


D006  
SECT. THRU FIREPLACE ON WOOD FLOOR

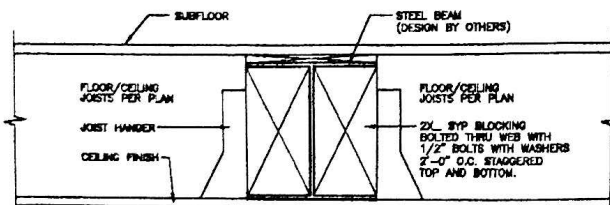


D004  
SECTION THRU STEEL BEAM

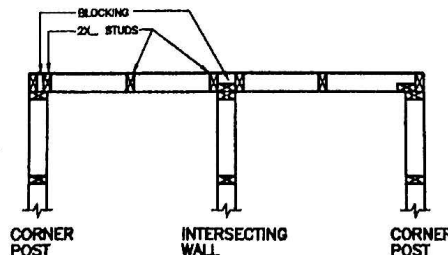


D007  
DETAIL BASIC WALL FRAMING

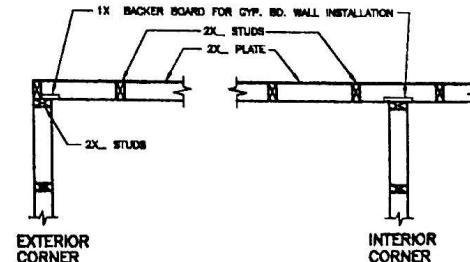

D008  
DETAIL ADVANCED WALL FRAMING



PLAN VIEW  
OF SUSPENDED HEARTH



**Standard Homes Plan Service, Inc.**

2700 SUNSET LAKE ROAD FUQUAY-VARINA, NC 27528 (919)552-5877

SEE HOW OUR DESIGN PROCESS ONLINE AT WWW.STANDARDHOMES.COM



STANDARD CONSTRUCTION DETAILS

D