



August 16, 2021

Mr. Mike Hamm, PE  
State of North Carolina  
Department of Insurance  
Manufactured Building Division  
1202 Mail Service Center  
Raleigh, NC 27699-1202

RE: CMH Manufacturing, Inc. #958  
Model: 3452-NC

Dear Mr. Hamm,

Enclosed, you will find one (1) copy of the above-mentioned project for your files.

Should you have any questions or comments, please contact me at your earliest convenience.

Sincerely,

*David Richter*

David Richter  
Account Manager

**CMH**  
 Manufacturing, Inc.  
 engineering department - modular

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
 David Richter

Date:  
 8/11/2021

TYPE : MODULAR

## MODEL PLAN INDEX

<b>Model #</b>	<b>3452</b>	<b>State</b>
<b>Manufacturer</b>	CMH Manufacturing, Inc.	<b>NC</b>
<b>Brand Name</b>	CLAYTON	
<b>Unit Size</b>	29'-8" x60'-0"	
<b>Description</b>	3 BEDROOM / 2 BATH	

Category	Document Description	Page or Sheet #
<i>Index</i>	<i>Model Plan Index</i>	<b>IX-1</b>
<i>Technical Sheet</i>	<i>Light &amp; Vent</i>	<b>TS-1</b>
<i>Technical Sheet</i>	<i>Energy Compliance</i>	<b>Prescriptive</b>
<i>Technical Sheet</i>	<i>HVAC System Calc</i>	<b>ATTACHED</b>
<i>Technical Sheet</i>	<i>Electrical Load Calc</i>	<b>TS-5</b>
<i>Model Plan</i>	<i>Cover Sheet</i>	<b>1-0</b>
<i>Model Plan</i>	<i>Cross Section / Fastening Schedule</i>	<b>1-0.2</b>
<i>Model Plan</i>	<i>Master Plan</i>	<b>1-1</b>
<i>Model Plan</i>	<i>HVAC Layout-Perimeter Duct</i>	<b>4-4</b>
<i>Model Plan</i>	<i>HVAC Layout - Overhead Duct</i>	<b>4-5</b>
<i>Model Plan</i>	<i>DWV Plumbing Schematic</i>	<b>8-1</b>
<i>Model Plan</i>	<i>Supply Plumbing</i>	<b>9-1</b>
<i>Model Plan</i>	<i>Electrical Plan</i>	<b>11-1</b>
<i>Model Plan</i>	<i>Exterior Elevations - Front &amp; Right</i>	<b>20-1</b>
<i>Model Plan</i>	<i>Exterior Elevations - Rear &amp; Left</i>	<b>20-2</b>
<i>Model Plan</i>	<i>OFF Frame Foundation</i>	<b>21-30PSF</b>
<i>Model Plan</i>	<i>ON Frame Foundation</i>	<b>21-PS</b>
<i>Technical Sheet</i>	<i>OFF &amp; ON-Frame Foundation Package</i>	<b>ATTACHED</b>
<i>Model Plan</i>	<i>Dryer Installation Details</i>	<b>4-1</b>
<i>Model Plan</i>	<i>Electrical Legend</i>	<b>TS-6</b>
<i>Technical Sheet</i>	<i>Plumbing Plan</i>	<b>PLN-1.8</b>
<i>Technical Sheet</i>	<i>Trusses</i>	<b>ATTACHED</b>
<b>SEE APPROVED MODULAR MANUAL FOR ;</b>		
<b>1. SECTIONS</b>		<b>2. TYPICAL DETAILS</b>
<b>3. REQUIRED CONSTRUCTION METHODS</b>		<b>4. MATERIALS</b>

# CMH

Manufacturing, Inc.  
engineering department - modular

REVISIONS		
DATE :	REVISION BY :	GCK
August 16, 2021	REVISION DATE :	

## TECHNICAL SHEET FOR LIGHT / VENT DATA

MODEL NUMBER	3452
SIZE OF UNIT	29'-8" x60'-0"
WINDOW SQ. FTG. STD.	
WINDOW SQ. FTG. W/ OPT.	
FIGURED FOR :	CLAYTON WINDOWS
PERCENTAGE OF LIGHT REQ'D.	8%
PERCENTAGE OF VENT REQ'D.	4%

Room	Area	Square Footage		Required		Percentage of		Artificial Light	Artificial Vent
		Installed	Light	Light	Vent	Installed	Light		
LIVING ROOM	264.3	36.6	18.6	21.1	10.6	13.8%	7.0%		
PRIMARY BEDROOM	215.7	24.4	12.4	17.3	8.6	11.3%	5.7%		
BEDROOM 2	137.0	12.2	6.2	11.0	5.5	8.9%	4.5%		
BEDROOM 3	136.7	12.2	6.2	10.9	5.5	8.9%	4.5%		
DINING ROOM	113.2	12.2	6.2	9.1	4.5	10.8%	5.5%		
KITCHEN	211.3	6.3		16.9	8.5	3.0%		YES	YES

APPROVED BY  
 8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter



**Load Short Form**  
*Entire House*  
**Clayton Homes**



8/16/2021

Job: 3452  
 Date: 08/11/21  
 By: GCK

5000 Clayton Road, Maryville, TN 37804 Phone: 865-380-3000

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
**David Richter**

**Project Information**

For: CZ3 ~ R-38-15-22

**Design Information**

	Htg	Clg		Infiltration
Outside db (°F)	25	92	Method	Simplified
Inside db (°F)	70	75	Construction quality	Semi-tight
Design TD (°F)	45	17	Fireplaces	
Daily range	-	M		
Inside humidity (%)	30	50		
Moisture difference (gr/lb)	18	35		

0

**HEATING EQUIPMENT**


Make	Smart Comfort
Trade	
Model	
AHRI ref	
Efficiency	100 EFF
Heating input	10.0 kW
Heating output	34121 Btuh
Temperature rise	29 °F
Actual air flow	1113 cfm
Air flow factor	0.048 cfm/Btuh
Static pressure	0.30 in H2O
Space thermostat	

**COOLING EQUIPMENT**

Make	Smart Comfort
Trade	13 SEER R SERIES R410A AC
Cond	R4A336GKH
Coil	FED003610+NADA43601CK
AHRI ref	0
Efficiency	11.5 EER, 13 SEER
Sensible cooling	23380 Btuh
Latent cooling	10020 Btuh
Total cooling	33400 Btuh
Actual air flow	1113 cfm
Air flow factor	0.059 cfm/Btuh
Static pressure	0.30 in H2O
Load sensible heat ratio	0.80

ROOM NAME	Area (ft²)	Htg load (Btuh)	Clg load (Btuh)	Htg AVF (cfm)	Clg AVF (cfm)
Util	131	2570	2091	122	123
Bath2	88	1168	1008	56	59
Kit	245	2545	2873	121	168
DinRm / LivRm	400	5419	5226	258	306
BR3	153	2759	1753	131	103
Clos	49	0	0	0	0
BR2	148	2035	1502	97	88
Foyer	70	1264	557	60	33
Hall	26	0	0	0	0
P.Clo	57	0	0	0	0
PBR	232	2903	2547	138	149
P.Bath	156	2760	1446	131	85

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.



Entire House	1756	23422	19005	1113	1113
Other equip loads		4333	1637		
Equip. @ 0.97 RSM			20022		
Latent cooling			5054		
<b>TOTALS</b>	<b>1756</b>	<b>27755</b>	<b>25076</b>	<b>1113</b>	<b>1113</b>

**APPROVED BY**  
 **8/16/2021**  
 Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
**David Richter**

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.



## Project Information

For: CZ3 ~ R-38-15-22

## Design Conditions

**Location:**

Charlotte/Douglas, NC, US  
Elevation: 768 ft  
Latitude: 35°N

**Outdoor:**

Drybulb (°F)  
Daily range (°F)  
Wet bulb (°F)  
Wind speed (mph)

**Heating**

25  
-  
-  
15.0

**Cooling**

92  
19 ( M )  
74  
7.5

**Indoor:**

Indoor temperature (°F)  
Design TD (°F)  
Relative humidity (%)  
Moisture difference (gr/lb)

**Heating**

70  
45  
30  
17.9

**Cooling**

75  
17  
50  
34.8


**Infiltration:**

Method  
Construction quality  
Fireplaces

Simplified  
Semi-tight  
0


## Heating

Component	Btuh/ft²	Btuh	% of load
Walls	3.9	5606	20.2
Glazing	15.8	3095	11.2
Doors	14.4	547	2.0
Ceilings	1.2	2054	7.4
Floors	2.9	5056	18.2
Infiltration	2.0	3296	11.9
Ducts		3768	13.6
Piping		0	0
Humidification		0	0
Ventilation		4333	15.6
Adjustments		0	0
<b>Total</b>		<b>27755</b>	<b>100.0</b>

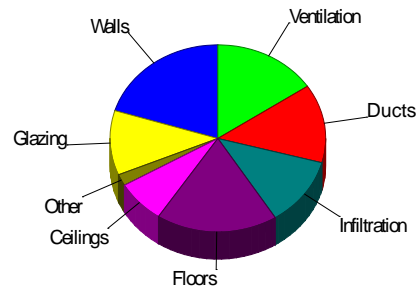

## Cooling

Component	Btuh/ft²	Btuh	% of load
Walls	1.9	2766	13.4
Glazing	26.8	5271	25.5
Doors	9.3	355	1.7
Ceilings	1.4	2406	11.7
Floors	0.8	1427	6.9
Infiltration	0.4	671	3.2
Ducts		2590	12.5
Ventilation		1637	7.9
Internal gains		3520	17.1
Blower		0	0
Adjustments		0	0
<b>Total</b>		<b>20642</b>	<b>100.0</b>

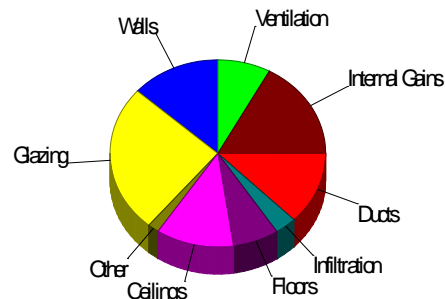

Latent Cooling Load = 5054 Btuh  
Overall U-value = 0.070 Btuh/ft²·°F

Data entries checked.

APPROVED BY

8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter



**Component Constructions**  
*Entire House*  
**Clayton Homes**

APPROVED BY



8/16/2021

**Job:** 3452  
**Date:** 08/11/21  
**By:** GCK

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

5000 Clayton Road, Maryville, TN 37804 Phone: 865-380-3000

## Project Information

For: CZ3 ~ R-38-15-22

## Design Conditions

<b>Location:</b>		<b>Indoor:</b>		<b>Heating</b>	<b>Cooling</b>
Charlotte/Douglas, NC, US		Indoor temperature (°F)		70	75
Elevation: 768 ft		Design TD (°F)		45	17
Latitude: 35°N		Relative humidity (%)		30	50
		Moisture difference (gr/lb)		17.9	34.8
<b>Outdoor:</b>	<b>Heating</b>	<b>Cooling</b>	<b>Infiltration:</b>		
Drybulb (°F)	25	92	Method	Simplified	
Daily range (°F)	-	19 ( M )	Construction quality	Semi-tight	
Wet bulb (°F)	-	74	Fireplaces	0	
Wind speed (mph)	15.0	7.5			

### Construction descriptions

#### Walls

12D-0sw: Frm wall, vnl ext, 3/8" wood shth, r-15 cav ins, 1/2" gypsum board int fnsh, 2"x4" wood frm, 16" o.c. stud

Or	Area ft²	U-value Btuh/ft²-°F	Insul R ft²-°F/Btuh	Htg HTM Btuh/ft²	Loss Btuh	Clg HTM Btuh/ft²	Gain Btuh
n	287	0.086	15.0	3.87	1109	1.91	547
e	445	0.086	15.0	3.87	1722	1.91	849
s	284	0.086	15.0	3.87	1098	1.91	542
w	434	0.086	15.0	3.87	1678	1.91	828
all	1449	0.086	15.0	3.87	5606	1.91	2766

#### Partitions

(none)

#### Windows

Clayton - Thermopane Low-E: Clayton - Thermopane Low-E; 50% blinds 45°, medium; 50% outdoor insect screen; 6.67 ft head ht

n	15	0.350	0	15.8	236	9.22	138
e	75	0.350	0	15.8	1181	26.3	1973
w	107	0.350	0	15.8	1677	26.3	2802
all	197	0.350	0	15.8	3095	25.0	4914

#### Doors

CMH - Standard Door: CMH - Standard Door - Solid no storm

e	20	0.320	0	14.4	289	9.34	188
s	18	0.320	0	14.4	257	9.34	167
all	38	0.320	0	14.4	547	9.34	355

#### Ceilings

16B-38ad: Attic ceiling, asphalt shingles roof mat, r-38 ceil ins, 1/2" gypsum board int fnsh

	1756	0.026	38.0	1.17	2054	1.37	2406
--	------	-------	------	------	------	------	------

#### Floors

Floor R22: R-22 Insulation Flr floor, frm flr, 10" thkns, amb ovr

	1756	0.064	22.0	2.88	5056	0.81	1427
--	------	-------	------	------	------	------	------



wrightsoft®  
 A M&E® / Beckwith Manufacturing Company

Right-Suite® Universal 2019 19.0.09 RSU24773

2021-Aug-11 15:33:57

Page 1

...htsoft HVAC\--WS-SN\--WS-Models\3452-P-Duct.rup Calc = MJ8 Front Door faces: N



**Project Summary**  
Entire House  
Clayton Homes

Job: 3452  
Date: 08/11/21  
By: GCK

5000 Clayton Road, Maryville, TN 37804 Phone: 865-380-3000

**Project Information**

For: CZ3 ~ R-38-15-22

Notes: R-38-15-22

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

**Design Information**

Weather: Charlotte/Douglas, NC, US

**Winter Design Conditions**

Outside db 25 °F  
Inside db 70 °F  
Design TD 45 °F

**Summer Design Conditions**

Outside db 92 °F  
Inside db 75 °F  
Design TD 17 °F  
Daily range M  
Relative humidity 50 %  
Moisture difference 35 gr/lb

**Heating Summary**

Structure 19655 Btuh  
Ducts 3768 Btuh  
Central vent (90 cfm) 4333 Btuh  
Outside air  
Humidification 0 Btuh  
Piping 0 Btuh  
Equipment load 27755 Btuh

**Sensible Cooling Equipment Load Sizing**

Structure 16415 Btuh  
Ducts 2590 Btuh  
Central vent (90 cfm) 1637 Btuh  
Outside air  
Blower 0 Btuh  
Use manufacturer's data n  
Rate/swing multiplier 0.97  
Equipment sensible load 20022 Btuh

**Infiltration**

Method Simplified  
Construction quality Semi-tight  
Fireplaces 0

**Latent Cooling Equipment Load Sizing**

Structure 1650 Btuh  
Ducts 1331 Btuh  
Central vent (90 cfm) 2074 Btuh  
Outside air  
Equipment latent load 5054 Btuh

	Heating	Cooling
Area (ft <sup>2</sup> )	1756	1756
Volume (ft <sup>3</sup> )	15802	15802
Air changes/hour	0.26	0.14
Equiv. AVF (cfm)	68	37

**Equipment Total Load (Sen+Lat)** 25076 Btuh  
Req. total capacity at 0.70 SHR 2.4 ton

**Heating Equipment Summary**

Make Smart Comfort  
Trade  
Model  
AHRI ref  
Efficiency 100 EFF  
Heating input 10.0 kW  
Heating output 34121 Btuh  
Temperature rise 29 °F  
Actual air flow 1113 cfm  
Air flow factor 0.048 cfm/Btuh  
Static pressure 0.30 in H2O  
Space thermostat

**Cooling Equipment Summary**

Make Smart Comfort  
Trade 13 SEER R SERIES R410A AC  
Cond R4A336GKH  
Coil FED003610+NADA43601CK  
AHRI ref 0  
Efficiency 11.5 EER, 13 SEER  
Sensible cooling 23380 Btuh  
Latent cooling 10020 Btuh  
Total cooling 33400 Btuh  
Actual air flow 1113 cfm  
Air flow factor 0.059 cfm/Btuh  
Static pressure 0.30 in H2O  
Load sensible heat ratio 0.80

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.







**Manual S Compliance Report**  
*Entire House*  
**Clayton Homes**

Job: 3452  
 Date: 08/11/21  
 By: GCK

5000 Clayton Road, Maryville, TN 37804 Phone: 865-380-3000

**Project Information**

For: CZ3 ~ R-38-15-22

**Cooling Equipment**

**Design Conditions**

Outdoor design DB:	92.0°F	Sensible gain:	20642	Btuh	Entering coil DB:	77.2°F
Outdoor design WB:	74.0°F	Latent gain:	5054	Btuh	Entering coil WB:	63.9°F
Indoor design DB:	75.0°F	Total gain:	25695	Btuh		
Indoor RH:	50%	Estimated airflow:	1113	cfm		

**Manufacturer's Performance Data at Actual Design Conditions**

Equipment type:	Split AC			
Manufacturer:	Smart Comfort	Model:	R4A336GKH+FED003610+NADA43601CK	
Actual airflow:	1113	cfm		
Sensible capacity:	23380	Btuh	113%	of load
Latent capacity:	10020	Btuh	198%	of load
Total capacity:	33400	Btuh	130%	of load SHR: 70%

**Heating Equipment**

**Design Conditions**

Outdoor design DB:	25.0°F	Heat loss:	27755	Btuh	Entering coil DB:	65.8°F
Indoor design DB:	70.0°F					

**Manufacturer's Performance Data at Actual Design Conditions**

Equipment type:	Elec strip			
Manufacturer:	Smart Comfort	Model:		
Actual airflow:	1113	cfm		
Output capacity:	10.0	kW	123%	of load
				Temp. rise: 54 °F

**APPROVED BY**  
  
 8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

**David Richter**

Meets all requirements of ACCA Manual S.





**Duct System Summary**  
*Entire House*  
**Clayton Homes**

Job: 3452  
 Date: 08/11/21  
 By: GCK

5000 Clayton Road, Maryville, TN 37804 Phone: 865-380-3000

**Project Information**

For: CZ3 ~ R-38-15-22

	<b>Heating</b>	<b>Cooling</b>
External static pressure	0.30 in H2O	0.30 in H2O
Pressure losses	0 in H2O	0 in H2O
Available static pressure	0.30 in H2O	0.30 in H2O
Supply / return available pressure	0.216 / 0.084 in H2O	0.216 / 0.084 in H2O
Lowest friction rate	0.081 in/100ft	0.081 in/100ft
Actual air flow	1113 cfm	1113 cfm
Total effective length (TEL)		372 ft

**Supply Branch Detail Table**

Name	Design (Btuh)	Htg (cfm)	Clg (cfm)	Design FR	Diam (in)	H x W (in)	Duct Matl	Actual Ln (ft)	Ftg.Eqv Ln (ft)	Trunk
BR2	h 2035	97	88	0.091	6.0	0x0	VIFx	24.0	215.0	st6
BR3	h 1379	66	51	0.092	6.0	0x0	VIFx	40.2	195.0	st6
BR3-A	h 1379	66	51	0.091	6.0	0x0	VIFx	33.5	205.0	st6
Bath2	c 1008	56	59	0.089	6.0	0x0	VIFx	17.4	225.0	st4
DinRm / LivRm	c 1742	86	102	0.081	6.0	0x0	VIFx	31.9	235.0	st3
DinRm / LivRm-A	c 1742	86	102	0.081	6.0	0x0	VIFx	41.5	225.0	st3
DinRm / LivRm-B	c 1742	86	102	0.081	6.0	0x0	VIFx	52.0	215.0	st3
Foyer	h 1264	60	33	0.085	6.0	0x0	VIFx	25.5	230.0	st5
Kit	c 1437	60	84	0.082	6.0	0x0	VIFx	13.2	250.0	st3
Kit-A	c 1437	60	84	0.081	6.0	0x0	VIFx	23.2	245.0	st3
P.Bath	h 1380	66	42	0.084	6.0	0x0	VIFx	54.0	205.0	st5
P.Bath-A	h 1380	66	42	0.085	6.0	0x0	VIFx	59.4	195.0	st5
PBR	c 1273	69	75	0.083	6.0	0x0	VIFx	35.9	225.0	st5
PBR-A	c 1273	69	75	0.083	6.0	0x0	VIFx	46.9	215.0	st5
Util	c 2091	122	123	0.090	6.0	0x0	VIFx	25.5	215.0	st4

**APPROVED BY**  
  
 8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

**David Richter**

## Supply Trunk Detail Table

Name	Trunk Type	Htg (cfm)	Clg (cfm)	Design FR	Veloc (fpm)	Diam (in)	H x W (in)	Duct Material	Trunk
st3	Peak AVF	379	475	0.081	976	9.8	5 x 14	ShtMetl	st1
st4	Peak AVF	178	182	0.089	374	7.4	5 x 14	ShtMetl	st1
st1	Peak AVF	556	656	0.081	835	12.0	0 x 0	VinIFlx	
st5	Peak AVF	329	267	0.083	677	9.4	5 x 14	ShtMetl	st2
st6	Peak AVF	228	191	0.091	469	8.1	5 x 14	ShtMetl	st2
st2	Peak AVF	557	457	0.083	709	12.0	0 x 0	VinIFlx	

## Return Branch Detail Table

Name	Grille Size (in)	Htg (cfm)	Clg (cfm)	TEL (ft)	Design FR	Veloc (fpm)	Diam (in)	H x W (in)	Stud/Joist Opening (in)	Duct Matl	Trunk
rb1	0x0	587	573	64.1	0.130	549	14.0	0x 0		VIFx	
rb2	0x0	527	540	103.6	0.081	505	14.0	0x 0		VIFx	

APPROVED BY


**NIA**

8/16/2021


Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

**David Richter**





### First Floor

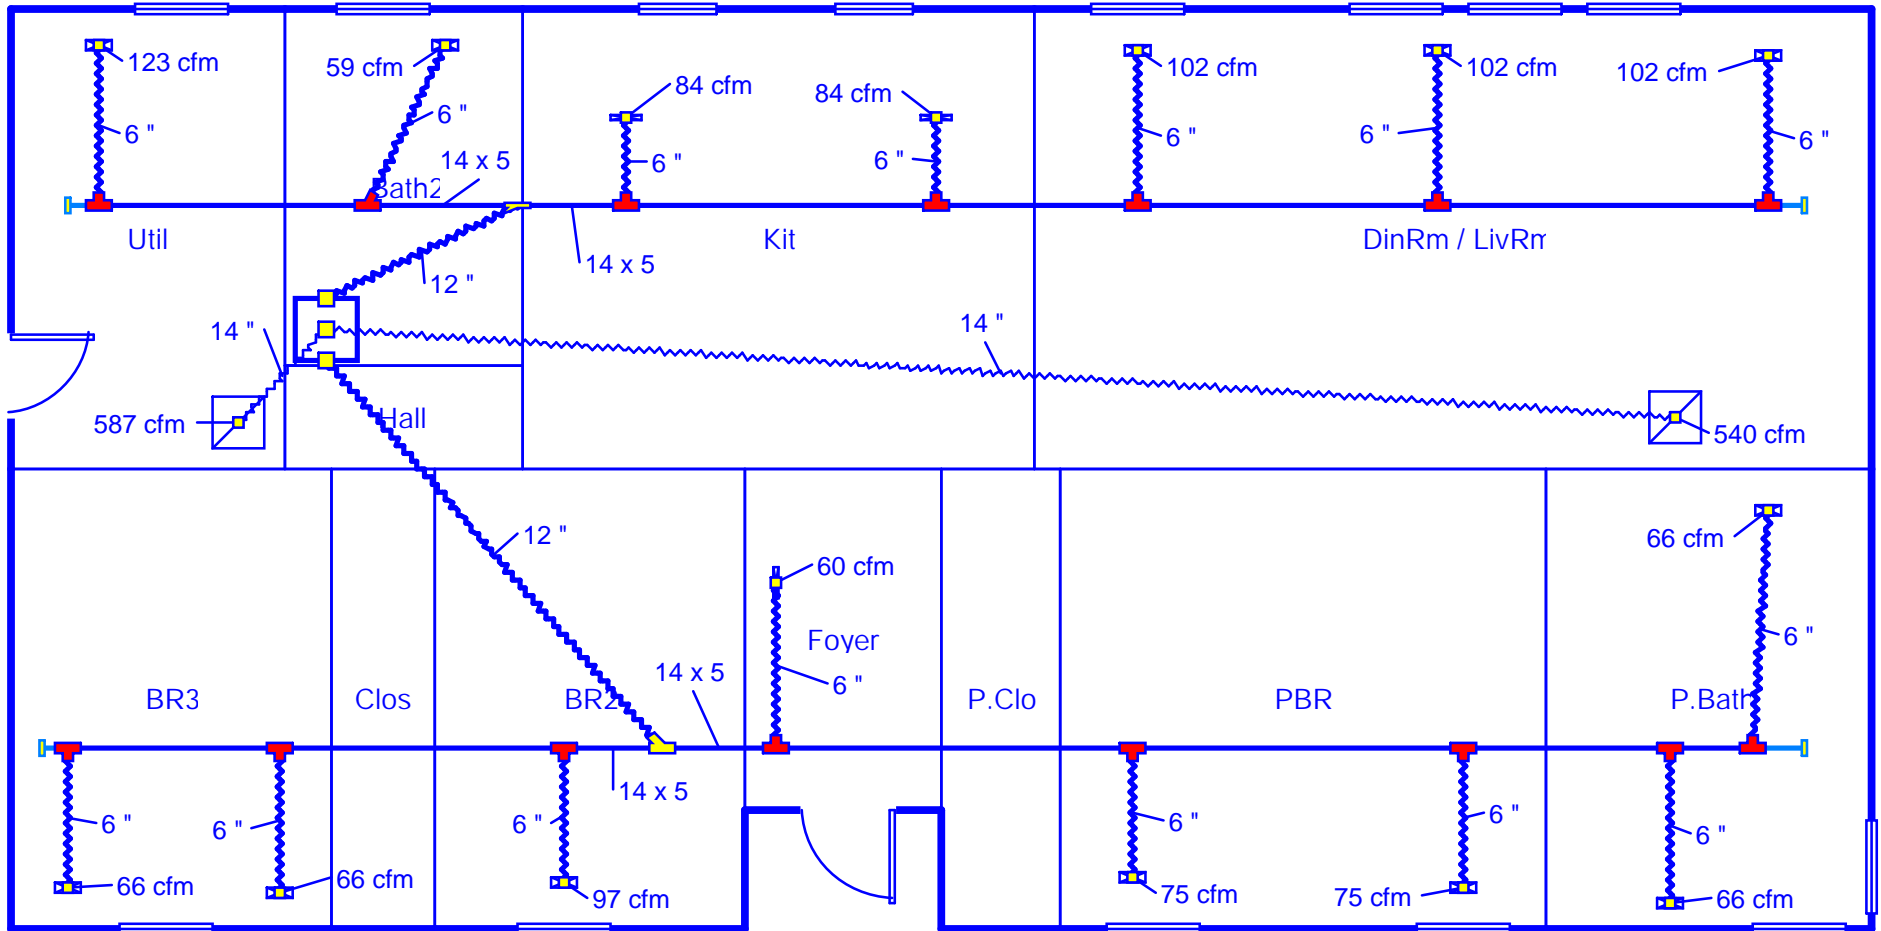

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

Job #: 3452  
Performed by GCK for:  
CZ3 - R-38-15-22

Clayton Homes

5000 Clayton Road  
Maryville, TN 37804  
Phone: 865-380-3000

Scale: 1 : 74

Page 1

Right-Suite@ Universal 2019  
19.0.09 RSU24773  
2021-Aug-11 15:34:28  
...S~SN~-WS-Models\3452~P-Duct.

# ELECTRICAL FEEDER CALCULATION

<b>CMH</b> Manufacturing, Inc. <i>engineering department - modular</i>	PAGE:	1 of 1
	DATE:	11-Aug-21
	BY:	GCK

MODEL NO.	<b>3452</b>	Per NEC 220-30
-----------	-------------	----------------

<b>1. LIGHTING LOAD:</b>					
1st floor			2nd floor		
length =	<b>60.00</b>	FT.	length =	<b>0.00</b>	FT.
width =	<b>29.67</b>	FT.	width =	<b>0.00</b>	FT.
Total area =	<b>1780</b>	SQ. FT.	Minimum number of 15 Amp circuits =	<b>3</b>	
	X	<b>3</b>	VA		
TOTAL	<b>5340</b>	VA			


<b>2. SMALL APPLIANCE LOAD:</b>			<b>3. LAUNDRY LOAD:</b>		
Number of circuits	<b>3</b>		Number of circuits	<b>1</b>	
	X	<b>1500</b>	VA	X	<b>1500</b>
TOTAL	<b>4500</b>	VA	TOTAL	<b>1500</b>	VA

<b>4. APPLIANCE LOAD:</b>		
Electric Range =		<b>12100</b> VA
Electric Water Heater =		<b>5000</b> VA
Electric Clothes Dryer =		<b>5600</b> VA
Cooktop =		<b>0</b> VA
Wall Oven =		<b>0</b> VA
Freezer =		<b>1200</b> VA
Dishwasher & Disposal =		<b>2376</b> VA
Gas furnace motor =		<b>0</b> VA
Micro-wave oven		<b>1200</b> VA

<b>5. TOTAL OF OTHER LOADS (1, 2 &amp; 3)</b>		
	<b>LEG A</b>	
Lighting load =	<b>5340</b>	
Small appliance load =	<b>4500</b>	
Laundry =	<b>1500</b>	
Appliance load =	<b>27476</b>	
Sub-Total =	<b>38816</b>	
10000 VA @ 100% =	<b>10000</b>	
Remainder @ 40% =	<b>11526</b>	
Total =	<b>21526</b>	VA
	<b>89.69</b>	AMPS

<b>6. HVAC LOAD:</b>			
Lineal feet of baseboard heaters =		<b>0</b>	
Number of baseboard heater circuits =		<b>0</b>	
Total baseboard heater load =		<b>0.0</b>	Amps
Use 65% w/ less than 4 or 40% w/ 4 or more circuits (*)			
Electric furnace @ 65% (*)			
Circuit 1 =	<b>60</b>	Amps	<b>39.00</b> Amps
Circuit 2 =	<b>0</b>	Amps	<b>0.00</b> Amps
Air conditioner (*)			<b>Amps</b>
Total HVAC load (*- Use largest of these only) =		<b>39.00</b>	Amps

<b>7. TOTAL OF ALL LOADS =</b>	<b>128.69</b>	Amps
--------------------------------	---------------	------

APPROVED BY  
  
 8/16/2021  
 Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
 David Richter

FURN SIZE  
10KW

**DOOR AND WINDOW SCHEDULE**

**NOTE:** FLOOR PLAN WINDOW SIZES WITH AN "SG" DESIGNATION REPRESENTS SAFETY GLAZING REQUIRED PER IRC SECTION R308.4

SIZES	ROUGH OPENING	LIGHT (@ 8%)	VENT (@ 4%)
30 X 40 WDW.	30 1/4" X 40 1/4"	6.30	0.00
24 X35 WDW.	24 1/4" X 35 1/4"	4.10	2.10
24 X54 WDW.	24 1/4" X 54 1/4"	6.80	3.50
30 X 60 WDW.	30 1/4" X 60 1/4"	9.90	5.20
36 X 35 WDW.	36 1/4" X 35 1/4"	6.60	3.30
36 X 54 WDW.	36 1/4" X 54 1/4"	10.80	5.60
36 X 60 WDW.	36 1/4" X 60 1/4"	12.20	6.20
36 X 72 WDW.	36 1/4" X 72 1/4"	14.90	7.70
36 X 08 WDW.	36 1/4" X 08 1/4"	0.50	0.00
36 x 12 WDW.	36 1/4" X 12 1/4"	1.10	0.00
64 x 35 WDW.	64 1/4" X 35 1/4"	11.50	2.60
58 x 35 WDW.	58 1/4" X 35 1/4"	10.10	2.20
36 X 48 WDW.	36 1/4" X 38 1/4"	9.25	4.70
30 X 72 WDW.	30 1/4" X 72 1/4"	12.10	6.20
40 x 60 WDW.	40 1/4" X 60 1/4"	13.70	7.00

DOORS			
2-8 X 6-8 DOOR	35 1/2" X 80"	-	-
3-0 X 6-8 DOOR	38" X 80"	-	-
PATIO DOOR	72" X 80"	33.6	16.8
ATRIUM DOOR	75 3/8" X 82 1/2"	21.15	17.3

**FASTENING REQUIREMENTS:** FOR DOORS AND WINDOWS, USE EITHER # 8 X 1" SCREWS, 7/16" X 1 1/2" X 16 GA. STAPLES, OR .092 X 2 1/4" PD NAILS, AT 12" ON CENTER MAXIMUM.

<u>DESIGN CRITERIA</u>	<u>CLASSIFICATION:</u>
- FLOOR LIVE LOAD = 40 PSF	- USE GROUP = R3
- GROUND SNOW LOAD = 30PSF	
- ATTIC LIVE LOAD = 10 PSF	- CONSTRUCTION TYPE IS V-B (UNPROTECTED)
- SEISMIC DESIGN CATEGORY "C"	- SOIL PROFILE CATEGORY "D"
- WIND EXPOSURE - 'C'	- Mean Roof Height - 22'-0" max.
DESIGN WIND SPEED = 90 MPH 100MPH 120MPH	
ULITMATE WIND SPEED = 117 MPH 130 MPH 152 MPH	

**ATTENTION LOCAL INSPECTION DEPARTMENT**  
 SET-UP INSTRUCTIONS FOR THIS MODULAR UNIT ARE INCLUDED BY ATTACHMENT TO THESE PLANS. ANY PLAN SET WHICH DOES NOT INCLUDE AN ATTACHMENT ENTITLED "SET UP MANUAL" IS INCOMPLETE

**SET- UP INSTRUCTIONS**  
 SEE SETUP MANUAL SENT WITH HOME.

**REQUIREMENTS FOR FIRESTOPPING**  
 INSTALLATION OF NON- COMBUSTIBLE MATERIALS AROUND ALL OPENINGS THAT ARE VERTICAL PENETRATIONS IN THE FLR. AND CLG.  
**ATTENTION LOCAL INSPECTION DEPARTMENT**  
 THE FOLLOWING ITEMS LISTED HAVE NOT BEEN COMPLETED BY CMH MFG, Inc., HAVE NOT BEEN INSPECTED BY NTA, INC AND ARE NOT CERTIFIED BY THE STATE OF NORTH CAROLINA MODULAR LABEL. CODE COMPLIANCES MUST BE DETERMINED BY THE LOCAL JURISDICTION FOR THE FOLLOWING:  
 - HVAC SYSTEM (SITE INSTALLATION AND CONNECTIONS)  
 -THIS UNIT MUST BE CONNECTED TO A PUBLIC WATER SUPPLY AND SEWER SYSTEM, IF THESE ARE AVAILABLE.

**CODE COMPLIANCE**

ALL PLANS MEET OR EXCEED THE FOLLOWING:

**North Carolina State Building Code Compliance:**  
 - NC Residential Code - 2018 Edition  
  
 - NC Electrical Code - 2017



Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
 David Richter



**RIDGE BEAMS-SIZES AND MAX. SPAN CHART**  
 RIDGE BM. CHART-SEE MATING WALL PG. RC-60.0 FOR MAX. CALCULATIONS-SEE MATING WALL PGS. CRC SECTION

Soffit materials for this unit assume that the building face will be 10 feet or greater from the property line when installed on site. Where the building face is less than 10 feet from the property line, underlayment materials and ventilation in accordance with Section R302.1.1,NC Residential Code, must be provided and installed at the site and inspected by the local jurisdiction

**THERMAL ZONE REQUIREMENT**  
 -THIS BUILDING DESIGN COMPLIES WITH OR EXCEEDS MINIMUM REQUIREMENTS FOR NORTH CAROLINA THERMAL ZONE 5  
 -MODEL IS DESIGNED TO MEET THERMAL ZONE 5 AND BELOW PER TABLE N1101.2 REFERENCED IN THE NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION FOR ONE & TWO FAMILY DWELLINGS. REScheck ANALYSIS AND COMPLIANCE REPORT FOR THERMAL ZONE CALCULATION IS PROVIDED FOR EACH SPECIFIC MODEL AND IS ATTACHED IN THE SUBMITTED MODEL APPROVAL PACKAGE.

BTUS PER HVAC CALCS  
 FURNANCE SIZE PER HVAC CALCS  
**INSULATION PACKAGES**  
 PRESCRIPTIVE

**MODULAR MANUAL REFERENCES**

ITEMS BELOW ARE REFERENCED FOR NON PRESCRIPTIVE USE

**FLOOR: ON FRAME CONSTRUCTION**  
DETAILS - SECTIONS ON FLOORS FOR ON FRAME: FL-500  
CALCULATIONS - SEE CFL SECTION

**FLOOR: OFF FRAME CONSTRUCTION**  
DETAILS - SECTIONS ON FLOORS FOR OFF FRAME: FL - 100

**MARRIAGE WALLS - 2x CONSTRUCTION**  
DETAILS - MW-20.0, MW-30.0, MW-40.0  
CALCULATIONS - SEE CMW SECTION

**PLUMBING FIXTURES**  
 SEE PAGE PLN - 1.8

**ELECTRICAL APPLIANCES AND LOADS**  
ELECTRICAL - SEE PAGES PLN-1.0 for WH & PLN-1.5 for FURN  
CALCULATION - SEE TECHNICAL SHEET ATTACHED FOR MODEL SPECIFIC ELECTRICAL PANEL LOAD CALC FOR 200 AMP SERVICE

**ANCHORAGE REQUIREMENTS**  
FOUNDATION SECTIONS FOR PERIMETER ON FRAME:  
 PER SETUP MANUAL

**ANCHORAGE REQUIREMENTS**  
FOUNDATION SECTIONS FOR PERIMETER OFF FRAME:  
 PER SETUP MANUAL

**TRUSSES - DETAILS / CALCULATIONS**  
 PER TRUSS PRINTS

**ALL MODELS ARE AVAILABLE WITH FLOOR PLAN REVERSED FROM LEFT TO RIGHT AND / OR FRONT TO BACK.**

**MARRIAGE WALL COLUMNS SPAN CHART**  
 DETAIL - SEE MATING WALL COLUMNS (PAGE MW-20.0)  
 CALCULATIONS - SEE CMW SECTION

**INSTRUCTIONS ON FILLING OUT PLAN SET BEFORE CONSTRUCTION**  
 YOU MUST CHECK THE APPROPREATE BOX OF WHAT THE STRUCTURE IS TO BE BUILT TO BEFORE PRODUCTION BEGINS. THE MARK SET MUST ACCOMPANY THE UNIT THROUGH THE PRODUCTION PROCESS.

**EXTERIOR SIDEWALL HEADERS - SIZES AND MAXIMUM SPAN CHART**  
 HEADER CHART - SEE EXTERIOR WALL PAGE EW - 20.0  
 CALCULATIONS - CEW SECTION

**ATTENTION LOCAL INSPECTION DEPARTMENT:**  
**IF THIS STRUCTURE IS IN A THERMAL ZONE MORE STRINGENT THAN THAT LISTED ON THESE PLANS, IS SET ON PILINGS, OR IS INSTALLED AT A MOUNTAIN REGION OR COASTAL HIGH HAZARD SITE SUCH THAT WIND OR OTHER DESIGN PARAMETERS ARE INCREASED, THE DESIGN MUST BE DETERMINED TO BE ADEQUATE FOR ACTUAL SITE CONDITIONS. ALTERATIONS MAY BE REQUIRED TO BRING THE HOME INTO COMPLIANCE WITH THE MORE STRINGENT CONDITIONS.**

"Service entrance conductors routed from their point of entrance into the structure, to their point of attachment to the service enclosure a distance horizontally not more than twice the nominal width of the service enclosure and vertically not more than the greater of 5 feet or twice the nominal height of the sevice enclosure shall be considered to be in compliance with the requirements of 230-70(a) of the current National Electrical Code. Service entrance conductors may be routed in the most direct route or at right angles. Service entrance conductors in excess of these specified limits will not be allowed unless specifically authorized by special permission from the electrical inspector having jurisdiction to accommodate adverse site conditions which would not reasonably allow installation within this criteria."

**This home is NOT designed for placement in Coastal High Hazard Areas or Ocean Hazard Areas.**

<b>CMH</b> Manufacturing, Inc.	REVISIONS	BY	DATE	ALL MODULAR MODELS
				COVER SHEET 1-0

TYPICAL FASTENING SCHEDULE:

FLOOR FASTENING

RIM JOIST TO JOIST  
 FLOOR BLOCKING TO JOIST  
 MULTIPLE JOIST  
 DECKING TO FLOOR FRAMING

REFERENCE 'CFL' - FLOOR CONSTRUCTION CALCULATIONS OF THE MANUAL.

PER FL-110 OR FL-510.0 IN APPROVED MANUAL  
 PER FL-100.0 IN APPROVED MANUAL  
 .131 x 3" NAILS @ 10" O.C., W/ GLUE 80%  
 PER FL-10 IN APPROVED MANUAL

EXTERIOR WALL FASTENING

LOWER TOP PLATE &  
 BOTTOM PLATE TO STUD  
 DOUBLE TOP PLATES  
 HEADER TO STUDS  
 HEADER COMPONENTS  
 STUDS TO SILLS  
 EXTERIOR SIDING  
 BOTTOM PLATE TO FLOOR  
 SIDEWALL TO ENDWALL  
 WALL WALL TO WALL TOP PLATES  
 EXTERIOR WALL SHEATHING

REFERENCE 'CEW' - EXTERIOR WALL CONSTRUCTION CALCULATIONS OF THE MANUAL

PER EW-25 IN APPROVED MANUAL DOUBLE STUDS 7/16" x 2-1/2" x 15 GA. STAPLES @ 6" O.C.  
 PER EW-1 IN APPROVED MANUAL  
 PER EW-20 CHARTS IN APPROVED MANUAL  
 PER EW-20 IN APPROVED MANUAL  
 PER EW-20 IN APPROVED MANUAL  
 PER THE MANUFACTURER'S SPECIFICATIONS  
 PER EW-31 IN APPROVED MANUAL  
 PER EW-30 FOR NON-SHEARWALL OR PER SW-40 FOR SHEARWALL OR PER EW-0.0 IN APPROVED MANUAL  
 3" x 6" x .036" (20 GA.) GALVANIZED STEEL PLATE W/ (6) .131 x 3" NAILS AT EACH SIDE AT EACH  
 FOR APA RATED SHEATHING; 7/16" x 1-3/4" x 15 GA. STAPLES AT 6" O.C. AT ALL EDGES & 12" O.C. FIELD. FOR  
 COMPOSITE WALLS, FASTEN PER EW-40. FOR SHEARWALL FASTEN PER SW-40 OR ATTACHED PAGES (IF ATTACHED). ALL  
 OTHER SHEATHING FASTENED PER  
 MANUFACTURER'S INSTALLATION INSTRUCTIONS.

MATING WALL FASTENING

LOWER TOP PLATE TO STUD  
 BOTTOM PLATE TO STUD  
 MULTIPLE STUDS  
 STANDARD COLUMN  
 DOUBLE TOP PLATES  
 BOTTOM PLATE TO FLOOR  
 MATING WALL TO ENDWALL  
 WALL TO WALL TOP PLATES

REFERENCE 'CMW' - MARRIAGE WALL CALCULATIONS OF THE MANUAL

PER MW-40 IN APPROVED MANUAL  
 PER MW-40 IN APPROVED MANUAL  
 7/16" x 2-1/2" x 15 GA. STAPLES OR .131 x 3" NAILS @ 16" O.C. TO EACH MEMBER  
 PER MW-20 IN APPROVED MANUAL  
 PER MW-40 IN APPROVED MANUAL  
 PER MW-31 IN APPROVED MANUAL  
 PER EW-30 IN APPROVED MANUAL  
 3" x 6" x .036" (20 GA.) GALVANIZED STEEL PLATE W/ (6) .131 x 3" NAILS AT EACH SIDE AT EACH WALL OR OVERLAPPED  
 PLATE PER EW-0.

INTERIOR WALL FASTENING

BOTTOM PLATE TO STUDS  
 TOP PLATE TO STUD  
 DOUBLE STUDS  
 FLAT HEADER TO STUDS  
 WALL TO FLOOR  
 WALL TO WALL  
 TOP PLATE TO ROOF SYSTEM  
 GYPSUM TO WALL FRAMING

PER PT-40 IN APPROVED MANUAL  
 PER PT-40 IN APPROVED MANUAL  
 7/16" x 2-1/2" x 16 GA. STAPLES @ 16" O.C.  
 PER PT-20 IN APPROVED MANUAL  
 PER PT-40 IN APPROVED MANUAL  
 PER PT-30 IN APPROVED MANUAL  
 PER PT-40 IN APPROVED MANUAL  
 PER THE RESIDENTIAL BUILDING CODE TABLES

ROOF FASTENING

CEILING BOARD TO TRUSS  
 BLOCKING TO TRUSS  
 TRUSS TO SIDEWALL TOP PLATE  
 TRUSS TO RIDGE BEAM  
 TRUSS TO EDGE RAIL  
 EDGE RAIL TO MATING WALL  
 TRUSS TO ENDWALL TOP PLATE  
 ROOF DECKING TO TRUSS  
 SHINGLE TO ROOF DECKING  
 OUTLOOKER TO TRUSS

REFERENCE 'CRC' - ROOF CONSTRUCTION CALCULATIONS OF THE MANUAL

FOAM-SEAL 2100 SPRAY ADHESIVE PER THE MANUFACTURER'S SPECIFICATIONS  
 (2) 7/16" x 2-1/2" x 15 GA. STAPLES DIRECT  
 PER RC-30 IN APPROVED MANUAL  
 PER RC-65 IN APPROVED MANUAL  
 PER MW-31 CHARTS IN APPROVED MANUAL  
 PER MW-31 CHARTS IN APPROVED MANUAL  
 PER SW-40 IN APPROVED MANUAL FOR SHEARWALLS AND RC-33.0 FOR NON-SHEARWALLS  
 PER SW20.0 THRU SW-389E.2 (IF NOT ATTACHED) IN APPROVED MANUAL  
 PER THE MANUFACTURER'S OR ARMA SPECIFICATIONS  
 PER RC-70 IN APPROVED MANUAL

INSTALLATION FASTENING

REFERENCE INSTALLATION PAGES PROVIDED IN EACH APPROVAL.


- (CS1) 7/16" APA RATED ROOF DECKING 24/16 SPAN RATING.
- (CS2) 15# MIN. ROOF UNDERLAYMENT; SINGLE LAYER w/ GREATER THAN 4:12 ROOF PITCH; DOUBLE LAYER w/ 4:12 OR LESS
- (CS3) MIN. 20 YEAR SHINGLES.
- (CS4) 1 1/2" WIDE ENGINEERED WOOD BEAM, EACH HALF IN OPEN SPAN AREAS GREATER THAN 48".
- (CS5) ENGINEERED WOOD TRUSSES: COMPONENTS & SPACING PER TRUSS PRINT  
 \* FOR CONNECTION AND SET-UP OF ROOF:  
 SEE MODULAR SET-UP PAGES ATTACHED TO APPROVAL

- (CS6) CEILING INSULATION, BLOWN OR BATT.
- (CS7) CONTINUOUS VENTED SOFFIT.
- (CS8) DOUBLE 2x4 TOP PLATE (MIN.).
- (CS9) 2x4 STUDS @ 16" O.C. STUD GRADE SPF (MIN.).
- (CS10) WALL INSULATION (BATT)
- (CS11) 3/8" OSB SHEATHING WITH WATER RESISTIVE BARRIER BELOW ALL EXT. FINISH MATERIAL. CORROSION-RESISTANT FLASHING REQUIRED AT ALL LOCATIONS AS SHOWN ON APPROVED MANUAL DETAILS
- (CS12) SINGLE 2x4 BOTTOM PLATE SPF #3 (MIN.).
- (CS13) 3/8" (MIN.) GYPSUM WALL BOARD.
- (CS14) FLOOR INSULATION (BATT.)
- (CS15) MIN. 19/32" RATED DECKING 16" O.C. OR 32/16 SPAN RATING.
- (CS16a)


Duct Insulation:

- 1 - Min R-8
- 2 - A VAPOR RETARDER HAVING A MAXIMUM 0.05 PERM IN ACCORDANCE WITH ASTM E96, OR ALUMINUM FOIL WITH A MINIMUM THICKNESS OF 2 MILLS, SHALL BE INSTALLED ON THE EXTERIOR OF THE INSULATION ON THE COOLING SUPPLY DUCT THAT PASS THROUGH UNCONDITIONED SPACE CONDUCTIVE TO CONDENSATION EXCEPT WHERE THE INSULATION IS SPRAY POLYURETHANE FOAM WITH A MAXIMUM WATER VAPOR PERMEANCE OF 3 PERM PER INCH AT THE INSTALLED THICKNESS.

- (CS16) MAIN HEAT DUCT. (MAY BE SITE INSTALLED BY OTHERS)
- (CS17) OFF FRAME PER FL-110.0
- (CS18) OFF FRAME PER FL-110.0
- (CS19) 2x4 (MIN.) MARRIAGE WALL STUDS @ 16" O.C.
- (CS20) LISTED BOTTOM BOARD, WHERE OCCURS.
- (CS21) 1/2" SHIM FOR COMPRESSION STRIP.
- (CS22) DOUBLE 2x4 (MIN.) TOP PLATE.
- (CS23) 2x4 (MIN.) BOTTOM PLATE.
- (CS24) 1/2" (MIN.) GYPSUM BOARD CEILING.
- (CS25) WEDGE SUPPORT AT CATHEDRAL CEILING, EACH END OF TRUSS.
- (CS27) CONTINUOUS 2x3 SPF #3 MINIMUM FOR TRUSS TOP RAIL FOR RIDGE CONNECTION
- (CS28) 2x FULL DEPTH BLOCKING 24" O.C. (2) JOIST BAY MIN. ENDWALL LOCATION ONLY.
- (CS29) LAP BOARD, WOOD OR VINYL SIDING, HARDI SIDING, OR EXPOSED SHEATHING FOR ON SITE EXTERIOR FINISH INSTALLATION.

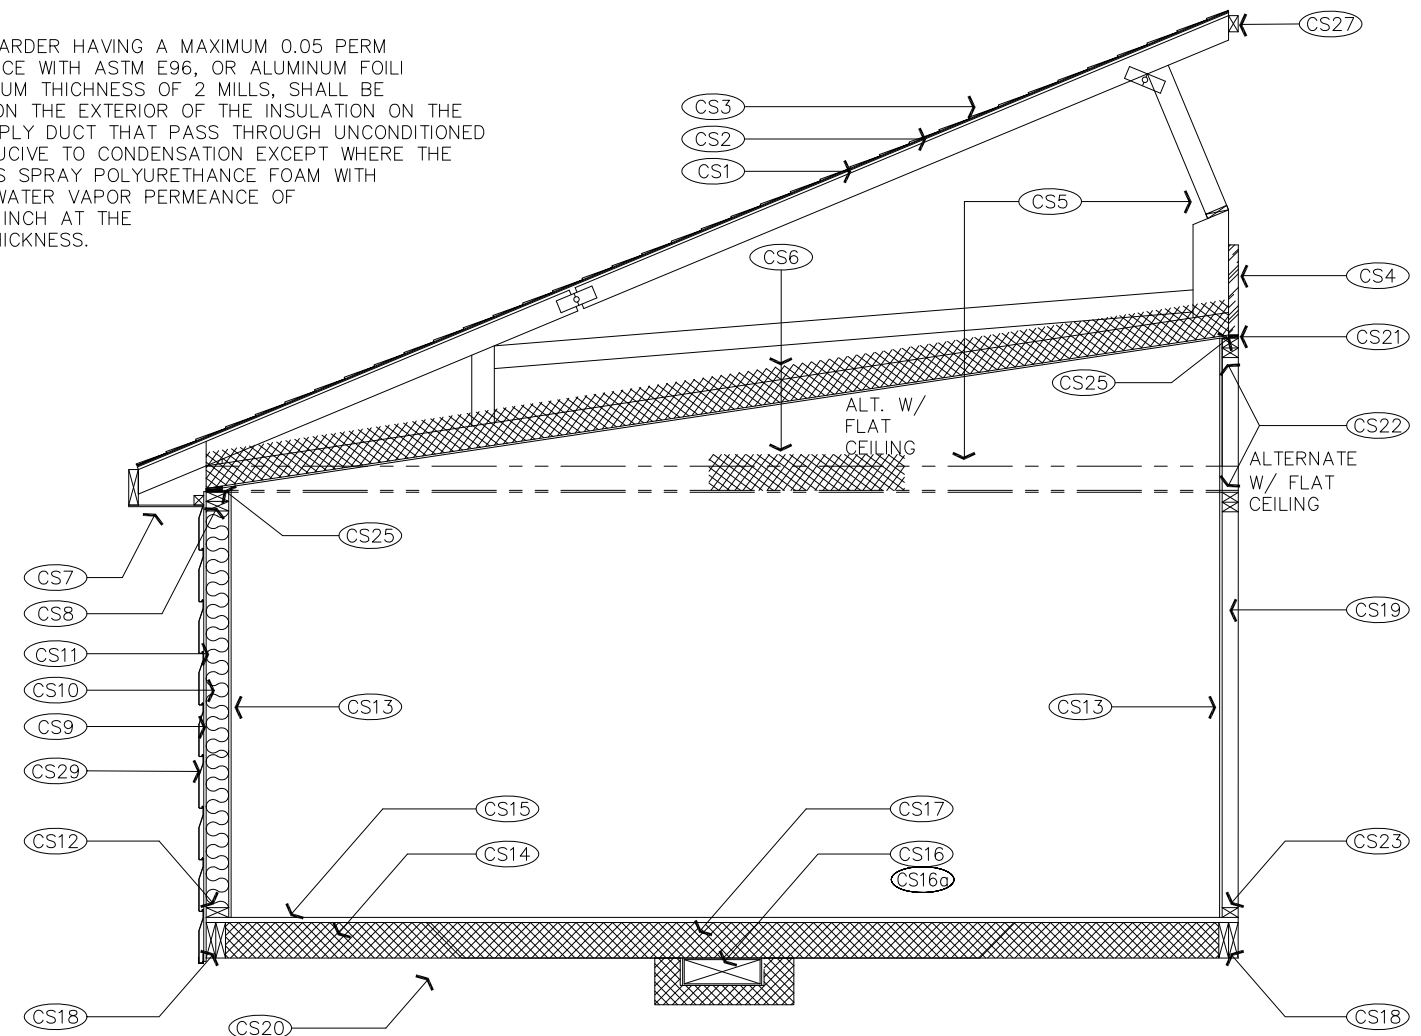

<b>CMH</b> MANUFACTURING, INC	<b>TYPICAL CROSS SECTION &amp;                  FASTENING SCHEDULE</b>		BRAND:	SERIES:	MODEL NO.:
				NC/SC/DE MODULAR	ALL
			PLANT:	DESCRIPTION:	
			#958	OFF FRAME HINGED ROOF	
DRAWN BY:	DATE DRAWN:	DATE PRINTED:	SHEET:		
DRR	10-21-15	4-25-17	1-0.2		

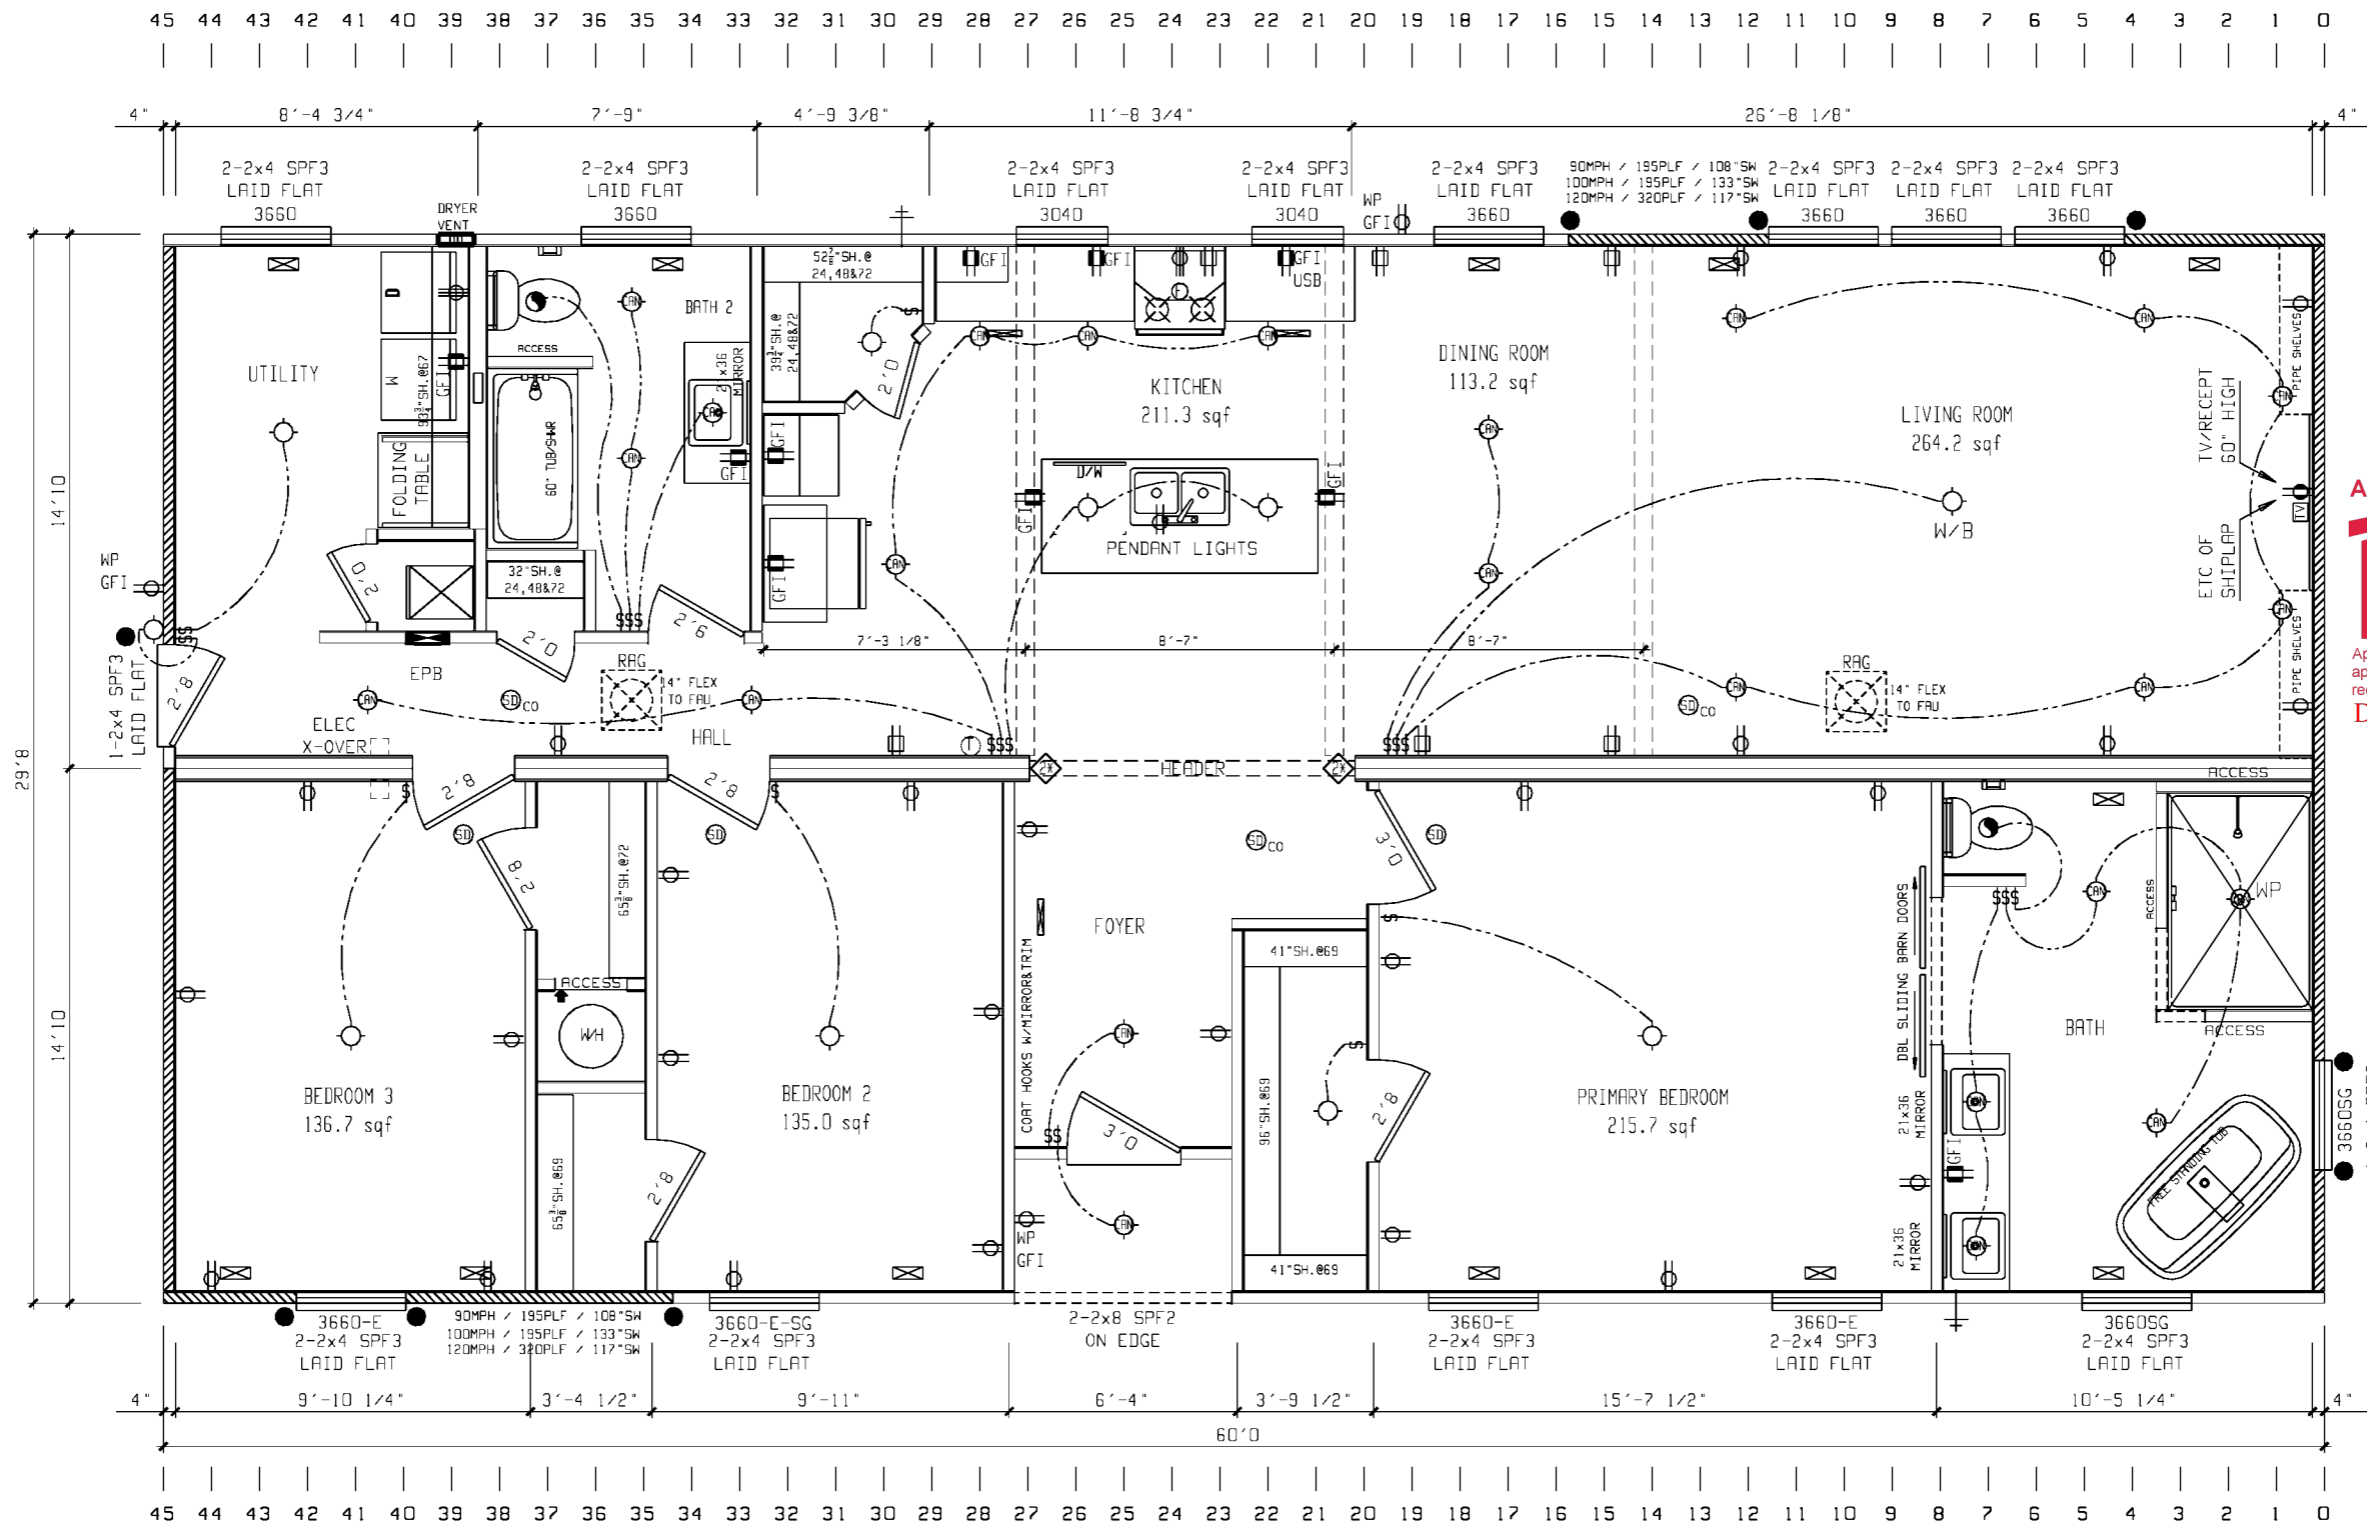

APPROVED BY  
**NIA**  
 8/16/2021  
 Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
 David Richter

195PLF EFFECTIVE LENGTHS  
 244"EW/108"SW  
 BASED ON SW-31.10, .N.C.17, .78.1-2  
 ENGINEERED METHOD,  
 UNBLOCKED DIAPHRAGM SW-20-237B.1  
 90 MPH WIND SPEED

195PLF EFFECTIVE LENGTHS  
 301"EW/133"SW  
 BASED ON SW-31.10, .N.E.17, .78.1-2  
 ENGINEERED METHOD,  
 UNBLOCKED DIAPHRAGM SW-20-237B.1  
 100 MPH WIND SPEED

320PLF EFFECTIVE LENGTHS  
 273"EW/117"SW  
 BASED ON SW-31.10, .N.I.17, .78.1-2  
 ENGINEERED METHOD,  
 UNBLOCKED DIAPHRAGM SW-20-389B.1  
 120 MPH WIND SPEED

RIDGE BEAM PER: RC-60.3.R.K.M. .20  
 COLUMNS PER: MW-20.3.R.K.M.48.20-1  
 2x4 SIDEWALL HEADERS PER:  
 EW-20.3.R.K.C.22.20 (90MPH)  
 EW-20.3.R.K.E.22.20 (100MPH)  
 EW-20.3.R.K.I.22.20 (120MPH)

INSULATION DONE PER THE NORTH CAROLINA  
 2018 PRESCRIPTIVE METHOD  
 CZ3: R=38 CEILING R=15 WALLS R=22 FLOOR  
 CZ4: R=38 CEILING R=15 WALLS R=22 FLOOR  
 CZ5: R=38 CEILING R=19 WALLS R=30 FLOOR  
 U = 0.35 / SHGC = 0.28

RETURN AIR REQUIREMENTS		● INDICATES FREE END SHEAR WITH BLOCKING
① 20"x16" GRILL REQUIRED	④ 4"x24" OR 6"x14" GRILL REQUIRED	
② 4"x10" GRILL W/ 2 1/2" DOOR UNDERCUT		
③ DOOR(S) MUST BE UNDERCUT 2 1/2" MIN.		

BRAND	SCHULT	SERIES	CL32
<b>CLAYTON HOME BUILDING GROUP</b>			

REVISIONS	BY	DATE


GENERAL NOTES
CEILING HEIGHT = 108.0

DRAWING TITLE	<b>PRIMARY PLAN-NC</b>
---------------	------------------------

MODEL NAME	3452	SO. FT.	1756
PLANT	958	DESCRIPTION	32X60 3BR-2BA
MODEL NO.	3452	DRAWN BY	GCK
ORIG. DATE	08/11/2021	DATE PRINTED	08/16/2021
SHEET NO.	1-1		

B-SECTION HITCH END



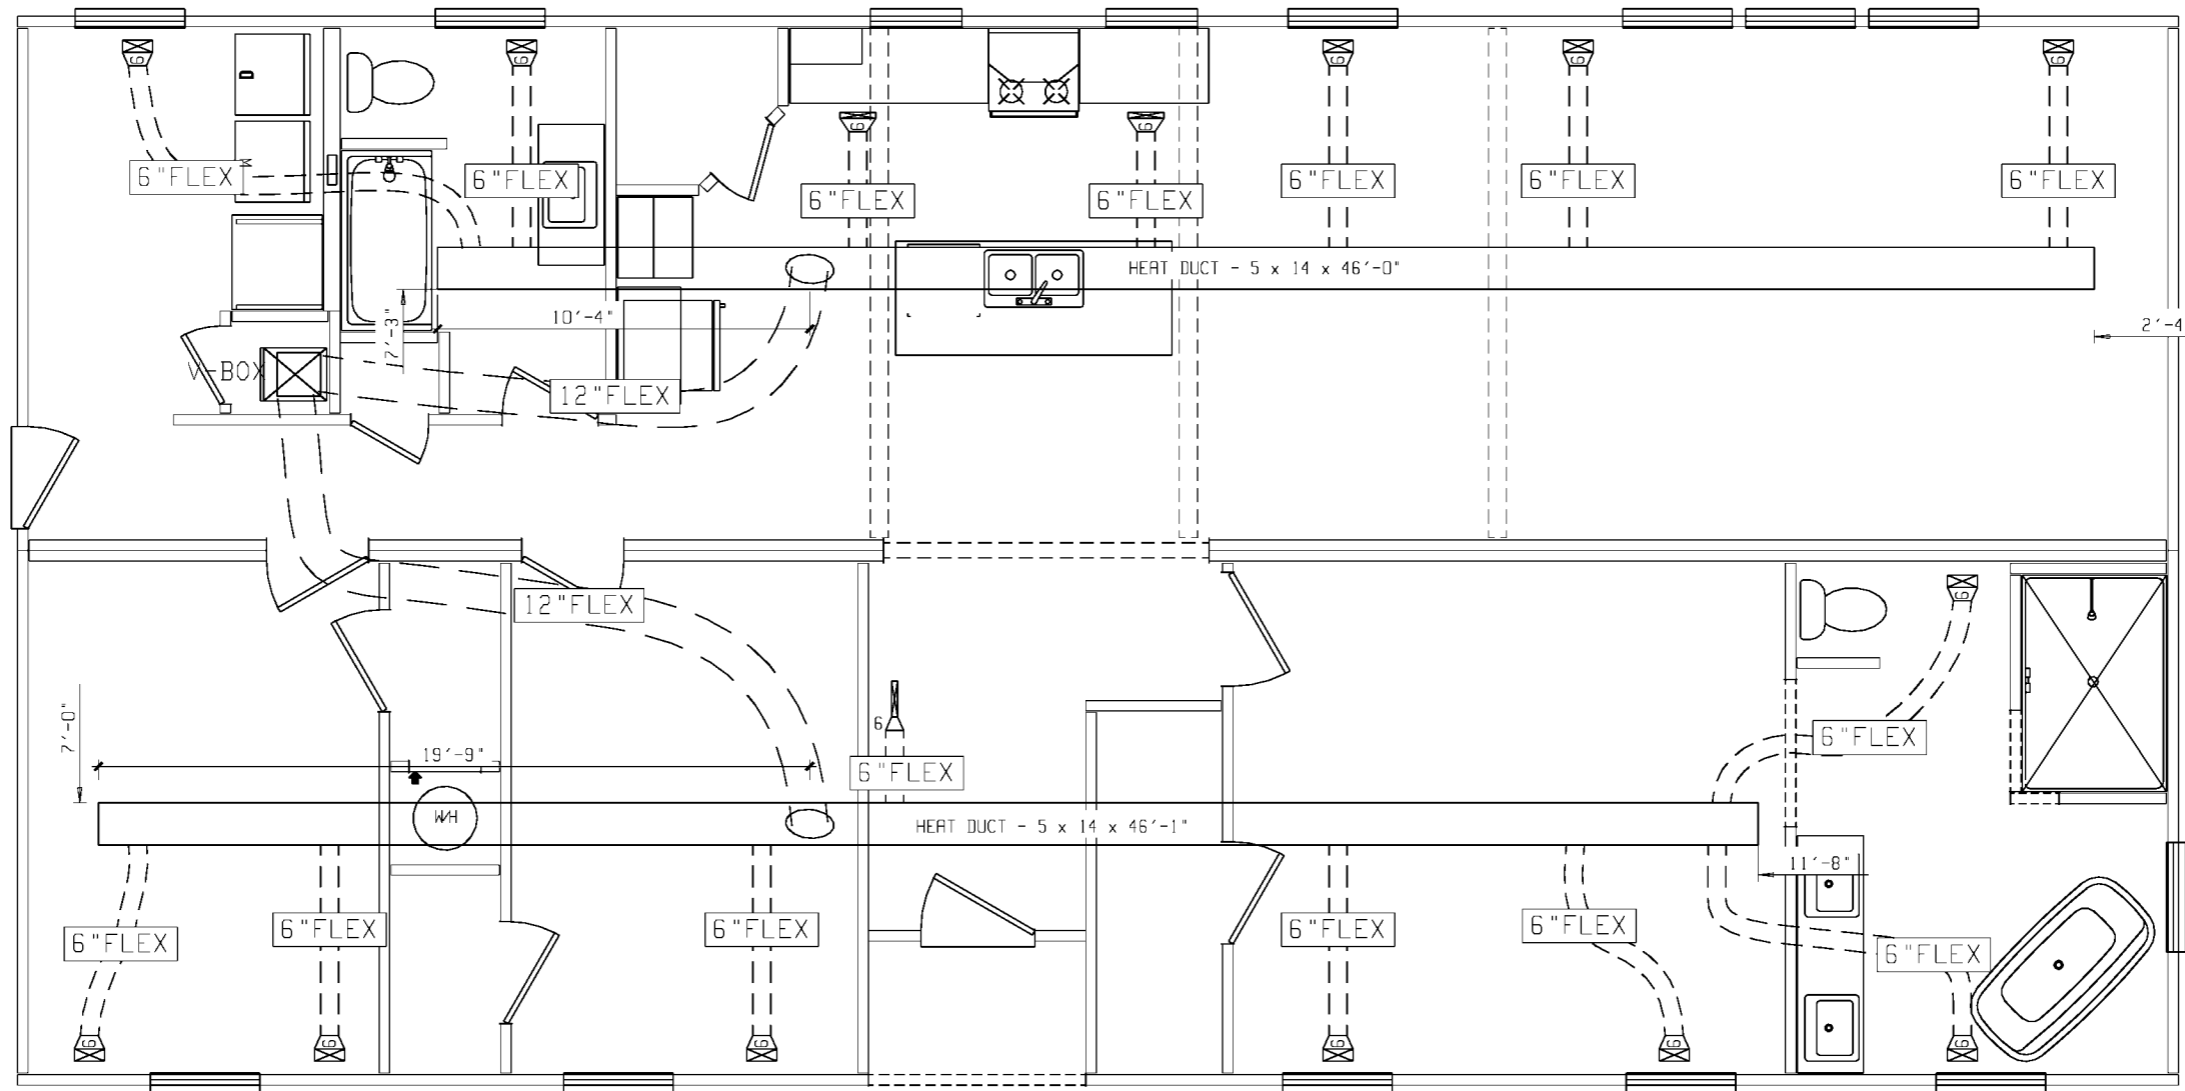

R-SECTION HITCH END

B-SECTION HITCH END

APPROVED BY  
**NIA** 8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
**David Richter**

BRAND SCHULT SERIES CL32  
**CLAYTON HOME BUILDING GROUP**

REVISIONS	BY	DATE

GENERAL NOTES

DRAWING TITLE  
**PERIMETER LOOP HVAC**


MODEL NAME		3452		SO. FT.	1756
PLANT	DESCRIPTION	MODEL NO.		3452	
958	32X60 3BR-2BA	3452			
DRAWN BY	ORIG. DATE	DATE PRINTED	SHEET NO.		
GCK	08/11/2021	08/16/2021	4-4		

\*NOTE\*  
 DASHED LINES REPRESENT BELOW  
 FLOOR DWV PIPE TO BE FIELD INSTALLED  
 BY OTHERS.  
 BUILDER IS RESPONSIBLE TO  
 ASSURE THAT FINAL SYSTEM  
 CONFORMS TO ALL APPLICABLE CODES.

PIPING AND FITTING MATERIAL TYPE TO BE:  
 ABS (ACRYLONITRILE-BUTADIENE-STYRENE)  
 OR PVC (POLYVINYL CHLORIDE)

PIPE LEGEND

=====	1 1/2"
=====	2"
=====	3"
A	13"
D	5
E	2
F	3
FF	1
M	2
N	1
O	2
P	1
PP	1
Q	4
Q, J	1
U	1
W, I	1
X	1
Z	1
1.5" PIPE	20 FT
2" PIPE	10 FT
3" PIPE	85 FT

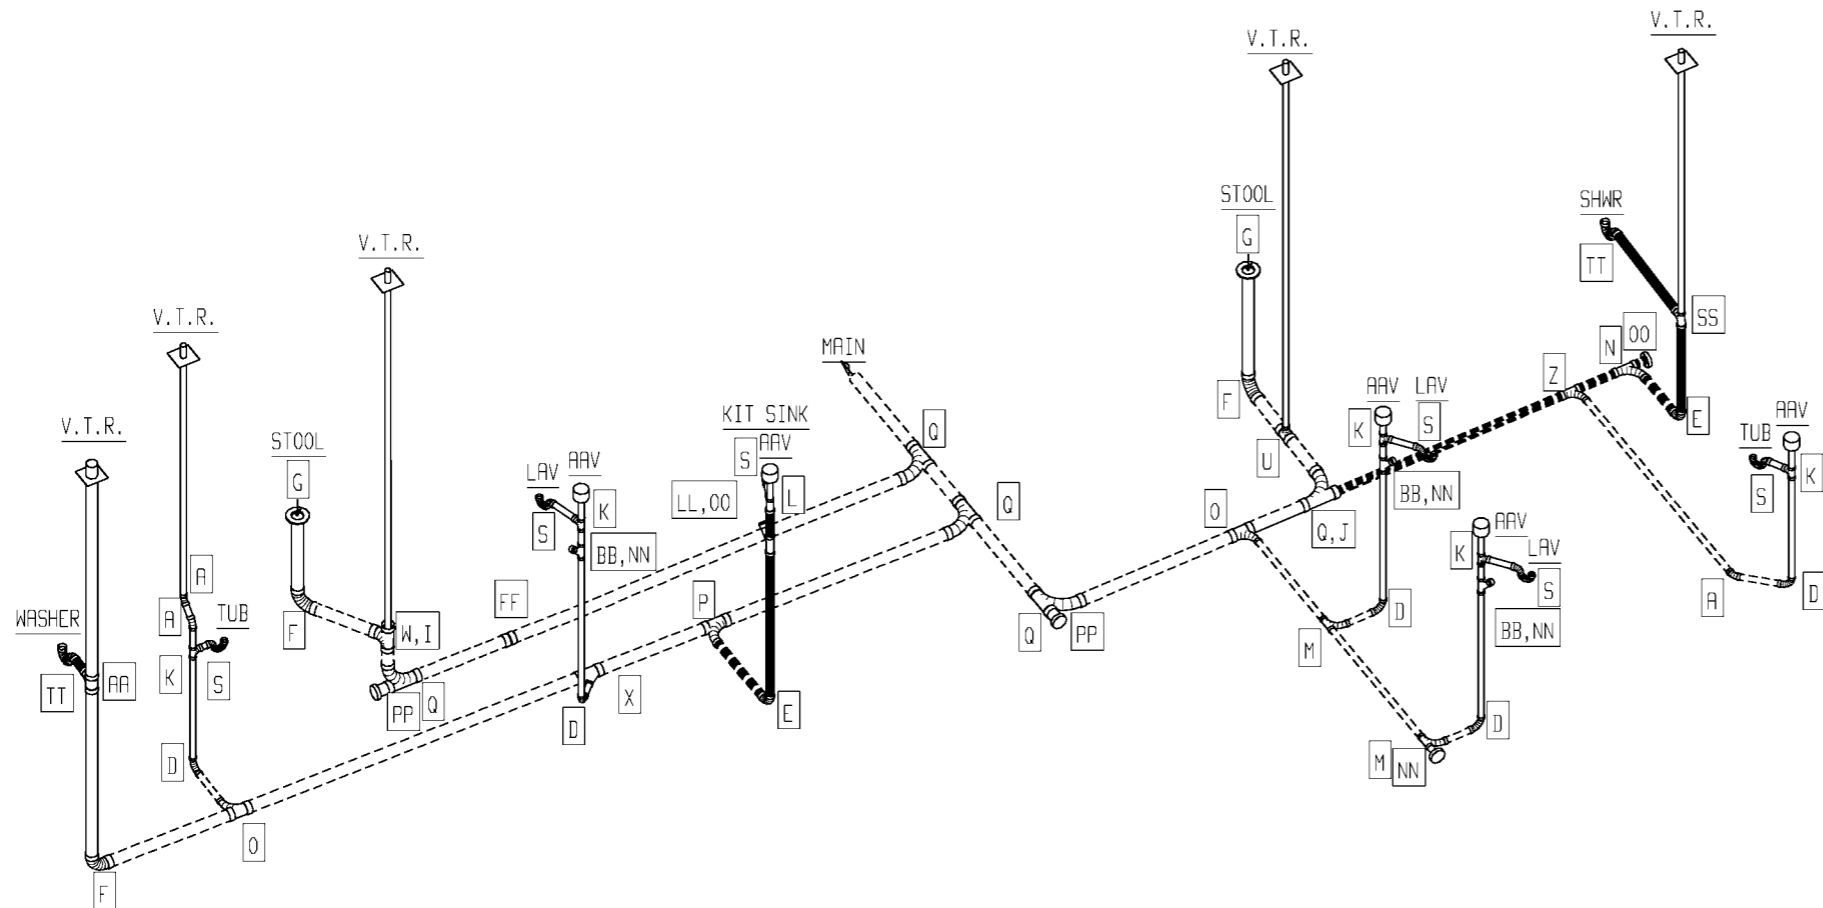


NOTE:  
 ACCESS SHALL BE PROVIDED TO ALL AIR ADMITTANCE VALVES. THE VALVE SHALL  
 BE LOCATED WITHIN A VENTILATED SPACE THAT ALLOWS AIR TO ENTER THE VALVE

APPROVED BY  
**NIA**  
 8/16/2021  
 Approval of this document does not authorize or  
 approve any deviation or deviations from the  
 requirements of applicable State Laws.  
 David Richter


LET	DESCRIPTION	LET	DESCRIPTION	LET	DESCRIPTION	LET	DESCRIPTION
A	1.5" x 45° LT-1/8 BEND	B	2" x 45° LT-1/8 BEND	C	3" x 45° LT-1/8 BEND	D	1.5" x 90° LONG SWEEP-1/4 BEND
E	2" x 90° LSWEPT-1/4 BEND	F	3" x 90° LSWEPT-1/4 BEND	G	4" x 3" CLOSET FLANGE	H	2" x 1.5" FLUSH BUSHING
I	3" x 1.5" FLUSH BUSHING	J	3" x 2" FLUSH BUSHING	K	1.5" SANITARY TEE	L	2" x 1.5" x 1.5" SAN TEE
M	1.5" LTTY	N	2" LTTY	O	3" x 3" x 1.5" LTTY	P	3" x 3" x 2" LTTY
Q	3" LTTY	R	3" 3-WAY ELBOW	S	1.5" x 1.5" P-TRAP	T	3" x 3" x 1.5" x 1.5" DBL SAN TEE
U	3" x 3" x 1.5" SAN TEE	V	1.5" x 90° LONG SWEEP STREET	W	3" SANITARY TEE	X	3" x 3" x 1.5" WYE
Y	2" 3-WAY ELBOW	Z	2" x 2" x 1.5" LTTY	AA	3" x 3" x 2" SAN TEE	AB	1.5" x 45° WYE
CC	2" x 90° LSWEPT STREET	DD	1.5" x 45° 1/8 BEND STREET	EE	1.5" COUPLING	FF	3" COUPLING
GG	1.5" P-TRAP @ WASHER	HH	1.5" SAN TEE STREET	II	2" x 1.5" x 1.5" LTTY	JJ	2" x 1.5" x 2" LTTY
KK	2" x 1/4 BEND STREET	LL	2" x 45° WYE	MM	3" DBL SAN TEE	NN	1.5" C.O. W/PLUG
OO	2" C.O. W/PLUG	PP	3" C.O. W/PLUG	QQ	2" x 2" x 1.5" WYE REDUCING	RR	1.5" 1/4 BEND
SS	2" x 1.5" x 2" SAN TEE	TT	2" P-TRAP	UU	2" x 45° 1/8 BEND STREET	VV	2" COUPLING
WW	3" x 45° 1/8 BEND STREET	XX	2" SANITARY TEE	YY	4" CLOSET FLANGE	ZZ	4" COUPLING
AB	1.5" CONT WASTE	AC	1.5" x 22 1/2" ELBOW STREET	AD	2" x 22 1/2" ELBOW STREET	AE	3" x 3" x 2" x 2" DBL SAN TEE
AF	2" x 1.5" x 1.5" SAN TEE STREET	AG	2" x 1.5" x 1.5" 3-WAY ELBOW	AH	3" x 22 1/2" 1/16 BEND ELBOW	AI	1.5" 3-WAY ELBOW
AJ	2" x 22 1/2" 1/16 BEND ELBOW	AK	4" x 3" CLOSET BEND STR (CUT DOWN 1.5")	AL	3" x 3" x 3" WYE	AM	3" 1/4 BEND
AN	2" x 3" PIPE INCREASER	AO	3" x 3" x 2" WYE	AP	2" 1/4 BEND	AQ	2" x 2" x 2" x 2" DBL SAN TEE
AR	1.5" x 3" PIPE INCREASER	AS	1.5" x 1.5" x 1.5" x 1.5" DBL SAN TEE	AT	3" DOUBLE FIXTURE TEE	AU	2" x 2" x 1.5" x 1.5" DBL SAN TEE
AV	3" x 3" x 2" x 2" SAN TEE (SI) LEFT	AW	3" x 3" x 3" x 1.5" SAN TEE (SI) LEFT	AX	3" x 3" x 3" x 2" SAN TEE (SI) LEFT	AY	3" x 3" x 2" x 2" SAN TEE (SI) RIGHT
AZ	3" x 3" x 3" x 1.5" SAN TEE (SI) RIGHT	BA	3" x 3" x 3" x 2" SAN TEE (SI) RIGHT	BC	3" x 3" x 3" x 2" SAN TEE DBL(SI)	BD	3" x 3" x 3" x 1.5" x 1.5" SAN T DBL(SI)
BE	1.5" x 2" PIPE INCREASER	BF	3" x 3" x 1.5" 90° LSWEPT LOW HEEL INLET	BG	3" x 3" x 2" 90° LSWEPT LOW HEEL INLET	BH	1.5" x 22 1/2" 1/16 BEND ELBOW
BI	4" x 3" CLOSET BEND STREET	BJ		BK		BL	

BRAND SCHULT	SERIES CL32	REVISIONS	BY	DATE	GENERAL NOTES	DRAWING TITLE <b>DWV SCHEMATIC</b>	MODEL NAME 3452	SO. FT. 1756
CLAYTON HOME BUILDING GROUP							PLANT 958	DESCRIPTION 32X60 3BR-2BA
							MODEL NO. 3452	
							DRAWN BY GCK	ORIG. DATE 08/11/2021
							DATE PRINTED 08/16/2021	SHEET NO. 8-1

PIPING AND FITTING MATERIAL TYPE TO BE:  
 PEX TYPE BY QUEST, CPVC OR COPPER  
 PRESSURE RANGE 50-60 PSI  
 60' DEVELOPED LENGTH

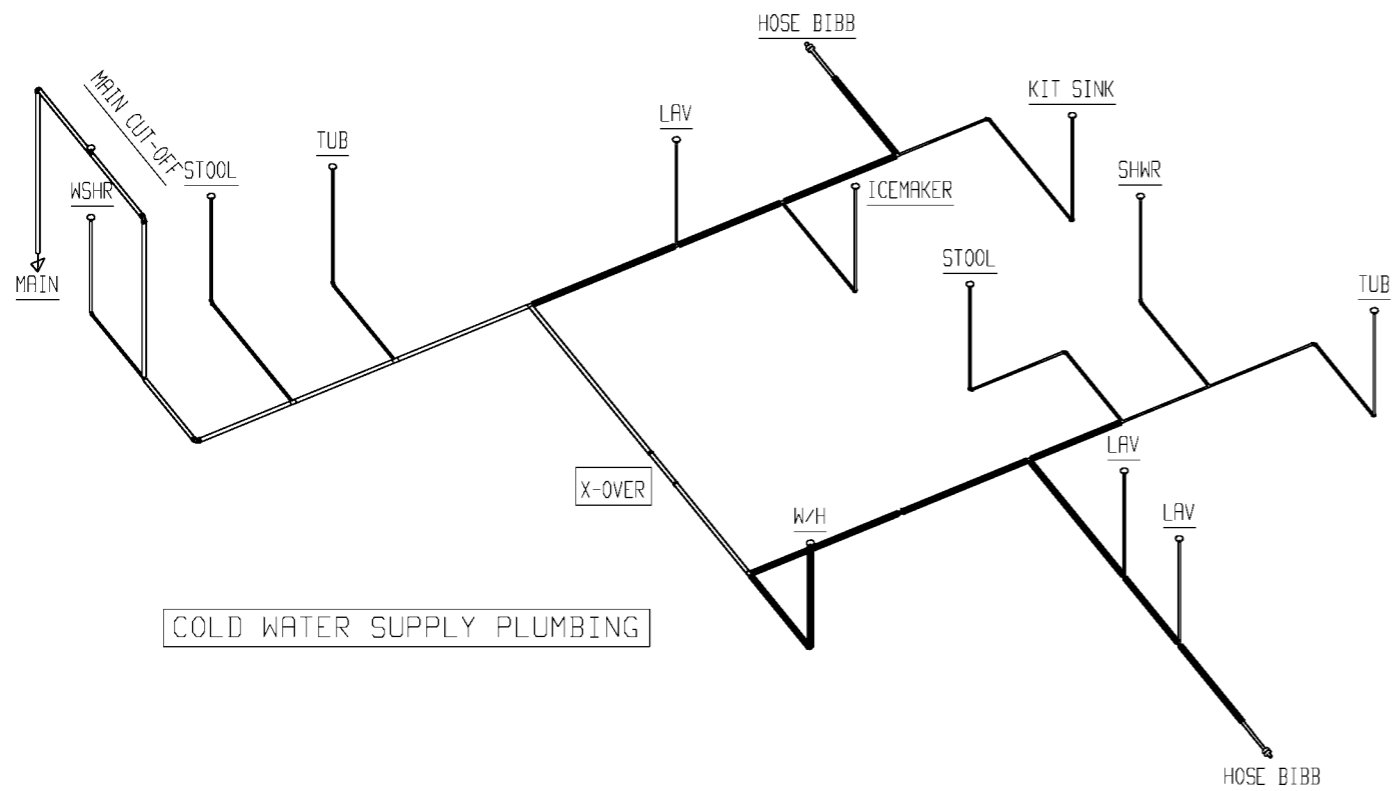

COLD WATER SUPPLY PLUMBING

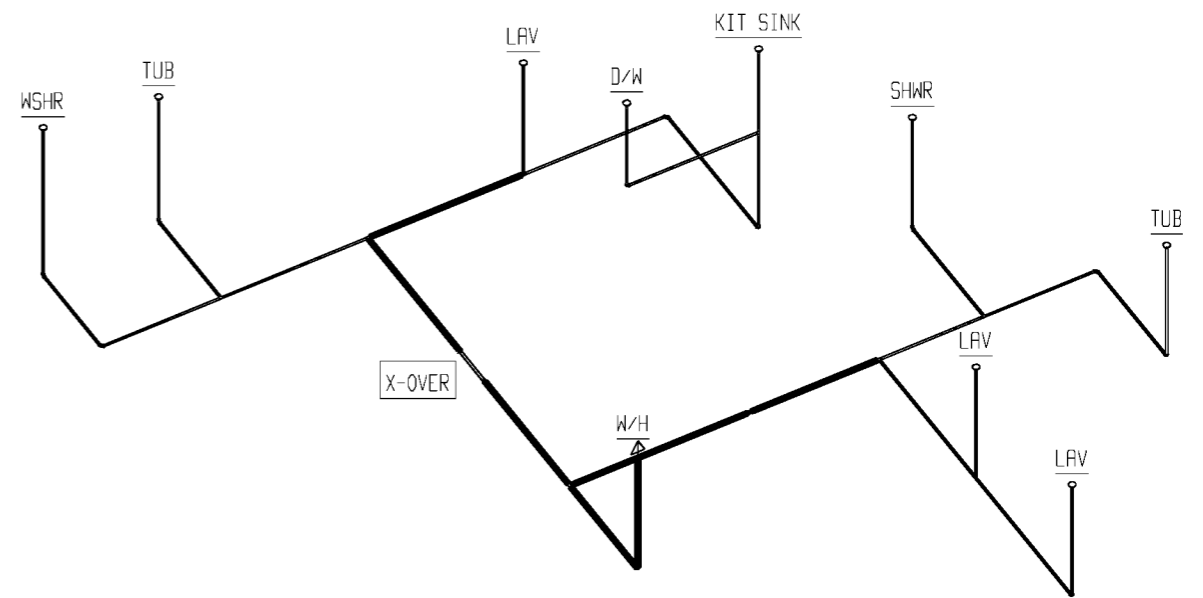

HOT WATER SUPPLY PLUMBING

APPROVED BY  
**NIA** 8/16/2021  
 Approval of this document does not authorize or  
 approve any deviation or deviations from the  
 requirements of applicable State Laws.  
 David Richter


PIPE LEGEND	
1"	
3/4"	
1/2"	

BRAND SO. FT. SCHULT	SERIES CL32	REVISIONS	BY	DATE	GENERAL NOTES HOSE BIBBS PER SPECS	DRAWING TITLE <b>SUPPLY PLUMBING</b>	MODEL NAME 3452	SO. FT. 1756		
<b>CLAYTON HOME BUILDING GROUP</b>							PLANT 958	DESCRIPTION 32X60 3BR-2BA	MODEL NO. 3452	
							DRAWN BY GCK	ORIG. DATE 08/11/2021	DATE PRINTED 08/16/2021	SHEET NO. 9-1

1756 SQ. FT. ATTIC AREA  
 854 SQ. IN. REQUIRED  
 VENTED SOFFIT - 7.38 SQ. IN. VENT/FT  
 54 FT RIDGE CAP/VENT-18.00 SQ. IN. VENT/FT  
 885 SQ. IN. PROVIDED FOR SOFFIT  
 972 SQ. IN. PROVIDED FOR RIDGE VENT


33'-4"

VINYL LAP SIDING/SHINGLE ROOF

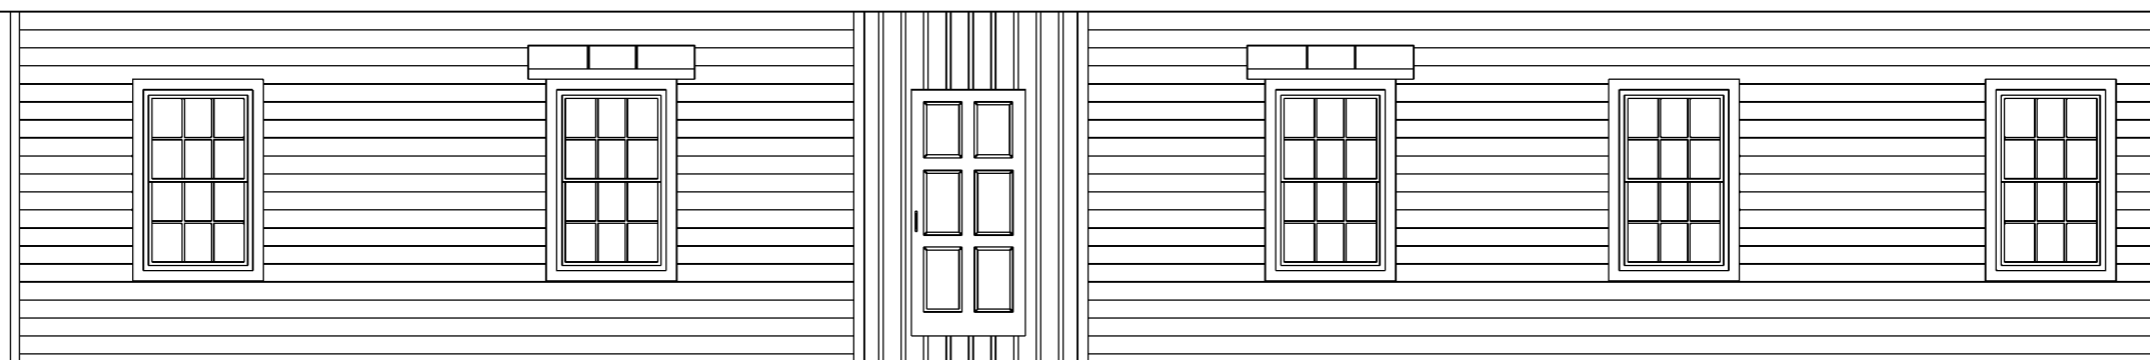

2 COLUMNS W/BOARD AND BATTEN BETWEEN

FRONT ELEVATION

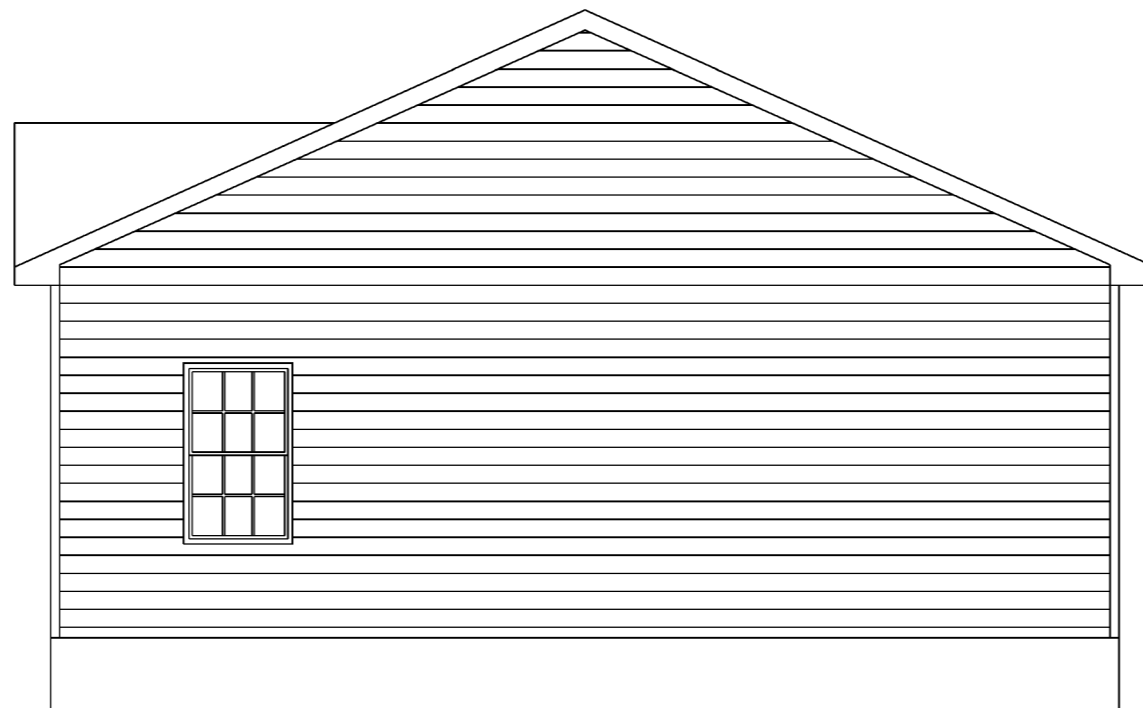

RIGHT SIDE ELEVATION

APPROVED BY



8/16/2021


Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

BRAND SCHULT	SERIES CL32	REVISIONS	BY	DATE	GENERAL NOTES	DRAWING TITLE <b>EXTERIOR ELEVATION FRONT &amp; RIGHT SIDE</b>	MODEL NAME 3452	SO. FT. 1756		
CLAYTON HOME BUILDING GROUP							PLANT 958	DESCRIPTION 32X60 3BR-2BA	MODEL NO. 3452	
							DRAWN BY GCK	ORIG. DATE 08/11/2021	DATE PRINTED 08/16/2021	SHEET NO. 20-1



**IMPORTANT:**  
 THIS FOUNDATION DRAWING IS MODEL SPECIFIC AND ILLUSTRATES THE BASIC LAYOUT ONLY.  
 FOR FOUNDATION CONSTRUCTION, FASTENING AND SECUREMENT DETAILS YOU MUST REFER  
 TO THE ATTACHED FOUNDATION MANUAL INCLUDED WITH THIS HOME.

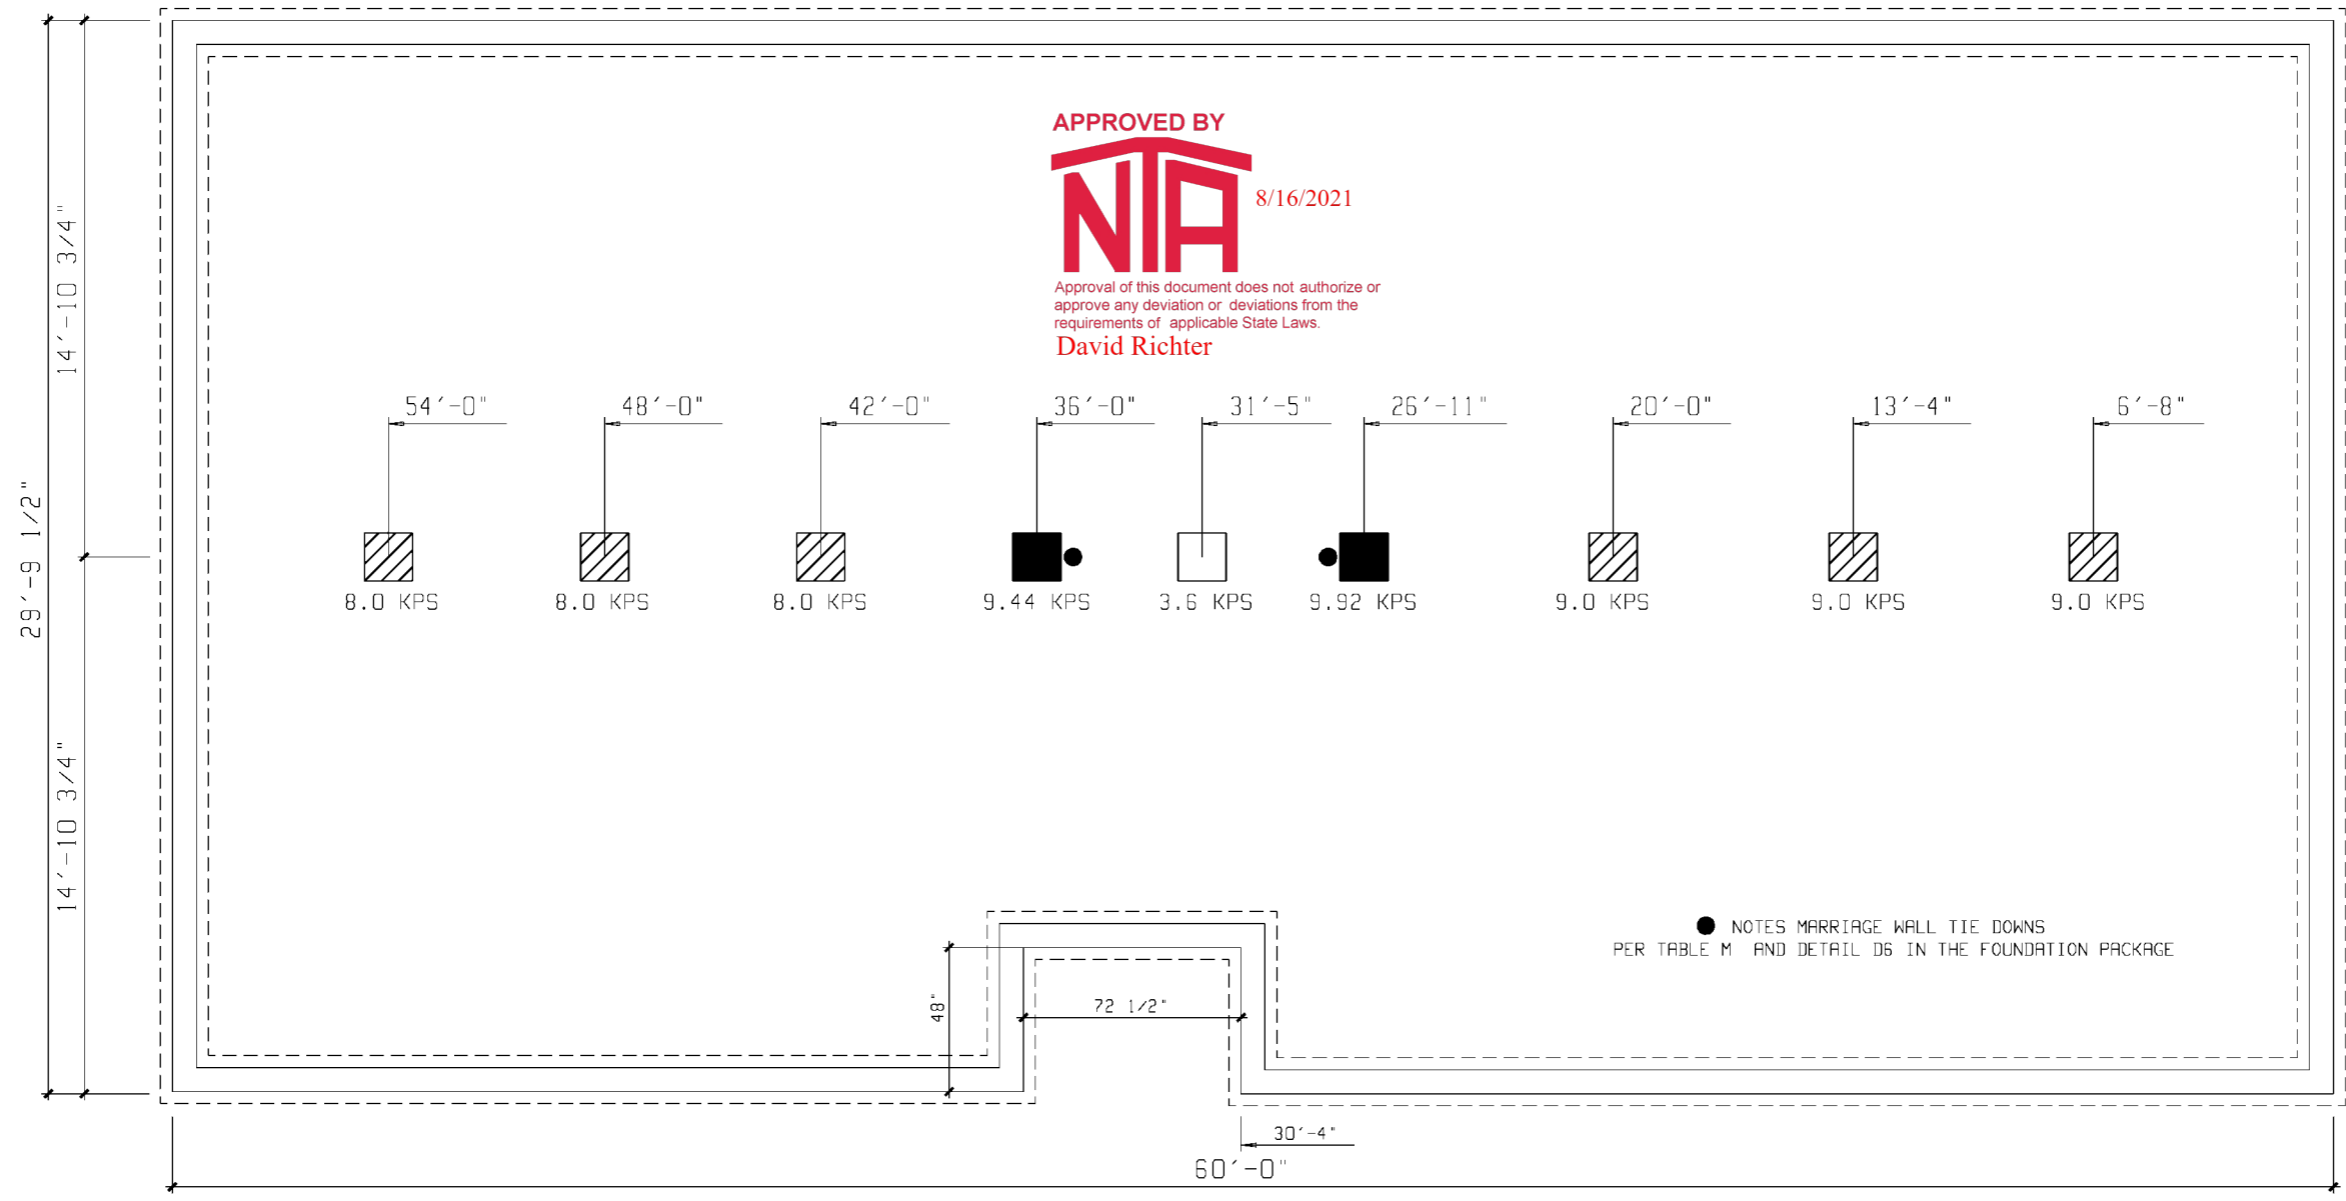

NOTE: THE OVERALL FOUNDATION WIDTH SHOWN IS 1 1/2" LARGER THAN THE ACTUAL FLOOR WIDTH TO COMPENSATE FOR PRODUCTION AND ASSEMBLY TOLERANCES.

PIER LEGEND	
	= SUPPORT AT MATING COLUMN
	= SUPPORT UNDER MATING WALL
	= SUPPORT UNDER MATING OPENING
	= SUPPORT AT PORCH/RECESSED ENTRY
	= SUPPORT UNDER MAIN I-BEAM
	= SUPPORT UNDER PERIMETER WALL
	= SUPPORT AT CROSS I-BEAM BASEMENT

<b>CRAWLSPACE VENTILATION</b> VENTILATION IS BASED ON 144 SQ. IN. OF VENT FOR EVERY 150 SQ. FT. OF CRAWLSPACE AREA WITH APPROVED VAPOR RETARDER MATERIAL. ONE SUCH VENT MUST BE WITHIN 3 FT. OF EACH CORNER		1756 SQ. FT. OF CRAWLSPACE AREA 1709 SQ. IN. OF VENT REQUIRED 33 VENTS NEEDED @ 52 SQ. IN. EACH 1716 SQ. IN. VENTILATION INSTALLED MINIMUM		<b>CRAWL SPACE</b> 18" MIN CLEARANCE BELOW BOTTOM OF FLOOR JOIST. GROUND TO BE COVERED WITH APPROVED VAPOR RETARDER MATERIAL.		INSTALL SWITCHED LIGHT AND GFCI RECEPT AT CRAWL SPACE ENTRANCE FOR SERVICE OF MECHANICAL EQUIPMENT PER NEC - 210-70 (C)		NOTE: MASONRY UNITS FOR STAND ALONE PIERS SHALL BE LAID IN TYPE "M" OR "S" MORTAR OR SHALL BE COVERED WITH SURFACE BONDING CEMENT COMPLYING WITH ASTM C 887 WHEN ACCEPTABLE TO LOCAL BUILDING AUTHORITY. SURFACE BONDING CEMENT SHALL BE APPLIED IN STRICT COMPLIANCE OF MANUFACTURERS INSTRUCTIONS. BOTTOM COURSE SHALL BE LAID IN TYPES "M" OR "S" MORTAR OR BONDING MORTAR (CEMENT).		MODEL NAME 3452		SQ. FT. 1756	
BRAND SCHULT	SERIES CL32	REVISIONS		BY	DATE	GENERAL NOTES SEE INSTALLATION MANUAL FOR FOUNDATION GENERAL NOTES & TIE-DOWN REQUIREMENTS		DRAWING TITLE 20130 PSF FOUNDATION		PLANT 958	DESCRIPTION 32X60 3BR-2BA	MODEL NO. 3452	SHEET NO. 21-30PSF
CLAYTON HOME BUILDING GROUP										DRAWN BY GCK	ORIG. DATE 08/11/2021	DATE PRINTED 08/16/2021	

**OFF FRAME BASEMENT & CRAWL FOUNDATION DESIGN FOR:**  
29' - 8 " 2-SECTION MODULAR  
1 STORY- W.O ATTIC

Attic without storage where the maximum clear height between joist and rafter is less than 42 inches or req'd insulation depth exceeds the depth of the bottom chord.

**PERIMETER ANCHORED SYSTEM- BUILDING IS SECURED TO FOUNDATION WALLS TO SUPPORT WIND AND SEISMIC FORCES.**

**SIDEWALLS ARE SUPPORTED (PERIMETER BLOCKED)**

**BUILDING CODE INFORMATION:**

IRC (2015)

ASCE 7-10

2018 NORTH CAROLINA RESIDENTIAL CODE

**BUILDING SITE INFORMATION:**

\*MAXIMUM ULTIMATE/DESIGN WIND SPEED & EXPOSURE: 117/ 90 MPH EXPOSURE C-enclosed

MINIMUM SOIL BEARING CAPACITY: 1500 PSF

MAXIMUM GROUND SNOW(S): 20 PSF, 30 PSF

Flat roof snow load (Pg)=20.0 PSF ,23.1 PSF

SEISMIC DESIGN CATEGORY: C

DESIGN SPECTRAL RESPONSE ( $S_{DS}$ ): 0.49

SEISMIC SOIL SITE CLASS: D

**HOME INFORMATION:**

UNIT WIDTH: 29' - 8 "

MAX. UNIT LENGTH: 76 ft.

ROOF PITCH: 6/12 to 6/12

DESIGN LOADS: 40 PSF FL. LL., 7PSF T.C.D.L., 8PSF B.C.

D.L., 13PSF FL. DL. &, 10PSF B.C.L.L

MAX. SIDEWALL HEIGHT: 108 INCHES

TOTAL MATING WALL RIM JOIST BEAMS: (4) 2X10 #2 SPF

RIM JOIST SPLICES: 6" X 8" MiTek MT20 metal plates each side

**OFF FRAME FLOOR**

PLANT NUMBER: 958

*\* Ultimate wind speed Vult. Per ASCE 7-10/ allowable stress design wind speed Vasd. All wind speeds are indicated as (Vasd) design speeds unless otherwise indicated.*

This design is the property of CMH Manufacturing and cannot be used without authorization. This design is exclusively for use with new homes built by CMH Manufacturing. Use with homes built by other companies is strictly prohibited.

FILENAME:958I-14.R.J.C.22.22.210( )

Page 1 of 29



program version: 19.9

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

PAGE DESCRIPTION	DETAIL	PAGE #
COVER		1
TABLE OF CONTENTS		2
PREFACE		3
INSTRUCTIONS		4
GENERAL NOTES		5
SOIL CLASSIFICATION (TABLE R405.1)		8
FOUNDATION WALL DESIGN		9
UNBALANCED FOUNDATIONS TABLE L	TABLE L	10
PIER AND FOOTER DESIGN TABLE M	TABLE M	11
MIN. POST CAPACITY AND FOOTER DESIGN TABLE N	TABLE N	12
PORCH AND RECESS SUPPORT AND ANCHORAGE	TABLE P	13
KEY PLAN 7 - OFF-FRAME BASEMENT	KEY 7	14
KEY PLAN 8 - OFF-FRAME CRAWL PLAN	KEY 8	15
NON-REINFORCED PERIMETER WALL - DETAIL D1	D1	16
NON-REINFORCED MATING PIER / CRAWLSPACE ONLY (MORTAR EMBEDDED) - DETAIL D3	D3	17
REINFORCED MATING PIER / BASEMENT OR CRAWLSPACE - DETAIL D5	D5	18
MATING WALL COLUMN TIE DOWN - DETAIL D6	D6	19
ADJUSTABLE STEEL COLUMN POST / BASEMENT OR CRAWLSPACE - DETAIL D7	D7	20
NON-REINFORCED PERIMETER SUPPORT PIER D15	D15	21
SPECIAL HIGH CAPACITY SHEARWALL HOLD-DOWN	D18	22
DOUBLE MUD SILL CONSTRUCTION OPTION.	D34	23
FLOOR TO SILL PLATE FASTENING - DETAIL E	E	24
FLOOR TO SILL PLATE FASTENING - DETAIL F	F	25
FLOOR TO SILL PLATE FASTENING - DETAIL G	G	26
FLOOR TO SILL PLATE FASTENING - DETAIL H	H	27
FLOOR TO SILL & SILL TO FOUNDATION SECUREMENT WITH DETAIL H PLATES		28
FLOOR TO SILL & SILL TO FOUNDATION SECUREMENT WITHOUT DETAIL H PLATES		29

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter





# Preface

This foundation design manual is dedicated to the ever-growing trend to place homes over basements and permanent foundations. CMH Manufacturing, Inc. has attempted to address the more common installation configurations. These may or may not be the only acceptable designs for basements or permanent foundations. If deviations are made from these details, it is the homeowner' s and/or installation contractor' s responsibility to obtain proper documentation and engineer' s details of construction acceptable to the local authority having jurisdictions. CMH Manufacturing, Inc. will not supply any details other than what is contained in the following design manual. If an alternate design is requested it must be provided by an independent engineer subject to local approval. The owner/contractor is responsible for any additional construction details, permits, inspections and fees associated with these items.

Setting a home over a basement or permanent foundation requires special knowledge, experience and equipment to accomplish a safe and proper set. Contractors performing this type of installation must be licensed, bonded and insured to protect all aspects of this type of work.

APPROVED BY  
 8/16/2021  
Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
David Richter

# Instructions

1. Determine site soil classification, (see table R405.1).
2. The provided foundation and anchorage designs are not applicable for the following conditions. In all these cases a complete geotechnical evaluation must be performed and foundation must be designed by a professional engineer in accordance with section 1805.8 (IBC) for site specific conditions.
  - Site contains OL, OH or Pt class soils.
  - Site contains compressible or shifting soils.
  - Site contains expansive soils per IRC (R403.1.8.1) or per local authority and adopted code.
  - Site contains soils which do not provide the minimum allowable soil bearing strength as specified per the provided designs.
  - Foundation walls support unbalanced loads on opposite sides of building, such as a daylight basement or walk out basement where the building aspect ratio, L/W, exceeds the values specified in Table L.
  - Site with soils subject to liquefaction or soil containing high concentration of sulfate.
3. Determine foundation wall height for each wall of foundation. Reference **Detail – D1 or D2** for wall height.
4. Determine height of backfill for each wall of foundation. Reference **Table L** when backfill heights along the foundation wall are unbalanced. Reference **Detail – D1 or D2** for perimeter foundation wall construction.
5. Determine what type of mateline supports will be used. Reference **Detail - D3, D4, D5 or D7** for mateline columns and **Detail – D14** for cross beams.
6. Determine if type H connector plates will be used around the perimeter of the building. Fastening and anchoring tables have been provided with and without the use of the H connectors.
7. Find the **Floor to Sill Plate & Sill Plate to Foundation** table for site soil classification.
8. Find site wall height and backfill height line and follow this line across. Heights are listed as maximums, therefore any line beneath (greater height) may be utilized for items 10 ,11 & 12 below.
9. If type H connectors will be installed the table labeled **With Type H Plate Connectors** can be utilized. Note (6) will specify spacing for H plates along sidewalls and Note (7) will specify spacing for H plates along each endwall.
10. Select desired rim to sill connection from line in table (E, F or G for sidewalls and E or G for endwalls).
11. Select desired anchor type (4 or 5) for sill to foundation wall connection and determine anchor spacing for sidewall and endwall under corresponding column.
12. Determine if shearwall foundation holddowns are required by checking far right column within selected row. See **Shearwall Foundation Holddown Detail (Detail D18)** for connection requirements

The above process may be repeated as desired for different foundation wall and backfill combinations.



## General Notes

1. Foundation plans and details developed by CMH Manufacturing, Inc. are provided to our company owned sales centers and wholesale distribution partners. Alternate foundation systems may be used in lieu of these plans provided they are designed by a local professional Engineer or Architect familiar with the local soil and climate conditions, and are approved by the local authority having jurisdiction.
2. All notes stating "in field" or "by owner" are obligations pertaining to owner/contractor.
3. Owner /Contractor shall provide complete foundation, including footing drains, vapor barrier, sill plate, anchor bolts, stair area, slab and footing reinforcement along with damp proofing, waterproofing, backfill, and all finish work per Chapter 4 of IRC or per adopted local building code.
4. Owner/Contractor shall be responsible for performing all work in accordance with previously approved construction details and obtaining all necessary inspections as required by local or state authorities.
5. Not designed for areas likely to have collapsible, expansive, compressible, shifting, liquifaction, soil containing high concentration of sulfate or other unknown soil characteristics. In these conditions a local engineer must provide foundation design and the building official shall determine whether to require a soil test to determine the soil characteristics. This soil test shall be made by an approved testing agency using an approved method.
6. Pier spacing is dimensioned to centerline unless otherwise noted.
7. The foundation dimensions shown are nominal. An increase in module width should be expected due to module expansion, setting tolerances, etc. The foundation contractor should consult with the manufacturer of the modules prior to construction of the foundation to determine the actual width of the home and placement of anchors.
8. All steel support columns shall have protective coating and a load capacity equal to or greater than specified on foundation plan (k=1000 pounds).
9. All foundation construction materials and installation shall be in accordance with all state and local codes.
10. Backfill shall not be placed against the wall until the wall has sufficient strength and has been anchored to the floor above or has been sufficiently braced to prevent damage by the backfill. Heavy-equipment must be restricted to a minimum distance to the foundation at least equal to the depth of the foundation.
11. Solid cap block or cement fill required at top courses of all masonry piers or pilasters.
12. The foundation design has been designed to be placed in the seismic zone indicated on the cover of this document. Please note that all CMH structures have been designed for seismic (zone/category) A, B, or C only, unless otherwise noted on floor plan and cover page of these instructions.
13. All piers shall be constructed of 8"x8"x16" concrete masonry units conforming to ASTM C90 with a minimum compressive strength of 700 psi. Masonry foundation walls must be laid in type m or s mortar. When required per tables or details, piers of masonry units shall be laid in type m or s mortar. All dry stack masonry should be surfaced bonded with an approved adhesive product.

14. All reinforcing steel shall be Grade 60 minimum. All splices shall be lapped 24" minimum and splices shall be offset 30" minimum within same footer.
15. All concrete grout shall be 3000 psi at 28 days.
16. Reference the model plan drawing for specific foundation layout.
17. Concrete footings shall have a minimum compressive strength of 3000 psi at 28 days. Concrete foundation walls and other concrete exposed to weather shall have a minimum compressive strength of 3000 psi at 28 days and in moderate and severe weather areas the concrete shall be air entrained no less than 5 percent and not more than 7 percent. See table R301.2(1) and R402.2 of IRC
18. All exterior footings shall be placed at least 12" below the undisturbed ground surface. All exterior footings shall extend below the frost line or otherwise frost protected in accordance with Sections R403.1.4.1 through R403.1.4.2 of IRC or per adopted local building code.
19. Top of foundation walls shall extend a minimum of 6-1/2" above finished adjacent grade. Wood framing members, including wood sheathing, that rest on exterior foundation walls and are less than 8" from exposed earth shall be of naturally durable or preservative-treated wood. Wood floor joist shall not be closer than 18" from exposed ground in under floor space.
20. Contractor shall verify all site conditions and dimensions prior to starting foundation. Notify home manufacturer of any discrepancies immediately.
21. The foundation must be designed and built to local codes and ordinances and must be approved and inspected by local building officials.
22. Access shall be to all under floor spaces. Access shall be a minimum of 18" by 24" . If mechanical equipment is installed in this area, please refer to the Mechanical Code for minimum access opening. Through wall access openings shall not be located under an exterior door.
23. Under floor space shall be ventilated with a net area ratio not less than 1 square foot for each 150 square feet of under floor space area placed in accordance with local codes. Ratio may be reduced to 1/1,500 where ground is covered with a 6-mil polyethylene or approved vapor retarder.
24. Field installed wiring in basement is subject to local inspection. Basement smoke alarms must be installed at foot of stairs and interconnected with home smoke alarms and tested on site. Smoke alarms must be located, installed, and tested in conformance with local building requirements.
25. Large clear spans along masonry wall require a column or pier at each end. See model specific foundation plan for required capacity and additional column requirements.
26. Basement stairs (widths, handrails, clearances, headroom, landings, fire protection, etc.) are the responsibility of the owner/contractor and must be constructed to comply with local building codes.
27. Owner/contractor shall not alter basement stair opening without written approval from CMH Manufacturing, Inc.

28. Lighting and receptacles in basement are the responsibility of owner/contractor.
29. Termite protection shall be provided per the building code and local requirements and are responsibility of owner/contractor.
30. Ground snow load is indicated on foundation plans. Snow load must be verified per locality. Building has not been designed to be located within a Tsunami design zone.
31. This structure has not been designed to be located within flood hazard locations or in Coastal A Zones. When site is located in a flood hazard area or in Coastal A Zones as determined by the local authority having jurisdiction or flood hazard maps. The unit shall have lowest floor elevated above the design floor elevation. Foundation and anchorage designs shall be provided by a local engineer in conformance with locally adopted building code and ASCE-24-14.
32. All connection hardware, anchor bolts, straps, hold-downs, washers and fasteners shall be a minimum of ASTM A653 Type G185 zinc coated galvanized or stainless when in contact with pressure treated sill plates or other pressure treated lumber.
33. Radon control, when required by a local jurisdiction, shall be provided and installed by others in accordance with appendix F of the IRC.
34. Topographic wind effects have not been considered. Home has not been designed to be located in areas designated as having local historical data documenting structural damage to buildings caused by wind speed-up at isolated hills, ridges and escarpments.
35. Surface drainage shall be devirted to a storm sewer or other approved collection point. Lots shall be graded to drain surface water away from foundation walls. The grade shall fall a minimum of 6 inches within the first 10 feet.
- 36 A 6-mil-thick polyethylene moisture barrier shall be applied over the porous layer with the basement floor constructed over the polyethylene.
37. Concrete and Masonry Foundation walls that retain earth and enclose interior spaces and floors below grade shall be damp proofed from the top of the footing to the finished grade. Masonry walls shall have not less than 3/8" Portland cement parging applied to the exterior of the wall. The parging shall be damp proofed in accordance with one of the following.
- a. Bituminous coating, b. 3 pound per sq. yard of arcylic modified cement, c. 1/8" coat of surface-bonding cement complying with ASTM C887, d. Material permitted for waterproofing per Section R406.2, e. Other approved methods or materials.
38. Concrete and masonry foundation walls that retain earth and enclose interior spaces and floors below grade in areas of high water table or other severe soil-water conditions shall be waterproofed from the top of the footing to the finished grade in accordance with one of the following:
- a. 2-ply hot-mopped felts, b. 55 pound rolled roofing, c. 6-mil polyvinyl chloride, 6-mil polyethylene, d. 40-mil polymer-modified asphalt., e, 60-mil flexible polymer cement, f. 1/8" cement-based, fiber-reinforced, waterproof coating, g. 60-mil solvent-free liquid-applied synthetic rubber.
39. If building is located within a wind borne debris region glazed openings shall be protected from wind borne debris. Wind Borne debris protection is the responsibility of others.
40. When Geotechnical report is required or available, all recommendations shall be followed and geotechnical engineer shall review all foundation plans to verify applicability with recommendations and engineer shall be present on regular basis during site preparation, fill placement and foundation excavation.
41. Self-closing rated doors shall be installed between garage and house (on-site by other).(R302.5.1)
- 42.Reserved.
43. A 6-mil polyethylene or approved vapor retarder with joints lapped not less than 12 inches shall be placed between the concrete floor slab and the base course or the prepared subgrade.

APPROVED BY  
**NIA**  
8/16/2021  
Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
David Richter

# SOIL CLASSIFICATION

TABLE R405.1 W/ NC admendments						
LATERAL SOIL LOAD	UNIFIED SOIL CLASSIFICATION SYSTEM SYMBOL	SOIL DESCRIPTION	DRAINAGE CHARACTERISTICS <sup>a</sup>	FROST HEAVE POTENTIAL	VOL. CHANGE POTENTIAL EXPANSION <sup>b</sup>	ALLOWABLE SOIL PRESSURE
30 psf LATERAL SOIL LOAD	GW	Well-graded gravels, gravel sand mixtures, little or no fines	Good	Low	Low	5000
	GP	Poorly graded gravel or gravels sand mixtures, little or no fines	Good	Low	Low	5000
	SW	Well-graded gravels, gravelly sands, little or no fines	Good	Low	Low	3000
	SP	Poorly graded sand, or gravelly sands, little or no fines	Good	Low	Low	3000
45 psf LATERAL SOIL LOAD	GM	Silty gravels, gravel-sand-silt mixtures	Good	Medium	Low	3000
	SM	Silty sand, sand-silt mixtures	Good	Medium	Low	3000
	GC	Clayey gravels, gravel-sand-clay mixtures	Medium	Medium	Low	3000
60 psf LATERAL SOIL LOAD	SC	Clayey sands, sand-clay mixture	Medium	Medium	Low	3000
	ML	Inorganic silts and very fine sands, rock flour, silty or clayey fine sands or clayey silts with slight plasticity	Medium	High	Low	2000*
	CL	Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, lean clays	Medium	Medium	Medium to Low	2000*
	CH	Inorganic clays of high plasticity, fat clays	Poor	Medium	High	2000*
	MH	Inorganic silts, micaceous or diatomaceous fine sandy or silty soils, elastic silts	Poor	High	High	2000*
SPECIAL INSPECTION REQUIRED	OL	Organic silts and organic silty clays of low plasticity	Poor	Medium	Medium	SPECIAL INSPECTION REQUIRED
	OL	Organic clays of medium to high plasticity, organic silts	Unsatisfactory	Medium	High	
	Pt	Peat and other highly organic soils	Unsatisfactory	Medium	High	

a. The percolation rate for good drainage is over 4 inches per hour, medium drainage is 2 inches to 4 inches per hour, and poor is less than 2 inches per hour.

b. Soils with low potential expansion typically have a plasticity index (PI) of 0 to 15, soils with a medium potential expansion have a PI of 10 to 35 and soils with a high potential expansion have PI greater than 20.

\* Where the building official determines that in place soils with an allowable bearing capacity of less than 2000 psf are likely to be present at the site, the allowable bearing capacity shall be determined by a soils investigation.

**APPROVED BY**  
  
 8/16/2021  
 Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
**David Richter**

FILENAME:958I-14.R.J.C.22.22.210(L)

**TABLE R404.1.1:IRC (2015) PERIMETER FOUNDATION WALL MINIMUM REQUIREMENTS [Seismic Seismic Zone: Design]**

Max. Wall Height	Maximum Unbalanced Fill*	GW, GP, SW, & SP Soil Class (30 PSF)			GM, GC, SM-SC, & ML Soil Class (45 PSF)			SC, MH, ML-CL, & Inorganic CL Soil Class (60 PSF)		
		Plain Masonry 1 Walls	8" Reinforced Masonry Walls <sup>5,9</sup>	8" Poured Concrete Walls <sup>6,7</sup>	Plain Masonry 1 Walls	8" Reinforced Masonry Walls <sup>5,9</sup>	8" Poured Concrete Walls <sup>6,7</sup>	Plain Masonry 1 Walls	8" Reinforced Masonry Walls <sup>5,9</sup>	8" Poured Concrete Walls <sup>6,7</sup>
0 to 5 feet	4	6 in. solid (3) or 8 in.	-	PC	6 in. solid (3) or 8 in.	-	PC	6 in. solid (3) or 8 in.	-	PC
	5	6 in. solid (3) or 8 in.	-	PC	8 in.	-	PC	10 in.	-	PC
6 feet to 7 feet	4	6 in. solid (3) or 8 in.	#4 @ 48 in. o.c.	PC	8	#4 @ 48 in. o.c.	PC	8	#4 @ 48 in. o.c.	PC
	5	6 in. solid (3) or 8 in.	#4 @ 48 in. o.c.	PC	10 in.	#4 @ 48 in. o.c.	PC	10 in.	#4 @ 48 in. o.c.	PC
	6	10 in.	#4 @ 48 in. o.c.	PC	12 in.	#5 @ 48 in. o.c.	PC	10 in. solid (3)	#5 @ 48 in. o.c.	#5 @ 48 in. o.c.
	7	12 in.	#5 @ 48 in. o.c.	PC	10 in. solid (3)	#6 @ 48 in. o.c.	#5 @ 46 in. o.c.	12 in. solid (3)	#6 @ 40 in. o.c.	#6 @ 48 in. o.c.
8 feet	4	6 in. solid (3) or 8 in.	#4 @ 48 in. o.c.	PC	6 in. solid (3) or 8 in.	#4 @ 48 in. o.c.	PC	8	#4 @ 48 in. o.c.	PC
	5	6 in. solid (3) or 8 in.	#4 @ 48 in. o.c.	PC	10 in.	#4 @ 48 in. o.c.	PC	12 in.	#4 @ 48 in. o.c.	PC
	6	10 in.	#4 @ 48 in. o.c.	PC	12 in.	#5 @ 48 in. o.c.	PC	12 in. solid (3)	#5 @ 48 in. o.c.	#6@32in o.c.
	7	12 in.	#5 @ 48 in. o.c.	PC	12 in. solid (3)	#6 @ 48 in. o.c.	#5 @ 41 in. o.c.	Footnote (4)	#6 @ 40 in. o.c.	#6@32 in. o.c.
9 feet	4	6 in. solid (3) or 8 in.	#4 @ 48 in. o.c.	PC	6 in. solid (3) or 8 in.	#4 @ 48 in. o.c.	PC	8 in.	#4 @ 48 in. o.c.	PC
	5	8 in.	#4 @ 48 in. o.c.	PC	10 in.	#4 @ 48 in. o.c.	PC	12 in.	#5 @ 48 in. o.c.	PC
	6	10 in.	#4 @ 48 in. o.c.	PC	12 in.	#4 @ 48 in. o.c.	PC	12 in. solid (3)	#6 @ 48 in. o.c.	#6@35 in. o.c.
	7	12 in.	#5 @ 48 in. o.c.	PC	12 in. solid (3)	#6 @ 48 in. o.c.	#6@35 in. o.c.	Footnote (4)	#6 @ 40 in. o.c.	#6@32 in. o.c.
	8	12 in. solid (3)	#6 @ 48 in. o.c.	#6@36 in. o.c.	Footnote (4)	#6 @ 40 in. o.c.	#6@32 in. o.c.	Footnote (4)	#6 @ 24 in. o.c.	#6@28 in. o.c.
10 feet	9	Footnote (4)	#6 @ 40 in. o.c.	#6@35 in. o.c.	Footnote (4)	#6 @ 24 in. o.c.	#6@25 in. o.c.	Footnote (4)	#6 @ 16 in. o.c.	#6@24 in. o.c.
	8	NA	#6 @ 48 in. o.c.	#6 @ 35 in. o.c.	NA	#6 @ 32 in. o.c.	#6 @ 29 in. o.c.	NA	#6 @ 24 in. o.c.	#6 @ 21 in. o.c.
	9	NA	#6 @ 40 in. o.c.	#6@34 in. o.c.	NA	#6 @ 24in. o.c.	#6@22 in. o.c.	NA	#6 @ 16 in. o.c.	#6@16 in. o.c.
	10	NA	#6 @ 32 in. o.c.	#6 @ 27 in. o.c.	NA	#6 @ 16 in. o.c.	#6 @ 17 in. o.c.	NA	#6 @ 16 in. o.c.	#6 @ 13 in. o.c.

\*Unbalanced backfill height is the difference in height between the exterior finish grade level and the top of the basement slab or crawl space grade.

Backfill shall be placed only AFTER the home has been anchored to the foundation wall.

(1) - All block must conform to ASTM C90 (700 psi rated) and be laid in a running bond of Type M or S mortar with overlapping pattern .

UngROUTED hollow masonry units are permitted except where otherwise indicated.

(3) - Solid grouted hollow units or solid masonry units.

(4) - Wall construction per reinforced units or design required.

(5) - Vertical reinforcement shall be Grade 60 minimum. The distance from the face of the soil side of the wall to the center of vertical reinforcement shall be at least 5".

(6) - PC = Plain Concrete (Concrete with less reinforcement than minimum for reinforced concrete)

(7) - All reinforcement shall be Grade 60 minimum. The distance from the face of the soil side of the wall to the vertical reinforcement shall be at least 6 1/16", but not more than 6 11/16".

'All information above has been extracted from the 2009 IRC Tables R404.1.1(1), Tables R404.1.1(2) Tables R404.1.2(3)

(8) Reserved

(9) Reserved

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

FILENAME:958I-14.R.J.C.22.22.210(L)

## Maximum Aspect Ratio, L/W for Unbalanced Foundations

Maximum Wall Height	Maximum Unbalanced Fill	SOIL CLASS		
		GW, GP, SW, & SP (30 PSF)	GM, GC, SM-SC, & ML (45 PSF)	SC, MH, ML-CL, & Inorganic CL (60 PSF)
7 feet	4	4.0	4.0	4.0
	5	4.0	3.4	2.6
	6	3.0	2.0	1.5
	7	1.9	1.2	0.9
8 feet	4	4.0	4.0	4.0
	5	4.0	3.9	2.9
	6	3.4	2.3	1.7
	7	2.1	1.4	1.1
	8	1.4	1.0	0.7
9 feet	4	4.0	4.0	4.0
	5	4.0	4.0	3.3
	6	3.8	2.6	1.9
	7	2.4	1.6	1.2
	8	1.6	1.1	0.8
	9	1.1	0.8	0.6

### Instructions:

Where foundation wall support unbalanced load on opposite sides of building such as daylight basement, the building aspect ratio, L/W, shall not exceed the value specified in Table above. R404.1(3)

- 1 - Determine foundation wall height, unbalanced fill depth, and soil class to determine aspect ratio from table above.
- 2 - Multiple "W" times aspect ratio.
- 3 - Result is equal to the maximum allowable building length on the exposed side.

### Example 1 - check sidewall for 26'-8" x 60'-0" home.

Basement Wall Height = 8'-0"

Unbalanced backfill = 7'-0"

Soil Class = SP

Aspect Ratio from Table above = 2.1

26.67 x 2.1 = 56'-0" max. allowable length - **example fails**

Try again using 6'-0" max. unbalanced fill with an aspect ratio of 3.4.

26.67 x 3.4 = 90'-8" max. allowable length - **example passes**

**Max. allowable backfill is 6'-0"**

### Example 2 - check endwall for 26'-8" x 60'-0" home.

Basement Wall Height = 8'-0"

Unbalanced backfill = 7'-0"


Soil Class = SP

Aspect Ratio from Table above = 2.1

60 x 2.1 = 126'-0" max. allowable length - **example passes**

"L" = total overall dimension of the building on the exposed side

"W" = the total overall dimension of the building on the side adjacent to the exposed side

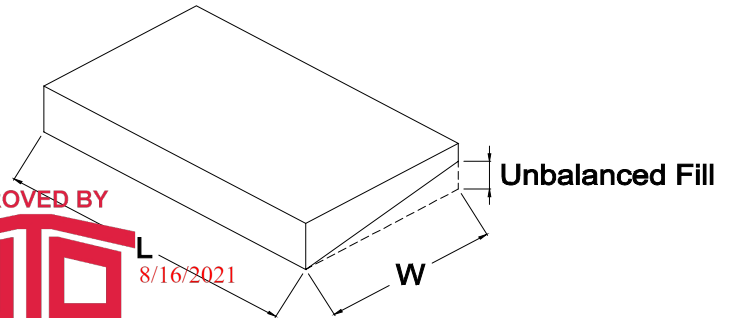

APPROVED BY  
**NIA**  
8/16/2021  
David Richter

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

**Required Rim Joist to Sill Plate Fastening at wall "L".**

Use a 20 Gauge metal angle clip at 24" o.c. with (5) 8d nails per leg or an approved connector supplying 230 pounds per linear foot capacity.

\*Page extracted from 2006 IRC section R404.1.5 & Table R404.1(3)

**Schult**

**UNBALANCED FOUNDATIONS (TABLE L)**

DATE: 3/27/07      FILENAME: 958I-14.R.J.C.22.22.210( )

PAGE #: **Page 10 of 29**



**TABLE M - MINIMUM CONCRETE BLOCK PIER AND FOOTER SIZE**

AT MATING WALL COLUMNS (REF. DETAILS D4 OR D5)						# of Uplift Ties
GROUND SNOW	20	30				
MAXIMUM MATING LINE SPAN BETWEEN MATING WALL COLUMN SUPPORTS	4'	(S) 28"x28"X10" OR 32" Dia. X 12"	(S) 28"x28"X10" OR 32" Dia. X 12"			0
	6'	(D) 40"x40"X12" OR 46" Dia. X 19"	(D) 40"x40"X12" OR 46" Dia. X 19"			0
	8'	(D) 40"x40"X12" OR 46" Dia. X 19"	(D) 40"x40"X12" OR 46" Dia. X 19"			0
	10'	(D) 40"x40"X12" OR 46" Dia. X 19"	(D) 40"x40"X12" OR 46" Dia. X 19"			1
	12'	(D) 40"x40"X12" OR 46" Dia. X 19"	(D) 40"x40"X12" OR 46" Dia. X 19"			1
	14'	(D) 40"x40"X12" OR 46" Dia. X 19"	(D) 40"x40"X12" OR 46" Dia. X 19"			1
	16'	(D) 40"x40"X12" OR 46" Dia. X 19"	(D) 40"x40"X12" OR 46" Dia. X 19"			1
	18'	(D) 40"x40"X12" OR 46" Dia. X 19"	(D) 40"x40"X12" OR 46" Dia. X 19"			1
	20'	(D) 40"x40"X12" OR 46" Dia. X 19"	(D) 40"x40"X12" OR 46" Dia. X 19"			1
	22'	(D) 40"x40"X12" OR 46" Dia. X 19"	(D) 40"x40"X12" OR 46" Dia. X 19"			1
	24'	(D) 40"x40"X12" OR 46" Dia. X 19"	(D) 40"x40"X12" OR 46" Dia. X 19"			1
	26'	(D) 40"x40"X12" OR 46" Dia. X 19"	(T) 48"x48"X16" OR 56" Dia. X 24"			1
	28'	(D) 40"x40"X12" OR 46" Dia. X 19"	(T) 48"x48"X16" OR 56" Dia. X 24"			1
	30'	(D) 40"x40"X12" OR 46" Dia. X 19"	(T) 48"x48"X16" OR 56" Dia. X 24"			1
	32'	(D) 40"x40"X12" OR 46" Dia. X 19"	(T) 48"x48"X16" OR 56" Dia. X 24"			1
	34'	(T) 48"x48"X16" OR 56" Dia. X 24"	(T) 48"x48"X16" OR 56" Dia. X 24"			1
36'	(T) 48"x48"X16" OR 56" Dia. X 24"	(T) 48"x48"X16" OR 56" Dia. X 24"			1	
46'	(T) 48"x48"X16" OR 56" Dia. X 24"	(T) 48"x48"X16" OR 56" Dia. X 24"			1	
<b>SUPPORTS UNDER MATING OPENING AS CLEARSPANS IN FEET</b>						
PIER SPACING	7.9'	7.9'				
PIER CONFIG.	(S) 28"x28"X10" OR 28" Dia.	(S) 28"x28"X10" OR 28" Dia.				
<b>SUPPORTS UNDER MATING WALLS- CLEARSPANS IN FEET</b>						
PIER SPACING	6.7'	6.7'				
PIER CONFIG.	(S) 28"x28"X10" OR 32" Dia.	(D) 40"x40"X12" OR 33" Dia.				

Girder beams construction to be (4) 2X10 #2 SPF joists. Splices 6" X 8" MiTek MT20 metal plates each side

**Chart Key:**

(Pier Configuration) Min. footer width (inches) x Min. footer length (inches) x Min. footer depth (inches)

(S)= Single stack block configuration.

(D)= Double stack block configuration.

(T)= Triple stack block configuration.

(DR)=Double stack reinforced & fully grouted configuration.

IE. For 20 psf 178" box with 14' opening:Double stack pier on a 40"x 40" sq. footer 12" deep footing.

**30' 1 STORY- W.O ATTIC OFF FRAME BASEMENT & CRAWL With Roof Pitch of 6/12 Min. to 6/12 Max.**

**NOTES:** 1 DESIGNED FOR 90 MPH MAX. WIND SPEED.

2 DESIGNED FOR 1500 PSF MIN. ALLOWABLE SOIL BEARING CAPACITY.

3 DESIGN TO \* Ultimate wind speed Vult. Per ASCE 7-10/ allowable stress design wind speed Vasd. All wind speeds are indicated as (Vasd) design speed

4 MAX. MATING WALL OPENINGS LISTED IN CHART ASSUME OPENING IN BOTH HALVES. IF ANCHOR IS TIED TO ONLY ONE

COLUMN (ONE HALF) THEN HALF THE OPENING SIZE CAN BE USED WHEN LOOKING UP VALUE IN TABLE ABOVE. PIER

SUPPORTS REQUIRED AT EACH SIDE OF DOOR OPENINGS AND ALL EXTERIOR WALL OPENINGS GREATER THAN 4'.

5 WHEN PIER CONFIGURATION IS NOT GIVEN IN CHART THE ACTUAL LOADS EXCEED ALL

PREDESIGNED PIERS AND A LOCAL ENGINEER MUST DESIGN THE SUPPORTS FOR THE

GIVEN LOADS (- UPLIFT/ + GRAVITY LOADS).

6 ALL PIERS SHALL BE EMBEDDED IN TYPE M OR S MORTAR.

7.Round footers or Round Piles with diameter as required above may be used as alternate to square footing or square footing and block piers.

**APPROVED BY**



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

**David Richter**

FILENAME:958I-14.R.J.C.22.22.210( )

**TABLE N - STRUCTURAL STEEL POST AND FOOTER SIZE AT MATING WALL COLUMNS (REF. DETAIL D7)**

GROUND SNOW	20	30				Uplift force	
MAXIMUM MATING LINE SPAN BETWEEN MATING WALL COLUMN SUPPORTS	4'	(9k) 30"x30"X11"	(9k) 30"x30"X11"				0 #
	6'	(9k) 30"x30"X11"	(9k) 30"x30"X11"				0 #
	8'	(9k) 30"x30"X11"	(14k) 38"x38"X13"				0 #
	10'	(14k) 38"x38"X13"	(14k) 38"x38"X13"				14.06 #
	12'	(14k) 38"x38"X13"	(14k) 38"x38"X13"				114.06 #
	14'	(14k) 38"x38"X13"	(14k) 38"x38"X13"				214.06 #
	16'	(14k) 38"x38"X13"	(14k) 38"x38"X13"				314.06 #
	18'	(14k) 38"x38"X13"	(14k) 38"x38"X13"				414.06 #
	20'	(14k) 38"x38"X13"	(14k) 38"x38"X13"				514.06 #
	22'	(14k) 38"x38"X13"	(20k) 44"x44"X14"				614.06 #
	24'	(14k) 38"x38"X13"	(20k) 44"x44"X14"				714.06 #
	26'	(14k) 38"x38"X13"	(20k) 44"x44"X14"				814.06 #
	28'	(14k) 38"x38"X13"	(20k) 44"x44"X14"				914.06 #
	30'	(20k) 44"x44"X14"	(20k) 44"x44"X14"				1014.06 #
	32'	(20k) 44"x44"X14"	(20k) 44"x44"X14"				1114.06 #
	34'	(20k) 44"x44"X14"	(20k) 44"x44"X14"				1214.06 #
36'	(20k) 44"x44"X14"	(20k) 44"x44"X14"				1314.06 #	
46'	(20k) 44"x44"X14"	(30k) 54"x54"X17"				1814.06 #	
<b>SUPPORTS UNDER MATING OPENING AS CLEARSPANS IN FEET</b>							
POST SPACING	7.9'	7.9' 0/C				Girder beams construction to be (4) 2X10 #2 SPF joists. Splices 6" X 8" MiTek MT20 metal plates each side	
FOOTER SIZE	(9k) 30"x30"X11"	(9k) 30"x30"X11"					
<b>SUPPORTS UNDER MATING WALLS- CLEARSPANS IN FEET</b>							
POST SPACING	6.7'	6.7'					
FOOTER SIZE	(9k) 30"x30"X11"	(9k) 30"x30"X11"					



Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
David Richter

**Chart Key:**

(Post Load)= Minimum allowable compression rating which post must be rated in kips (1000 lbs.).  
 (Post Capacity and Footer Size) Min. footer width (inches) x Min. footer length (inches) x Min. footer depth (inches)  
 Note: Steel piers must have a minimum steel base plate size of 4 inches x 5.5 inches which bears directly on footer sized per chart.  
 Minimum steel column top plate size of 4"x5.5"for 9000#; 6"x6"for 14000#; 6"x8"for 20000# & 6"x12"for 30000#

**Minimum footer Reinforcement (Number of #4 bars each way):**

<u>Footer size</u>	<u># of No. 4 bars</u>	<u>Footer size</u>	<u># of No. 4 bars</u>
30"x30"	3	44"x44"	6
38"x38"	5	54"x54"	9

**30' 1 STORY- W.O ATTIC OFF FRAME BASEMENT & CRAWL With Roof Pitch of 6/12 Min. to 6/12 Max.**

- NOTES:** 1 DESIGNED FOR 90 MPH MAX. WIND SPEED.  
 2 DESIGNED FOR 1500 PSF MIN. ALLOWABLE SOIL BEARING CAPACITY.  
 3 DESIGN TO \* Ultimate wind speed Vult. Per ASCE 7-10/ allowable stress design wind speed Vasd. All wind speeds are indicated as (v)  
 4 MAX. MATING WALL OPENINGS LISTED IN CHART ASSUME OPENING IN BOTH HALVES. IF ANCHOR IS TIED TO ONLY ONE COLUMN (ONE HALF) THEN HALF THE OPENING SIZE CAN BE USED WHEN LOOKING UP VALUE IN TABLE ABOVE. PIERS SUPPORTS REQUIRED AT EACH SIDE OF DOOR OPENINGS AND ALL EXTERIOR WALL OPENINGS GREATER THAN 4'.  
 5 WHEN PIER CONFIGURATION IS NOT GIVEN IN CHART THE ACTUAL LOADS EXCEED ALL PREDESIGNED FOOTERS AND A LOCAL ENGINEER MUST DESIGN THE SUPPORTS FOR THE GIVEN LOADS (- UPLIFT/ + GRAVITY LOADS).

**Support and anchorage for 16" Max. Recess**

NON CORNER- SPANS ARE NOT LOCATED WITH 6' OF END OF HOME

PIER CONFIGURATION AND MINIMUM FOOTER SIZE UNDER SIDEWALL PORCH/ RECESS SUPPORT <sup>1,4</sup>												
GROUND SNOW			20 #		30 #							
Max. span <sup>3</sup>	UPLIFT LOAD <sup>10</sup>	# Brk <sup>2</sup>	w/ground anchors	w/concrete anchors	w/ground anchors	w/concrete anchors	w/ground	w/concrete	w/ground	w/concrete	w/ground	w/concrete
4	-217.45977 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
6	-326.18966 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
8	-434.91954 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
10	-543.64943 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
12	-652.37932 #	-1	(D) 40"x40"X12"	(D) 40"x40"X12"	(D) 40"x40"X12"	(D) 40"x40"X12"						



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
David Richter

CORNER- SPANS ARE LOCATED WITH 6' OF END OF HOME

PIER CONFIGURATION AND MINIMUM FOOTER SIZE UNDER SIDEWALL PORCH/ RECESS SUPPORT <sup>1,4</sup>												
GROUND SNOW			20 #		30 #							
Max. span <sup>3</sup>	UPLIFT LOAD <sup>10</sup>	# Brk <sup>2</sup>	w/ground anchors	w/concrete anchors	w/ground anchors	w/concrete anchors	w/ground	w/concrete	w/ground	w/concrete	w/ground	w/concrete
4	-190.32075 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
6	-285.48112 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
8	-380.6415 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
10	-475.80187 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
12	-570.96224 #	-1	(D) 40"x40"X12"	(D) 40"x40"X12"	(D) 40"x40"X12"	(D) 40"x40"X12"						

**Support and anchorage for 48" Max. Porch Depth**

NON CORNER- SPANS ARE NOT LOCATED WITH 6' OF END OF HOME


PIER CONFIGURATION AND MINIMUM FOOTER SIZE UNDER SIDEWALL PORCH/ RECESS SUPPORT <sup>1,4</sup>												
GROUND SNOW			20 #		30 #							
Max. span <sup>3</sup>	UPLIFT LOAD <sup>10</sup>	# Brk <sup>2</sup>	w/ground anchors	w/concrete anchors	w/ground anchors	w/concrete anchors	w/ground	w/concrete	w/ground	w/concrete	w/ground	w/concrete
4	-134.41255 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
6	-201.61883 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
8	-268.82511 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
10	-336.03138 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
12	-403.23766 #	-1	(D) 40"x40"X12"	(D) 40"x40"X12"	(D) 40"x40"X12"	(D) 40"x40"X12"						

CORNER- SPANS ARE LOCATED WITHIN 6' OF END OF HOME


PIER CONFIGURATION AND MINIMUM FOOTER SIZE UNDER SIDEWALL PORCH/ RECESS SUPPORT <sup>1,4</sup>												
GROUND SNOW			20 #		30 #							
Max. span <sup>3</sup>	UPLIFT LOAD <sup>10</sup>	# Brk <sup>2</sup>	w/ground anchors	w/concrete anchors	w/ground anchors	w/concrete anchors	w/ground	w/concrete	w/ground	w/concrete	w/ground	w/concrete
4	-104.11898 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
6	-156.17847 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
8	-208.23796 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
10	-260.29745 #	-1	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"	(S) 28"x28"X10"						
12	-312.35694 #	-1	(D) 40"x40"X12"	(D) 40"x40"X12"	(D) 40"x40"X12"	(D) 40"x40"X12"						

- NOTES:
- Piers supports are required under all porch/ recess post and at intersection of sidewall (see key plan).
  - # Brk- Number of uplift brackets required under the support column. Brackets per Detail D6. Brackets may be installed individually or in pairs and must be tied to a ground anchor or concrete anchor with a minimum design capacity of 3150#. An alternate uplift connector may be used which has the required uplift load indicated above.
  - NG- Indicates that uplift exceeds standard angle and tie down capacity and alternate design is require.
  - Max. Span- Maximum distance between adjacent porch post or supports as measure parallel to box length.
  - Piers- Indicates the minimum CMU block configuration (S)ingle, (D)ouble, (T)riple or (DR)ouble (R)enforced and minimum footer size. See Detail D3 of D4 for pier configuration.
  - w/ ground anchors- Minimum footer size for gravity load support at post. Uplift is taken to ground anchor anchors placed in soil.
  - w/ concrete anchors- Minimum footer size based on gravity and uplift. Concrete anchors embedded into foot carry uplift load.
  - off frame basement & crawl foundation design for: 29' - 8" 2-section modular
  - designed for 90 mph max. wind speed.
  - Desgin for 1500 psf min. allowable soil bearing capacity.
  - Designed to the \* Ultimate wind speed Vult. Per ASCE 7-10/ allowable stress design wind speed Vasd. All wind speeds are ind

<b>Schult</b>	
<b>PORCH &amp; RECESS (TABLE P)</b>	
DATE: 3/27/07	9581-14.R.J.C.22.22.210(L)
PAGE #:	<b>Page 13 of 29</b>

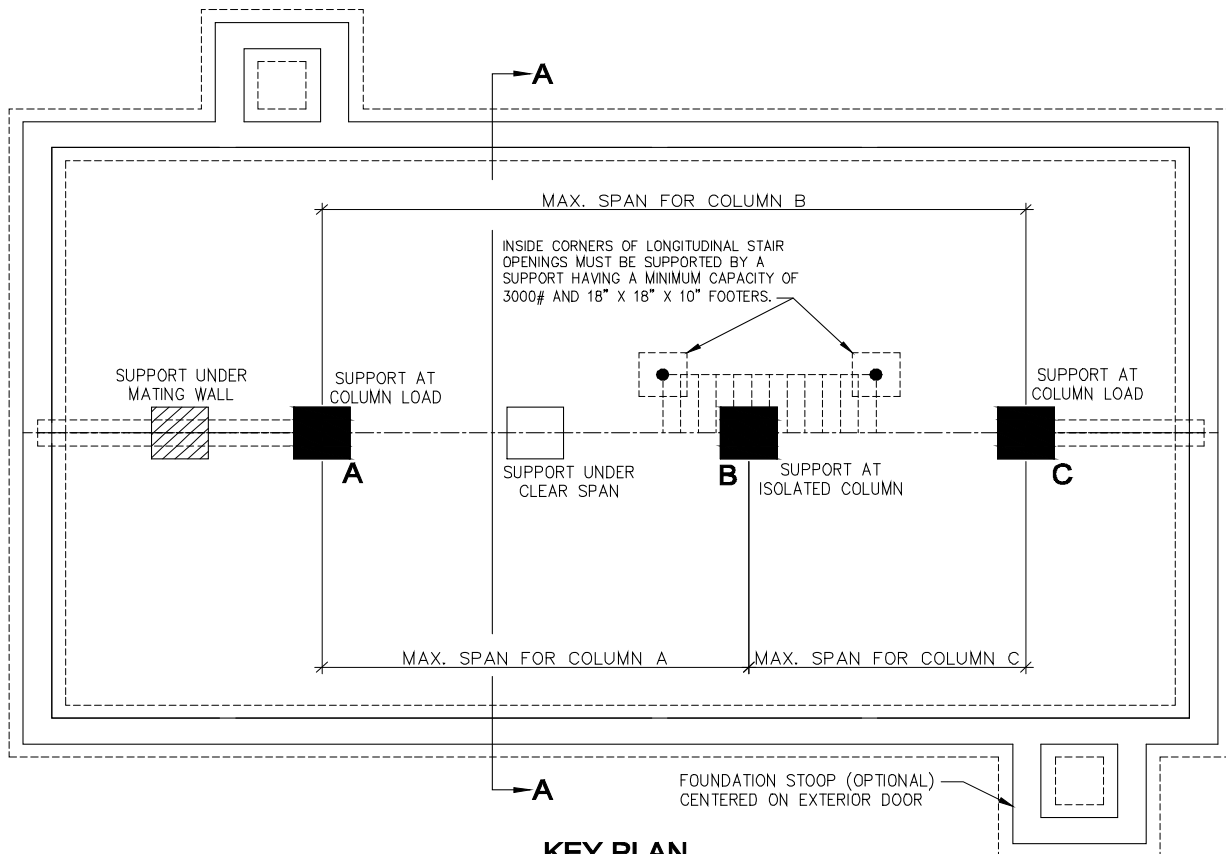

**KEY PLAN**  
**OFF-FRAME BASEMENT - 2 SECTION**  
 NOT TO SCALE

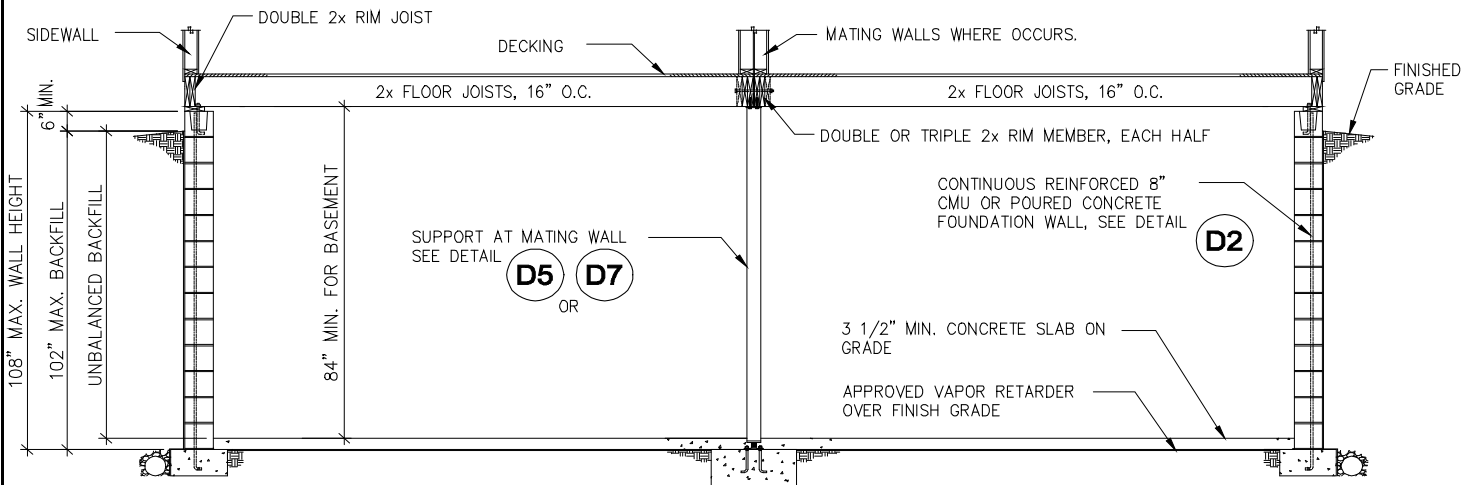

**CROSS SECTION A-A**

**NOTES:**

1. MARRIAGE LINE POSTS SHALL SUPPORT THE MARRIAGE WALL, COLUMNS AND STAIR LOADS WHERE OCCURS. REFER TO SPECIFIC FOUNDATION LAYOUT FOR LOCATION INFORMATION.
2. SEE GENERAL NOTES SECTION FOR VENTILATION, DRAINAGE AND OTHER FOUNDATION REQUIREMENTS.



Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

**Schult**


**KEY PLAN 7 - OFF-FRAME / BASEMENT / 2 SECTION**

DATE: 05/25/07


958I-14.R.J.C.22.22.210(L)

PAGE #:

Page 14 of 29

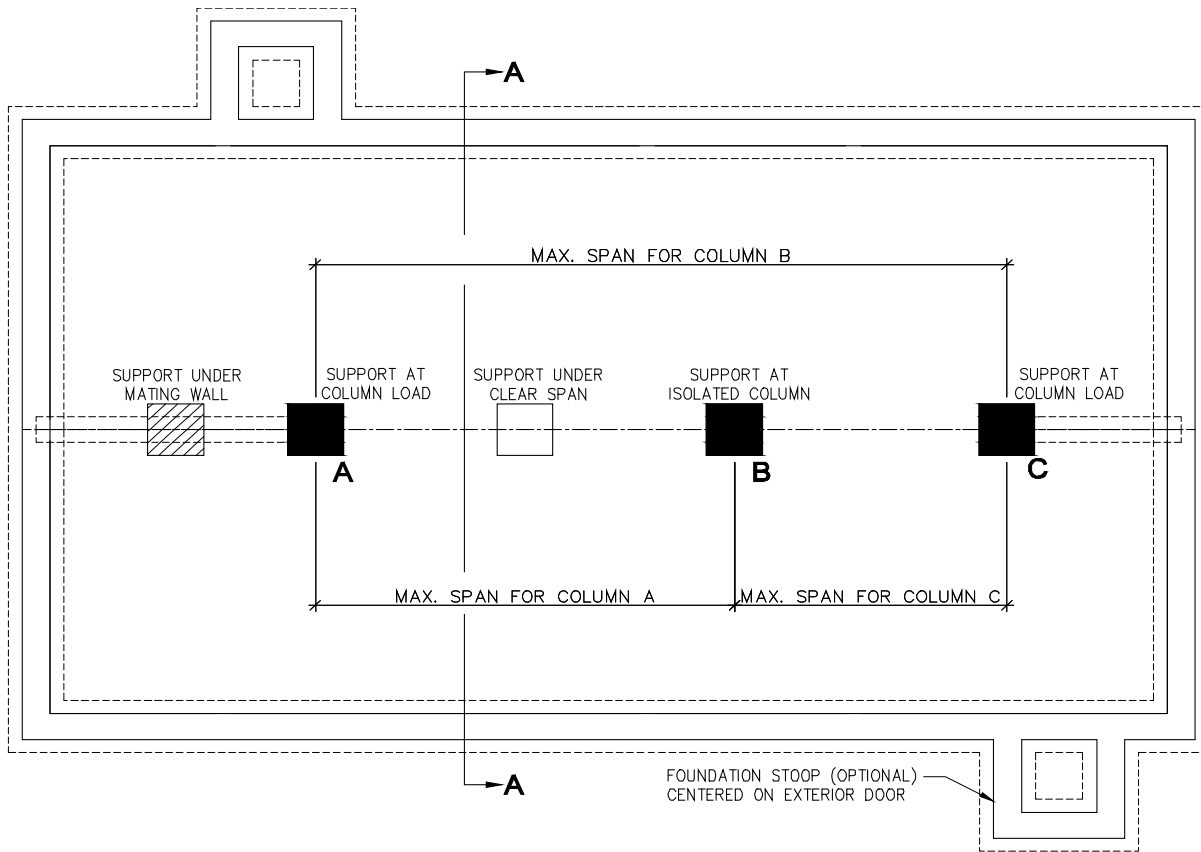

**KEY PLAN**  
**OFF-FRAME CRAWL SPACE - 2 SECTION**  
 NOT TO SCALE

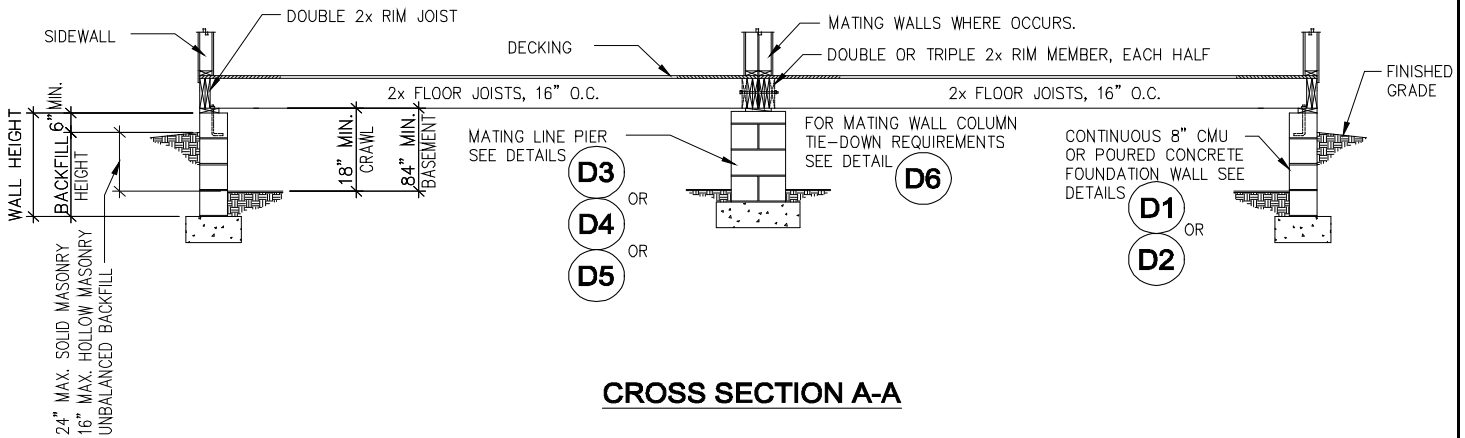

**CROSS SECTION A-A**

**NOTES:**

- MARRIAGE LINE POSTS SHALL SUPPORT THE MARRIAGE WALL, COLUMNS AND STAIR LOADS WHERE OCCURS. REFER TO SPECIFIC FOUNDATION LAYOUT FOR LOCATION INFORMATION.
- SEE GENERAL NOTES SECTION FOR VENTILATION, DRAINAGE AND OTHER FOUNDATION REQUIREMENTS.

**APPROVED BY**  
  
 8/16/2021  
 Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
**David Richter**


**Schult**

**KEY PLAN 8 - OFF-FRAME / CRAWL SPACE / 2 SECTION**

DATE: 05/25/07

958I-14.R.J.C.22.22.210(L)

PAGE #:

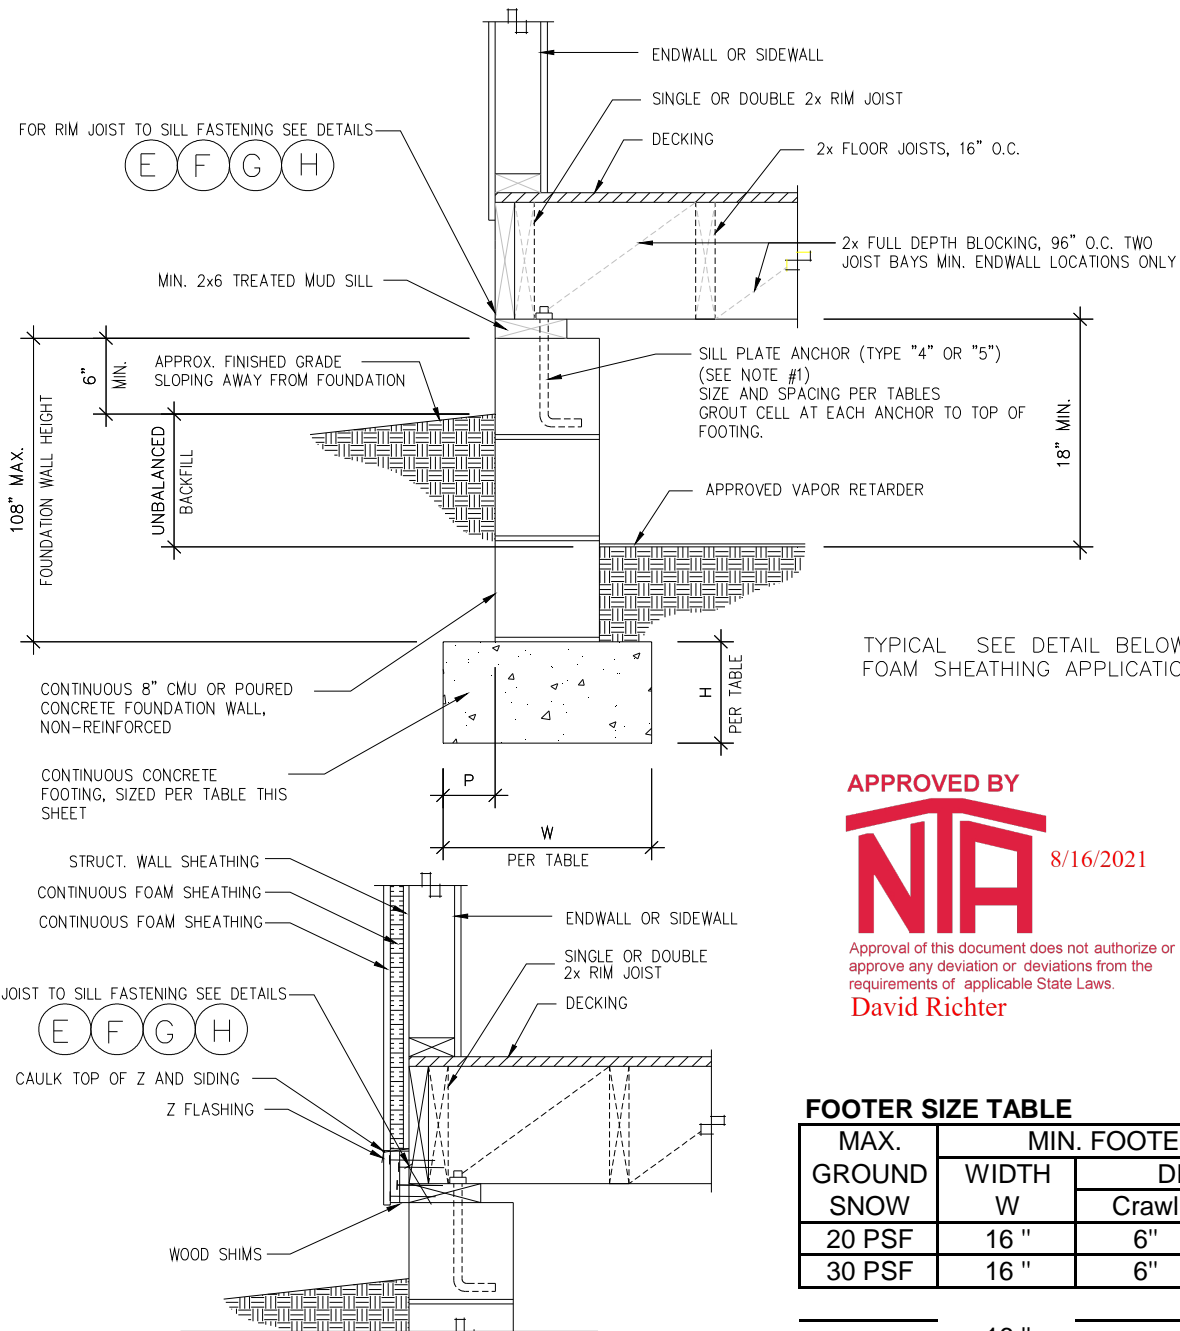

**APPROVED BY**  
  
 8/16/2021  
 Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
**David Richter**

**FOOTER SIZE TABLE**

MAX. GROUND SNOW	MIN. FOOTER SIZE		
	WIDTH W	DEPTH H	
		Crawl	Basement
20 PSF	16"	6"	6"
30 PSF	16"	6"	6"
	16"		

**NON-REINFORCED PERIMETER FOUNDATION WALL**  
**BASEMENT OR CRAWLSPACE**  
**MAX. 90 MPH WIND SPEED & SEISMIC ZONE C**  
**30' WIDE 1 STORY- W.O ATTIC**

- NOTES:
- MUD SILL TO FOUNDATION ANCHORS:  
 TYPE 4: 1/2" DIAMETER STEEL ANCHOR BOLTS EMBEDDED 7" MIN. INTO CONCRETE FOUNDATION WALL OR CLOSE CELL CMU WITH 2"x2"x1/8" WASHERS AND NUTS. BOLT HEADS SHALL NOT BE RECESSED INTO SINGLE SILL PLATE.  
 TYPE 5: SIMPSON MAB OR MAS MUD SILL ANCHOR INSTALLED PER INSTALLATION INSTRUCTIONS.
  - RIM TO MUD SILL FASTENING AND SILL TO FOUNDATION ANCHOR SPACING SHALL BE THE MINIMUM OF:
    - SPACING GIVEN IN APPLICABLE TABLES FOR UNIT CONFIGURATION AND WIND SPEED.
    - SPACING GIVEN IN BACKFILL/ SIDEWALL TABLES FOR GIVEN UNIT CONFIGURATION, MAXIMUM BASEMENT WALL HEIGHT, BACKFILL DEPTH, AND LOCAL SOIL CLASSIFICATION.
  - DISTANCE FROM EDGE OF FOOTER TO FACE OF FOUNDATION WALL (P) SHALL NOT BE LESS THAN 2" AND SHALL NOT EXCEED THE FOOTER THICKNESS (H).
  - 1500 PSF MIN. ALLOWABLE SOIL BEARING CAPACITY.

**Schult**

**NON-REINFORCED PERIMETER FOUNDATION WALL - DETAIL - D1**

DATE: 07/17/07 958I-14.R.J.C.22.22.210(L)

PAGE #:

APPROVED BY






1/2" BOLTS, NUTS, AND WASHERS OR 3/8" LAG SCREWS REQUIRED THRU RIM JOIST GIRDER. SIZE AND SPACING PER HOME SETUP MANUAL.

8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

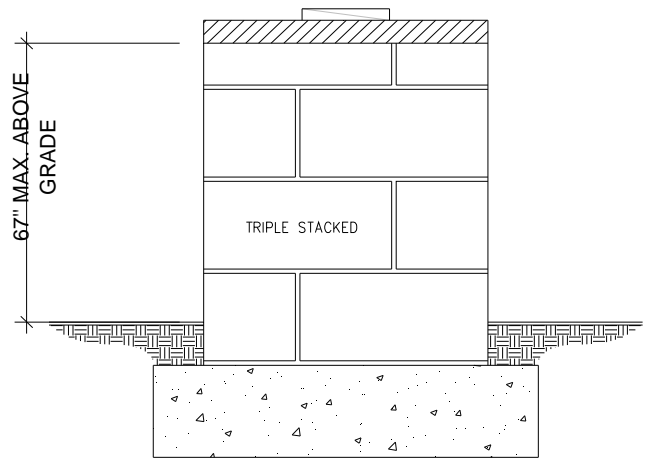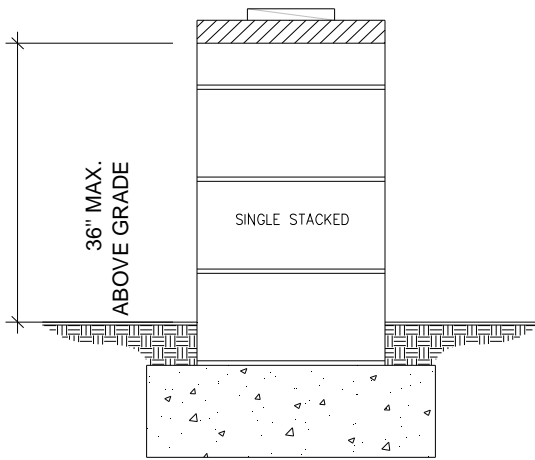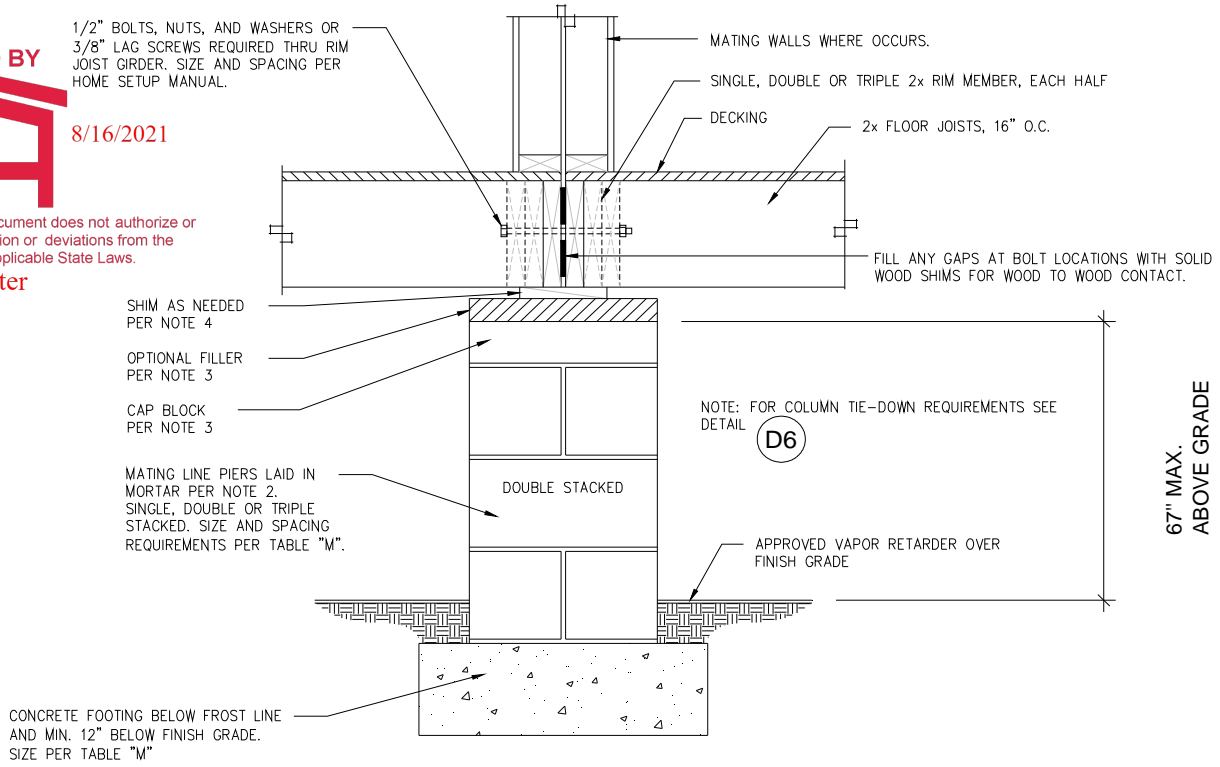

**NON-REINFORCED MATING WALL OR COLUMN SUPPORT PIER  
CRAWL SPACE ONLY**

**NOTES:**

1. FOOTINGS MUST BE LEVEL IN ALL DIRECTIONS. PIERS ARE TO BE PLACED CENTERED ON THE FOOTING SO THAT THE FOOTING PROJECTION FROM THE PIER IS EQUAL FROM SIDE-TO-SIDE AND FRONT-TO-BACK. PIERS MUST BE LEVEL VERTICALLY ON ALL SIDES AND SQUARE WITH THE FOOTING.
2. CONCRETE BLOCKS FOR PIERS ARE 8" x 16" x 8" NOMINAL SIZE, HOLLOW CELL LOAD BEARING CMU'S MANUFACTURED IN CONFORMANCE WITH ASTM C90, GRADE "N". OPEN CELLS ARE ALIGNED VERTICALLY. THE PIERS SHALL BE LAID IN RUNNING BOND WITH TYPE M OR S MORTAR OR APPROVED ALTERNATE (SEE GENERAL NOTE 12). SINGLE STACKED BLOCKS TO BE LAID WITH LONG SIDE PERPENDICULAR TO MATE LINE RIM JOISTS. DOUBLE STACKED BLOCK IS LAID WITH EACH LAYER AT A RIGHT ANGLE TO THE PREVIOUS LAYER. THE TOP COURSE OR THE CAP BLOCKS SHALL BE PERPENDICULAR TO THE MATE LINE RIM JOISTS.
3. CAP BLOCKS SHALL BE 4" SOLID CONCRETE OR MASONRY BLOCK. 2x NOMINAL HARDWOOD OR 1/2" STEEL MAY BE USED AS A CAP BLOCK IF THE TOP COURSE OF THE PIER IS SOLID MASONRY OR CONCRETE OR IF THE TOP COURSE OF A HOLLOW PIER IS FILLED WITH CONCRETE OR GROUT. OPTIONAL FILLER MATERIAL MAY BE 2x NOMINAL HARDWOOD OR 2" OR 4" NOMINAL SOLID CONCRETE BLOCK. ALL CAPS AND FILLER SHALL BE OF THE SAME NOMINAL DIMENSIONS AS THE PIERS THEY REST UPON. INDIVIDUAL LENGTHS OF CAP BLOCKS AND FILLER SHALL BE PERPENDICULAR TO THE MATE LINE RIM JOISTS.
4. SHIMS SHALL BE OF HARDWOOD, AT LEAST 3 1/2" WIDE AND 6" LONG AND ARE NOT TO EXCEED ONE INCH IN THICKNESS. SHIMS SHALL BE PERPENDICULAR TO MATE LINE, FITTED AND DRIVEN TIGHT BETWEEN CAP BLOCKS OR FILLER AND MATE LINE RIM JOISTS.
5. MARRIAGE LINE PIERS SHALL SUPPORT THE MARRIAGE WALL AND COLUMNS WHERE OCCURS PER MODEL SPECIFIC FOUNDATION PLAN. MAXIMUM PIER SPACING PER TABLE "M".
6. SEE GENERAL NOTES FOR DRAINAGE AND OTHER FOUNDATION REQUIREMENTS.

<b>Schult</b>	
<b>NON-REINFORCED MATING WALL COLUMN SUPPORT PIER - CRAWLSPACE ONLY - DETAIL - D3</b>	
DATE: 06/13/07	958I-14.R.J.C.22.22.210( )
PAGE #:	Page 17 of 29

1/2" BOLTS, NUTS, AND WASHERS OR 3/8" LAG SCREWS REQUIRED THRU RIM JOIST GIRDER. SIZE AND SPACING PER HOME SETUP MANUAL.

MATING WALLS WHERE OCCURS.

SINGLE, DOUBLE OR TRIPLE 2x RIM MEMBER, EACH HALF.

DECKING

2x FLOOR JOISTS, 16" O.C.

FILL ANY GAPS AT BOLT LOCATIONS WITH SOLID WOOD SHIMS FOR WOOD TO WOOD CONTACT.

SHIM AS NEEDED PER NOTE 4

OPTIONAL FILLER PER NOTE 3

CAP BLOCK PER NOTE 3

NOTE: FOR COLUMN TIE-DOWN REQUIREMENTS SEE DETAIL **D6**

MATING LINE DOUBLE STACKED PIER PER NOTE 2. REINFORCE PIER WITH (4) #4 VERTICAL REBAR. GROUT CELLS SOLID TO FOOTING. SIZE AND SPACING PER TABLE "M".

MASONRY JOINT TYPE M OR S MORTAR

108" MAX. ABOVE GRADE

FINISH GRADE AT CRAWL SPACE APPLICATION

3 1/2" MIN. CONCRETE SLAB ON GRADE FOR BASEMENT APPLICATION

APPROVED VAPOR RETARDER OVER FINISH GRADE

APPROVED VAPOR RETARDER

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

CONCRETE FOOTING BELOW FROST LINE. REINFORCED WITH (3) #4 REBAR EACH WAY. SIZE PER TABLE "M".

MIN. DIAMETER OF BEND SHALL BE 3" AS MEASURED FROM INSIDE OF REINFORCING BARS WITH A 6" LONG MIN. LEG.

6" MIN.

**REINFORCED MATING WALL OR COLUMN SUPPORT PIER  
BASEMENT OR CRAWL SPACE  
(PIER SPACING AND FOOTER SIZE PER TABLE M)**

**NOTES:**

1. FOOTINGS MUST BE LEVEL IN ALL DIRECTIONS. PIERS ARE TO BE PLACED CENTERED ON THE FOOTING SO THAT THE FOOTING PROJECTION FROM THE PIER IS EQUAL FROM SIDE-TO-SIDE AND FRONT-TO-BACK. PIERS MUST BE LEVEL VERTICALLY ON ALL SIDES AND SQUARE WITH THE FOOTING.
2. CONCRETE BLOCKS FOR PIERS ARE 8" x 16" x 8" NOMINAL SIZE, HOLLOW CELL LOAD BEARING CMU's MANUFACTURED IN CONFORMANCE WITH ASTM C90, GRADE "N". OPEN CELLS ARE ALIGNED VERTICALLY. THE PIERS SHALL BE LAID IN RUNNING BOND WITH TYPE M OR S MORTAR. SINGLE STACKED BLOCKS TO BE LAID WITH LONG SIDE PERPENDICULAR TO MATE LINE RIM JOISTS. DOUBLE STACKED BLOCK IS LAID WITH EACH LAYER AT A RIGHT ANGLE TO THE PREVIOUS LAYER. THE TOP COURSE OR THE CAP BLOCKS SHALL BE PERPENDICULAR TO THE MATE LINE RIM JOISTS.
3. CAP BLOCKS SHALL BE 4" SOLID CONCRETE OR MASONRY BLOCK. 2x NOMINAL HARDWOOD OR 1/2" STEEL MAY BE USED AS A CAP BLOCK IF THE TOP COURSE OF THE PIER IS SOLID MASONRY OR CONCRETE OR IF THE TOP COURSE OF A HOLLOW PIER IS FILLED WITH CONCRETE OR GROUT. OPTIONAL FILLER MATERIAL MAY BE 2x NOMINAL HARDWOOD OR 2" OR 4" NOMINAL SOLID CONCRETE BLOCK. ALL CAPS AND FILLER SHALL BE OF THE SAME NOMINAL DIMENSIONS AS THE PIERS THEY REST UPON. INDIVIDUAL LENGTHS OF CAP BLOCKS AND FILLER SHALL BE PERPENDICULAR TO THE MATE LINE RIM JOISTS.
4. SHIMS SHALL BE OF HARDWOOD, AT LEAST 3 1/2" WIDE AND 6" LONG AND ARE NOT TO EXCEED ONE INCH IN THICKNESS. SHIMS SHALL BE PERPENDICULAR TO MATE LINE, FITTED AND DRIVEN TIGHT BETWEEN CAP BLOCKS OR FILLER AND MATE LINE RIM JOISTS.
5. MARRIAGE LINE PIERS SHALL SUPPORT THE MARRIAGE WALL AND COLUMNS WHERE OCCURS PER MODEL SPECIFIC FOUNDATION PLAN. MAXIMUM PIER SPACING PER TABLE "M".
6. SEE GENERAL NOTES FOR DRAINAGE AND OTHER FOUNDATION REQUIREMENTS.

Schult


**REINFORCED MATING WALL OR  
COLUMN SUPPORT PIER -  
BASEMENT OR CRAWL SPACE  
DETAIL - D5**

DATE: 06/04/07

958I-  
14.R.J.C.22.22.210( )

PAGE #:




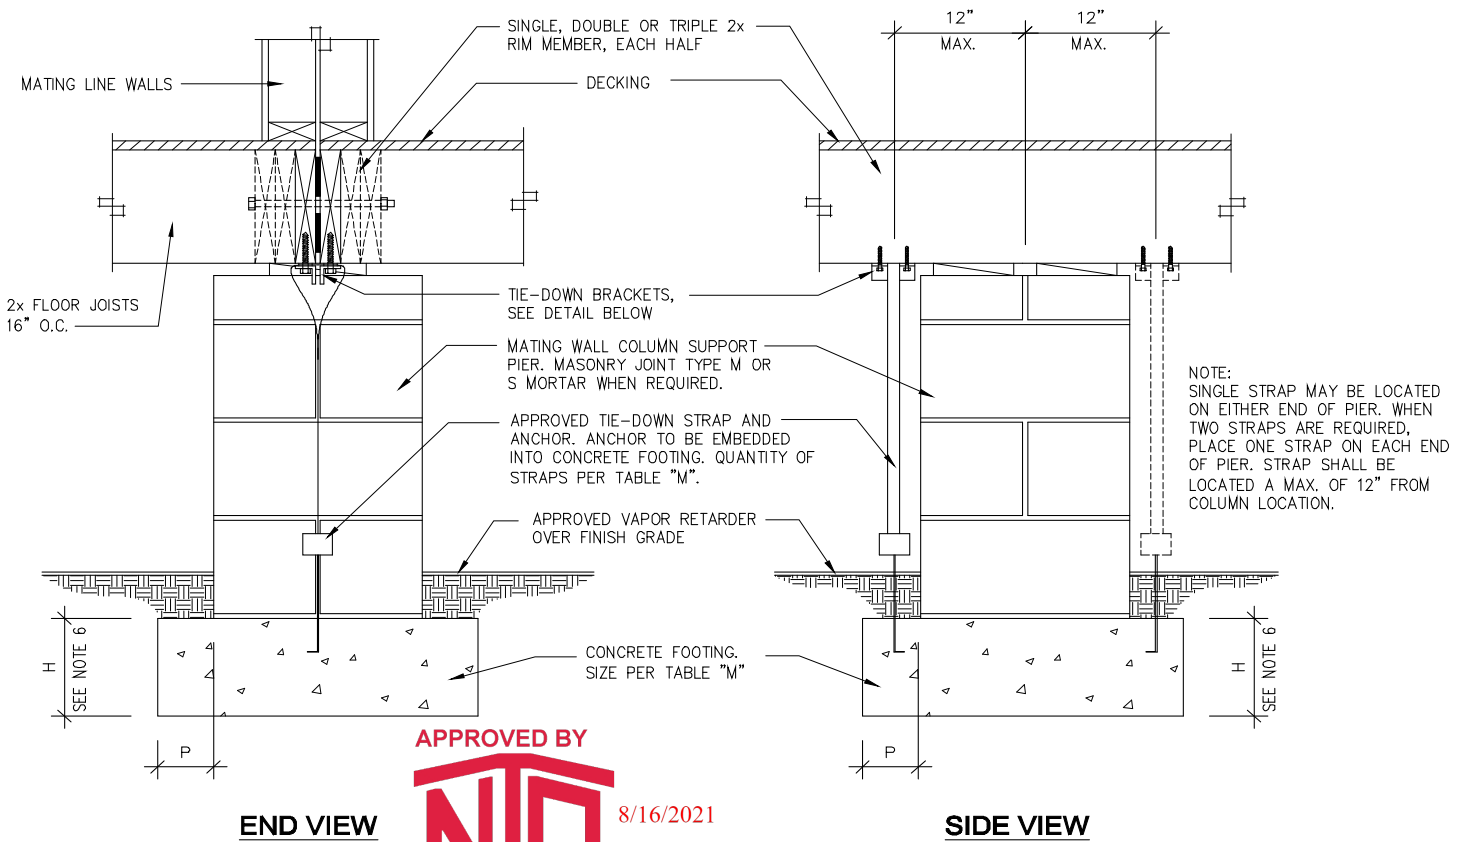


NOTE:  
SINGLE STRAP MAY BE LOCATED ON EITHER END OF PIER. WHEN TWO STRAPS ARE REQUIRED, PLACE ONE STRAP ON EACH END OF PIER. STRAP SHALL BE LOCATED A MAX. OF 12" FROM COLUMN LOCATION.

APPROVED BY  
**NIA** 8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

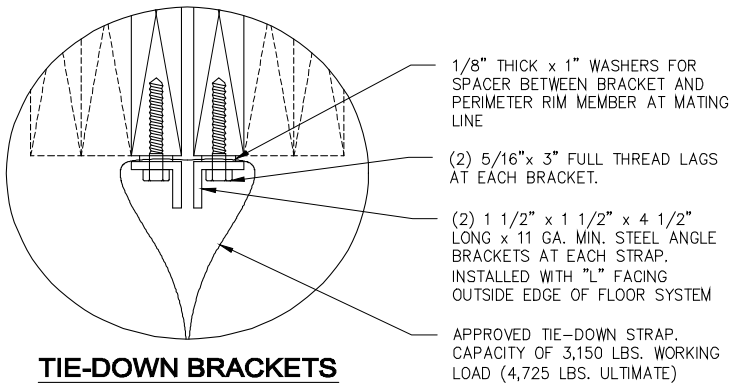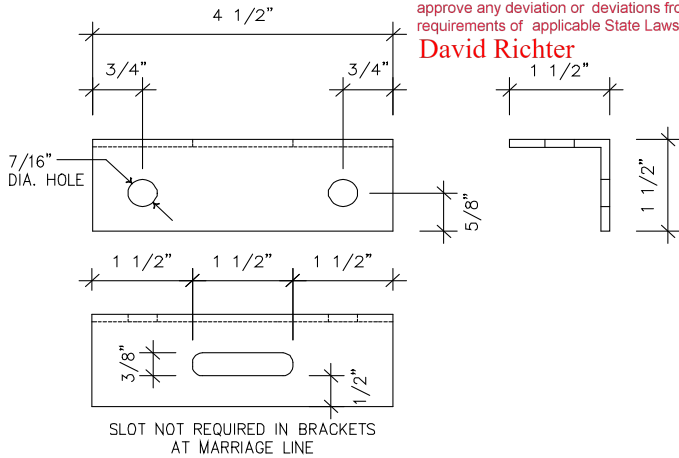

**MATING WALL COLUMN TIE DOWN**

- NOTES:
1. ALL MARRIAGE WALL COLUMN LOCATIONS WITH OPENINGS 4 FEET OR GREATER MAY REQUIRE THE INSTALLATION OF COLUMN BRACKETS AND TIE-DOWNS. SEE TABLE "M" FOR REQUIREMENTS.
  2. EACH BRACKET IS RATED FOR AN ALLOWABLE WORKING LOAD OF 1,719 LBS.
  3. THE CAPACITY OF BOTH THE TIE-DOWN STRAP AND ANCHOR MUST BE 3,150 LBS. WORKING LOAD (4,725 LBS. ULTIMATE)
  4. USE A RADIUS CLIP FOR ALL BRACKET APPLICATIONS BY THREADING A PIECE OF STRAP OVER THE BRACKETS BEFORE LOOPING THE TIE-DOWN STRAP AROUND THE BRACKET.
  5. GROUND ANCHORS WHICH ARE LISTED FOR THE REQUIRED CAPACITY ABOVE MAY BE USED IN LIEU OF CONCRETE ANCHOR.
  6. DISTANCE FROM EDGE OF FOOTING TO FACE OF FOUNDATION WALL (P) SHALL NOT BE LESS THAN 2" AND SHALL NOT EXCEED THE FOOTING THICKNESS (H). FOOTING THICKNESS MAY BE 10" IF GROUND ANCHORS WITH AN UPLIFT CAPACITY OF 3,150 LBS. ARE USED IN PLACE OF CONCRETE ANCHORS.
  7. FOOTING SIZES PER TABLE "M" HAVE BEEN DESIGNED ASSUMING CONCRETE ANCHORS WILL BE UTILIZED. IF GROUND ANCHORS ARE UTILIZED TO TRANSMIT UPLIFT INTO GROUND SOIL, THE DEPTH OF THE FOOTING MAY BE REDUCED TO (P). WHERE (P) IS EQUAL TO THE GREATEST DISTANCE FROM EDGE OF FOOTING TO EDGE OF PIER. MINIMUM DEPTH IS 9".

**Schult**

**MATING WALL COLUMN TIE DOWN - DETAIL - D6**

DATE: 06/29/07 958I-14.R.J.C.22.22.210( )

PAGE #:

**Page 19 of 29**

1/2" BOLTS, NUTS, AND WASHERS OR 3/8" LAG SCREWS REQUIRED THRU RIM JOIST GIRDER. SIZE AND SPACING PER HOME SETUP MANUAL

MATING WALLS WHERE OCCURS.

SINGLE, DOUBLE OR TRIPLE 2x RIM MEMBER, EACH HALF

DECKING

2x FLOOR JOISTS, 16" O.C.

FILL ANY GAPS AT BOLT LOCATIONS WITH SOLID WOOD SHIMS FOR WOOD TO WOOD CONTACT.

(2) 5/16" x 3" LAG SCREWS WITH WASHERS THROUGH POST PLATE INTO RIM JOIST. PILOT HOLES MUST BE SITE DRILLED.

11 GA., 3" DIA. MIN. ADJUSTABLE STEEL MONO POST WITH MIN. 1/4" PLATES TOP AND BOTTOM. SIZE AND SPACING PER TABLE "N".  
NOTE: THE MIN. CAPACITY RATING OF EACH POST MUST BE GREATER THAN OR EQUAL TO THE SPECIFIED LOAD CAPACITY OF TABLE "N".

SECURE STEEL POST BOTTOM PLATE TO FOOTING WITH (4) 1/2" DIA. ANCHOR BOLTS OR WEDGE ANCHORS, NUTS AND WASHERS. (UTILIZE 5/8" DIA. ANCHOR BOLTS FOR SEISMIC DESIGN CATEGORY "E" OR HIGHER). MAKE POST ADJUSTMENTS BEFORE POURING SLAB.

APPROVED VAPOR RETARDER

NOTE:  
FOR POST SUPPORTING MATING WALL OPENINGS, POST MUST BE RATED AND SECURED TO GIRDER BEAM AND FOOTING FOR UPLIFT FORCE SPECIFIED IN TABLE "N".

3 1/2" MIN. CONCRETE SLAB ON GRADE. IMPORTANT: ALL STEEL POSTS MUST BE INSTALLED AND FINAL ADJUSTMENTS MADE BEFORE SLAB IS Poured. Poured SLAB LOCKS POST ADJUSTMENTS PERMANENTLY.

REINFORCED CONCRETE FOOTING WITH (3) #4 REBARS EACH WAY. SIZE PER TABLE "N".

108" MAX.

**ALTERNATE POST INSTALLATION:** STEEL POSTS MAY BE INSTALLED WITH SCREW JACK ASSEMBLY AT THE TOP OR BOTTOM. STEEL POSTS INSTALLED WITHOUT THE SCREW JACK ASSEMBLY AT THE BOTTOM AND ENCASED IN CONCRETE ARE SUBJECT TO LOAD REDUCTIONS. VERIFY THE CAPACITY OF THE STEEL POST BASED ON THE INSTALLATION METHOD PRIOR TO INSTALLATION OF THE POST.

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

**ADJUSTABLE STEEL COLUMN POST  
BASEMENT OR CRAWL SPACE  
(MAXIMUM POST SPACING PER TABLE N)**

**NOTES:**

1. FOOTINGS MUST BE LEVEL IN ALL DIRECTIONS. STEEL POSTS ARE TO BE PLACED CENTERED ON THE FOOTING SO THAT THE FOOTING PROJECTION FROM THE POST IS EQUAL FROM SIDE-TO-SIDE AND FRONT-TO-BACK. COLUMN POSTS MUST BE LEVEL VERTICALLY ON ALL SIDES AND SQUARE WITH THE FOOTING.
2. MARRIAGE LINE STEEL POSTS SHALL SUPPORT THE MARRIAGE WALL AND COLUMNS WHERE OCCURS PER
3. SEE GENERAL NOTES FOR DRAINAGE AND OTHER FOUNDATION REQUIREMENTS.




Schult

**ADJUSTABLE STEEL COLUMN  
POST - BASEMENT OR CRAWL  
SPACE - DETAIL - D7**

DATE: 06/08/07

958I-14.R.J.C.22.22.210(L)

PAGE #:

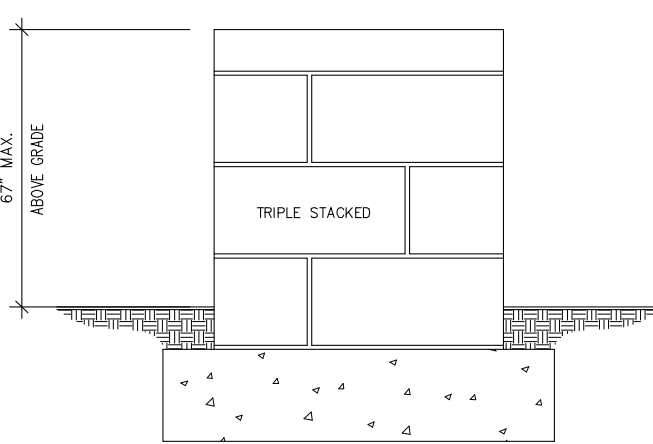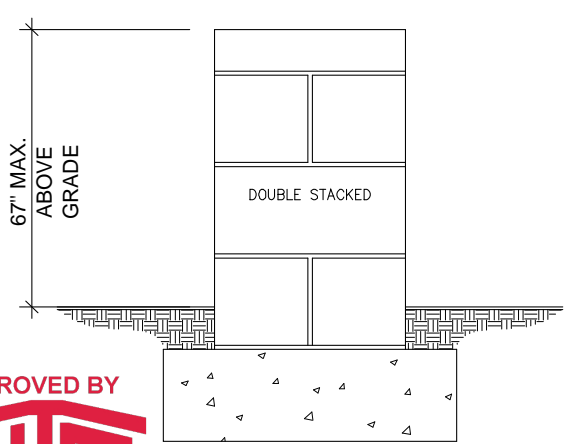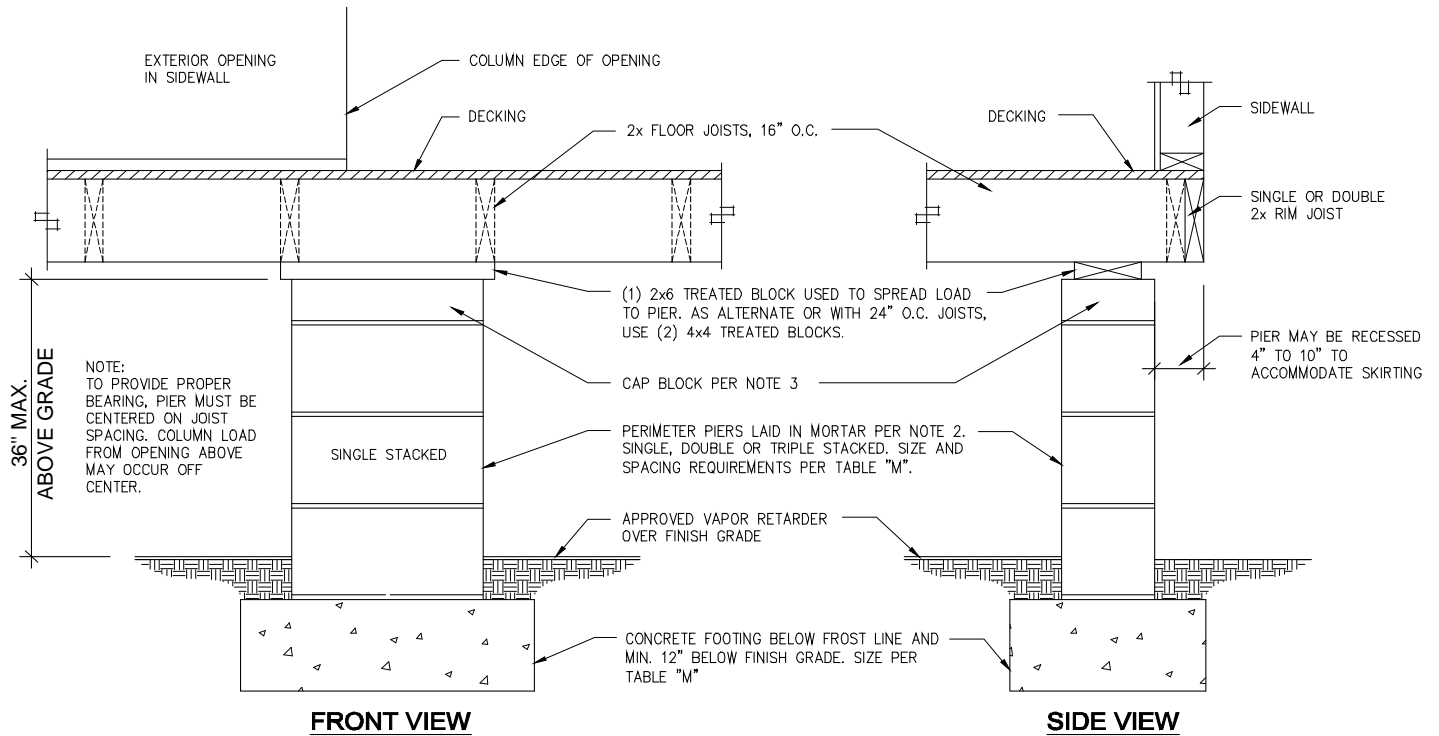

APPROVED BY



8/16/2021

**NON-REINFORCED PERIMETER OR PORCH POST SUPPORT PIER**

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

**NOTES:**

1. FOOTINGS MUST BE LEVEL IN ALL DIRECTIONS. PIERS ARE TO BE PLACED CENTERED ON THE FOOTING SO THAT THE FOOTING PROJECTION FROM THE PIER IS EQUAL FROM SIDE-TO-SIDE AND FRONT-TO-BACK. PIERS MUST BE LEVEL VERTICALLY ON ALL SIDES AND SQUARE WITH THE FOOTING.
2. CONCRETE BLOCKS FOR PIERS ARE 8" x 16" x 8" NOMINAL SIZE, HOLLOW CELL LOAD BEARING CMU'S MANUFACTURED IN CONFORMANCE WITH ASTM C90, GRADE "N". OPEN CELLS ARE ALIGNED VERTICALLY. SEE NOTE 7. FOR MORTAR REQUIREMENT. SINGLE STACKED BLOCKS TO BE LAID WITH LONG SIDE PERPENDICULAR TO MATE LINE RIM JOISTS. DOUBLE STACKED BLOCK IS LAID WITH EACH LAYER AT A RIGHT ANGLE TO THE PREVIOUS LAYER. THE TOP COURSE OR THE CAP BLOCKS SHALL BE PERPENDICULAR TO THE MATE LINE RIM JOISTS.
3. CAP BLOCKS SHALL BE 4" SOLID CONCRETE OR MASONRY BLOCK. 2x NOMINAL HARDWOOD OR 1/2" STEEL MAY BE USED AS A CAP BLOCK IF THE TOP COURSE OF THE PIER IS SOLID MASONRY OR CONCRETE OR IF THE TOP COURSE OF A HOLLOW PIER IS FILLED WITH CONCRETE OR GROUT. OPTIONAL FILLER MATERIAL MAY BE 2x NOMINAL HARDWOOD OR 2" OR 4" NOMINAL SOLID CONCRETE BLOCK. ALL CAPS AND FILLER SHALL BE OF THE SAME NOMINAL DIMENSIONS AS THE PIERS THEY REST UPON. INDIVIDUAL LENGTHS OF CAP BLOCKS AND FILLER SHALL BE PERPENDICULAR TO THE MATE LINE RIM JOISTS.
4. SHIMS SHALL BE OF HARDWOOD, AT LEAST 3 1/2" WIDE AND 6" LONG AND ARE NOT TO EXCEED ONE INCH IN THICKNESS. SHIMS SHALL BE PERPENDICULAR TO MATE LINE, FITTED AND DRIVEN TIGHT BETWEEN CAP BLOCKS OR FILLER AND MATE LINE RIM JOISTS.
5. MARRIAGE LINE PIERS SHALL SUPPORT THE MARRIAGE WALL AND COLUMNS WHERE OCCURS PER MODEL SPECIFIC FOUNDATION PLAN. MAXIMUM PIER SPACING PER TABLE "M".
6. SEE GENERAL NOTES FOR DRAINAGE AND OTHER FOUNDATION REQUIREMENTS.

7. THE PIERS SHALL BE LAID IN RUNNING BOND WITH TYPE M OR S MORTAR OR DRY STACKED ABOVE FIRST COURSE WITH SURFACE BONDING AGENT APPLIED THAT MEETS ASTM C887 WHEN ACCEPTABLE TO LOCAL AUTHORITY. BONDING AGENT MUST BE INTENDED FOR USE/APPLICATION AND SHALL BE INSTALLED PER MANUFACTURES SPECIFICATINS.

Schult

**NON-REINFORCED PERIMETER/  
PORCH POST SUPPORT PIER -  
DETAIL - D15**

DATE: 07/18/07

9581-14.R.J.C.22.22.210(L)

PAGE #:

APPROVED BY





8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

SIMPSON MSTCM40 STRAP OR STHD14 STRAP IS IN ADDITION TO REQUIRED ANCHOR BOLTS AND RIM TO MUD SILL FASTENING REQUIREMENTS. (SEE HOME FLOOR TO SILL PLATE AND SILL PLATE TO FOUNDATION CHARTS FOR NUMBER OF STRAPS REQUIRED AT EACH HOLD-DOWN LOCATION.)

NOTE: STRAP MUST BE POSITIONED A MINIMUM OF 1 1/2" FROM EDGE OF FOUNDATION WALL.

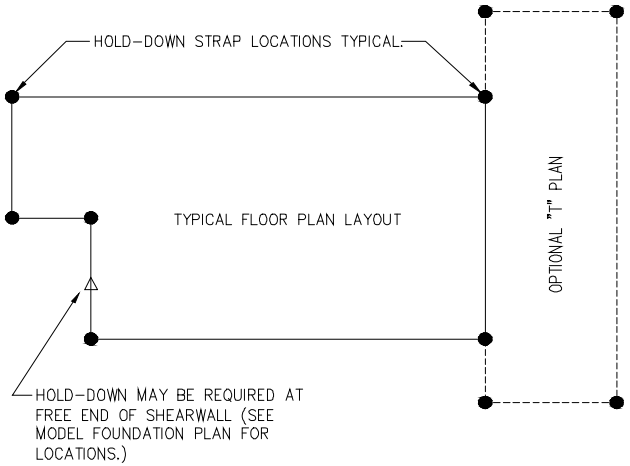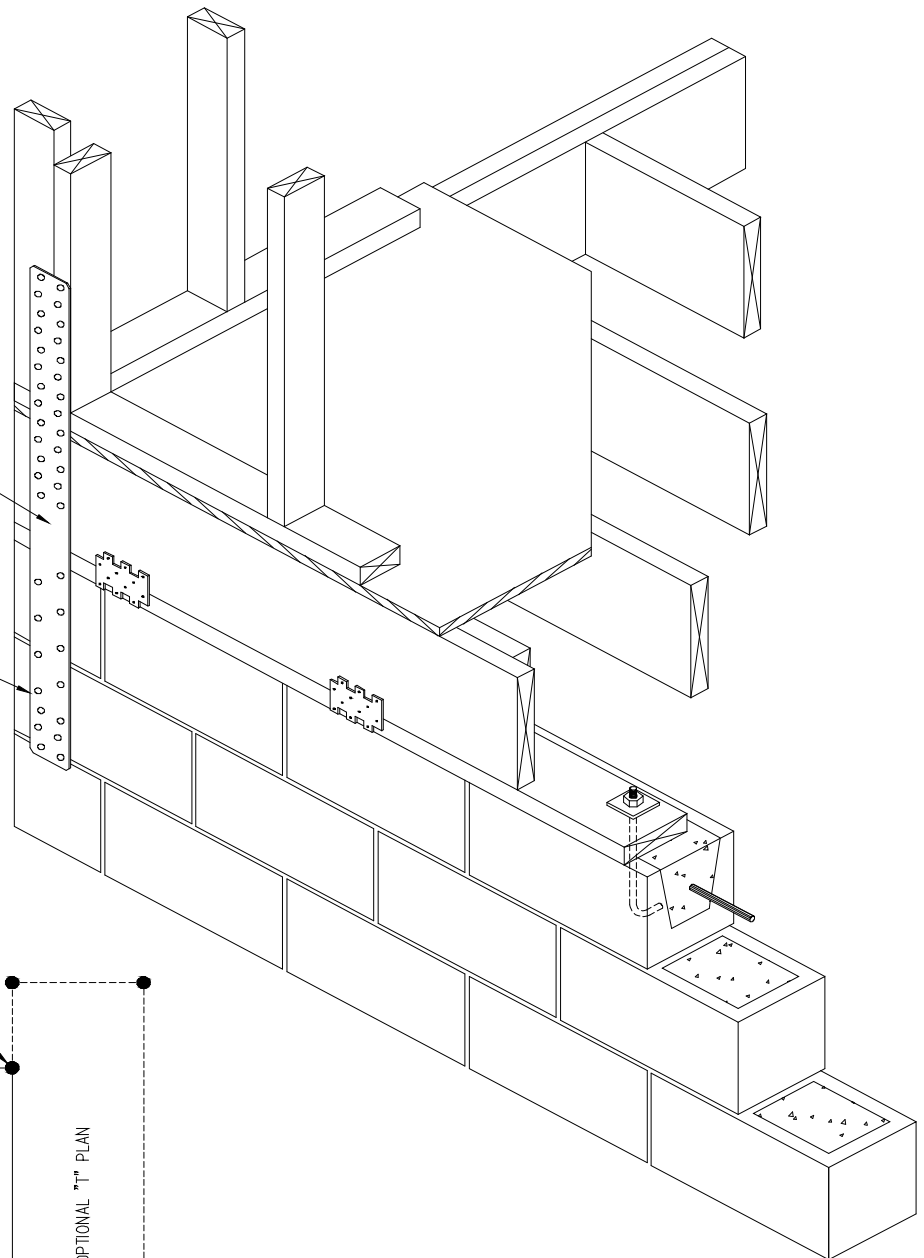

**SHEARWALL FOUNDATION HOLD-DOWN**

NOTES:

1. WHERE REQUIRED AT FREE-END HOLD-DOWNS (AS LOCATED ON THE FOUNDATION LAYOUT) OR AT BUILDING CORNERS PER THE FASTENING TABLES INCLUDED WITHIN THIS FOUNDATION DESIGN PACKAGE, THE FOUNDATION HOLD-DOWN STRAPS ARE THE RESPONSIBILITY OF OTHERS AND ARE NOT PROVIDED BY CLAYTON HOME BUILDING GROUP OR SUBSIDIARIES.
2. SIMPSON MSTCM40 SHALL BE FASTENED TO WALL STUD WITH (26) 16d NAILS AND TO FOUNDATION WALL WITH (14) 1/4" x 2 1/4" TITAN SCREWS.
3. SIMPSON MSTCM40 OR STHD14 STRAP MAY BE PLACED ON ENDWALL OR SIDEWALL. MINIMUM EDGE DISTANCE OF TITAN SCREW TO CONCRETE OR MASONRY BLOCK CORNER OF 1 1/2" MUST BE MAINTAINED.
4. SIMPSON MSTCM40 STRAP IS IN ADDITION TO THE REQUIRED ANCHOR BOLTS AND RIM TO MUD SILL FASTENING REQUIREMENTS.
5. SIMPSON STHD14 STRAP (POURED WALLS) MUST BE FASTENED TO WALL STUD WITH (38) .148X 3 1/4" NAILS.)
6. DESIGN STRAP CAPACITY: MSTCM40=4250# AND STHD14= 5025#

Schult

**SHEARWALL FOUNDATION HOLD-DOWN - DETAIL - D18**



DATE: 06/13/07

958I-14.R.J.C.22.22.210( )

PAGE #:


Page 22 of 29

WHEN FASTENING TABLES WITH H PLATES ARE USED SIMPSON LTP4 SHALL BE INSTALLED PER DETAIL H. TO BOTH BOTTOM MUD SILL TO UPPER MUD SILL & TOP MUD SILL TO RIM JOIST. SPACING PER HOME FLOOR TO SILL PLATE & SILL WITH H PLATE TABLES.

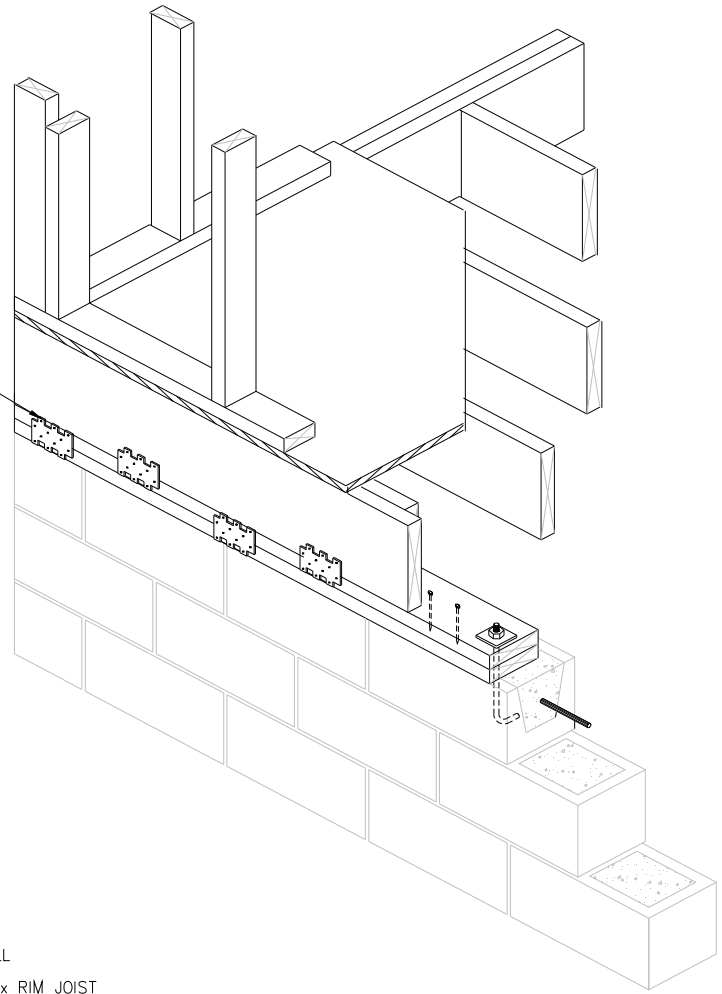

FASTEN UPPER TOP PLATE TO BOTTOM PLATE WITH 8D (.131 x 3") NAILS SPACED PER TYPE E FASTENER TYPE SPACING FOR RIM TO SILL

FASTEN RIM JOIST TO SILL WITH 10D (.148 x 3") CORROSION RESISTANT NAILS. ON CENTER SPACING OF FASTENER TYPE "E" IN TABLES. NOTE: IF SPACING REQUIRES ADDITIONAL TYPE "H" PLATE CONNECTORS, SEE DETAIL ABOVE AND DETAIL (H)

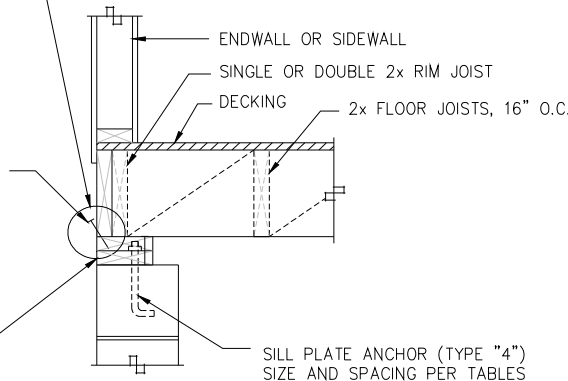

MIN. 2x6 TREATED MUD SILLS TOP PLATE ONLY MAY BE NOTCHED OR COUNTER SUNK TO RECEIVE NUTS/ WASHERS.

APPROVED BY  
**NIA** 8/16/2021  
 Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
 David Richter

**DOUBLE MUD SILL OPTION**

- NOTES:
1. MUD SILL TO FOUNDATION ANCHORS:  
 TYPE 4: 1/2" DIAMETER STEEL ANCHOR BOLTS EMBEDDED 7" MIN. INTO CONCRETE FOUNDATION WALL OR CLOSE CELL CMU WITH 2"x2"x1/8" WASHERS AND NUTS. BOLT HEADS SHALL NOT BE RECESSED INTO BOTTOM MUD SILL PLATE.
  2. UPPER MUD SILL MUST BE FASTENED TO LOWER MUD SILL WITH .131"x3" NAILS SPACED PER RIM JOIST TO MUD SILL SPACING TABLE FOR TYPE E FASTENERS.
  4. WHEN FASTENING TABLES WITH H PLATES ARE USED, SIMPSON LPT4 PLATES MUST BE INSTALLED FROM LOWER MUD SILL TO UPPER MUD SILL AND FROM UPPER MUD SILL TO RIM JOIST PER FASTENING SPACED PER RIM TO MUD SILL SPACING TABLES.

Schult

**DOUBLE MUD SILL FOUNDATION WALL DETAIL - D34**

DATE: 06/04/07

I-14.R.CC.C.42.0.210


PAGE #:



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

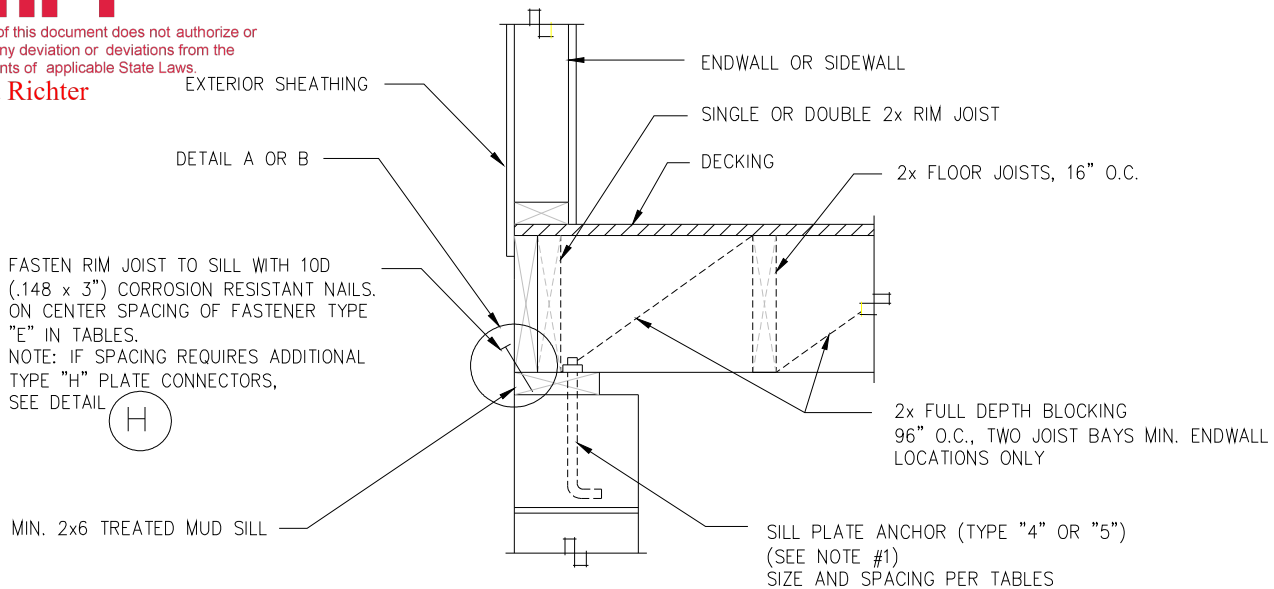


FASTEN RIM JOIST TO SILL WITH 10D (.148 x 3") CORROSION RESISTANT NAILS. ON CENTER SPACING OF FASTENER TYPE "E" IN TABLES.  
NOTE: IF SPACING REQUIRES ADDITIONAL TYPE "H" PLATE CONNECTORS, SEE DETAIL (H)

MIN. 2x6 TREATED MUD SILL

2x FULL DEPTH BLOCKING 96" O.C., TWO JOIST BAYS MIN. ENDWALL LOCATIONS ONLY

SILL PLATE ANCHOR (TYPE "4" OR "5") (SEE NOTE #1) SIZE AND SPACING PER TABLES

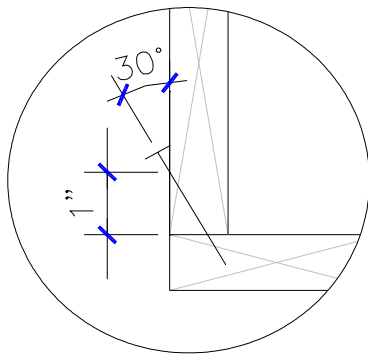


ALTERNATE FASTENER:

THE FOLLOWING ALTERNATE FASTENERS MAY BE USED WHEN SPACING IN CHART IS MULTIPLIED BY THE FOLLOWING FASTENER MULTIPLIER.

- 8D (.131 x 3") NAIL = .82
- 16D (.162 x 3 1/2") NAIL = 1.2
- #8 x 3" WOOD SCREW = .78

**DETAIL A- DIRECT RIM TO SILL FASTENING**

FASTENED THRU 7/16" MAX. EXTERIOR SHEATHING

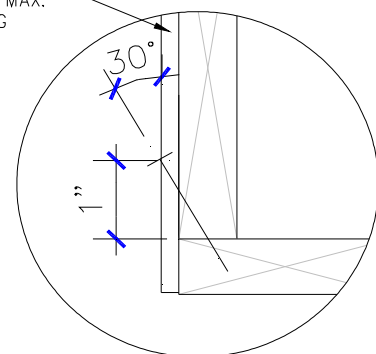

ALTERNATE FASTENER:

FASTENERS MAY BE INSTALLED THROUGH 7/16" MAXIMUM THICK WALL SHEATHING WHEN SPACING IN CHARTS ARE REDUCED BY MULTIPLYING BY THE FOLLOW:

- 10d (.148"x3") NAIL = .68
- 8D (.131 x 3") NAIL = .55
- 16D (.162 x 3 1/2") NAIL = .816
- #8 x 3" WOOD SCREW = .53

**DETAIL B- THRU SHEATHING RIM TO SILL FASTENING**

**FLOOR TO SILL PLATE FASTENING -TYPE "E" -ENDWALL OR SIDEWALL**

**NOTES:**

- 1) MUD SILL TO FOUNDATION ANCHORS:  
TYPE 4: DIAMETER STEEL ANCHOR BOLTS EMBEDDED 7" MIN. INTO CONCRETE FOUNDATION WALL OR CLOSE CELL CMU WITH WASHERS AND NUTS. BOLT HEADS SHALL NOT BE RECESSED INTO SINGLE SILL PLATE.  
TYPE 5: SIMPSON MAB OR MASA MUD SILL ANCHOR INSTALLED PER INSTALLATION INSTRUCTIONS
- 2) RIM TO MUD SILL FASTENING AND SILL TO FOUNDATION ANCHOR SPACING SHALL BE THE MINIMUM OF:
  - a) SPACING GIVEN IN APPLICABLE TABLES FOR UNIT CONFIGURATION AND WIND SPEED.
  - b) SPACING GIVEN IN BACKFILL/ SIDEWALL TABLES FOR GIVEN UNIT CONFIGURATION, MAXIMUM BASEMENT WALL HEIGHT, BACKFILL DEPTH, AND LOCAL SOIL CLASSIFICATION.


**Schult**


**FLOOR TO SILL PLATE FASTENING - ENDWALL OR SIDEWALL - DETAIL - E**

DATE: 04/17/07

9581-14.R.J.C.22.22.210( )

PAGE #:

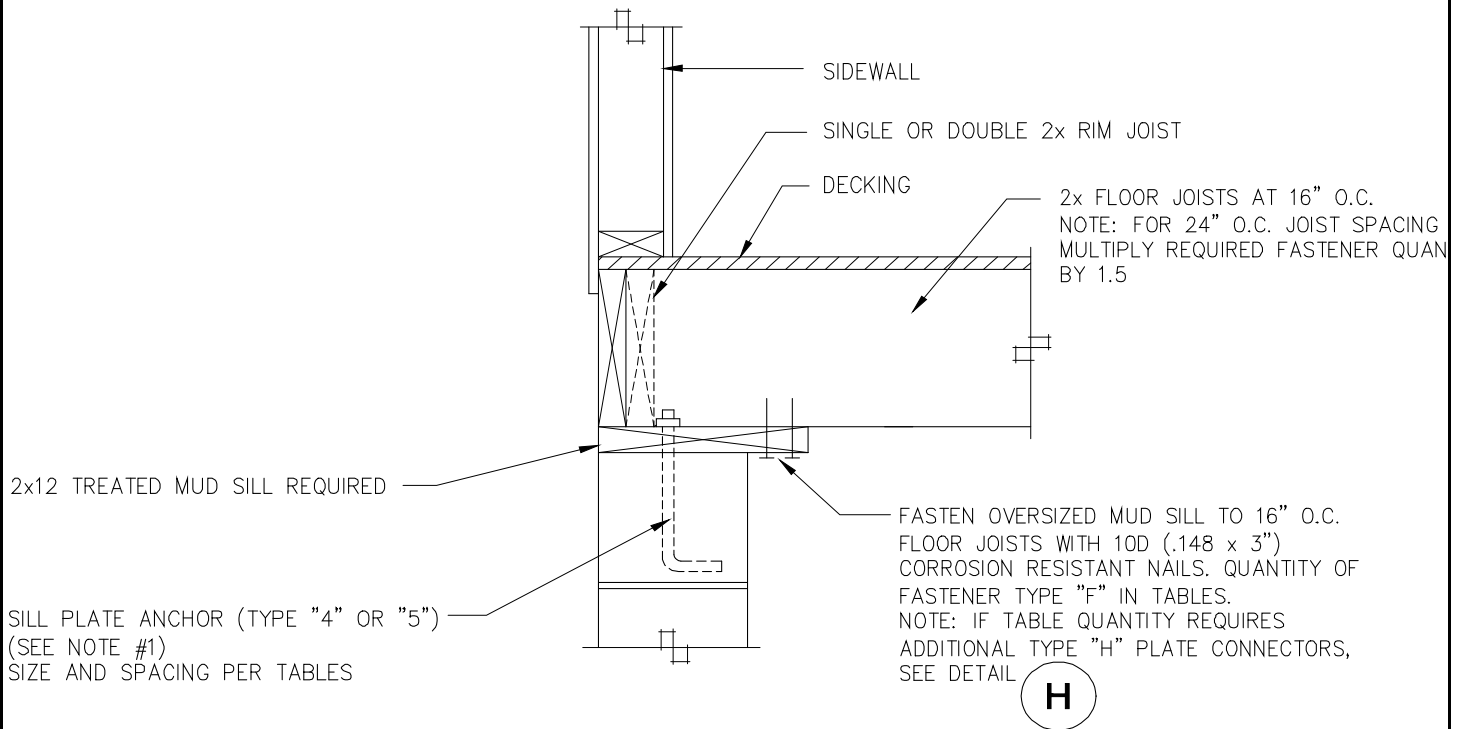

**APPROVED BY**  
  
 8/16/2021  
 Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
**David Richter**

ALTERNATE FASTENERS:  
 THE FOLLOWING ALTERNATE FASTENERS MAY BE USED WHEN QUANTITY IN TABLE IS MULTIPLIED BY THE FOLLOWING FASTENER MULTIPLIER.

8D (.131 x 3") NAIL = 1.21  
 16D (.162 x 3 1/2") NAIL = .83  
 #8 x 3" WOOD SCREW = 1.28

NOTE: THIS DETAIL FOR TYPE "F" FASTENING IS APPLICABLE TO SIDEWALL CONNECTIONS ONLY AND CAN NOT BE USED FOR ENDWALLS. SEE FASTENING TYPE "E" OR TYPE "G" FOR ENDWALL APPLICATION.

**FLOOR TO SILL PLATE FASTENING - TYPE "F" - SIDEWALL ONLY**

**NOTES:**

- 1) MUD SILL TO FOUNDATION ANCHORS:  
 TYPE 4: DIAMETER STEEL ANCHOR BOLTS EMBEDDED 7" MIN. INTO CONCRETE FOUNDATION WALL OR CLOSE CELL CMU WITH WASHERS AND NUTS. BOLT HEADS SHALL NOT BE RECESSED INTO SINGLE SILL PLATE.  
 TYPE 5: SIMPSON MAB OR MASA MUD SILL ANCHOR INSTALLED PER INSTALLATION INSTRUCTIONS
- 2) RIM TO MUD SILL FASTENING AND SILL TO FOUNDATION ANCHOR SPACING SHALL BE THE MINIMUM OF:
  - a) SPACING GIVEN IN APPLICABLE TABLES FOR UNIT CONFIGURATION AND WIND SPEED.
  - b) SPACING GIVEN IN BACKFILL/ SIDEWALL TABLES FOR GIVEN UNIT CONFIGURATION, MAXIMUM BASEMENT WALL HEIGHT, BACKFILL DEPTH, AND LOCAL SOIL CLASSIFICATION.


**Schult**

**FLOOR TO SILL PLATE  
 FASTENING - SIDEWALL ONLY  
DETAIL - F**


DATE: 04/17/07

958I-14.R.J.C.22.22.210(L)

PAGE #:

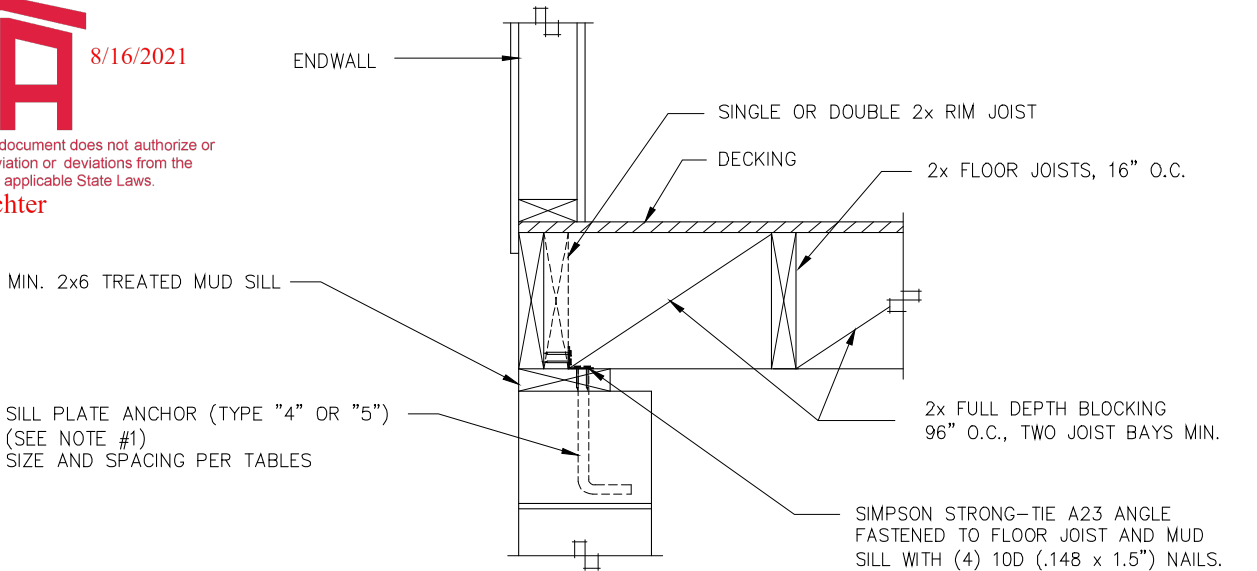

**ENDWALL DETAIL**

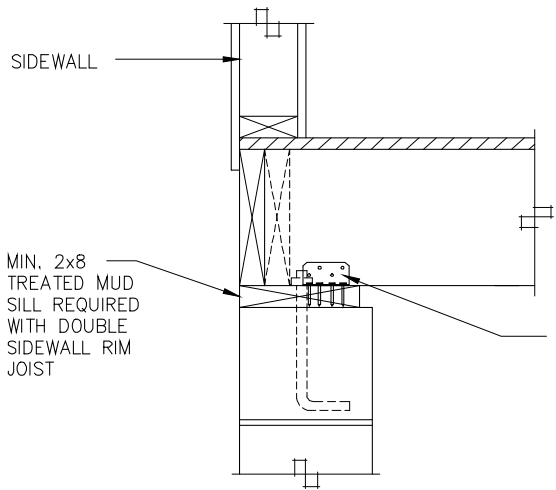


**SIDEWALL DETAIL**

SIMPSON STRONG-TIE A23 ANGLE FASTENED TO FLOOR JOIST AND MUD SILL WITH (4) 10D (.148 x 1.5") NAILS. (CORROSION RESISTANT NAIL REQUIRED INTO P.T. MUD SILL) O.C. SPACING PER FASTENER TYPE "G" IN TABLES.  
NOTE: IF SPACING REQUIRES ADDITIONAL TYPE "H" PLATE CONNECTORS, SEE DETAIL

**H**

SIMPSON STRONG-TIE A23 ANGLE FASTENED TO FLOOR JOIST AND MUD SILL WITH (4) 10D (.148 x 1.5") NAILS. (CORROSION RESISTANT NAIL REQUIRED INTO P.T. MUD SILL) USE (1) OR (2) ANGLES EA. JOIST PER FASTENER TYPE "G" IN TABLES.  
NOTE: IF SPACING REQUIRES ADDITIONAL TYPE "H" PLATE CONNECTORS, SEE DETAIL

**H**

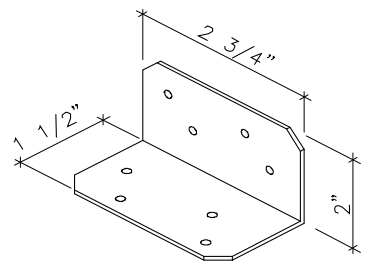

SIMPSON STRONG-TIE 'A23' ANGLE

**FLOOR TO SILL PLATE FASTENING - TYPE "G" - ENDWALL OR SIDEWALL**

NOTES:


- 1) MUD SILL TO FOUNDATION ANCHORS:
  - TYPE 4: DIAMETER STEEL ANCHOR BOLTS EMBEDDED 7" MIN. INTO CONCRETE FOUNDATION WALL OR CLOSE CELL CMU WITH WASHERS AND NUTS. BOLT HEADS SHALL NOT BE RECESSED INTO SINGLE SILL PLATE.
  - TYPE 5: SIMPSON MAB OR MASA MUD SILL ANCHOR INSTALLED PER INSTALLATION INSTRUCTIONS
- 2) RIM TO MUD SILL FASTENING AND SILL TO FOUNDATION ANCHOR SPACING SHALL BE THE MINIMUM OF:
  - a) SPACING GIVEN IN APPLICABLE TABLES FOR UNIT CONFIGURATION AND WIND SPEED.
  - b) SPACING GIVEN IN BACKFILL/ SIDEWALL TABLES FOR GIVEN UNIT CONFIGURATION, MAXIMUM BASEMENT WALL HEIGHT, BACKFILL DEPTH, AND LOCAL SOIL CLASSIFICATION.

**Schult**


**FLOOR TO SILL PLATE FASTENING - ENDWALL OR SIDEWALL - DETAIL - G**

DATE: 05/25/07 958I-14.R.J.C.22.22.210(L)




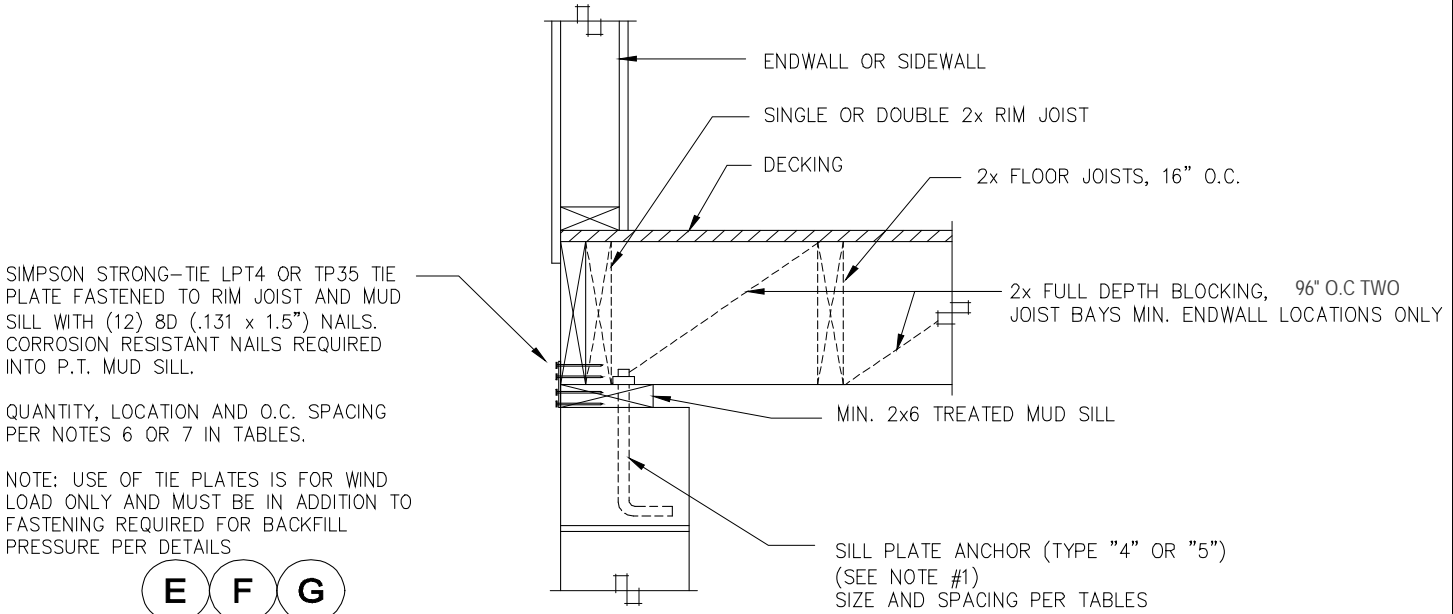


**E F G**

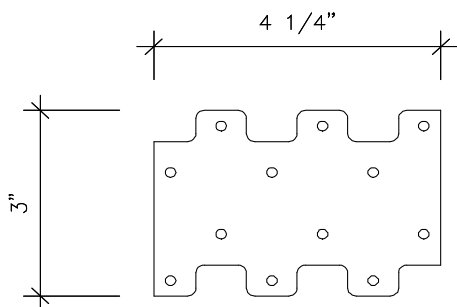

SIMPSON STRONG-TIE "LPT4" TIE PLATE

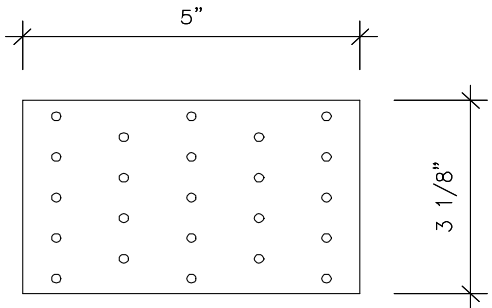

SIMPSON STRONG-TIE "TP35" TIE PLATE

**APPROVED BY**  
  
 8/16/2021  
 Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
**David Richter**

**FLOOR TO SILL PLATE FASTENING - TYPE "H" - ENDWALL OR SIDEWALL**

**NOTES:**

- 1) MUD SILL TO FOUNDATION ANCHORS:  
 TYPE 4: DIAMETER STEEL ANCHOR BOLTS EMBEDDED 7" MIN. INTO CONCRETE FOUNDATION WALL OR CLOSE CELL CMU WITH WASHERS AND NUTS. BOLT HEADS SHALL NOT BE RECESSED INTO SINGLE SILL PLATE.  
 TYPE 5: SIMPSON MAB OR MASA MUD SILL ANCHOR INSTALLED PER INSTALLATION INSTRUCTIONS
- 2) RIM TO MUD SILL FASTENING AND SILL TO FOUNDATION ANCHOR SPACING SHALL BE THE MINIMUM OF:
  - a) SPACING GIVEN IN APPLICABLE TABLES FOR UNIT CONFIGURATION AND WIND SPEED.
  - b) SPACING GIVEN IN BACKFILL/ SIDEWALL TABLES FOR GIVEN UNIT CONFIGURATION, MAXIMUM BASEMENT WALL HEIGHT, BACKFILL DEPTH, AND LOCAL SOIL CLASSIFICATION.

<b>Schult</b>	
<b>FLOOR TO SILL PLATE FASTENING - ENDWALL OR SIDEWALL - DETAIL - H</b>	
DATE: 04/17/07	958I-14.R.J.C.22.22.210(L)
PAGE #: <b>Page 27 of 29</b>	

# Home Floor to Sill Plate & Sill Plate to Foundation WITH TYPE H PLATE CONNECTORS (See note 6 & 7)

**SOIL CLASSES SC, ML-CL AND INORGANIC CL SOILS [Allowable bearing capacity of 1500 psf or less]**

**Unit Width: 29.67' to 29.67' Max.**

**Unit Length: 76' Max.**

**Roof Pitch: 6/12 to 6/12**

**Max. Roof Overhang: 12 "**

**Max. Sidewall Height: 9'**

**\*Wind Speed (3s): 90**

**Seismic Zone C**

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

Foundation Wall <sup>10</sup>		MAXIMUM FASTENER SPACING OR FASTENERS PER JOIST SPACING <sup>2,3 &amp; 5</sup>										# REQ'D S/W HDS SEE D18 /CORNER
		SIDEWALL FASTENING SPACING <sup>1</sup>					END WALL FASTENING					
		Rim to Sill <sup>6</sup>		Sill to Fnd. Wall			Rim to Sill <sup>7</sup>		Sill to Fnd. Wall			
Wall Height	Backfill Depth	Fastener Type			Anchor Spacing		Fastener Type		Anchor Spacing			
		E	F <sup>4</sup>	G <sup>4</sup>	4	5	E	G	4	5		
24 "	16 "	17.3" o.c.	1	1	72" o.c.	72" o.c.	40" o.c.	492" o.c.	57" o.c.	30" o.c.	0	
32 "	24 "	15.8" o.c.	1	1	72" o.c.	72" o.c.	16" o.c.	194" o.c.	55" o.c.	30" o.c.	0	
40 "	32 "	8.4" o.c.	2	1	72" o.c.	72" o.c.	8" o.c.	102" o.c.	49" o.c.	28" o.c.	0	
3.833'	3.33'	4.9" o.c.	2	1	45" o.c.	50" o.c.	5" o.c.	61" o.c.	40" o.c.	26" o.c.	0	
7'	4'	5.2" o.c.	2	1	48" o.c.	53" o.c.	5" o.c.	64" o.c.	41" o.c.	26" o.c.	0	
7'	5'	NA	4	1	24" o.c.	26" o.c.	NA	33" o.c.	24" o.c.	20" o.c.	0	
7'	6'	NA	6	2	13" o.c.	15" o.c.	NA	19" o.c.	13" o.c.	13" o.c.	0	
8'	4'	5.9" o.c.	2	1	55" o.c.	61" o.c.	6" o.c.	73" o.c.	44" o.c.	27" o.c.	0	
8'	5'	3.0" o.c.	3	1	27" o.c.	30" o.c.	3" o.c.	37" o.c.	27" o.c.	21" o.c.	0	
8'	6'	NA	6	2	15" o.c.	17" o.c.	NA	22" o.c.	15" o.c.	15" o.c.	0	
8'	7'	NA	9	2	10" o.c.	11" o.c.	NA	14" o.c.	10" o.c.	10" o.c.	0	
9'	3'	15.8" o.c.	1	1	72" o.c.	72" o.c.	16" o.c.	194" o.c.	55" o.c.	30" o.c.	0	
9'	4'	6.7" o.c.	2	1	62" o.c.	69" o.c.	7" o.c.	82" o.c.	46" o.c.	28" o.c.	0	
9'	5'	3.4" o.c.	3	1	31" o.c.	34" o.c.	3" o.c.	42" o.c.	30" o.c.	23" o.c.	0	
9'	6'	NA	5	2	17" o.c.	19" o.c.	NA	24" o.c.	17" o.c.	16" o.c.	0	
9'	7'	NA	8	2	11" o.c.	12" o.c.	NA	15" o.c.	11" o.c.	11" o.c.	0	
9'	8'	NA	11	NA	7" o.c.	8" o.c.	NA	10" o.c.	7" o.c.	8" o.c.	0	

**NOTES:**

1. Fastener Types A,B,C & D are not reflected in charts and are available prescriptively per table R404.1(1) in 2006 IRC.
2. See details for additional fastener options.
3. All fastener spacing must start within 12" maximum of each corner or half specified spacing (lesser of two).
4. Type F & G connectors are qty. per 16" oc. Joist spacing.
5. Fastener Type Key:  
 " Type E"- Fasteners toe-nailed through rim joist into sill plate (Refer to Detail E)  
 "Type F"- Fasteners direct nailed from sill plate into each floor joist (Applicable at Sidewalls only) (Refer to Detail F)  
 "Type G"- Number of Simpson A23 angles fastened to sill plate and each 16" OC. (2x8 min. sill plate) (Refer to Detail G)  
 "Type H"- Simpson LPT4 or TP35 plate fastened to rim joist and mud sill with (12) 8dx1.5" treated nails. (Refer to Detail H)
- Anchor Types:  
 "Type 4"- 1/2" x10" Anchor Bolt with 2"x2"x1/8" Washer between plate and nut.  
 "Type 5"- Simpson MAB15 (concrete) or MAB23 (concrete block) or MASA
6. Fasteners are in addition to (2) Type H tie plates spaced within 6' of corners & 96" oc. elsewhere along sidewalls.(See note 3)
7. Fasteners are in addition to Type H tie plates spaced at 33" oc. along endwall.
8. Three options (E,F,& G) for rim to sill fastening and two options (4 & 5) for sill plate to foundation anchorage have been provided in chart. Any combination of rim sill connectors and mud sill anchors maybe used.
9. All connection hardware, anchor bolts, straps, hold-downs, washers and fasteners shall be galvanized or stainless when in contact with PT sill plates or other PT lumber.
10. Maximum foundation wall height and maximum unbalanced backfill.

958I-14.R.J.C.22.22.210(L)

# Home Floor to Sill Plate & Sill Plate to Foundation WITHOUT TYPE H PLATE CONNECTORS (See note 6 & 7)

**SOIL CLASSES SC, ML-CL AND INORGANIC CL SOILS [Allowable bearing capacity of 1500 psf or less]**

**Unit Width: 29.67' to 29.67' Max.**

**Unit Length: 76' Max.**

**Roof Pitch: 6/12 to 6/12**

**Max. Roof Overhang: 12 "**

**Max. Sidewall Height: 9 '**

**\*Wind Speed (3s): 90**

**Seismic Zone C**

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter



Foundation Wall <sup>10</sup>		MAXIMUM FASTENER SPACING OR FASTENERS PER JOIST SPACING <sup>2,3 &amp; 5</sup>										# REQ'D S/W HDS SEE D18 /CORNER
		SIDEWALL FASTENING SPACING <sup>1</sup>					END WALL FASTENING					
Wall Height	Backfill Depth	Rim to Sill <sup>6</sup>			Sill to Fnd. Wall		Rim to Sill <sup>7</sup>		Sill to Fnd. Wall			
		Fastener Type			Anchor Spacing		Fastener Type		Anchor Spacing			
		E	F <sup>4</sup>	G <sup>4</sup>	4	5	E	G	4	5		
24 "	16 "	10.8" o.c.	1	1	72" o.c.	72" o.c.	8" o.c.	30" o.c.	57" o.c.	30" o.c.	1	
32 "	24 "	10.8" o.c.	1	1	72" o.c.	72" o.c.	8" o.c.	29" o.c.	55" o.c.	30" o.c.	1	
40 "	32 "	9.3" o.c.	1	1	72" o.c.	72" o.c.	7" o.c.	25" o.c.	49" o.c.	28" o.c.	1	
3.833 '	3.33 '	5.2" o.c.	2	1	45" o.c.	50" o.c.	5" o.c.	19" o.c.	40" o.c.	26" o.c.	1	
7 '	4 '	5.5" o.c.	2	1	48" o.c.	53" o.c.	5" o.c.	19" o.c.	41" o.c.	26" o.c.	1	
7 '	5 '	NA	4	1	24" o.c.	26" o.c.	3" o.c.	10" o.c.	24" o.c.	20" o.c.	0	
7 '	6 '	NA	6	2	13" o.c.	15" o.c.	NA	6" o.c.	13" o.c.	13" o.c.	0	
8 '	4 '	6.4" o.c.	2	1	55" o.c.	61" o.c.	6" o.c.	21" o.c.	44" o.c.	27" o.c.	1	
8 '	5 '	3.2" o.c.	3	1	27" o.c.	30" o.c.	3" o.c.	12" o.c.	27" o.c.	21" o.c.	0	
8 '	6 '	NA	6	2	15" o.c.	17" o.c.	NA	7" o.c.	15" o.c.	15" o.c.	0	
8 '	7 '	NA	9	2	10" o.c.	11" o.c.	NA	4" o.c.	10" o.c.	10" o.c.	0	
9 '	3 '	10.8" o.c.	1	1	72" o.c.	72" o.c.	8" o.c.	29" o.c.	55" o.c.	30" o.c.	1	
9 '	4 '	7.3" o.c.	2	1	62" o.c.	69" o.c.	6" o.c.	23" o.c.	46" o.c.	28" o.c.	1	
9 '	5 '	3.6" o.c.	3	1	31" o.c.	34" o.c.	4" o.c.	14" o.c.	30" o.c.	23" o.c.	0	
9 '	6 '	NA	5	1	17" o.c.	19" o.c.	NA	8" o.c.	17" o.c.	16" o.c.	0	
9 '	7 '	NA	8	2	11" o.c.	12" o.c.	NA	4" o.c.	11" o.c.	11" o.c.	0	
9 '	8 '	NA	11	NA	7" o.c.	8" o.c.	NA	3" o.c.	7" o.c.	8" o.c.	0	

**NOTES:**

1. RESERVED
2. See details for additional fastener options.
3. All fastener spacing must start within 12" maximum of each corner or half specified spacing (lesser of two).
4. Type F & G connectors are qty. per 16" oc. Joist spacing.
5. Fastener Type Key:  
 " Type E"- Fasteners toe-nailed through rim joist into sill plate (Refer to Detail E)  
 "Type F"- Fasteners direct nailed from sill plate into each floor joist (Applicable at Sidewalls only) (Refer to Detail F)  
 "Type G"- Number of Simpson A23 angles fastened to sill plate and each 16" OC. (2x8 min. sill plate) (Refer to Detail G)  
 "Type H"- Simpson LPT4 or TP35 plate fastened to rim joist and mud sill with (12) 8dx1.5" treated nails. (Refer to Detail H)
- Anchor Types:  
 "Type 4"- 1/2" x10" Anchor Bolt with 2"x2"x1/8" Washer between plate and nut.  
 "Type 5"- Simpson MAB15 (concrete) or MAB23 (concrete block) or MASA
6. Fasteners reflected in chart do NOT require "H type" connector plates to be installed along sidewall.
7. Fasteners reflected in chart do NOT require "H type" connector plates to be installed along endwall.
8. Three options (E,F,& G) for rim to sill fastening and two options (4 & 5) for sill plate to foundation anchorage have been provided in chart. Any combination of rim sill connectors and mud sill anchors maybe used.
9. All connection hardware, anchor bolts, straps, hold-downs, washers and fasteners shall be galvanized or stainless when in contact with PT sill plates or other PT lumber.
10. Maximum foundation wall height and maximum unbalanced backfill.

9581-14.R.J.C.22.22.210(\_)

**GENERAL NOTES:**

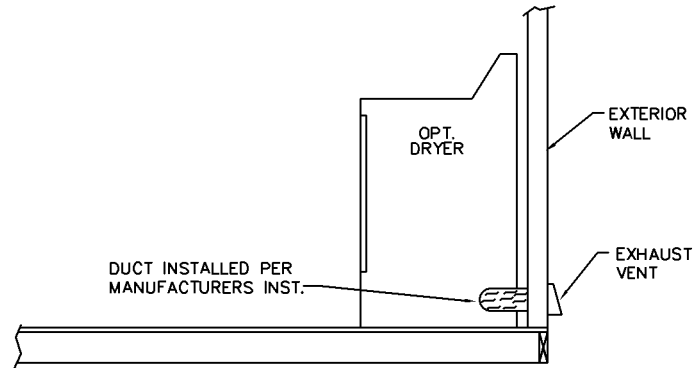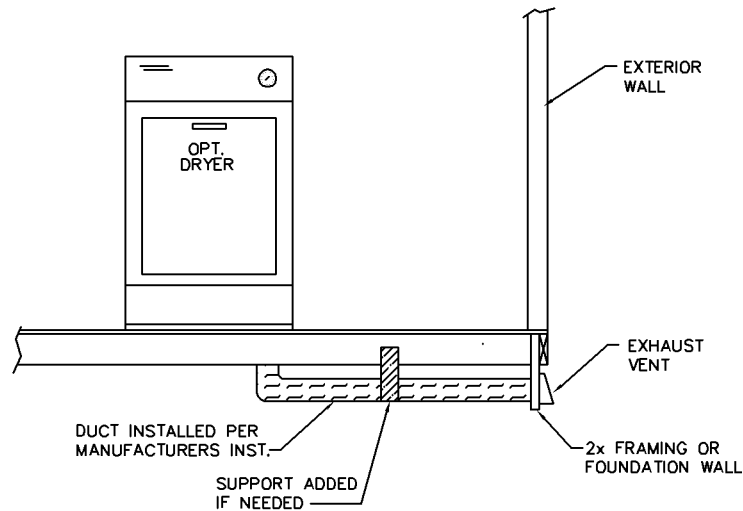

**INSTALLTION INSTRUCTIONS:**

EXHAUST DUCTS FOR DOMESTIC CLOTHES DRYERS SHALL BE CONSTRUCTED OF METAL OR NONCOMBUSTIBLE MATERIAL OF EQUAL STRENGTH AND CORROSION RESISTANCE AND SHALL HAVE A SMOOTH INTERIOR FINISH. NO PART OF THE DRYER DUCT TO BE IN CONTACT WITH THE GROUND. THE DUCT TO RUN TO THE OUTSIDE OF THE UNIT AND SHALL NOT TERMINATE UNDERNEATH THE UNIT. A APPROVED DAMPER TO BE INSTALLED ON THE END OF THE DUCT.

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

**APPROVAL SEAL:**



**TITLE:**  
**DRYER VENT INSTALLATION**

Drawn by: O'Neal

Date: 4/11/07 Draw #:

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

ELECTRICAL LEGEND (NOT TO SCALE)			
	LIGHT		PANEL BOX
	CAN LIGHT		THERMOSTAT
	PULL CHAIN LIGHT		SWITCH
	BATH FAN		3-WAY SWITCH
	FLUORESCENT LIGHT		PHONE JACK
	CABLE JACK		CEILING MOUNT C.O. & SMOKE DETECTOR
	15 AMP RECEPT FLOOR LEVEL		CEILING MOUNT C.O. DETECTOR
	15 AMP RECEPT CABINET LEVEL		WALL MOUNT SMOKE DETECTOR
	15 AMP RECEPT SIDEWAYS		CEILING MOUNT SMOKE DETECTOR
	20 AMP RECEPT FLOOR LEVEL		SWITCH LEG
	20 AMP RECEPT CABINET LEVEL		JUNCTION BOX
	20 AMP RECEPT SIDEWAYS		CEILING FAN
	240 VOLT RECEPT		
	15 AMP WATERPROOF RECEPT		POT & PAN RACK
	20 AMP WATERPROOF RECEPT		HEAT TAPE RECEPT
	FURNACE		WATER HEATER
A DASHED SYMBOL REPRESENTS AN OPTION			
GFI-INDICATES A GROUND FAULT PROTECTED RECEPT			

# PLUMBING FIXTURE DESCRIPTION CHART

APPLIANCE	MANUFACTURER	MODEL #	ANSI/ASME STANDARD
TOILET	BRISTOL BAY	VCEFB-03B	
SINKS	LYONS EL MUSTICE & SON PREMIUM FLOW CORESTONE & TEKA REVERE	KS01P4-TB #610 UTILITY SINGLE BOWL DOUBLE BOWL BAR SINK	
LAVATORIES	BRISTOL BAY	VCL-10	
TUB SHOWER	BAYMONT BATHWARE	5118 5100 5109	UL
SHOWER	BAYMONT BATHWARE	3309 3308 3304	UL
TUB	BAYMONT BATHWARE	2205 2272	UL

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

**Trenco**

818 Soundside Rd  
Edenton, NC 27932

Re: WPL-913-016-0315\_(16W)  
Schult - Richfield (MFG: 00958)

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Wood Perfect, Ltd.

Pages or sheets covered by this seal: I38370583 thru I38370596

My license renewal date for the state of North Carolina is December 31, 2019.

North Carolina COA: C-0844



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

August 30, 2019

Liu, Xuegang

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	Schult - Richfield (MFG: 00958)	138370583
WPL-913-016-0315_(16W)	9529-15B	HINGED TRUSS	1	1	M9529: 6/12 32 WIDE MOD/HUD Job Reference (optional)	

Wood Perfect, LLC, Guin, AL 33563

7.640 s Aug 16 2017 MiTek Industries, Inc. Fri Aug 30 08:38:42 2019 Page 1  
ID:7DsdCzXbX3z0puliq?qj47z75\_A-RmfLUqcqAavDs5JamB4GbUJW8r6l\_1Je3rHHZ\_yiIWR

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

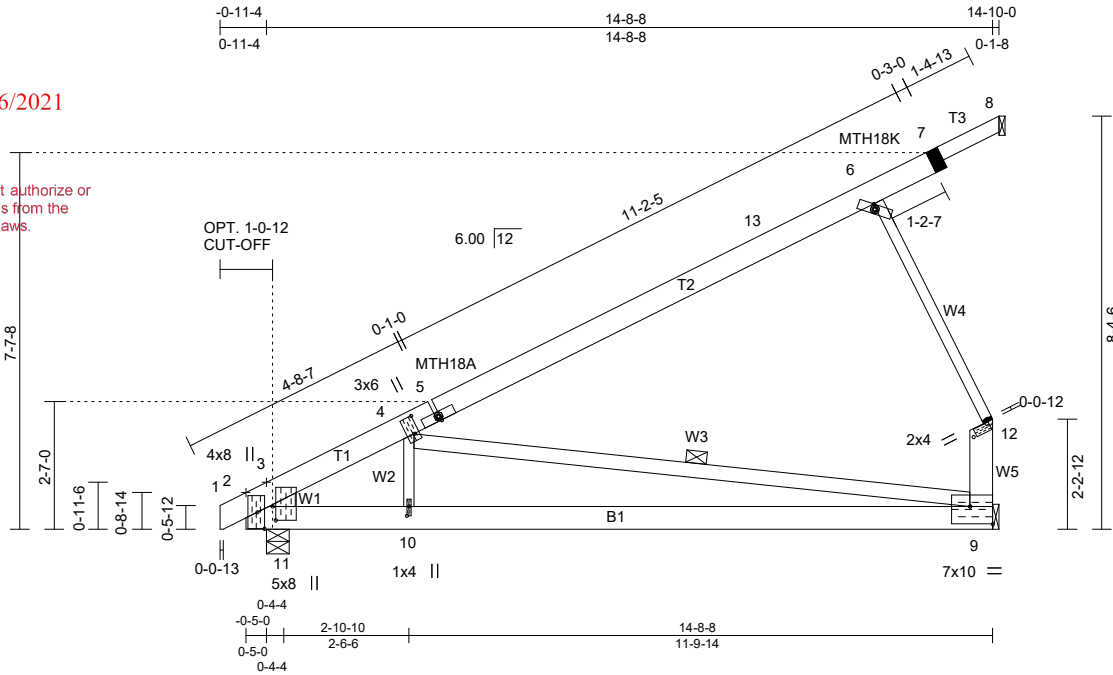


Plate Offsets (X,Y)--	[2:0-4-0,0-1-12], [4:0-4-4,0-1-4], [5:0-0-5,0-1-2], [6:0-0-11,0-1-2], [9:0-8-5,1-2-12], [9:Edge,0-4-4], [10:0-2-4,0-0-8], [11:0-3-6,0-0-12]
-----------------------	---

<b>SPACING--</b> 2-0-0 <b>LOADING (psf)</b>	<b>SPACING--</b> 1-4-0 <b>LOADING (psf)</b>	<b>SPACING--</b> 2-0-0 Plate Grip DOL 1.15 Lumber DOL 1.15 Rep Stress Incr YES Code IBC2015/TPI2014	<b>CSI.</b> TC 0.70 BC 0.55 WB 0.64 (Matrix)	<b>DEFL.</b> in (loc) l/defl L/d Vert(LL) -0.17 9-10 >999 240 Vert(CT) -0.32 9-10 >551 180 Horz(CT) 0.01 9 n/a n/a	<b>PLATES GRIP</b> MT20 197/144 MT18HS 197/144  Weight: 80 lb FT = 0%
--	--	---	--	--	--

<b>LUMBER-</b> TOP CHORD 2x6 SPF No.2 *Except* 7-8: 2x4 SPF No.2 BOT CHORD 2x6 SPF No.2 WEBS 2x3 SPF Stud *Except* 4-9: 2x4 SPF No.2, 9-12: 2x6 SPF Stud, 3-11: 2x6 SP No.2	<b>BRACING-</b> TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. BOT CHORD Rigid ceiling directly applied or 7-0-1 oc bracing. WEBS 1 Row at midpt 4-9 JOINTS 1 Brace at J(s): 12	<b>REACTIONS.</b> (lb/size) 9=627/Mechanical, 8=0/Mechanical, 2=735/0-5-8 Max Horz 8=103(LC 19), 2=464(LC 12) Max Uplift 9=506(LC 12), 2=321(LC 12) Max Grav 9=730(LC 19), 2=771(LC 19)	<b>FORCES.</b> (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown. TOP CHORD 2-3=1340/530, 3-4=1188/355, 4-5=503/24, 5-13=474/42, 6-13=279/57 9-12=463/492 BOT CHORD 2-11=792/929, 10-11=702/929, 9-10=792/929 WEBS 4-10=0/439, 4-9=779/569, 6-12=511/543, 3-11=273/252
--	--	--	--

**REQUIRED FIELD JOINT CONNECTIONS** - Maximum Compression (lb)/ Maximum Tension (lb)/ Maximum Shear (lb)/ Maximum Moment (lb-in)  
7=148/84/60/0, 12=511/543/0/0

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=152mph (3-second gust) Vas=120mph @24in o.c.; TC DL=4.4psf; BCDL=4.4psf; Alt=180mph @16ft o.c.; TC DL=6.6psf; BCDL=6.0psf; h=22ft; Cat. II; Exp C; enclosed; MWFRS (envelope) gable end zone and C-C Exterior (2) zone, cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) TC LL: ASCE 7-10; Pg=30.0 psf (ground snow); Ps=23.1 psf (roof snow); Category II; Exp C; Partially Exp. C=1-1
  - 3) Roof design snow load has been reduced to account for slope.
  - 4) Unbalanced snow loads have been considered for this design.
  - 5) This truss has been designed for greater of min roof live load of 18.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
  - 6) As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
  - 7) All plates are MT20 plates unless otherwise indicated.
  - 8) See HINGE PLATE DETAILS for plate placement.
  - 9) Provisions must be made to prevent lateral movement of hinged member(s) during transportation.
  - 10) All additional member connections shall be provided by others for forces as indicated.
  - 11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 12) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 13) Refer to girder(s) for truss to truss connections.
  - 14) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 506 lb uplift at joint 2.

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.

August 30, 2019

818 Soundside Road  
Edenton, NC 27932



Job	Truss	Truss Type	Qty	Ply	Schult - Richfield (MFG: 00958)	I38370583
WPL-913-016-0315_(16W)	9529-15B	HINGED TRUSS	1	1	M9529: 6/12 32 WIDE MOD/HUD Job Reference (optional)	

Wood Perfect, LLC, Guin, AL 33563

7.640 s Aug 16 2017 MiTek Industries, Inc. Fri Aug 30 08:38:43 2019 Page 2  
ID:7DsdCZXbX3z0puliq?qj47z75\_A-vyDjiAclxu14UFumKvbV8iFhtFSxjUYoHV0r5QyiwQ

**NOTES-**

- 15) "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- 16) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



818 Soundside Road  
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Schullt - Richfield (MFG: 00958)	138370593
WPL-913-016-0315_(16W)	9529-15L	HINGED TRUSS	1	1	M9529-P4: 6/12 32 WIDE MOD/HUD Job Reference (optional)	

Wood Perfect, LLC, Guin, AL 33563

ID:7DsdCZxbX3z0puliq?j47Z75\_A-CJ8MAZihH1v4gKw6Etd8wA2u63tkseHqv5DirWyyiwJ

4-0-0 SIDE WALL PORCH

**APPROVED BY**  
**NIA**  
Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.  
**David Richter**

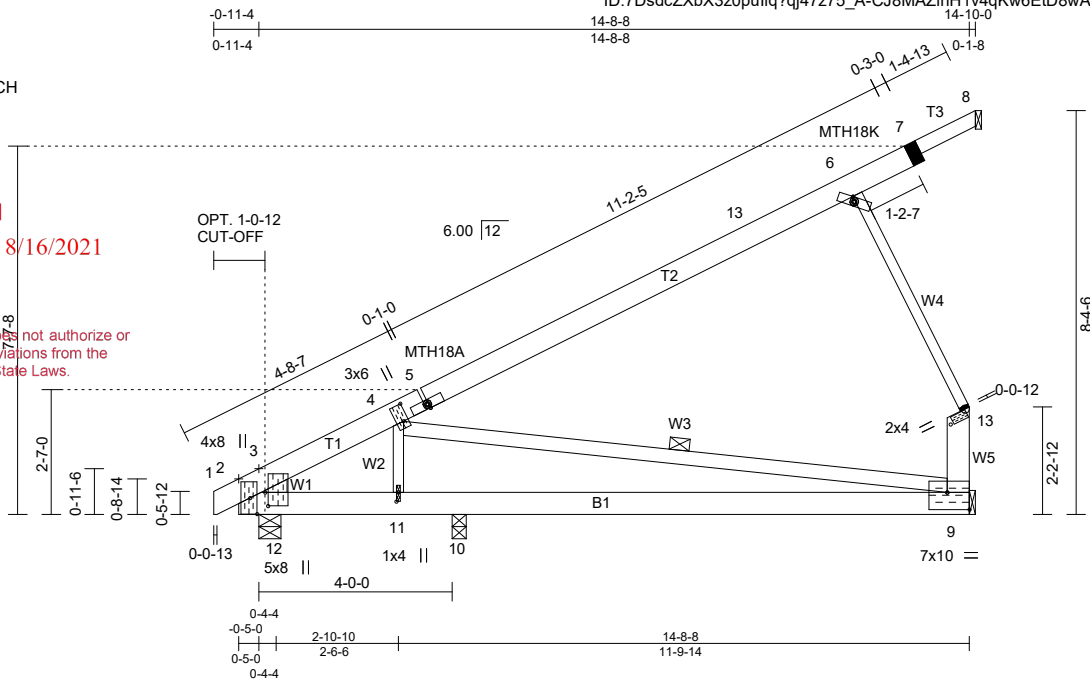


Plate Offsets (X,Y)-- [2:0-4-0,0-1-12], [4:0-4-4,0-1-4], [5:0-0-5,0-1-2], [6:0-0-11,0-1-2], [9:0-8-5,1-2-12], [9:Edge,0-4-4], [11:0-2-4,0-0-8], [12:0-3-6,0-0-12]					
<b>SPACING--</b> 2-0-0 <b>LOADING (psf)</b>	<b>SPACING--</b> 1-4-0 <b>LOADING (psf)</b>	<b>SPACING--</b> 2-0-0 <b>LOADING (psf)</b>	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES GRIP</b>
TCLL 23.1 (Ground Snow=30.0) TCDL 11.0 BCLL 0.0 * BCDL 10.0	TCLL 34.7 (Ground Snow=45.0) TCDL 16.5 BCLL 0.0 * BCDL 15.0	Plate Grip DOL 1.15 Lumber DOL 1.15 Rep Stress Incr YES Code IBC2012/TPI2007	TC 0.70 BC 0.42 WB 0.64 (Matrix)	in (loc) l/defl L/d Vert(LL) -0.14 9-10 >900 240 Vert(TL) -0.18 9-10 >679 180 Horz(TL) -0.01 9 n/a n/a	MT20 197/144 MT18HS 197/144  Weight: 80 lb FT = 0%



<b>LUMBER--</b>	<b>BRACING--</b>
TOP CHORD 2x6 SPF No.2 *Except* 7-8: 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals
BOT CHORD 2x6 SPF No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing
WEBS 2x3 SPF Stud *Except* 4-9: 2x4 SPF No.2, 9-13: 2x6 SPF Stud, 3-12: 2x6 SF No.2	WEBS 1 Row at midpt. 4-9
<b>REACTIONS.</b> (lb/size) 9=516/Mechanical, 8=0/Mechanical, 2=460/0-3-0, 10=389/0-3-8 Max Horz 8=-103(LC 19), 2=464(LC 12) Max Uplift 9=501(LC 12), 2=302(LC 12), 10=24(LC 12) Max Grav 9=625(LC 19), 2=511(LC 19), 10=570(LC 5)	JOINTS 1 Brace at Jt(s): 13
<b>FORCES.</b> (lb) - Max. Comp/Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD 2-3=-747/118, 3-4=-562/453, 4-5=-803/24, 5-14=-474/42, 6-14=-279/57, 9-13=-463/492	
BOT CHORD 2-12=-893/400, 1-12=-893/400, 10-11=-893/400, 9-10=-893/400	
WEBS 4-11=-365/281, 4-9=-189/672, 6-13=-611/543, 3-12=-432/250	

- REQUIRED FIELD JOINT CONNECTIONS** - Maximum Compression (lb)/ Maximum Tension (lb)/ Maximum Shear (lb)/ Maximum Moment (lb-in)  
7=148/84/60/0, 13=511/543/0/0
- NOTES--**
- 1) Wind: ASCE 7-10; Vult=152mph (3-second gust) Vasd=120mph @24in o.c.; TC DL=4.4psf; BCDL=4.0psf; (Alt. 180mph @ 16in o.c.; TC DL=6.6psf; BCDL=6.0psf); h=22ft; Cat. II; Exp C; enclosed; MWFRS (envelope) gable end 20lb and C-C Exterior 20lb and cantilever left exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) TCLL: ASCE 7-10; Pg=30.0 psf (ground snow); Ps=23.1 psf (roof snow); Category II; Exp C; Partially Exposed; C=1-1
  - 3) Roof design snow load has been reduced to account for slope
  - 4) Unbalanced snow loads have been considered for this design
  - 5) This truss has been designed for greater of min roof live load of 18.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
  - 6) As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
  - 7) All plates are MT-20 plates unless otherwise indicated.
  - 8) See HINGE PLATE DETAILS for plate placement.
  - 9) Provisions must be made to prevent lateral movement of hinged member(s) during transportation.
  - 10) All additional member connections shall be provided by others for forces as indicated.
  - 11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 12) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 13) Refer to girder(s) for truss to truss connections.
  - 14) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 501 lb uplift at joint 2 and 24 lb uplift at joint 10.


Continued on page 2

**WARNING--Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.

August 30, 2019



818 Soundside Road  
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Schult - Richfield (MFG: 00958)	I38370593
WPL-913-016-0315_(16W)	9529-15L	HINGED TRUSS	1	1	M9529-P4: 6/12 32 WIDE MOD/HUD Job Reference (optional)	

Wood Perfect, LLC, Guin, AL 33563

7.640 s Aug 16 2017 MiTek Industries, Inc. Fri Aug 30 08:38:50 2019 Page 2  
ID:7DsdCZXbX3z0puliq?qj47z75\_A-CJ8MAZihH1v4qKw6EtD8wA2u63tkseHqv5DirWyiWJ

**NOTES-**

- 15) "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- 16) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

APPROVED BY



8/16/2021

Approval of this document does not authorize or approve any deviation or deviations from the requirements of applicable State Laws.

David Richter

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




818 Soundside Road  
Edenton, NC 27932

# Symbols

## PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

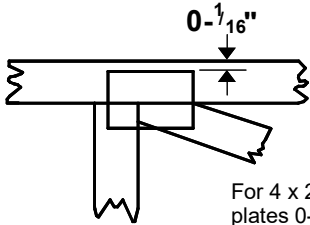

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.


\* Plate location details available in MiTek 20/20 software or upon request.

## PLATE SIZE

4 x 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

## Industry Standards:

- ANSI/TPI1: National Design Specification for Metal Plate Connected Wood Truss Construction.
- DSB-89: Design Standard for Bracing.
- BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

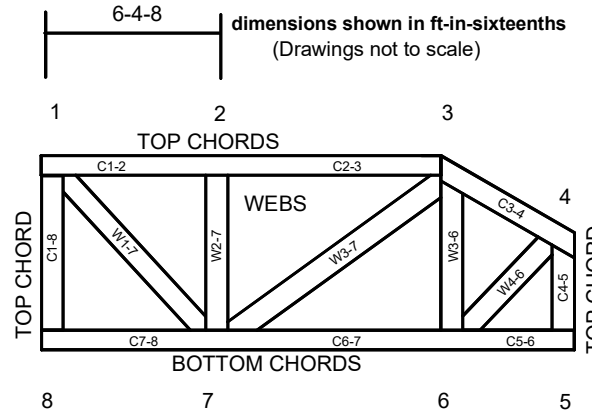

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

## PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988  
ER-3907, ESR-2362, ESR-1397, ESR-3282



Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 10/03/2015

# General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

- Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
- Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
- Never exceed the design loading shown and never stack materials on inadequately braced trusses.
- Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
- Cut members to bear tightly against each other.
- Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
- Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
- Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
- Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
- Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
- Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
- Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
- Top chords must be sheathed or purlins provided at spacing indicated on design.
- Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
- Connections not shown are the responsibility of others.
- Do not cut or alter truss member or plate without prior approval of an engineer.
- Install and load vertically unless indicated otherwise.
- Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
- Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
- Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.



# NORTH CAROLINA MODULAR PLANS REVIEW CHECKLIST

PAGE 2 of 3

revised June 2018

## Plan Sheet Page # and NOTES

**MECHANICAL**

Design calculations	attached
Installed unit capacity	attached
Supply and returns (locations and sizes)	4-4 & 4-5
Duct sizes	4-4 & 4-5
Specifications (units, ducts)	1-1, 4-4 & 4-5
All appliances furnished by mfg. shown on plans	1-1, exhaust fans 11-1

**ELECTRICAL**

Plan	11-1
Location of all electrical boxes	11-1
Electrical panel location	11-1
Note regarding main disconnect (if applicable)	
Exterior lighting and receptacles	11-1
Ground level receptacles (if applicable)	11-1
Smoke detector location(s)	11-1
Electrical load calculations	TS-5
Electrical panel layout (breaker and wire sizes, circuit schedule)	11-1
Panel and service entrance sizes	Panel: 1-0a, SE ref in set-up on 1-0
All fixtures furnished by mfg. shown on plans	11-1

**ACCESSIBILITY**

**(for other than 1 & 2 family dwellings)**

Entrances and means of egress	
Doors, doorways, and door hardware	
Stairs and handrails	
Toilet rooms, plumbing fixtures, grab bars, etc	
Bathrooms and shower rooms	
Occupancy specific requirements	
Multi-family dwellings: Type A and B units	

**FLOOR X-SECTION**

Joists and beam sizes and spacing	1-0.2
Materials species and grade	1-0.2
Sheathing, decking, and concrete as applicable	1-0.2
Fastening instructions	1-0.2
Insulation	1-0.2
Details as required for clarification	1-0.2 , other details ref manual on 1-0.2

**WALL X-SECTION**

Stud and column sizes and spacing	studs: 1-0.2; column charts: 1-0.2
Materials species and grade	1-0.2
Sheathing and bracing	1-0.2
Headers and lintels	header charts: 1-0.2
Finishes	1-0.2
Fastening instructions	1-0.2
Insulation	1-0.2
Details as required for clarification	Ref manual on 1-0.2

**NORTH CAROLINA  
MODULAR PLANS REVIEW CHECKLIST**

PAGE 3 of 3

revised June 2018

**Plan Sheet Page # and NOTES**

**CEILING / ROOF X-SECTION**

Truss, rafter, and beam spacing	1-0.2
Lumber species and grade	1-0.2
Sheathing and decking	1-0.2
Finishes	1-0.2
Fastening instructions	1-0.2
Insulation	1-0.2
Details including NC sealed truss designs or manual reference	man ref to trusses 1-0.2, other details man ref 1-0.2

**FOUNDATION PLAN**

Footings, pier, and curtain wall locations and specifications	21-30 PSF (OFF FRAME) & 21-PS (ON FRAME)
X-sections with dimensions	21-30 PSF (OFF FRAME) & 21-PS (ON FRAME)
Anchorage - sill plate to piers and curtain wall	21-30 PSF (OFF FRAME) & 21-PS (ON FRAME)
Anchorage - building to sill plate	21-30 PSF (OFF FRAME) & 21-PS (ON FRAME)
Anchorage - tie downs (lateral and longitudinal)	21-30 PSF (OFF FRAME) & 21-PS (ON FRAME)
Soil bearing capacity	21-30 PSF (OFF FRAME) & 21-PS (ON FRAME)
Minimum concrete compressive strength	21-30 PSF (OFF FRAME) & 21-PS (ON FRAME)
Mortar type	21-30 PSF (OFF FRAME) & 21-PS (ON FRAME)
Ventilation requirements (with and without vapor barrier)	21-30 PSF (OFF FRAME) & 21-PS (ON FRAME)
Crawl space access requirements	21-30 PSF (OFF FRAME) & 21-PS (ON FRAME)

**ENERGY COMPLIANCE**

Demonstrated compliance	PRESCRIPTIVE
-------------------------	--------------

**SET-UP INSTRUCTIONS**

Floor and ceiling connections	ref to set-up manual on 1-0.2
Marriage wall connections	ref to set-up manual on 1-0.2
Roof set-up and connection	ref to set-up manual on 1-0.2
Plumbing connections	ref to set-up manual on 1-0.2
Mechanical connections	ref to set-up manual on 1-0.2
Electrical connections	ref to set-up manual on 1-0.2
Fire stopping	1-0.2
Air infiltration elimination	ref to set-up manual on 1-0.2
Notice to inspections department attachment if set-up instructions are by attachment	1-0.2

**ITEMS NOT INSPECTED IN PLANT**

List of items not inspected by 3rd. Party	1-0.2
Notice to inspections department	1-0.2