

A Groundworks' Company

Scope of Work for: 80 Doonbeg Dr Fuquay-Varina NC 27526

The following will be performed as a crawlspace encapsulation project:

**CrawlSeal System to include the following:

-20 ml Vapor Barrier installed wall to wall with 100% floor coverage. All sections of liner will be overlapped a minimum of 1' and will be seamed together, attached with Christmas Tree fasteners, and caulked.

-Install WallSeal on basement walls to help prevent water vapor and moisture intrusion as well as direct wall leakage to the waterproofing system. (12 ml Vapor Barrier on Walls) -Wrap all existing CMU/Brick Piers 20 ml Vapor Barrier. Contractor will leave a termite inspection gap at the top of each pier. The liner will be fastened to the pier and the top edge of the liner will be sealed with caulking.

-All Vents will be sealed from inside the crawl space with R-10 Rigid 2" Foam Sheathing.

**Existing R-19 insulation will remain in the floor system.


**AprilAire E100 Dehumidifier install - unit specifications on page 2 Using Existing Electrical



A Groundworks' Company

	SPECIFIC	ATIONS
	SPECIFIC	ATIONS
Capacity		
	@ 80°F/60% RH	100 ppd
	@ 73°F/60% RH	85 ppd
Energy Factor		
	@ 80°F/60% RH	2.6 L/kW-h
	@ 73°F/60% RH	2.35 L/kW-h
Airflow @ varyin (external static p	g E.S.P. pressure - dry coil)	
	0.0" w.c.	280 CFM
	0.2" w.c.	245 CFM
	0.4" w.c.	210 CFM
Voltage, phase, frequency		120VAC, 1 phase, 60 Hz
Current draw ⁽¹⁾		6.9 Amps
Noise		55 dBA ducted
		Width: 14"
Dimensions: (cabinet only) ⁽²⁾		Height: 15"
(cabinet only)		Length: 26"
Unit Weight		64 lbs.
Shipping Weight	t	82 lbs.
Inlet air operatin	g conditions during	
-Dehumidification:		50°F-104°F, 40°F
		dew point min.
-Ventilation:		40°F-140°F, 0%-99% RH
		(non-condensing)
^(I) Rated canacity energy	w factor and current draw n	neasured at 80°E/60% RH inlet air at 0.0 ESP.

⁽⁷⁾Rated capacity, energy factor and current draw measured at 80°F/60% RH inlet air at 0.0 ESP.
⁽²⁾Height does not include adjustable feet. The width excludes the filter doors and length excludes the duct collars.

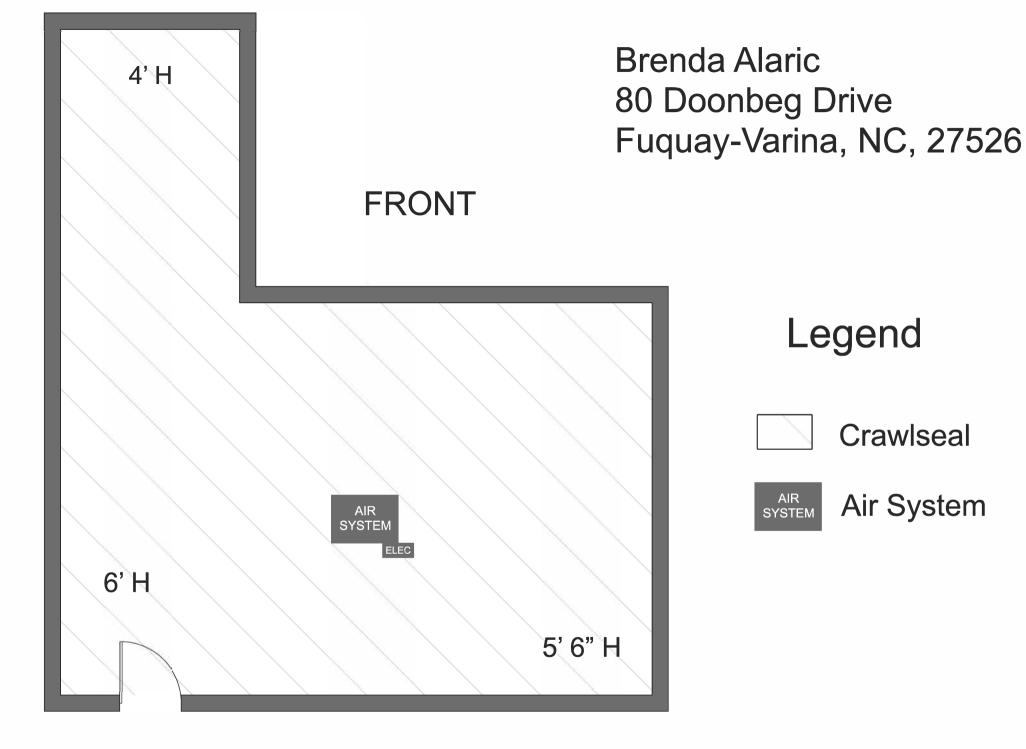

REAR