

APPENDIX H

AFFIDAVIT OF ON-SITE WASTEWATER EXISTING SYSTEM
PUSUANT TO N.C.G.S. §160D-1110(h1)

[This form is only required with a permit application if the permit applicant is applying for exemption as allowed by N.C.G.S. § 160D-1110(h1)]

STATE OF NORTH CAROLINA

COUNTY OF Harnett

_____ Inspection Department

Address and Parcel Identification of Real Property Where Building is to be Constructed or Altered:

98 Lahinch Drive Fuquay Varina, NC 27526

I, Alysha Dooley + Dwight Ross

(Print Full Name)

owner of the property, do hereby under penalties of perjury affirm that the proposed building construction will meet local and State on-site wastewater system setback requirements pursuant to N.C.G.S. § 130A-335. Additionally, the proposed construction shall not increase the design daily flow or wastewater strength of the existing system and thereby absolves the State, Inspection Department, and Local Health Department of any responsibility or liability regarding the existing wastewater system.

The property owner may, at his or her discretion, consult with an authorized on-site wastewater evaluator certified by the North Carolina On-Site Wastewater Contractors and Inspectors Certification Board or an inspector, as defined in N.C.G.S. § 90A-71(5), to locate the on-site wastewater existing system and verify setbacks requirements prior to executing this affidavit.

[Signature] [Signature] 3/23/24
(Signature of Affiant) Date

Sworn to (or affirmed) and Subscribed before me this the 23rd day of March, 2024.

[Signature]
Signature of Notary Public

Catherine M DeYoung
Printed Name of Notary Public

CATHERINE M DEYOUNG
Notary Public
Johnston Co., North Carolina
My Commission Expires Dec. 15, 2025

My Commission Expires: 12/15/2025 (Notary Stamp or Seal)

HTE# SFD2005-0058

Harnett County Department of Public Health

No. 26568

PERMIT # NA

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

SU 1429

PROPERTY LOCATION: 98 LATHING DR. (CHAUBEATZ ROAD)

Name: (owner) LG F HOMBS LLC SUBDIVISION AVERY POND LOT # 126

System Installer: THORNTON'S PLUMBING Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 25% REDUCTION SS-TTG Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

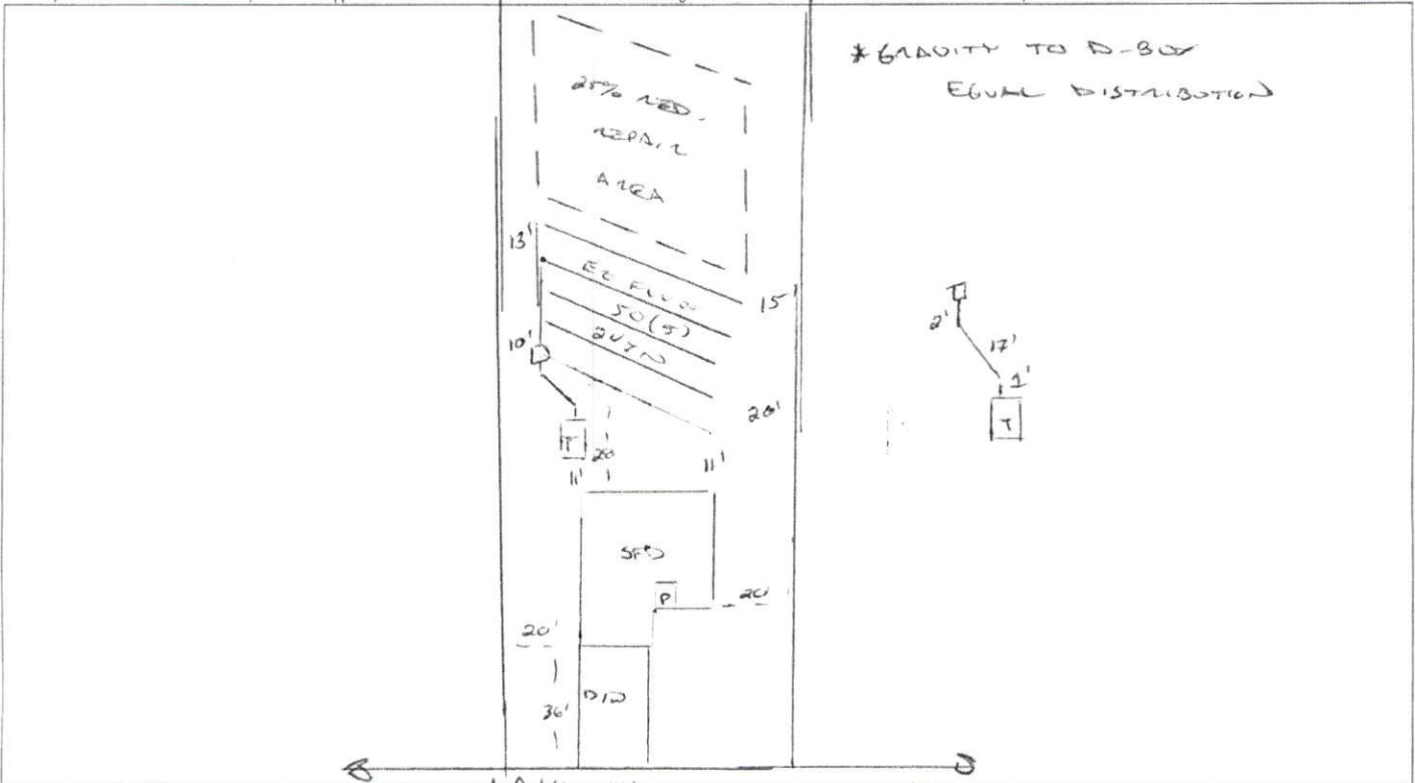

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EZ FLOW TTG Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 5 of each ditch 50 feet ditches 3 feet ditches 24 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 09/02/2020