

Harnett County Environmental Health

EXISTING SYSTEM APPROVAL

Issued by: Local Health Department AOWE Certified Inspector

Existing System Approval

- Site modification (e.g., storage shed) or footprint addition with no DDF or wastewater strength increase
 Reconnection when the proposed facility is in the same footprint as existing/previous facility

Construction Authorization/Notice of Intent to Construct

[issued for reconnection when the proposed facility is not in the same footprint as existing/previous facility pursuant to Session Law 2023-77, Section 5.(c)]
[certified inspectors are not authorized to approve reconnections outside of footprint pursuant to Session Law 2023-77, Section 5.(c)]

Applicant: Cavco Homes
Mailing Address: 413 E. Jackson blvd.

City: Erwin
State: NC Zip: 28339
Phone #: 252-412-2479
Email: ops111@cavco.com

Owner: Thomas Edward Ring Jr
Mailing Address: 57 Royal St.

City: Fuquay Varina
State: NC Zip: 27526
Phone #: 919-612-4943
Email: n/a

PIN/Lot Identifier: 0613-97-6451.000 Lot 18

Property Location/Address: 10 ROYAL ST FUQUAY VARINA, NC 27526

Facility Type: House/Modular Mobile/Manufactured Home Business Other: _____

Operation Permit/ATO #: BRES2404-0059 Design Daily Flow: 240 GPD
Number of Bedrooms: 2 Max # Occupants: 4 Other: _____
Wastewater Strength: Domestic High Strength Industrial Process Wastewater
Water Supply: Private well Public well Shared well Municipal Supply Spring Other: _____

Proposed Property Improvement: DW, 28' x 56', 2-Bedroom

All of the following must be checked for approval:

***For Reconnections:**

- Site complies with its Operation Permit or the wastewater system was in use prior to July 1, 1977
 No current or past uncorrected malfunction of the system as described in 15A NCAC 18E .1303(a)(2)
 DDF and wastewater strength for the proposed facility do not exceed that of the existing system
 Facility meets the setbacks in Section .0600 of 15A NCAC 18E
 Existing system is being operated and maintained in accordance with Section .1300 of 15A NCAC 18E and permit conditions.

***For Site Modifications or Footprint Expansions:**

- Proposed structure meets the setbacks in Section .0600 of 15A NCAC 18E

Approval Conditions: When installing final driveway do not place on top or drive over septic drain lines.

Build up Manufactured home and have Plumbing Stubbed out at highest point to avoid needing a pumo

Inspector's Printed Name: Ren Levocz

Inspector Certification #: 3445

Inspector's Signature: 

Date: 7-23-24

See attached site sketch


**EXISTING SYSTEM APPROVAL
SITE SKETCH**

Operation Permit/ATO #: BRES2404-0059

PIN/Lot Identifier: 0613-97-6451.000 Lot 18

Owner: Thomas Edward Ring Jr

Property Location/Address: 10 ROYAL ST FUQUAY VARINA, NC 27526

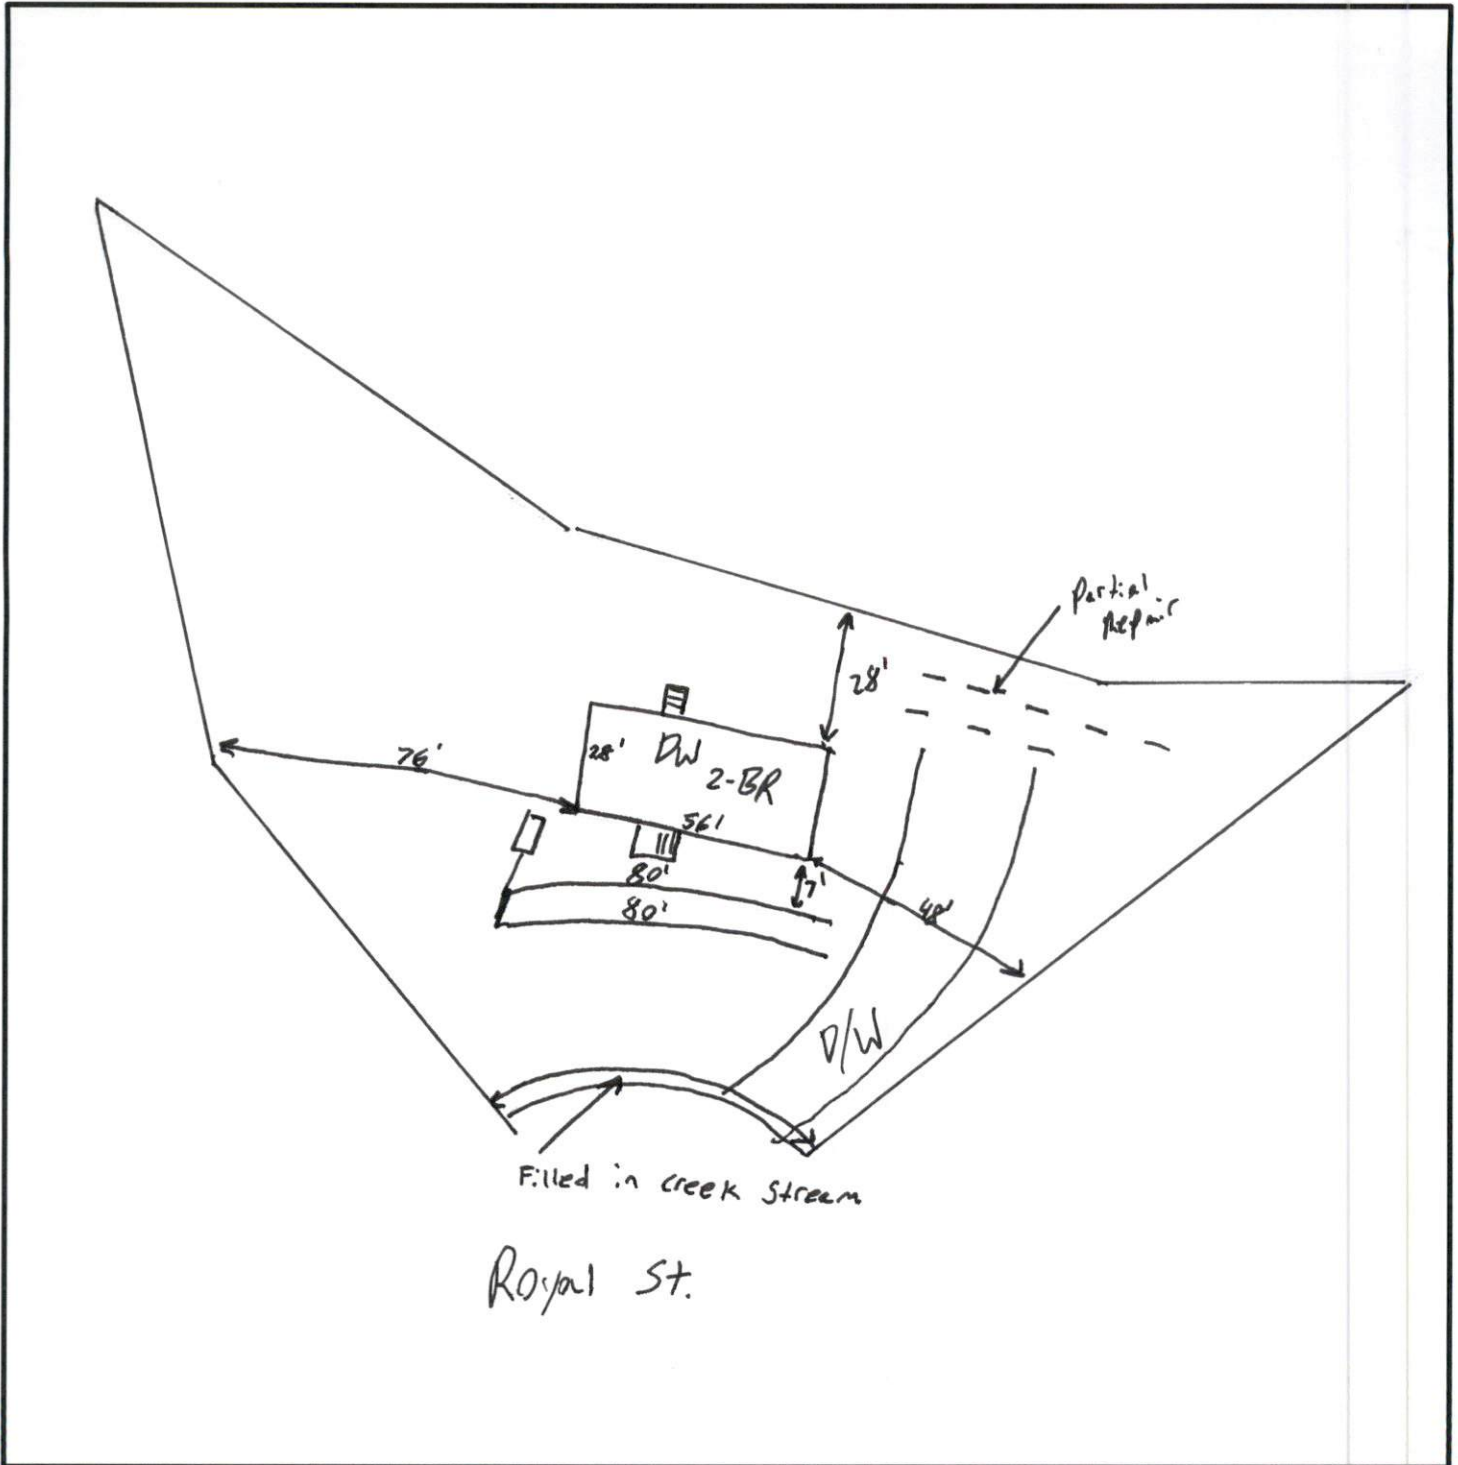

**Include the existing and proposed structures and applicable setbacks.*