

Harnett County Environmental Health

EXISTING SYSTEM APPROVAL

Issued by: Local Health Department AOWE Certified Inspector

Existing System Approval

Site modification (e.g., storage shed) or footprint addition with no DDF or wastewater strength increase

Reconnection when the proposed facility is in the same footprint as existing/previous facility

Construction Authorization/Notice of Intent to Construct

[issued for reconnection when the proposed facility is not in the same footprint as existing/previous facility pursuant to Session Law 2023-77, Section 5.(c)]

[certified inspectors are not authorized to approve reconnections outside of footprint pursuant to Session Law 2023-77, Section 5.(c)]

Applicant: Clayton Homes

Mailing Address: 1582 US Hwy 1

City: Youngsville

State: NC Zip: 27556

Phone #: 919-570-3366

Email: r665@claytonhomes.com

Owner: Bigda Kenneth James

Mailing Address: 365 BETTS RD

City: Holly Springs

State: NC Zip: 27540

Phone #: 919-535-8137

Email: N/A

PIN/Lot Identifier: 0646-40-0252.000 Lot 3

Property Location/Address: 365 BETTS RD HOLLY SPRINGS, NC 27540

Facility Type: House/Modular Mobile/Manufactured Home Business Other: _____

Operation Permit/ATO #: Bres2407-0036 Design Daily Flow: 360 GPD

Number of Bedrooms: 3 Max # Occupants: 6 Other: _____

Wastewater Strength: Domestic High Strength Industrial Process Wastewater

Water Supply: Private well Public well Shared well Municipal Supply Spring Other: _____

Proposed Property Improvement: Modular Home 32' x 66'

All of the following must be checked for approval:

***For Reconnections:**

Site complies with its Operation Permit or the wastewater system was in use prior to July 1, 1977

No current or past uncorrected malfunction of the system as described in 15A NCAC 18E .1303(a)(2)

DDF and wastewater strength for the proposed facility do not exceed that of the existing system

Facility meets the setbacks in Section .0600 of 15A NCAC 18E

Existing system is being operated and maintained in accordance with Section .1300 of 15A NCAC 18E and permit conditions.

***For Site Modifications or Footprint Expansions:**

Proposed structure meets the setbacks in Section .0600 of 15A NCAC 18E

Approval Conditions: Must Have D-Box and Septic Tank Outlet Clean out (build up of dry soil was inside during evaluation).

Inspector's Printed Name: Ren Levocz

Inspector Certification #: 3345

Inspector's Signature: 

Date: 7-29-24

See attached site sketch


EXISTING SYSTEM APPROVAL SITE SKETCH

Operation Permit/ATO #: Bres2407-0036

PIN/Lot Identifier: 0646-40-0252.000 Lot 3

Owner: Bigda Kenneth James

Property Location/Address: 365 BETTS RD HOLLY SPRINGS, NC 27540

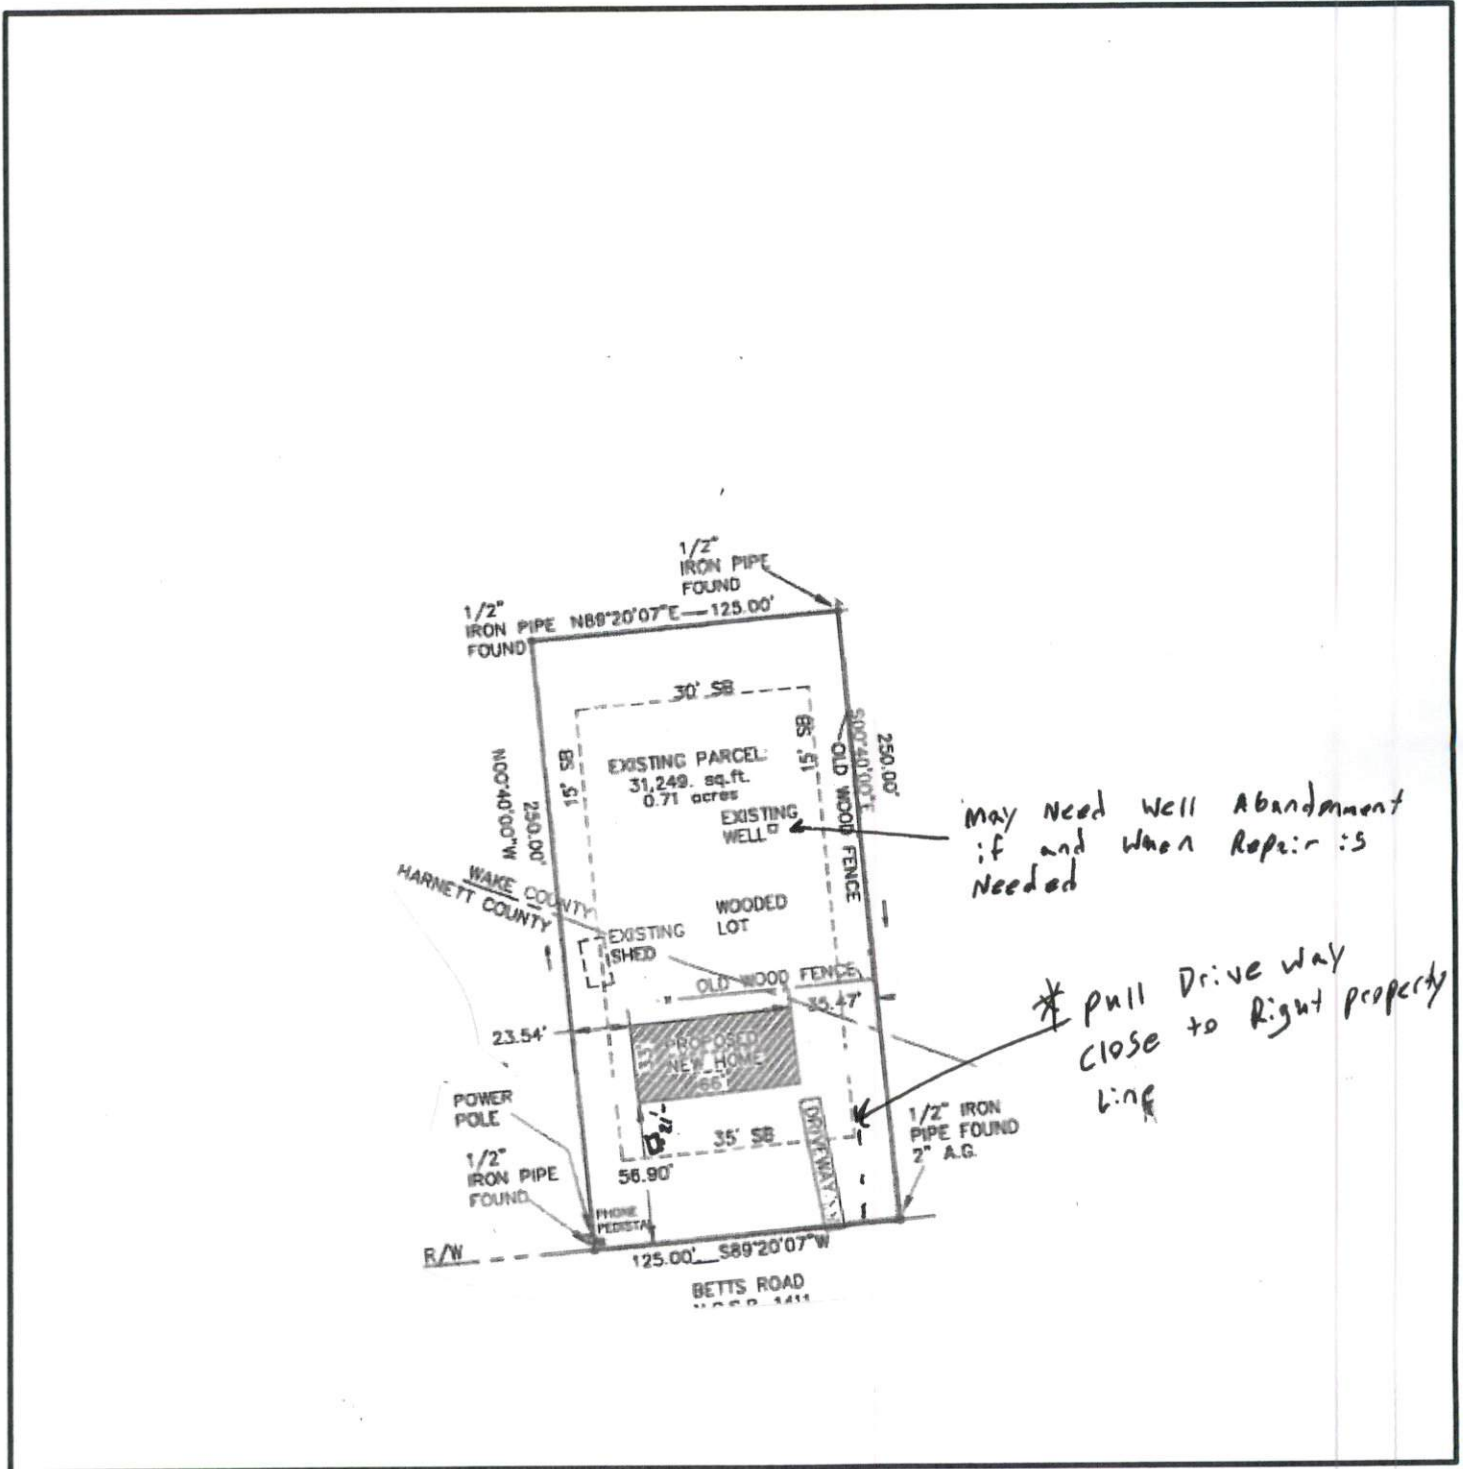

*Include the existing and proposed structures and applicable setbacks.