

Harnett County Environmental Health

EXISTING SYSTEM APPROVAL

Issued by: Local Health Department AOWE Certified Inspector

Existing System Approval

- Site modification (e.g., storage shed) or footprint addition with no DDF or wastewater strength increase
- Reconnection when the proposed facility is in the same footprint as existing/previous facility

Construction Authorization/Notice of Intent to Construct

[issued for reconnection when the proposed facility is not in the same footprint as existing/previous facility pursuant to Session Law 2023-77, Section 5.(c)]
[certified inspectors are not authorized to approve reconnections outside of footprint pursuant to Session Law 2023-77, Section 5.(c)]

Applicant: Ready Roofing

Mailing Address: 228 Airport Industrial Dr.

City: Clayton

State: NC Zip: 27520

Phone #: 919-807-1361

Email: Office@readyroofing.com

Owner: Walter Staton

Mailing Address: 16 Cardona Ct.

City: Fuquay Varina

State: NC Zip: 27526

Phone #: 919-921-6295

Email: gmompam2011@yahoo.com

PIN/Lot Identifier: 0664-76-6174.000 Lot 32
Property Location/Address: 16 CARDONA CT FUQUAY VARINA, NC 27526

Facility Type: House/Modular Mobile/Manufactured Home Business Other: _____

Operation Permit/ATO #: 28925 Design Daily Flow: 480 GPD

Number of Bedrooms: 4 Max # Occupants: 8 Other: _____

Wastewater Strength: Domestic High Strength Industrial Process Wastewater

Water Supply: Private well Public well Shared well Municipal Supply Spring Other: _____

Proposed Property Improvement: 12' x 22' Screened in Porch

All of the following must be checked for approval:


***For Reconnections:**

- Site complies with its Operation Permit or the wastewater system was in use prior to July 1, 1977
- No current or past uncorrected malfunction of the system as described in 15A NCAC 18E .1303(a)(2)
- DDF and wastewater strength for the proposed facility do not exceed that of the existing system
- Facility meets the setbacks in Section .0600 of 15A NCAC 18E
- Existing system is being operated and maintained in accordance with Section .1300 of 15A NCAC 18E and permit conditions.

***For Site Modifications or Footprint Expansions:**

- Proposed structure meets the setbacks in Section .0600 of 15A NCAC 18E

Approval Conditions: _____

Inspector's Printed Name: Ren Levocz Inspector Certification #: 3345
Inspector's Signature:  Date: 8-12-24

See attached site sketch


EXISTING SYSTEM APPROVAL SITE SKETCH

Operation Permit/ATO #: Bres2407-0040

PIN/Lot Identifier: 0664-76-6174.000 Lot 32

Owner: Walter Staton

Property Location/Address: 16 CARDONA CT FUQUAY VARINA, NC 27526

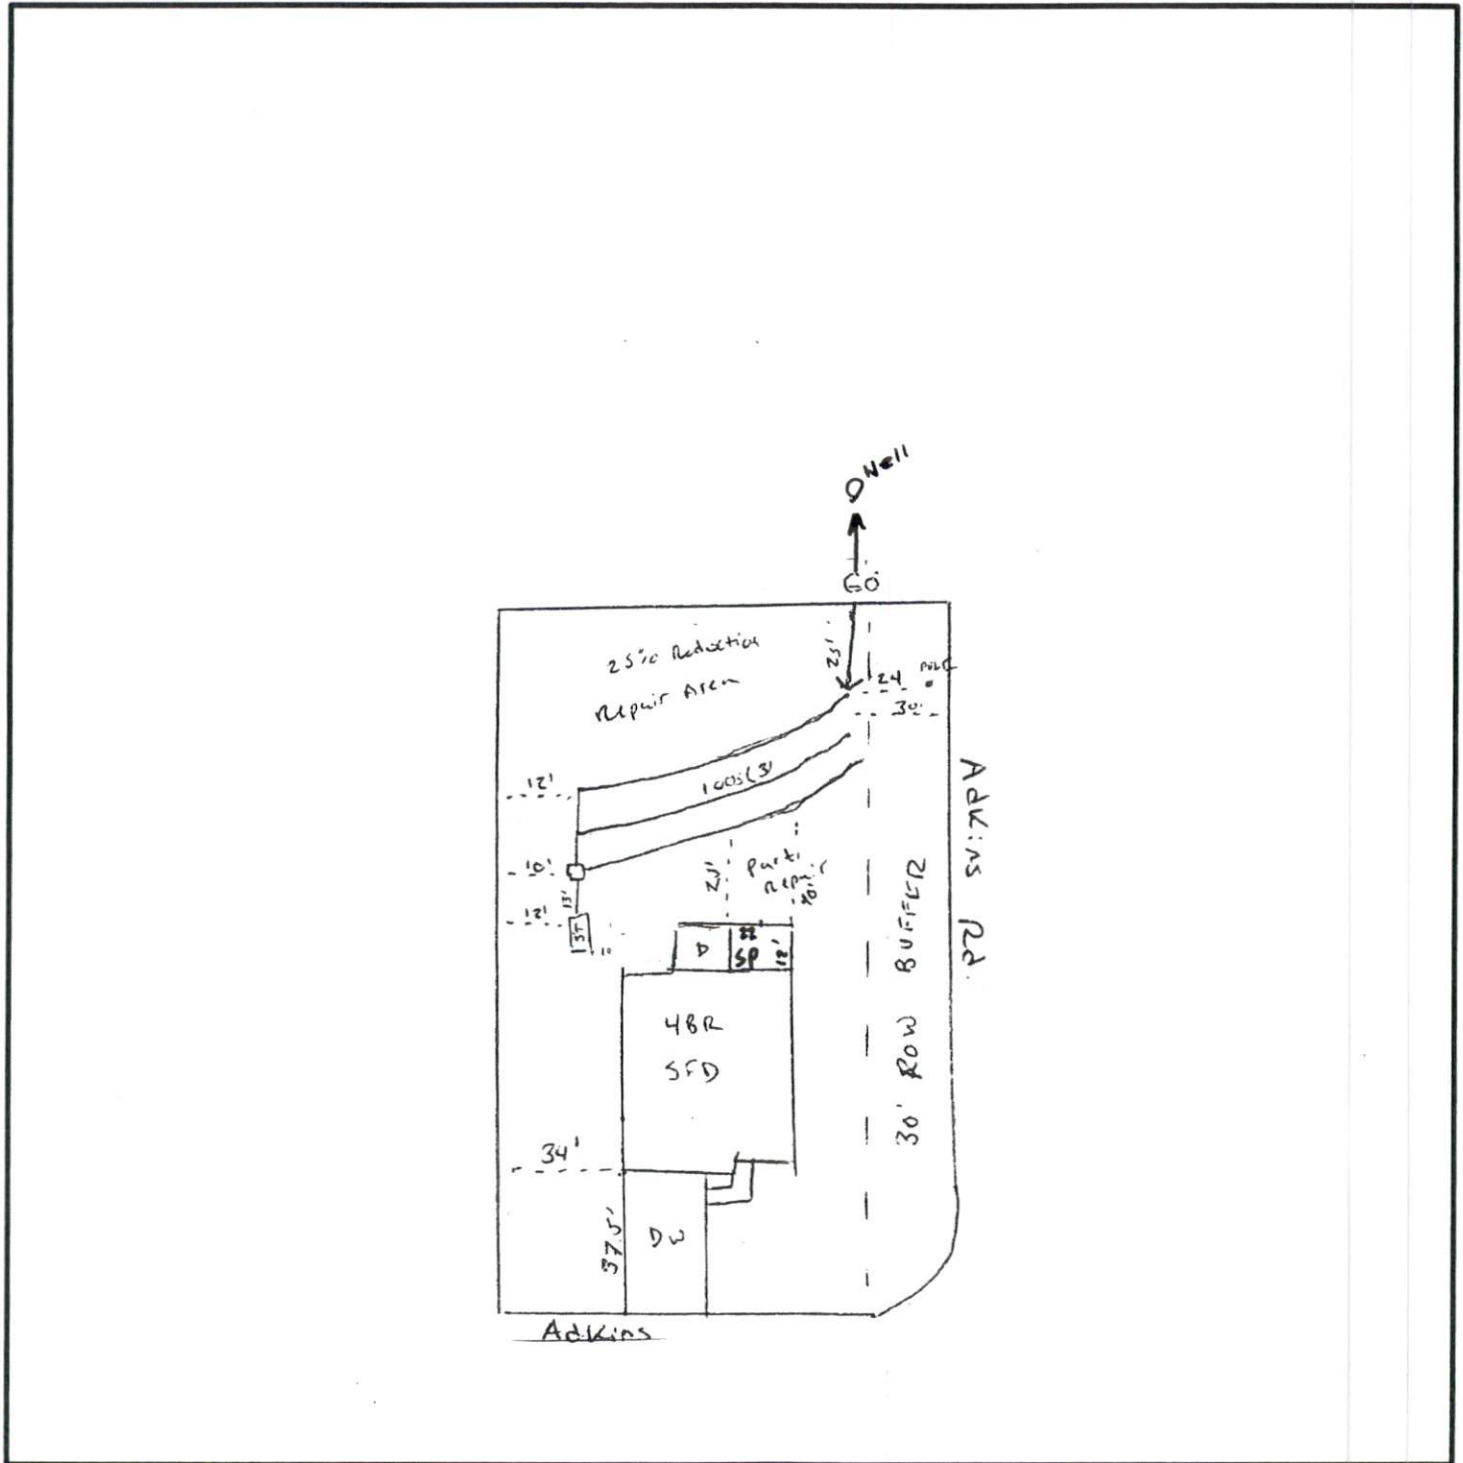

**Include the existing and proposed structures and applicable setbacks.*