

24-280 Date: 8-19-24 Drewn Design Br. KBB



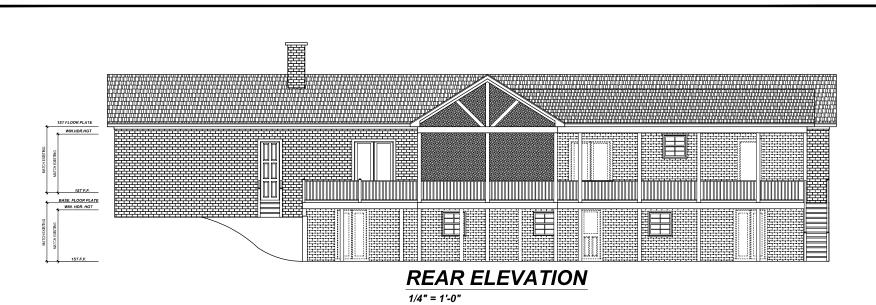


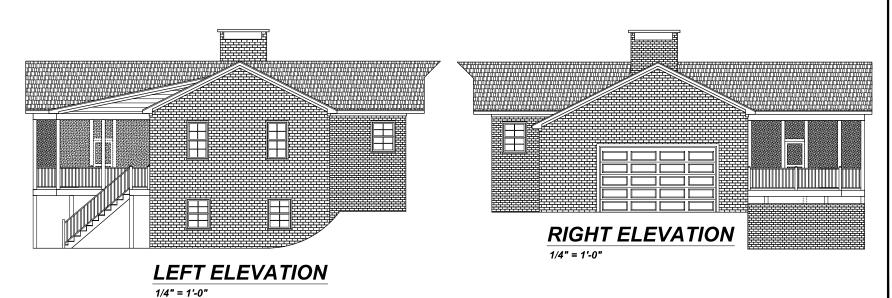

Scott & Samantha Dunn 671 Prospect Church Rd. Dunn, NC 28334

ELEVATIONS

Sheet Number

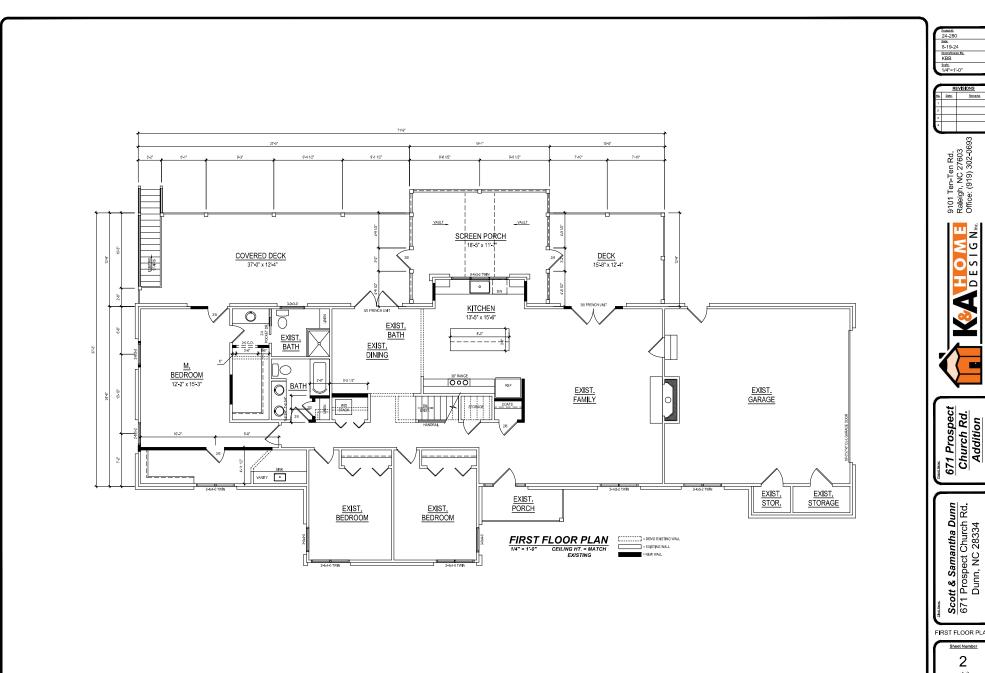

Website: www.KandAHomeDesigns.com Email: Kent@KandAHomeDesigns.com

671 Prospect Church Rd. Addition

Scott & Samantha Dunn 671 Prospect Church Rd. Dunn, NC 28334

FIRST FLOOR PLAN

Sheet Number 2

- IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY THAT ALL DIMENSIONS, ROOF PITCHES, AND SQUARE FOOTAGE ARE CORRECT PRIOR TO CONSTRUCTION. K&A HOME DESIGNS, INC. IS NOT RESPONSIBLE FOR ANY DIMENSIONING, ROOF PITCH, OR SQUARE FOOTAGE ERRORS ONCE CONSTRUCTION BEGINS.
- 2. ALL WALLS SHOWN ON THE FLOOR PLANS ARE DRAWN AT 4" UNLESS NOTED OTHERWISE.
- ALL ANGLED WALLSHOWN ON THE PLANS ARE 45 DEGREES UNLESS NOTED OTHERWISE
- STUD WALL DESIGN SHALL CONFORM TO ALL NORTH CAROLINA STATE BUILDING CODE RECUIREMENTS.
- DO NOT SCALE PLANS. DRAWING SCALE MAY BE DISTORTED DUE TO COPIER IMPERFECTIONS.
- ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH NORTH CAROLINA RESIDENTIAL STATE BUILDING CODE, 2018 EDITION.

# SQUARE FOOTAGE

HEATED SQUARE FOOTAGE		UNHEATED SQUARE FOOTAGE	
FIRST FLOOR=	N/A	GARAGE=	N/A
SECOND FLOOR=	N/A	FRONT PORCH=	N/A
THIRD FLOOR=	N/A	SCREEN PORCH=	252
BASEMENT=	2002	COV.DECK=	442
		DECK=	200

### TOTAL HEATED= 2002 TOTAL UNHEATED= 894

### **CRAWL SPACE VENTILATION CALCULATIONS**

-VENT LOCATIONS MAY VARY FROM THOSE SHOWN ON THE PLAN BUT SHOULD BE PLACED TO PROVIDE ADEQUATE VENTILATION AT ALL POINTS TO PREVENT DEAD AIR POCKETS.

-100% VAPOR BARRIER MUST BE PROVIDED WITH 12" MIN. LAP JOINTS.

-THE TOTAL AREA OF VENTILATION OPENINGS MAY BE REDUCED TO 1/1500 AS LONG AS REQUIRED OPENINGS ARE PLACED SO AS TO PROVIDE CROSS-VENTILATION OF THE SPACE. THE INSTALLATION OF OPERABLE LOUVERS SHALL NOT BE PROHIBITED. (COMPLY WITH NC CODE MIN. WITH REGARD TO VENT PLACEMENT FROM CORNERS)

N/A SQ. FT. OF CRAWL SPACE/1500

N/A SQ. FT. OF REQUIRED VENTILATION

PROVIDED BY: N/A VENTS AT 0.45 SQ, FT. NET FREE

VENTILATION EACH= N/A SQ. FT. OF VENTILATION

\*\*FOUNDATION DRAINAGE- WATERPROOFING PER SECTIONS 405 & 406.

# ATTIC VENTILATION CALCULATIONS

- CALCULATIONS SHOWN BELOW ARE BASED ON VENTILATORS USED AT LEAST 3 FT. ABOVE THE CORNICE VENTS WITH THE BALANCE OF VENTIALTION PROVIDED BE EAVE VENTS.

- CATHEDRAL CEILINGS SHALL HAVE A MIN. 1" CLEARANCE BETWEEN THE BOTTOM OF THE ROOF DECK AND THE INSULATION.

694 SQ. FT. OF ATTIC/300= 2.3

EACH OF INLET AND OUTLET REQUIRED.

### \*WALL AND ROOF CLADDING DESIGN VALUES


- WALL CLADDING IS DESIGNED FOR A 24.1 SQ. FT. OR GREATER POSITIVE AND NEGATIVE PRESSURE.
- ROOF VALUES BOTH POSITVE AND NEGATIVE SHALL BE AS FOLLOWS:

 $45.5\,\text{LBS}$  . PER SQ. FT. FOR ROOF PITCHES OF  $0/12\,\text{TO}\,2.25/12$ 

34.8 LBS. PER SQ. FT. FOR ROOF PITCHES OF 2.25/12 TO 7/12

21 LBS. PER SQ. FT. FOR ROOF PITCHES OF 7/12 TO 12/12

\*\* MEAN ROOF HEIGHT 30' OR LESS

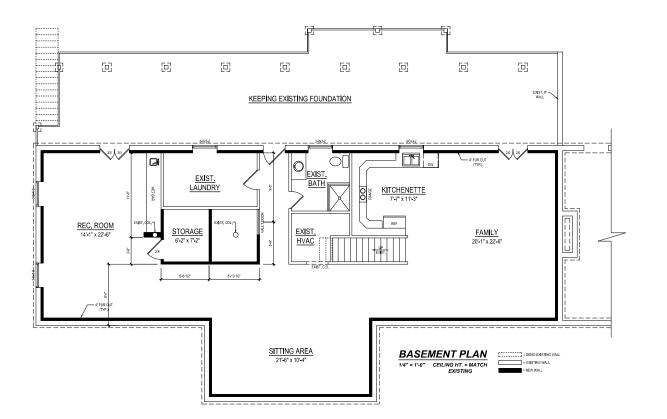

24-280
24-280
28-19-24
2rem Desire Bri
KBB
5ath
1/4"=1"-0"

9101 Ten-Ten Rd. Raleigh, NC 27603 Office: (919) 302-0693



671 Prospect Church Rd. Addition

> Scott & Samantha Dunn 671 Prospect Church Rd. Dunn, NC 28334

BASEMENT PLAN

3 of 3