

# Harnett County Department of Public Health

PERMIT # SFD 2212-0015

## Operation Permit

New Installation    Septic Tank    Nitrification Line    Repair    Expansion

PROPERTY LOCATION: SR, 1338 Mabry Rd

Name: (owner) Jabier Cueliar SUBDIVISION \_\_\_\_\_ LOT # 2

System Installer: Junior Cardenas Construction


Basement with plumbing:  Garage  Number of Bedrooms 4

Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: 25% Reduction Pressure Manifold Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

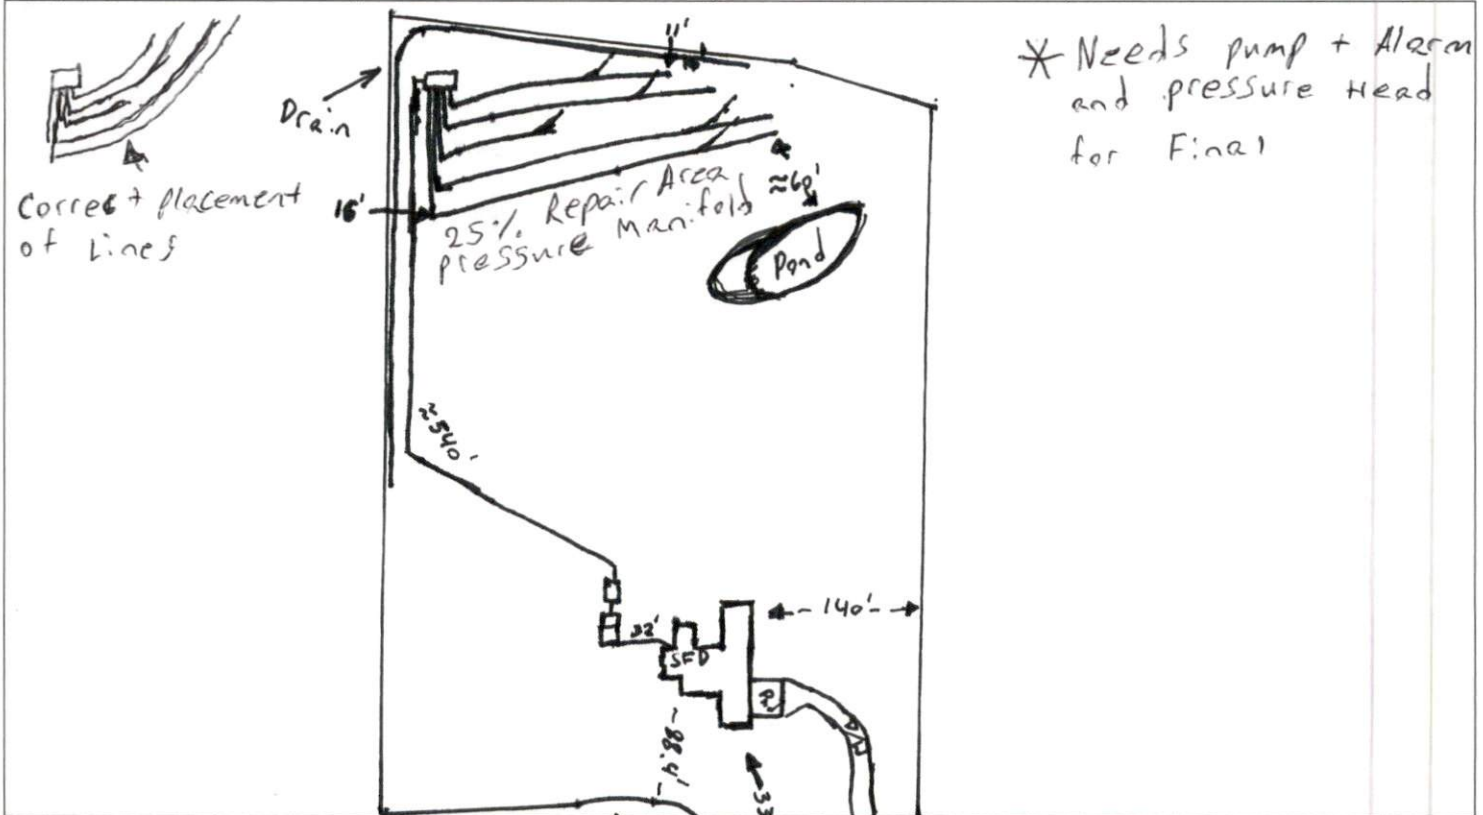

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_  
V. Other: \_\_\_\_\_

\_\_\_\_\_ D-Box    \_\_\_\_\_ Pump    \_\_\_\_\_ Alarm    \_\_\_\_\_ H2O Line    \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other 25% Red. Pressure Manifold   Septic Tank: 1,000 gallons   Pump Tank: 1,000 gallons  
Subsurface Drainage Field: No. of ditches 5   exact length of each ditch 430 <sup>total</sup> feet   width of ditches 3 feet   depth of ditches 12" inches  
French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent: James E. Manhart III RGHAS   Date: 1-24-24