

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM  
(Complete all fields in full)

OWNER: John Strickland DATE EVALUATED: 5-6-23  
ADDRESS: 89 gloves LN  
PROPOSED FACILITY: EX. SFD PROPOSED DESIGN FLOW (.0400): 360 PROPERTY SIZE: \_\_\_\_\_  
LOCATION OF SITE: \_\_\_\_\_ PROPERTY RECORDED: \_\_\_\_\_  
WATER SUPPLY: Public Single Family Well Shared Well Spring Other \_\_\_\_\_ WATER SUPPLY SETBACK: \_\_\_\_\_  
EVALUATION METHOD: Auger Boring Pit Cut TYPE OF WASTEWATER: Domestic High Strength IPWW

P R O F I L E  #	.0502 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY		OTHER PROFILE FACTORS				.0509 PROFILE CLASS & LTAR*	.0503 SLOPE CORRE CTION
			.0503 STRUCTURE/ TEXTURE	.0503 CONSISTENCE/ MINERALOGY	.0504 SOIL WETNESS/ COLOR	.0505 SOIL DEPTH	.0506 SAPRO CLASS	.0507 RESTR HORIZ		
1	2% LS	0-9	SL, 19'		7.5YR 7/1 = 32"	48"			.35	
		9-32	SCL, SBL	Fr, SS, NP, SE						
		32-48	CL, WK SBL							
2	2% LS	0-15	SL, 19'		7.5YR 7/1 = 34"	48"			.35	
		15-35	SCL, SBL	Fr, SS, NP, SE						
		35-48	CL, WK SBL							
3	2% LS	0-15	SL, 19'		7.5YR 7/1 = 35	48"			.35	
		15-35	SCL, SBL	Fr, SS, NP, SE						
		35-48	CL, WK SBL							
4										

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM	SITE CLASSIFICATION (.0509): <u>5</u> EVALUATED BY: <u>RL</u> OTHER(S) PRESENT: _____
Available Space (.0508)	<u>✓</u>	<u>✓</u>	
System Type(s)	<u>25% Rel</u>	<u>50% Rel</u>	
Site LTAR	<u>.35</u>	<u>.35</u>	
Maximum Trench Depth	<u>18-20"</u>	<u>18-20"</u>	
Comments: _____			
_____			
_____			
_____			

## LEGEND

LANDSCAPE POSITION	SOIL GROUP	SOIL TEXTURE	CONVENTIONAL LTAR (gpd/ft²)	SAPROLITE LTAR (gpd/ft²)	LPP LTAR (gpd/ft²)	MINERALOGY/ CONSISTENCE		STRUCTURE
CC (Concave slope)	I	S (Sand)	0.8 - 1.2	0.6 - 0.8	0.4 -0.6	MOIST	WET	SG (Single grain)
CV (Convex Slope)		LS (Loamy sand)		0.5 -0.7		Lo (Loose)	NS (Non-sticky)	M (Massive)
D (Drainage way)	II	SL (Sandy loam)	0.6 - 0.8	0.4 -0.6	0.3 - 0.4	VFR (Very friable)	SS (Slightly sticky)	GR (Granular)
FP (Flood plain)		L (Loam)		0.2 - 0.4		FR (Friable)	S (Sticky)	SBK (Subangular blocky)
FS (Foot slope)	III	SiL (Silt loam)	0.3 - 0.6	0.1 - 0.3	0.15 - 0.3	FI (Firm)	VS (Very sticky)	ABK (Angular blocky)
H (Head slope)		SCL (Sandy clay loam)		0.05 - 0.15**		VFI (Very firm)	NP (Non-plastic)	PR (Prismatic)
L (Linear Slope)		CL (Clay loam)		None		EFI (Extremely firm)	SP (Slightly plastic)	PL (Platy)
N (Nose slope)		SiCL (Silty clay loam)					P (Plastic)	
R (Ridge/summit)		Si (Silt)					VP (Very plastic)	
S (Shoulder slope)		IV				SC (Sandy clay)	0.1 - 0.4	0.05 - 0.2
T (Terrace)	SiC (Silty clay)		EXP (Expansive)					
TS (Toe Slope)	C (Clay)							
		O (Organic)	None					

\* Adjust LTAR due to depth, consistence, structure, soil wetness, landscape, position, wastewater flow and quality.

\*\*Sandy clay loam saprolite can only be used with advanced pretreatment in accordance with 15A NCAC 18E .1200.

*HORIZON DEPTH*

In inches below natural soil surface

*DEPTH OF FILL*

In inches from land surface

*RESTRICTIVE HORIZON*

Thickness and depth from land surface

*SAPROLITE*

S(suitable) or U(unsuitable); Evaluation of saprolite shall be by pits.

*SOIL WETNESS*

Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation

*CLASSIFICATION*

S (Suitable) or U (Unsuitable)

**Show profile locations and other site features (dimensions, reference or benchmark, and North).**

# Harnett County Environmental Health

## SITE SKETCH

PIN 1610-02-5164.000

Permit Number BRES2504-0059

STRICKLIN JOHN ERIC

Applicant's Name

[Signature] REHS

Authorized State Agent

Lot 2


Subdivision/Section/Lot Number

5-8-25

Date

System components represent approximate contours only. The contractor must flag the system prior to beginning the installation to ensure that the proper grade is maintained.

Scale = NTS

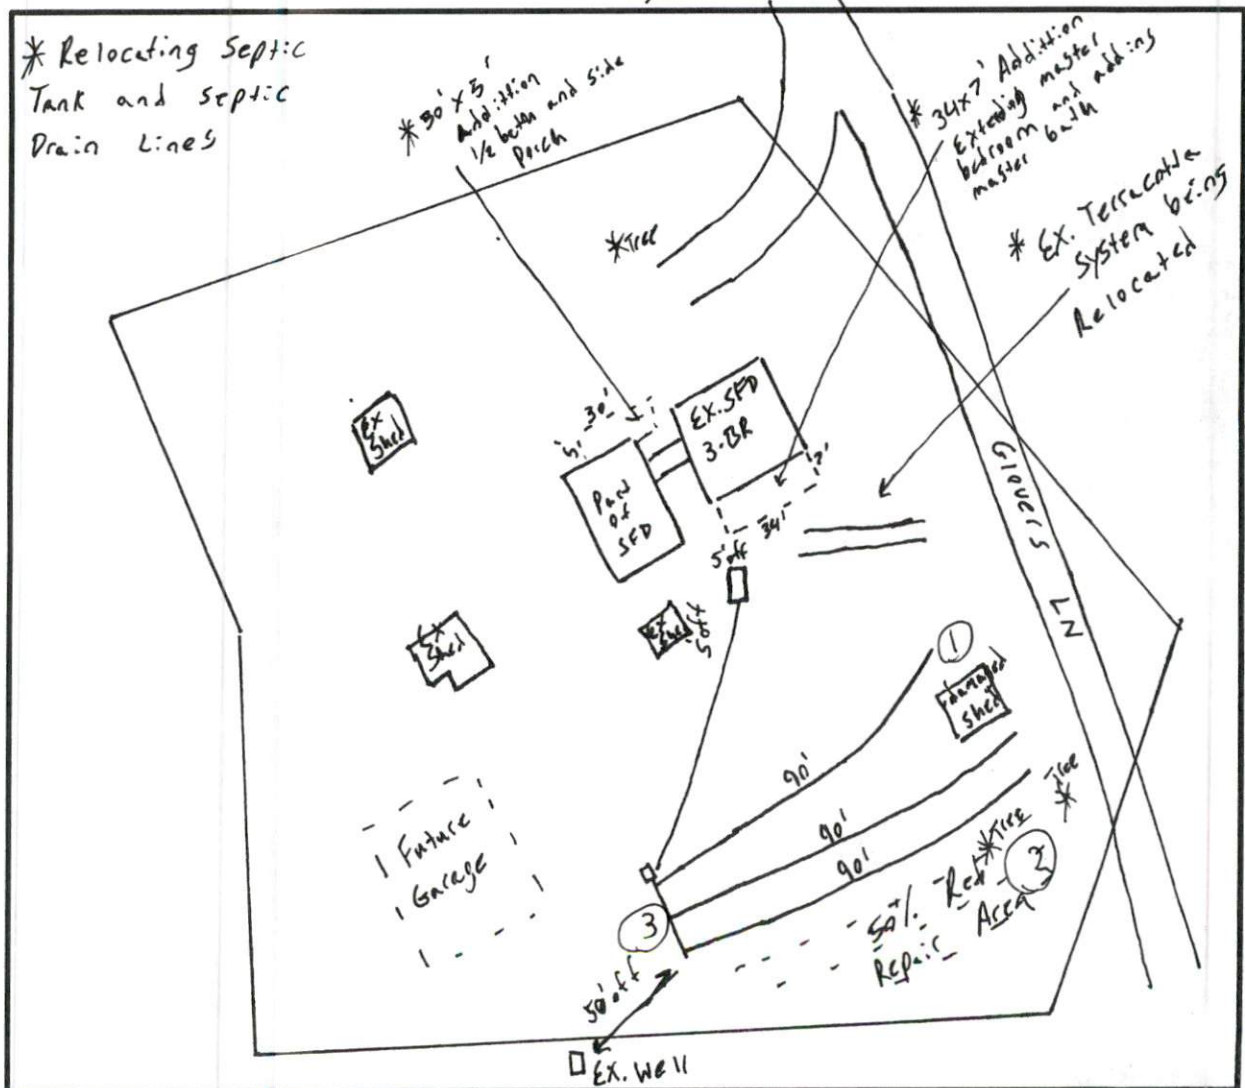

Soil Notes