

HTE# 13-5-31792

Harnett County Department of Public Health

PERMIT # 27561

Operation Permit

23002

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: Hy 27

Name: (owner) Benson Pentecostal Holiness Church SUBDIVISION _____ LOT # _____

System Installer: Ex Building to Church Registration # _____

Basement with plumbing: Garage Number of Bedrooms 230 people MAX


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Manufactured to 75% Recovery Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

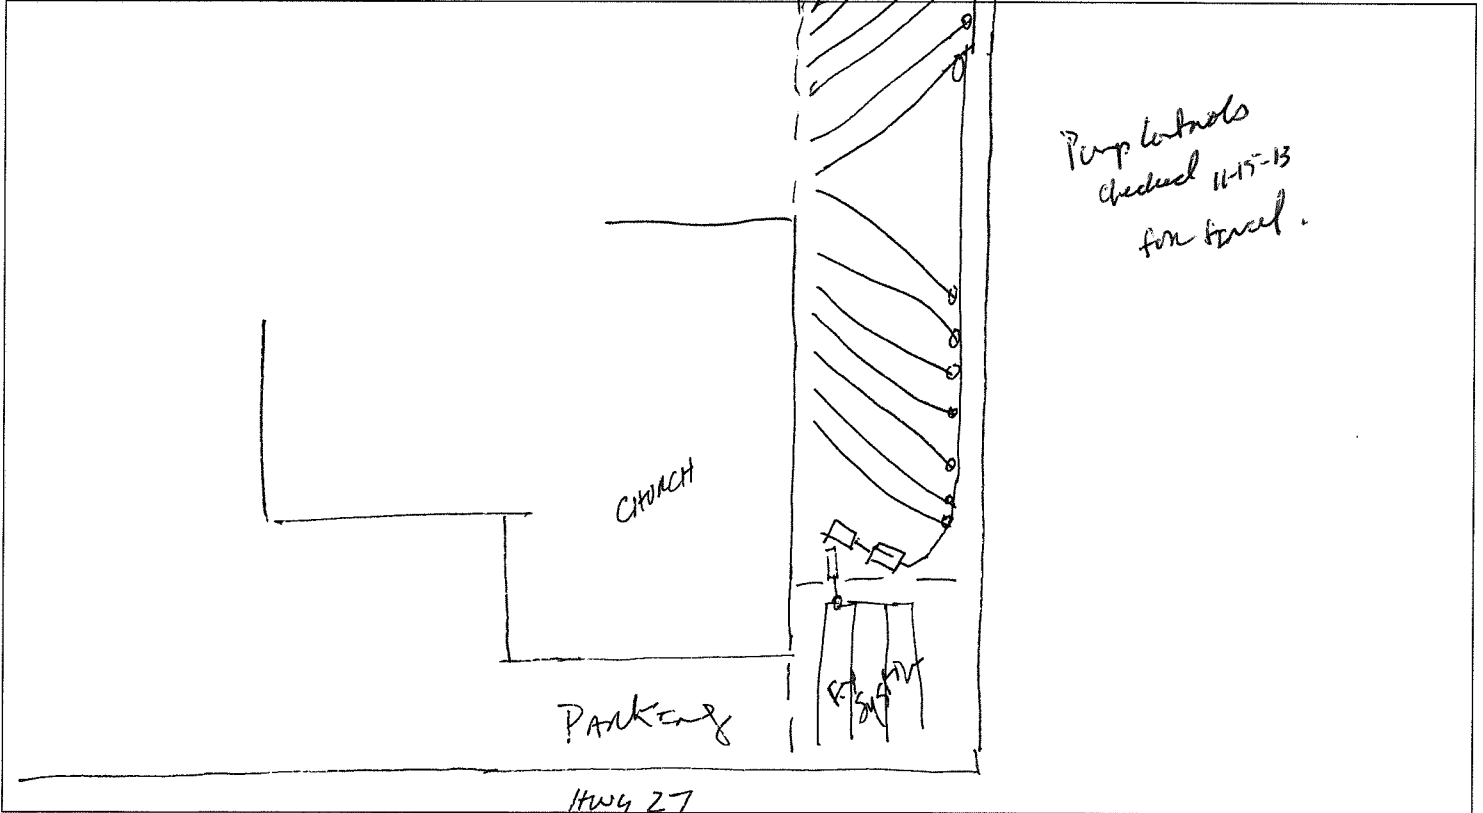

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Pressure Manufactured to 75% Recovery Septic Tank: 2600 gallons Pump Tank: 2150 gallons

Subsurface No. of exact length width of depth of

Drainage Field ditches 17 of each ditch 68" x 45' feet ditches 3 feet ditches 18" inches

French Drain Required: _____ Linear feet

Authorized State Agent James E. Mark Date 11-18-13