



INSPECTION DAILY REPORT

Date: Monday, June 04, 2018

Falcon Project Number: T18010.00

Project Name: Campbell University - Wrestling Room Addition

Project Address: Buies Creek, NC

Inspection Type(s): Structural Steel

Check Appropriate: Testing Inspection Continuous Periodic
Was Re-Inspection performed? Y | N Re-Inspection Hours: _____

Time Management:	Start Time: <u>9:00 AM</u>	End Time: <u>10:30 AM</u>	Time on Site: <u>1.50</u>
Describe Inspections Made, Including Locations:			+ Travel: <u>2.00</u>
Observed roof joist end welds and decking attachments to joists.			+ Report: <u>0.50</u>
			+ CPU: <u>0.00</u>
			+ Stand-by: <u>0.00</u>
			Total: <u>4.00</u>

List Test(s) Made:

1. <u>N/A</u>	4. _____
2. _____	5. _____
3. _____	6. _____

List Items Requiring Corrections:

- N/A
- _____
- _____

List Corrections of Previously Listed Items:

- N/A
- _____
- _____

List Changes to Approved Plans Authorized by the Building Official and Architect or Engineer:

1. <u>N/A</u>	3. _____
2. _____	4. _____


Comments:

Arrived on site as requested by the contractor to observe joist end welds and decking for the roof. The perimeter decking was not installed at this time. The installed decking was observed. The decking and joist end welds appeared to be installed in accordance with contract documents.

Signed: *Justin Gerner*
Print: Justin Gerner

Date: 6/4/2018 Rev: Dec-15
Contractor Notified? Yes

Plan from Today's Inspections:

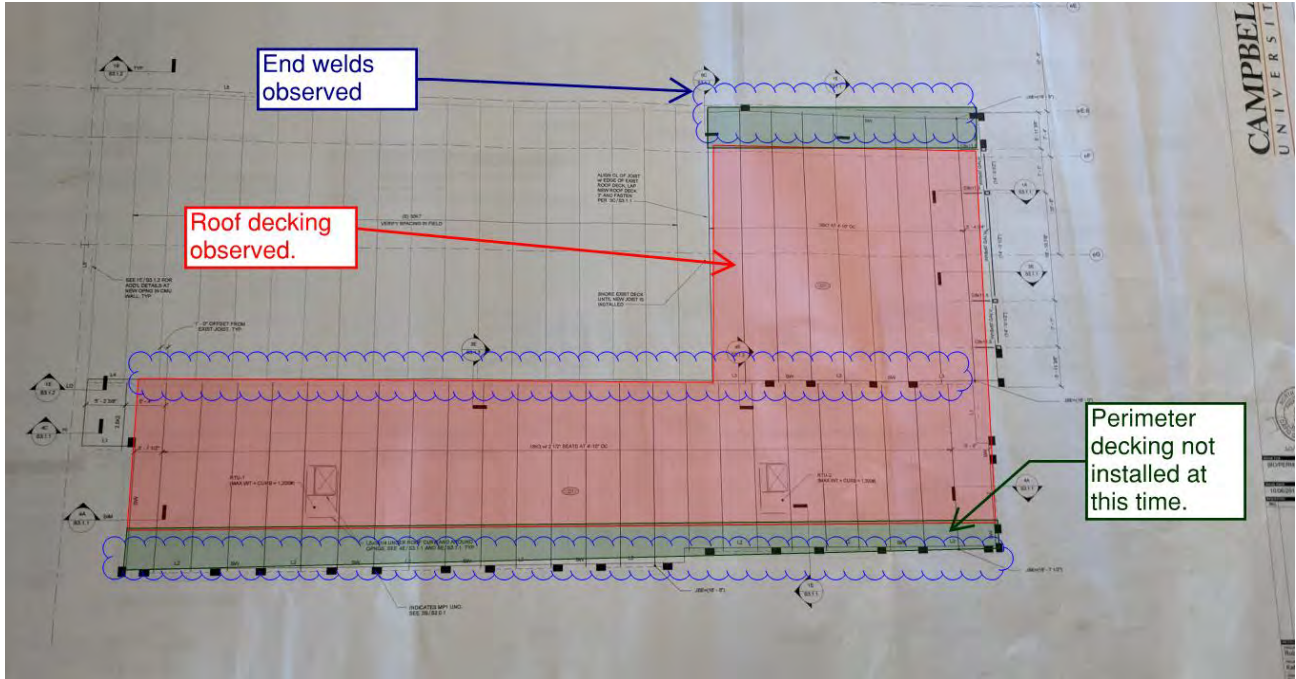

Areas observed.

Photos from Today's Inspections:



Joist End Weld



Decking Observed