

IMPROVEMENT PERMIT

01-5-3589

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Louis Sutton  New Installation  Septic Tank  
 Property Location: SR# NC 27  Repairs  Nitrification Line  
427 Lake Ridge Drive  
 Subdivision Mike Branch Lot # 15

Tax ID # \_\_\_\_\_ Quadrant # \_\_\_\_\_

Number of Bedrooms Proposed: 3 (existing) Lot Size: 1.25 AC

Basement with Plumbing:  Garage:  Please note that if addition to the house is closer than 5' from the house then new tank is required  
 Water Supply:  Well  Public  Community  
 Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system:  Conventional  Other \_\_\_\_\_

Size of tank: Septic Tank: existing gallons Pump Tank: \_\_\_\_\_ gallons


Subsurface Drainage Field No. of 1 exact length 200 width of 3 depth of 18-24 in.  
 ditches of each ditch ft. ditches ft. ditches in.

French Drain Required: \_\_\_\_\_ Linear feet

Date: 2-21-02

This permit is subject to revocation if site plans or intended use change.

Signed: [Signature]  
 Environmental Health Specialist

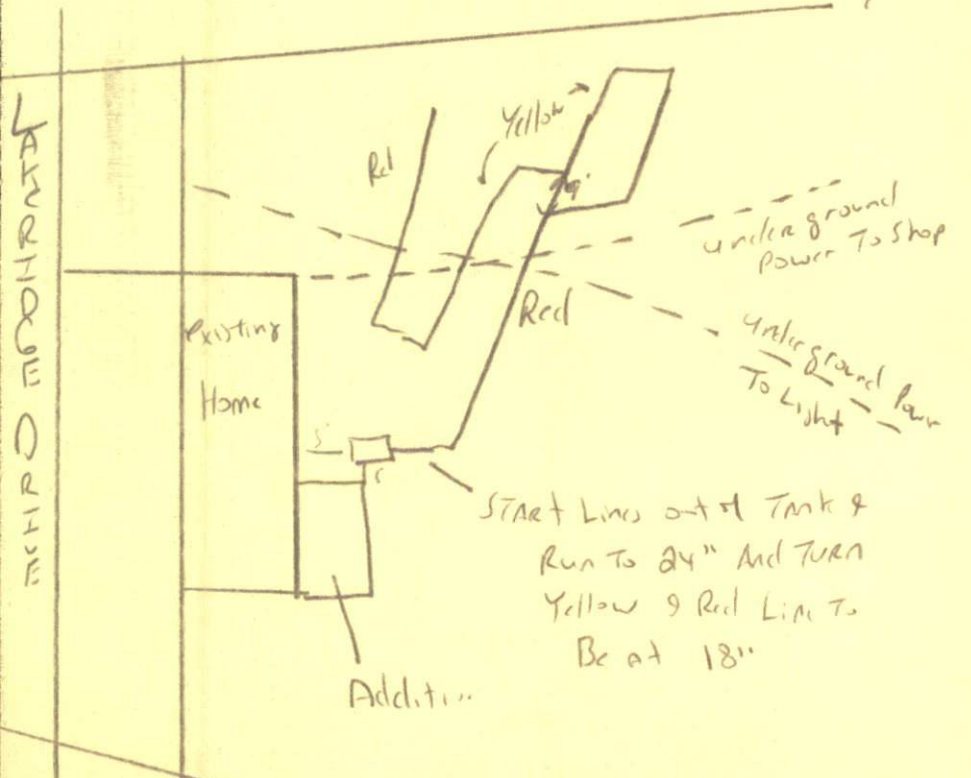

MW meet me on site before installing  
 Maintain all set backs  
 Where Drain field and underground power cross - hard pipe (PVC) Drain field access Power Line (DAM) OR ReRoute Power Lines Around Drain field

Do not Drive or park on septic system

ARNETT COUNTY HEALTH DEPARTMENT  
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department, Improvement Permit # 18720. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Louis Sutton 499-2014  
Name Telephone #  
427 Lake Ridge Drive Cameron NC  
Address  
NC 27  
Property Location SR# Road Name  
Mike Branch 15 existy (3) 1.25 AC  
Subdivision Lot # # Bedrooms Proposed Lot size

TYPE OF SYSTEM

New Installation [ ] Repair [ ] Septic Tank  Nitrification Lines

Conventional Other \_\_\_\_\_

[ ] Basement [ ] With Plumbing [ ] Without Plumbing

Water Supply: [ ] Well  Public - Minimum Well Setback: \_\_\_\_\_ Ft.

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 1 Length of lines 200 Ft.

Width of ditches 3 ft. Depth of ditches 18-24 inches

French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

[Signature] 2-21-02  
Signature of Authorized Agent for Harnett County Date