
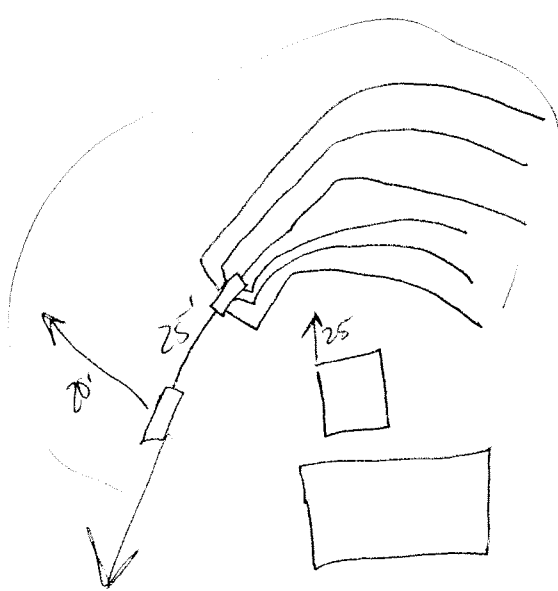


O

C

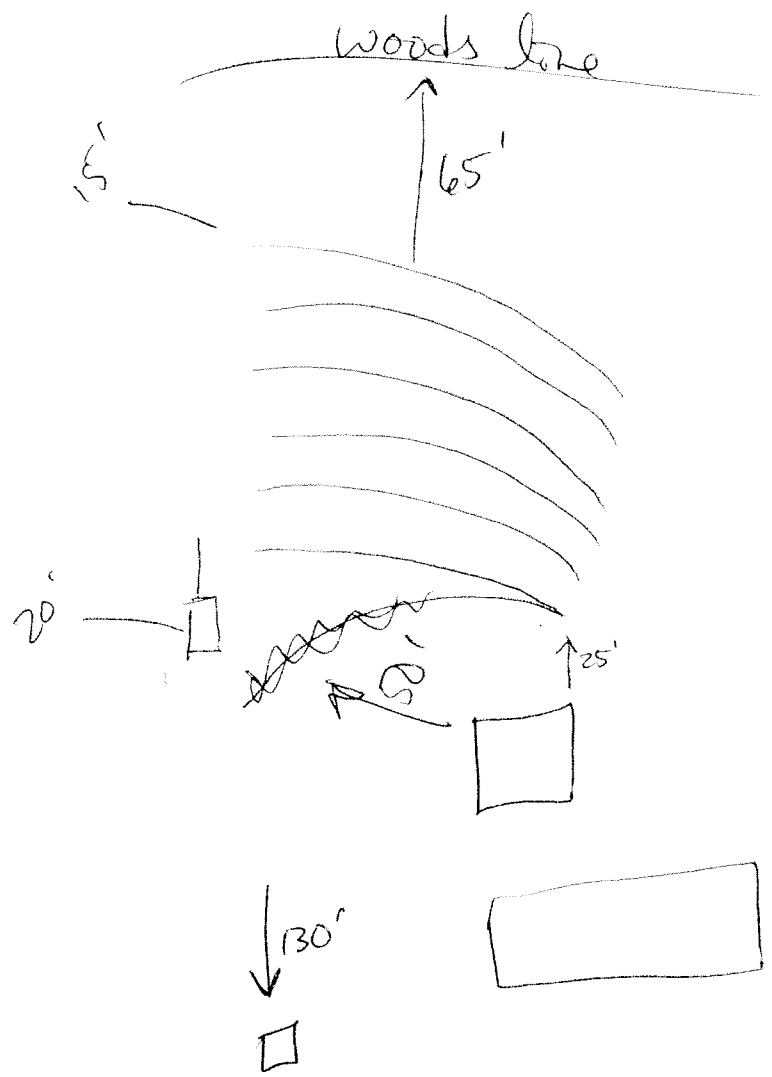

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: *DF-500 13178R*

Applicant:

Address:

Date Evaluated: *01.09.06*

Proposed Facility:

Design Flow (.1949): *600 gal/day*

Property Size: *5.9 Acre*

Location of Site:

Property Recorded: *U111*

- Water Supply: Public Individual Well Spring Other
- Evaluation Method: Auger Boring Pit Cut
- Type of Wastewater: Sewage Industrial Process Mixed

1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
		1941 Structure/ Texture	1941 Consistence Mineralogy	1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	
<i>2, 3</i>	<i>0-24</i>	<i>GR SL</i>	<i>VLR JC</i>					
	<i>24-38</i>	<i>SM SL</i>	<i>FR JR</i>		<i>38</i>		<i>.5-7</i>	<i>P1</i>
	<i>38</i>	<i>FR M20</i>						
	<i>0-42</i>	<i>GR SL</i>	<i>VLR JB</i>		<i>42</i>		<i>.6-5</i>	<i>P1</i>
	<i>42</i>	<i>Grass</i>						
	<i>0-38</i>	<i>GR SL</i>	<i>VLR JC</i>					
	<i>38-42</i>	<i>SM SL</i>	<i>FR JR</i>		<i>42</i>		<i>.5-7</i>	<i>P1</i>
	<i>42</i>	<i>Grass</i>						
	<i>0-38</i>	<i>GR SL</i>	<i>VLR JC</i>					
	<i>38-42</i>	<i>SM SL</i>	<i>FR JR</i>		<i>42</i>		<i>.5-7</i>	<i>P1</i>
	<i>0-38</i>	<i>GR SL</i>	<i>VLR JR</i>					
	<i>38-42</i>	<i>SM SL</i>	<i>FR JR</i>		<i>42</i>		<i>.5-4</i>	<i>P1</i>
<i>0-42</i>	<i>GR SL</i>	<i>VLR JC</i>						
<i>42-47</i>	<i>SM SL</i>	<i>FR JR</i>		<i>42</i>		<i>.5-4</i>	<i>P1</i>	

Description	Initial System	Repair System
Available Space (.1945)		<input checked="" type="checkbox"/>
System Type(s)	<i>Grass</i>	<i>WSP</i>
LTAR	<i>.45</i>	<i>.2</i>

Other Factors (.1946): _____

Site Classification (.1948): *P1*

Evaluated By: *[Signature]*

Others Present:

Change to 20% available to save space

Gun Ter
O. C. M. M.

