

HTE# 10-5-24069

# Harriet County Department of Public Health

21057

PERMIT # 26068

## Operation Permit

New Installation  Septic Tank  Repair  Nitrification Line  Expansion

PROPERTY LOCATION: SR1446 Purfoy RD

Name: (owner) MARY J HOFFNER SUBDIVISION Wexford LOT # 13

System Installer: CLEST ADAMS Registration # \_\_\_\_\_


Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: CONVENTIONAL Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

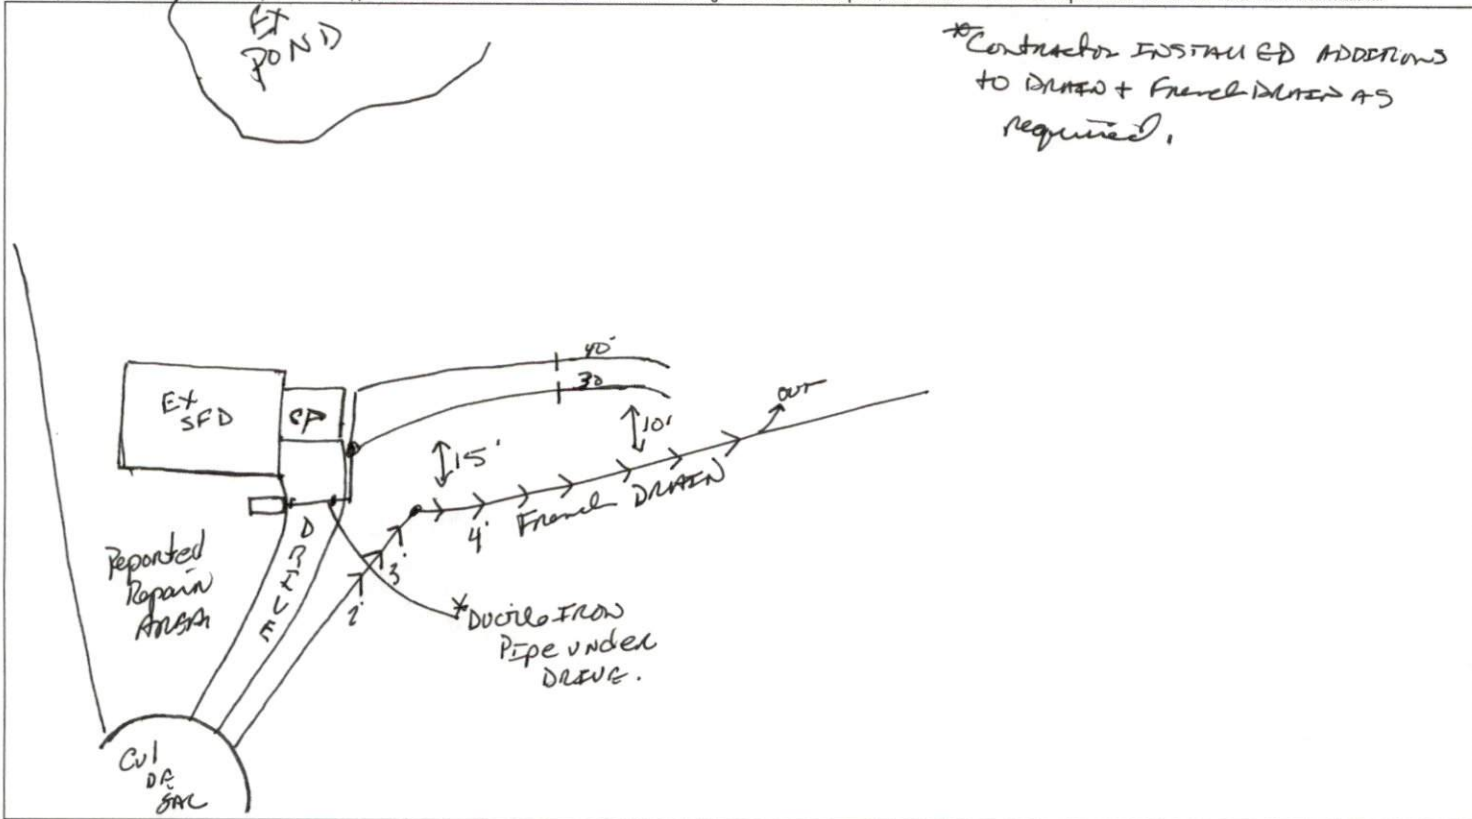

\*Contractor INSTALLED ADDITIONS TO DRAIN + FRENCH DRAIN AS REQUIRED.

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other \_\_\_\_\_ Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons

Subsurface No. of 1 exact length 30 width of \_\_\_\_\_ depth of \_\_\_\_\_

Drainage Field ditches 1 of each ditch 40 feet ditches 3 feet ditches 18 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent James S. Martin Date 9-21-10