

HTE# 08-5-19495

# Harnett County Department of Public Health

20364

PERMIT # 25159

## Operation Permit

New Installation  Septic Tank  Repair  Nitrification Line  Expansion

PROPERTY LOCATION: TYLER DENDE LN

Name: (owner) AGAPE KURE BEACH MINISTRIES SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: JASON MATHEWS Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms 18 PERSON CABIN


Type of Water Supply:  Community  Public  Well Distance from well 100 feet

System Type: III g Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

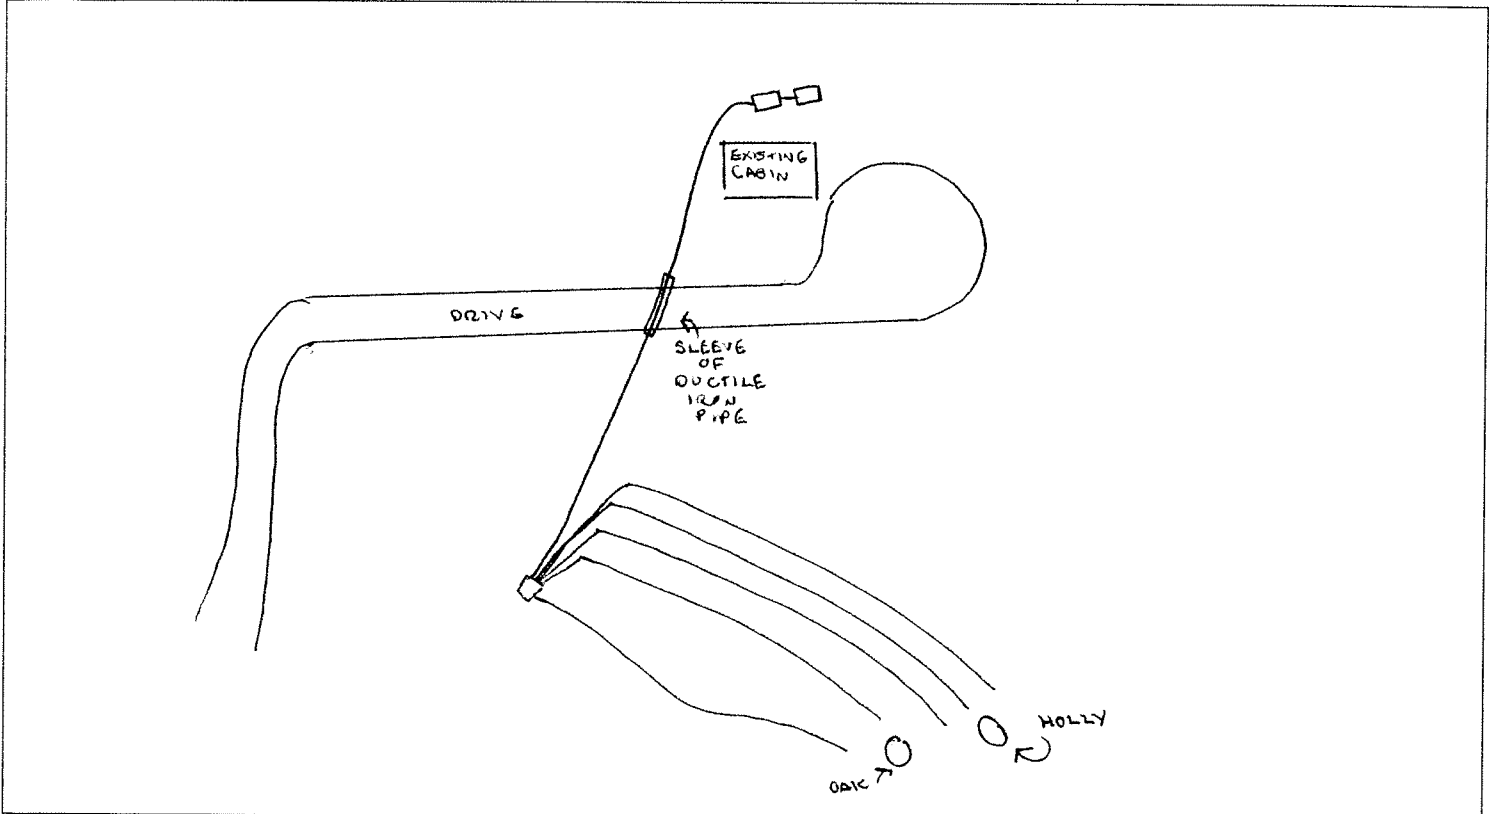

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: PRESSURE MANIFOLD - DESIGN SPECS ON FILE AT HCID

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other PUMP TO EZ LAY Septic Tank: 4000 gallons <sup>EXISTING</sup> Pump Tank: 5000 gallons

Subsurface Drainage Field: No. of ditches 5 exact length of each ditch 140 feet width of ditches 3 feet depth of ditches 18 inches

French Drain Required: \_\_\_\_\_ linear feet

Authorized State Agent RS (OLIVER TOLKSOFF) Date 12/30/08