

HTE# 08-5-19182

# Harnett County Department of Public Health

PERMIT # 25172

## Operation Permit

21906

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: US421

Name: (owner) SIERRA DAY TREATMENT ACADEMY SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: RICKY HOLLAND Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms 5609p9


Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: IVa Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

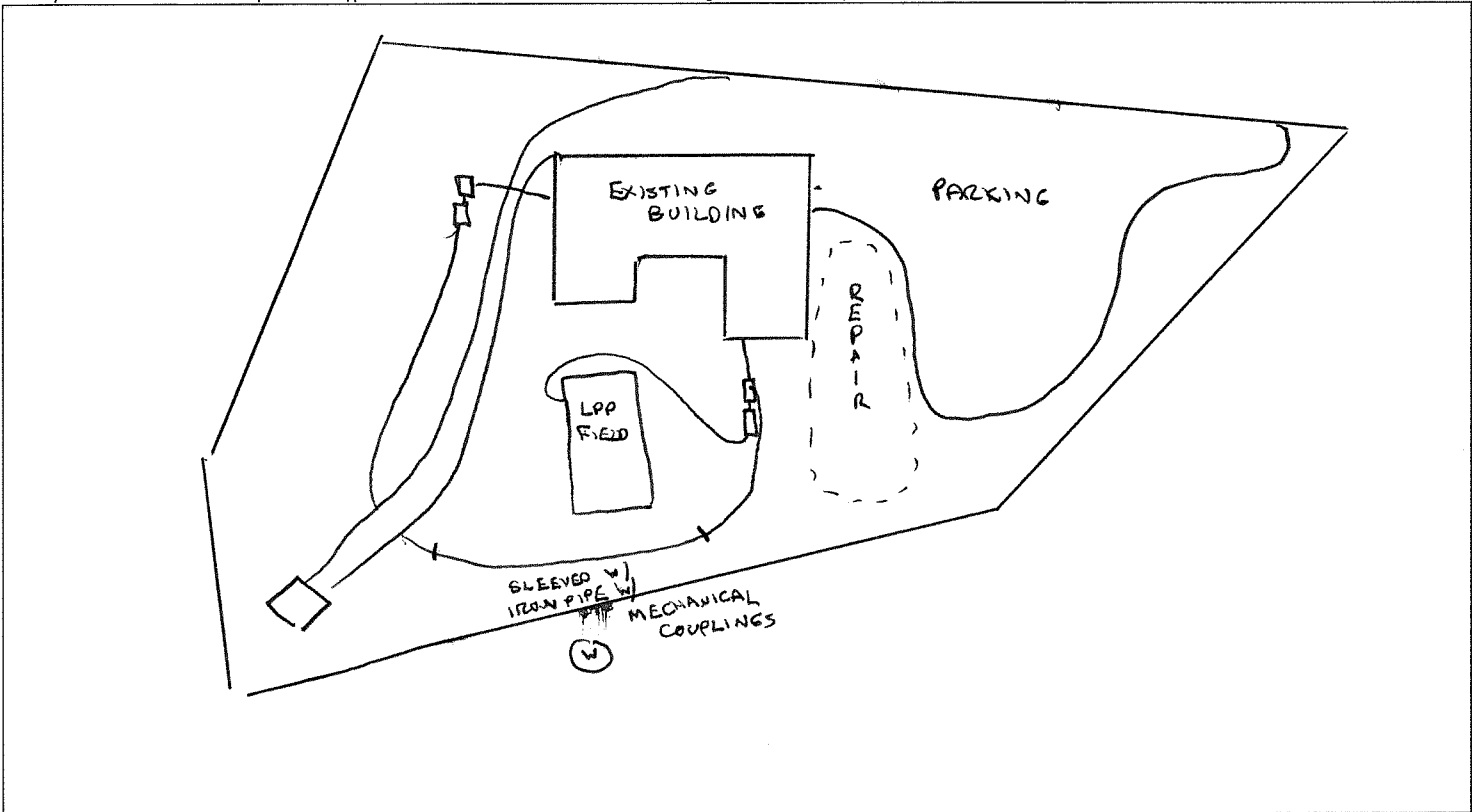

### PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes  No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: SYSTEM TO BE INSPECTED BY OPERATOR TWICE PER YEAR. REPORT TO BE SUBMITTED

TO HARNETT COUNTY HEALTH DEPARTMENT ONCE PER YEAR.

V. Other: ALL EXISTING TANKS FEED INTO EXISTING LPP SYSTEM. SYSTEM PERMITTED FOR 70 OCCUPANTS FOR  
TOTAL DAILY DESIGN FLOW OF 560 GALLONS

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other EXISTING LPP Septic Tank: \_\_\_\_\_ gallons Pump Tank: \_\_\_\_\_ gallons

Subsurface No. of exact length width of depth of  
Drainage Field ditches \_\_\_\_\_ of each ditch \_\_\_\_\_ feet ditches \_\_\_\_\_ feet ditches \_\_\_\_\_ inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] REHS Date 2/22/11