

HTE# 09-5-22911

Harnett County Department of Public Health

21253

PERMIT # 25784

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: NC HWY 24/87

Name: (owner) DAVID E GALATAS DDS SUBDIVISION BARCOCK VILLAGE LOT # 106

System Installer: AAA BACKHOE Registration # _____

Basement with plumbing: Garage Number of Bedrooms 1100sq CLINICAL SPACE (DENTIST'S OFFICE - 528sqft)


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: IIB Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

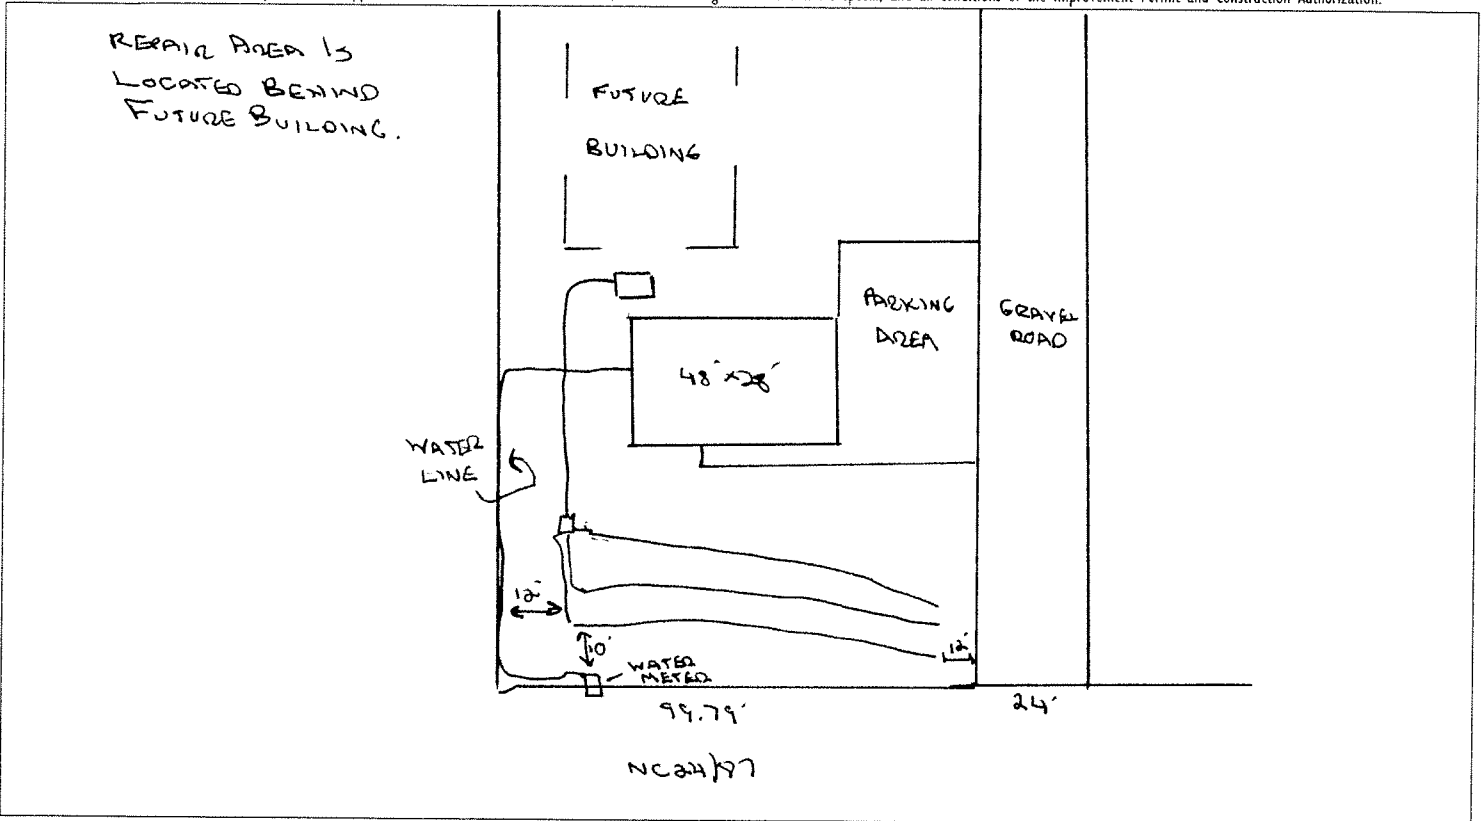

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: EFFLUENT TO BE SAMPLED PER STATE & COUNTY REQUIREMENTS. CONTRACT WITH M. COBAC EXECUTED ON 2/4/10
- V. Other: WATER LINE CROSSES AT LEAST 18" ABOVE SEPTIC SUPPLY LINE

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other _____ Septic Tank: 2200 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of depth of
Drainage Field ditches 3 of each ditch 75 feet ditches 3 feet ditches 24-48 inches

French Drain Required: _____ Linear feet

Authorized State Agent _____

GENS

Date 2/9/10