

#00-011613 + #00-011612

HARNETT COUNTY HEALTH DEPARTMENT

00-500053A+B

No 17492

IMPROVEMENT PERMIT

00-5000533B

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Robert J DEAN

New Installation Septic Tank

Property Location: SR# 1437 Ballard

Repairs Nitrification Line

Subdivision _____ Lot # A+B

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 4 Lot Size: 17.994 ACU

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 50' ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1200 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 3 exact length of each ditch 133 ft. width of ditches 3 ft. depth of ditches 18-24 in.


French Drain Required: - Linear feet

Date: 11-2-00

This permit is subject to revocation if site plans or intended use change.

Signed: James E. Manhart III R.S.
Environmental Health Specialist

THIS PERMIT COVERS
2 Applications
00-011613 + 00-011612

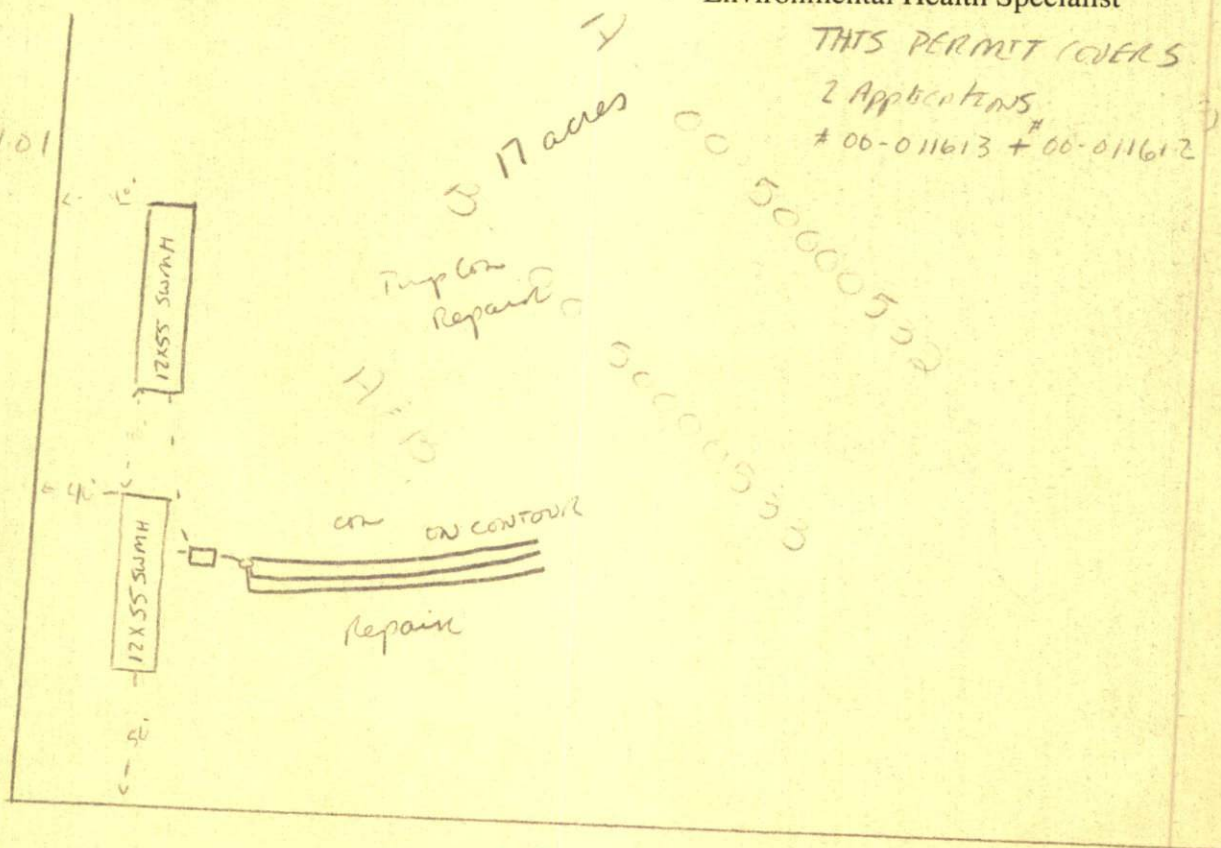

SR 1437

HARNETT COUNTY HEALTH DEPARTMENT AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 17492. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent Robert L DEAN

Name: Robert L DEAN Telephone # 552-5432

Address: 192 Avenue Spence Rd FUGWAY VARIANA N.C. 27526

Property Location: SR# 1437 Road Name Ballard Road

New Installation Repair Septic Tank Nitrification Lines

Subdivision _____ Lot # A9B

Number of Bedrooms Proposed: 4 Lot size: 17.994 acce

Basement _____ With Plumbing _____ Without Plumbing _____

Water Supply: Well Public Minimum Well Setback: 50' ft.

Type of System: Conventional Other _____

Tank Volume: Septic Tank 1200 gallons Pump Chamber _____ gallons

Nitrification Field Specifications

Number of fields 2 Number of Lines per Field 3 Length of lines 133

Width of ditches 3 ft. Depth of ditches 18-24 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: James E Manhart Pres. Date: 11-2-00