

OPERATIONS PERMIT


00-5-0901

Name: (owner) Mike Ray New Installation Septic Tank
 Property Location: SR# 2035 Repairs Nitrification Line
 Subdivision Stockyard Rd Est Lot # _____
 TAX ID# _____ Quadrant # _____
 Contractor: Mike Ray Registration # _____
 Basement with Plumbing: Garage:
 Water Supply: Well Public Community
 Distance From Well: 50 ft.

Following are the specifications for the sewage disposal system on above captioned property.

Type of system: Conventional Other _____
 Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons
 Subsurface Drainage Field: No. of 4 exact length 100 width of 3 depth of 18
 ditches of each ditch ft. ditches ft. ditches in.
 French Drain: _____ Linear feet

PERMIT NO. 16838 Date: 12/2/2001
 Inspected by: Gregory M. Lewis R.S.
 Environmental Health Specialist

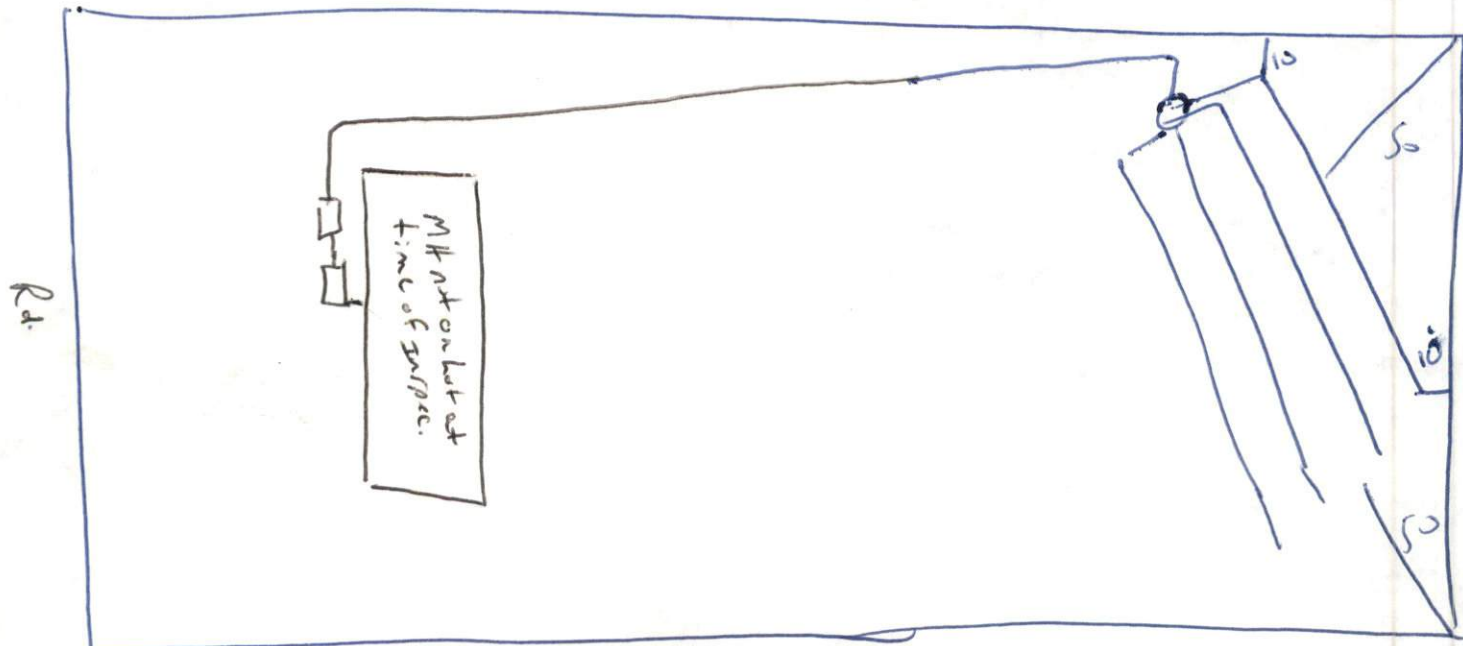

Lines Inspected done on 9-21-01 JOE WEST
 Need Tanks Pump Alarm Alarm Box 9" O" Box checked