

IMPROVEMENT PERMIT

01-5-2038 Rev

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Charles Tacia
Property Location: SR# NC 27
New Installation, Septic Tank, Repairs, Nitrification Line

Subdivision Cooper's Place Lot # 6

Tax ID # \_\_\_\_\_ Quadrant # \_\_\_\_\_

Number of Bedrooms Proposed: 3 (28x80) Lot Size: 1.19 ac

Basement with Plumbing: [ ] Garage: [ ]

Water Supply: [ ] Well [x] Public [ ] Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: [x] Conventional [ ] Other

Size of tank: Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons


Subsurface Drainage Field No. of ditches 4 exact length of each ditch 100 ft. width of ditches 3 ft. depth of ditches 1 in.

French Drain Required: \_\_\_\_\_ Linear feet

Date: 3-27-03

This permit is subject to revocation if site plans or intended use change.

Signed: [Signature] Environmental Health Specialist 365

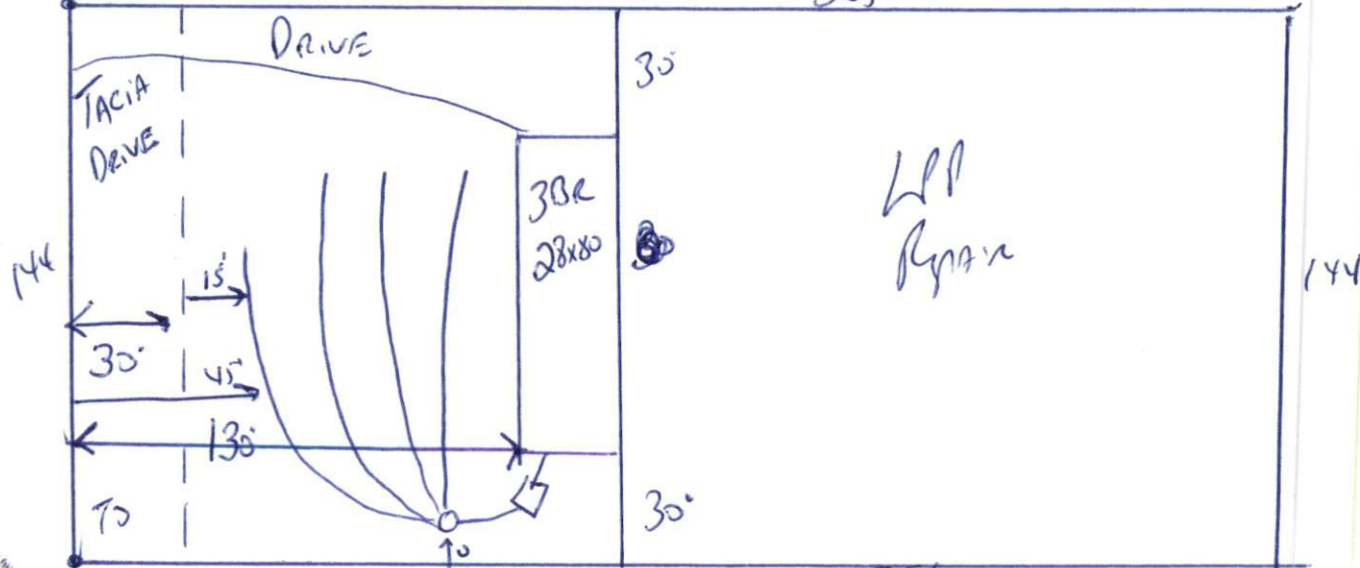

NC 27 Meet onsite - 18" Ditch Depth MAINTAIN ALL Setbacks - Do not Drive OR Park on septic system Keep Drain Lines 45' from Property Line with easement.

HARNETT COUNTY HEALTH DEPARTMENT  
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department, Improvement Permit # 19285. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Charles Tacia 499-1801  
Name Telephone#

Address

NC 27

Property Location SR# Road Name

Cooper's Place 6 3(28x80) 1.19 AC

Subdivision Lot # # Bedrooms Proposed Lot Size

**TYPE OF SYSTEM**

New Installation  Repair  Septic Tank  Nitrification Lines

Conventional  Other \_\_\_\_\_

Basement  With Plumbing  Without Plumbing

Water Supply:  Well  Public Water Supply Minimum Well Setback: 50 Ft.

Septic Tank 1000 gal Pump Chamber \_\_\_\_\_ gal

**NITRIFICATION FIELD SPECIFICATIONS**

Number of fields 1 # of lines per field 41 Length of lines 100 Ft.

Width of ditches 3 ft. Depth of ditches 18 inches

French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Joe White 03-27-03  
Signature of Authorized Agent for Harnett County of Harnett Date