


SITE/SOIL EVALUATION FOR ON-SITE WASTEWATER

APPLICANT NAME _____

DATE _____

FACTORS		PROFILES									
		1	2	3	4	5	6	7	8	9	10
LANDSCAPE POSITION	.1940	SS	SS	SS	SS						
SLOPE (%)	.1940	7-10	7-10	7-10							
HORIZON 1 DEPTH		0-8"	0-8"	0-38"	0-4"	0-32"	0-30"	0-38"	0-38"	0-38"	0-38"
Texture Group	.1941(A)(1)	S	S	S	S	S	S	S	S	S	S
Consistence	.1941	VFR		VFR	VFR	VFR	VFR	VFR	VFR	VFR	VFR
Structure	.1941(A)(2)	G		G	G		G	G	G	G	C
Mineralogy	.1941(A)(3)	NS/NP		NS/NP	NS/NP			NS/NP	NS/NP	NS/NP	NS/NP
HORIZON 2 DEPTH		8"	8"	38"	4"	34-36"	30"		38"	38"	38"
Texture Group	.1941(A)(1)	PM	PM	PM	C	SC2	PM		PM	PM	PM
Consistence	.1941				VFI	FR					
Structure	.1941(A)(2)				ABK	SBK					
Mineralogy	.1941(A)(3)				VS/VP	SS/SP					
HORIZON 3 DEPTH						36"					
Texture Group	.1941(A)(1)					PM					
Consistence	.1941										
Structure	.1941(A)(2)										
Mineralogy	.1941(A)(3)										
HORIZON 4 DEPTH											
Texture Group	.1941(A)(1)										
Consistence	.1941										
Structure	.1941(A)(2)										
Mineralogy	.1941(A)(3)										
SOIL WETNESS	.1942					36"		34"			
RESTRICTIVE HORIZON	.1944										
SAPROLITE	.1943/1956										
CLASSIFICATION	.1948	US	US	PS	US	PS	PS		PS	PS	PS
LONG TERM ACCEPTANCE RATE	.1955			.8		.5	.8		.8	.8	.8

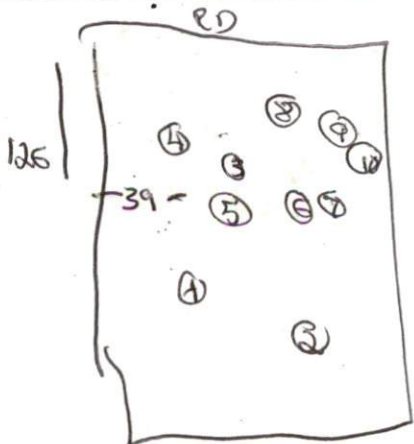

5 LINES 40' OF 25% REDUCTION
 9' ON CENTER
 RUN ON CONTOUR
 18" DEEP ON DEEPEST SIDE.
 COVER MAY BE NEEDED TO MAINTAIN
 6"