

COUNTY HEALTH DEPARTMENT

No 15227

IMPROVEMENT PERMIT

01-5-2617

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) OAKWOOD HOMES ☒ New Installation ☒ Septic Tank

Property Location: SR# NC 24/27 ☐ Repairs ☒ Nitrification Line

Subdivision _____ Lot # _____

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 (28x44) Lot Size: .925 Ac

Basement with Plumbing: ☐ Garage: ☐

Water Supply: ☐ Well ☒ Public ☐ Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: ☒ Conventional ☐ Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons


Subsurface Drainage Field No. of ditches 3 exact length of each ditch 80 ft. width of ditches 3 ft. depth of ditches 18 in.

French Drain Required: _____ Linear feet

Date: 8-1-01

This permit is subject to revocation if site plans or intended use change.

Signed: Joe Wilson
Environmental Health Specialist

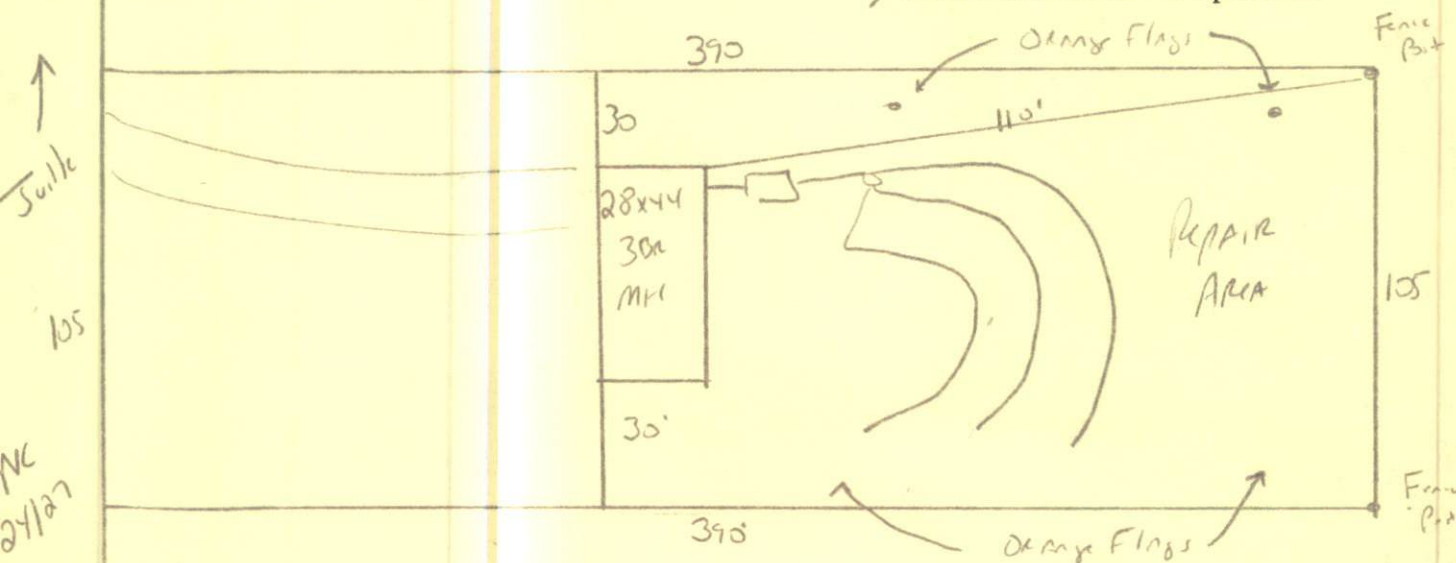

STUB out Plumbing shallow MAINTAIN All set Backs

Keep SYSTEM within my ORANGE FLAGS

Do not park on septic system

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 15227. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent Oak Wood Homes

Name: _____ Telephone # ⁹¹⁹ 776-5959

Address: _____

Property Location: SR # NC 24/27 Road Name _____

New Installation ☒ Repair _____ Septic Tank ☒ Nitrification Lines ☒

Subdivision _____ Lot # _____

Number of Bedrooms Proposed: 3 (28x44) Lot size: .925

Basement _____ With Plumbing _____ Without Plumbing _____

Water Supply: Well _____ Public ☒ Minimum Well Setback: _____ ft.

Type of System: Conventional ☒ Other _____

Tank Volume: Septic Tank 1000 gallons Pump Chamber _____ gallons

Nitrification Field Specifications

Number of fields 1 Number of Lines per Field 3 Length of lines 80

Width of ditches 2 ft. Depth of ditches 18 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: [Signature] Date: 8-1-01