

SITE/SOIL EVALUATION FOR ON-SITE WASTEWATER

APPLICANT NAME _____

DATE _____

FACTORS		PROFILES									
		1	2	3	4	5	6	7	8	9	10
LANDSCAPE POSITION	.1940	L	L	L	L						
SLOPE (%)	.1940	2	2	2	2						
HORIZON 1 DEPTH		0-18	0-18	0-18	0-12						
Texture Group	.1941(A)(1)	SL	SL	SL	SL						
Consistence	.1941	PK	PK	PK	PK						
Structure	.1941(A)(2)	GM	GM	GM	GM						
Mineralogy	.1941(A)(3)	NSNP	NSNP	NSNP	NSNP						
HORIZON 2 DEPTH		18-24	18-24	18-24	12-24						
Texture Group	.1941(A)(1)	SCL	SCL	SCL	SCL						
Consistence	.1941	PK	PK	PK	PK						
Structure	.1941(A)(2)	GM	GM	GM	GM						
Mineralogy	.1941(A)(3)	NSNP	NSNP	NSNP	NSNP						
HORIZON 3 DEPTH		24-36	24-36	24-36	24-36						
Texture Group	.1941(A)(1)	SC-cl	SC-cl	SC-cl	SC-cl						
Consistence	.1941	PK	PK	PK	PK						
Structure	.1941(A)(2)	ABU	ABU	ABU	ABU						
Mineralogy	.1941(A)(3)	SSP	SSP	SSP	SSP						
HORIZON 4 DEPTH											
Texture Group	.1941(A)(1)										
Consistence	.1941										
Structure	.1941(A)(2)										
Mineralogy	.1941(A)(3)										
SOIL WETNESS	.1942	36	34	36	34						
RESTRICTIVE HORIZON	.1944										
SAPROLITE	.1943/.1956										
CLASSIFICATION	.1948	PS	PS	PS	PS						
LONG TERM ACCEPTANCE RATE	.1955	.4	.4	.4	.4						


Quail Hollow
Subdivision A

~~FL 48789~~
Hatch Size
52' x 28'

Durane Currin
Book 888, Page 528-530
Cabinet "D", Slide 142-B

Required Front	Actual	Setbacks
Front	35	15
Side	10	15
Corner	20	15
Rear	25	100
Nearest Building	10	15

PLAN APPROVAL
DISTRICT RAZOM USE DWMT
#B.DROOMS 3
8-10-01 Cpl Williams
Planning Administrator

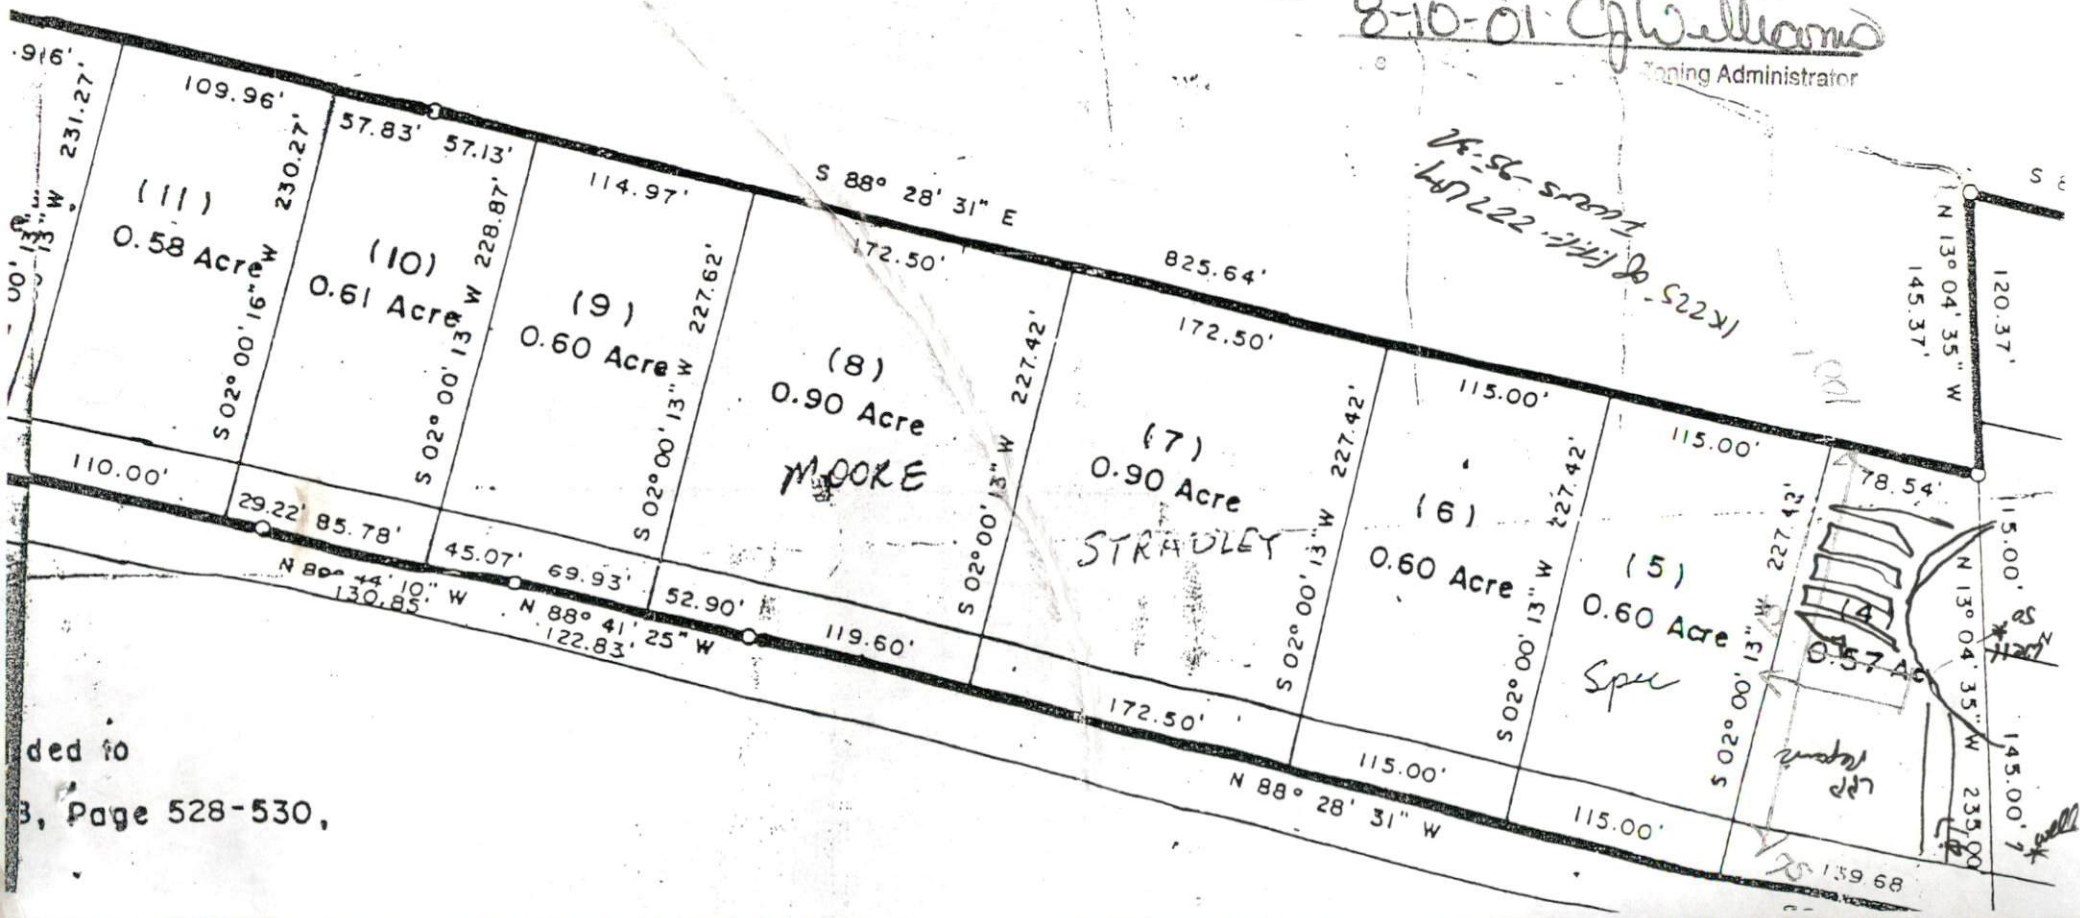

*26-56-5000
140222-27709
(K225 of File 27709-522)*