

# IMPROVEMENT PERMIT 0152813

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Christine Blue  New Installation  Septic Tank  
Property Location: SR# 1205 Oliver Rd  Repairs  Nitrification Line  
to JD MURICHSON LANE

Subdivision \_\_\_\_\_ Lot # \_\_\_\_\_

Tax ID # \_\_\_\_\_ Quadrant # \_\_\_\_\_

Number of Bedrooms Proposed: 3 (44x28) Lot Size: 1.0 ac

Basement with Plumbing:  Garage:  Please note changes in  
Water Supply:  Well  Public  Community Howe location  
Distance From Well: 55 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system:  Conventional  Other \_\_\_\_\_

Size of tank: Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons


Subsurface Drainage Field No. of ditches 1 exact length 200 ft. width of ditches 3 ft. depth of ditches 18 1/4 in.

French Drain Required: \_\_\_\_\_ Linear feet

Date: 9-19-01

This permit is subject to revocation if site plans or intended use change.

Signed: [Signature]  
Environmental Health Specialist

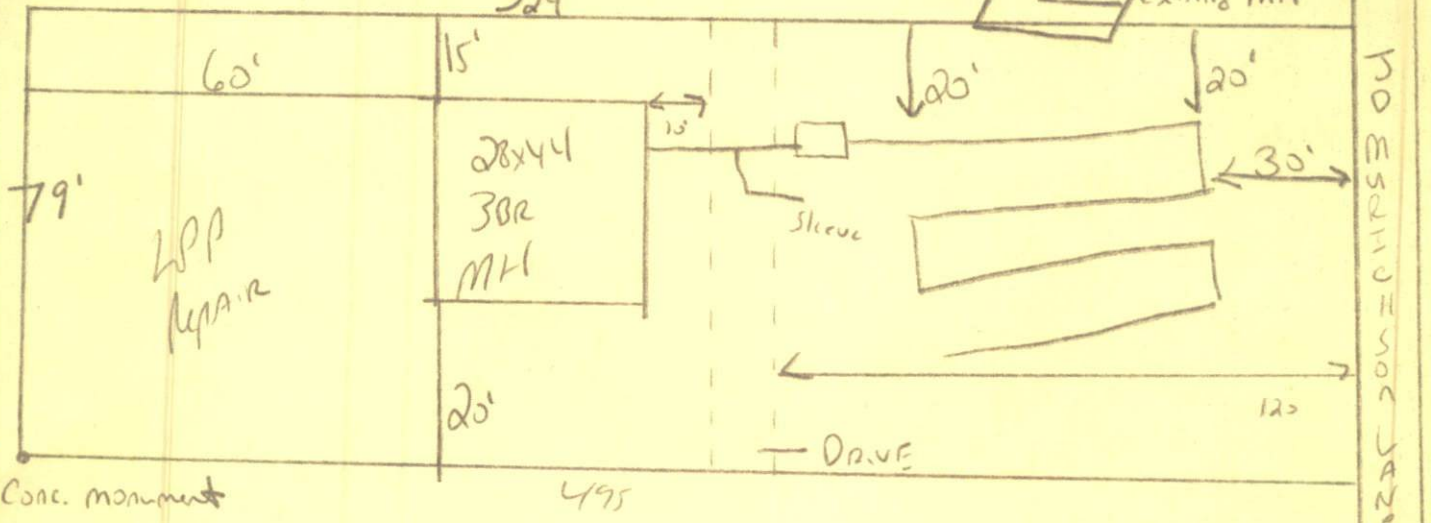

Keep Drain Line 20' from Property Line That has existing MH across it. Sleeve PVC Pipe where it cross driveway. Do not place any part of septic system within driveway. Keep system 30' from JD MURICHSON Lane. Do not drive or park on septic system.

HARNETT COUNTY HEALTH DEPARTMENT  
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 18524. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent Chestine Blue

Name: \_\_\_\_\_ Telephone # 499-6828

Address: \_\_\_\_\_

Property Location: SR # 1205 Road Name \_\_\_\_\_

New Installation  Repair  Septic Tank  Nitrification Lines

Subdivision \_\_\_\_\_ Lot # \_\_\_\_\_

Number of Bedrooms Proposed: 3 (20x44) Lot size: 1.0 AC

Basement  With Plumbing  Without Plumbing

Water Supply: Well  Public  Minimum Well Setback: 50 ft.

Type of System: Conventional  Other

Tank Volume: Septic Tank 1000 gallons Pump Chamber \_\_\_\_\_ gallons

Nitrification Field Specifications

Number of fields 1 Number of Lines per Field 1 Length of lines 200

Width of ditches 3 ft. Depth of ditches 18-24 inches

French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department  
Name: [Signature] Date: 9-14-01

(Revised 2/96)CNSTRCT.WPD