

IMPROVEMENT PERMIT

02-5-4016

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Susan Rogers Driggers New Installation Septic Tank
Property Location: SR# 1323 Repairs Nitrification Line

Subdivision Knoll Brook Est. Lot # 5

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 (16x76) Lot Size: 6.16 ac

Basement with Plumbing: Garage: MUST meet on site

Water Supply: Well Public Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons


Subsurface Drainage Field No. of ditches 1 exact length of each ditch 240 ft. width of ditches 3 ft. depth of ditches 18 MAX in.

French Drain Required: _____ Linear feet

Date: 02-19-02

This permit is subject to revocation if site plans or intended use change.

Signed: J. W. [Signature]
Environmental Health Specialist

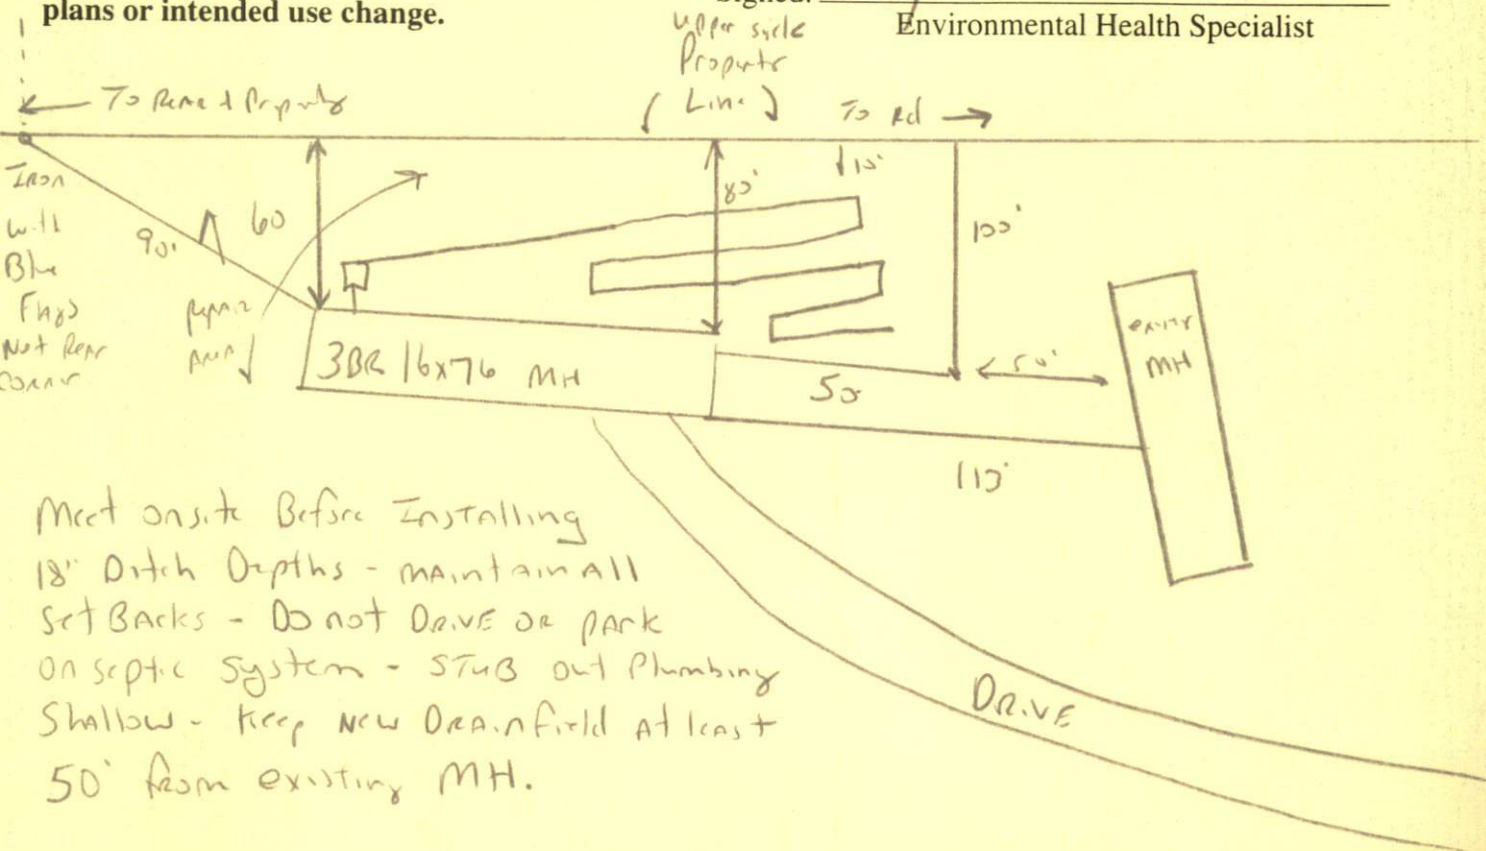

Meet on site Before Installing
18" Ditch Depths - maintain all
Setbacks - Do not Drive or Park
on septic system - STUB out Plumbing
Shallow - keep new Drainfield at least
50' from existing MH.

ARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department, Improvement Permit # 18717. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Name Susan R. Origer Telephone # 919-498-3427

Address _____

Property Location SR# 1320 Road Name Milton Welch

Subdivision Knoll Brook Est Lot # 5 # Bedrooms Proposed 3 (16x76) Lot size 6.1 AC

TYPE OF SYSTEM

New Installation Repair Septic Tank Nitrification Lines

Conventional Other _____

Basement With Plumbing Without Plumbing

Water Supply: Well Public - Minimum Well Setback: _____ Ft.

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 1 Length of lines 240 Ft.

Width of ditches 3 ft. Depth of ditches 18 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Signature of Authorized Agent for Harnett County [Signature]

Date 02-19-02