

SITE/SOIL EVALUATION FOR ON-SITE WASTEWATER

| FACTORS | | PROFILES | | | | | | | | | |
|----------------------------|-------------|----------|----|----|---|---|---|---|---|---|----|
| | | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |
| LANDSCAPE POSITION | .1940 | L | L | L | | | | | | | |
| SLOPE (%) | .1940 | 2 | 2 | 2 | | | | | | | |
| HORIZON 1 DEPTH | | 0-30 | | | | | | | | | |
| TEXTURE GROUP | .1941(A)(1) | SL | | | | | | | | | |
| CONSISTENCE | .1941 | SM | | | | | | | | | |
| STRUCTURE | .1941(A)(2) | GL | | | | | | | | | |
| MINERALOGY | .1941(A)(3) | NSNP | | | | | | | | | |
| HORIZON 2 DEPTH | | 30-42 | | | | | | | | | |
| TEXTURE GROUP | .1941(A)(1) | SCL | | | | | | | | | |
| CONSISTENCE | .1941 | SM | | | | | | | | | |
| STRUCTURE | .1941(A)(2) | GL | | | | | | | | | |
| MINERALOGY | .1941(A)(3) | NSNP | | | | | | | | | |
| HORIZON 3 DEPTH | | | | | | | | | | | |
| TEXTURE GROUP | .1941(A)(1) | | | | | | | | | | |
| CONSISTENCE | .1941 | | | | | | | | | | |
| STRUCTURE | .1941(A)(2) | | | | | | | | | | |
| MINERALOGY | .1941(A)(3) | | | | | | | | | | |
| HORIZON 4 DEPTH | | | | | | | | | | | |
| TEXTURE GROUP | .1941(A)(1) | | | | | | | | | | |
| CONSISTENCE | .1941 | | | | | | | | | | |
| STRUCTURE | .1941(A)(2) | | | | | | | | | | |
| MINERALOGY | .1941(A)(3) | | | | | | | | | | |
| SOIL WETNESS | .1942 | 32 | 32 | 32 | | | | | | | |
| RESTRICTIVE HORIZON | .1944 | | | | | | | | | | |
| SAPROLITE | .1943/.1956 | | | | | | | | | | |
| CLASSIFICATION | .1948 | | | | | | | | | | |
| LONG TERM ACCEPTANCE RANGE | .1955 | .4 | .4 | .4 | | | | | | | |

PLAN APPROVAL

DISTRICT RA-20M USE DWMTN


BEDROOMS 4

ds April 02 C Beel
Planning Administrator

Required Property Line Setbacks

| | Minimum | Actual |
|--------|-----------|-----------|
| Front | <u>35</u> | <u>36</u> |
| Side | <u>10</u> | <u>34</u> |
| Corner | <u>20</u> | |
| Back | <u>25</u> | <u>95</u> |
| Other | <u>10</u> | <u>✓</u> |

Emuel Blue

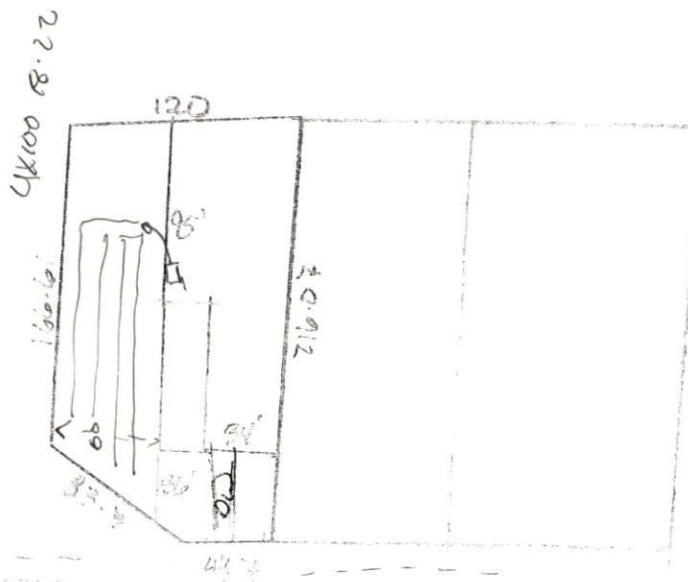

SA 1705
Old Fairground PD