

02-5-4881

HARNETT COUNTY HEALTH DEPARTMENT

No 13889

II. IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Freedom Homes

New Installation  Septic Tank

Property Location: SR# 1418 Oakridge River Rd.

Repairs  Nitrification Line

Subdivision Oakridge Bluffs Ph. 1 Lot # 3

Tax ID # \_\_\_\_\_ Quadrant # \_\_\_\_\_

Number of Bedrooms Proposed: 3 Lot Size: 4.48 Ac

Basement with Plumbing:  Garage:

Water Supply:  Well  Public  Community

Distance From Well: 50 min ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system:  Conventional  Other \_\_\_\_\_

Size of tank: Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons

Subsurface Drainage Field No. of ditches 4 exact length of each ditch 120 ft. width of ditches 3 ft. depth of ditches 18-20 in.


French Drain Required: \_\_\_\_\_ Linear feet

Date: 7/15/2002

This permit is subject to revocation if site plans or intended use change.

Signed: [Signature]  
Environmental Health Specialist

\*Maintain all setbacks  
\*Run ditches on contour

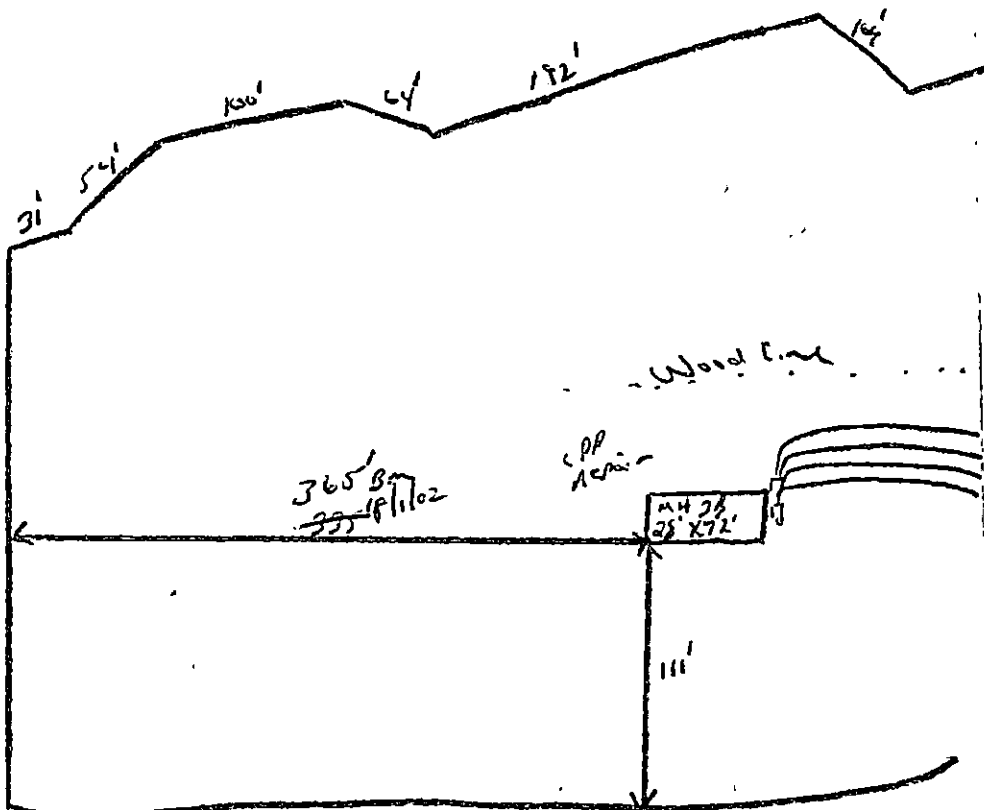

\*Not to scale

SR 1418

HARNETT COUNTY HEALTH DEPARTMENT  
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department, Improvement Permit # 13889. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Fredson Homes  
Name Telephone # 919-776-5959

1913 Keller Andrews Rd. Sanford, N.C. 27370  
Address

1418 Property Location SR# Oakridge Ln Road Name

Oakridge Bl. Pk 1 Subdivision 3 Lot # 3 # Bedrooms Proposed 4.48A Lot size

TYPE OF SYSTEM

New Installation  Repair  Septic Tank  Nitrification Lines

Conventional Other \_\_\_\_\_  Basement  With Plumbing  Without Plumbing

Water Supply:  Well  Public - Minimum Well Setback: 50 Ft.  
Septic Tank 1000 Pump Chamber \_\_\_\_\_

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 4 Length of lines 120 Ft.

Width of ditches 3 ft. Depth of ditches 18-20 inches

French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Bryan M. ... R.S. Signature of Authorized Agent for Harnett County 7/15/2002 Date