

**SOIL/SITE EVALUATION
 for ON-SITE WASTEWATER SYSTEM**

Owner:
 Address:
 Proposed Facility: Design Flow (.1949): **240 gpd**
 Location of Site:
 Water Supply: Public Individual Well
 Evaluation Method: Auger Boring Pit
 Type of Wastewater: Sewage Industrial Process

Applicant:
 Date Evaluated:
 Property Size:
 Property Recorded:
 Spring Other
 Cut
 Mixed

P R O F I L E #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
		0-12"	G LS	VFR NS/VP					US
		12-12"	PM	CR2 @ 12"					
		0-28"	G S	VFR NS/VP					PS
		0-32"	G S	VFR NS/VP	CR2 @ 30"				PS
		32-32"	PM						
		0-36"	GS	VFR NS/VP					PS
		36-36"	PM						
		0-32"	G S	VFR NS/VP	CR2 @ 30"				PS
		32-32"	PM						

Description	Initial System	Repair System
Available Space (.1945)	✓	✓
System Type(s)	CON.	UNDERGROUND CON.
Site LTAR	.R	.R

Other Factors (.1946): _____
 Site Classification (.1948): **PS**
 Evaluated By: **CV**
 Others Present:


COMMENTS: _____

<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE FR-FRIABLE FI-FIRM VFI-VERY FIRM EFI-EXTREMELY FIRM	NS-NON-STICKY SS-SLIGHTLY STICKY S-STICKY VS-VERY STICKY NP-NON-PLASTIC SP-SLIGHTLY STICKY P-PLASTIC VP-VERY PLASTIC
S-SHOULDER SLOPE		LS-LOAMY SAND			
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6		
FS-FOOT SLOPE		L-LOAM			
N-NOSE SLOPE	III	SI-SILT-	0.6 - 0.3		
H-HEAD SLOPE		SIL-SILT LOAM			
CC-CONCLAVE SLOPE		CL-CLAY LOAM			
CV-CONVEX SLOPE		SCL-SANDY CLAY LOAM			
T-TERRACE		SIC-SILTY CLAY			
FP-FLOOD PLAN	IV	C-CLAY	0.4 - 0.1		
		SC-SANDY CLAY			

STRUCTURE
 SG-SINGLE GRAIN
 M-MASSIVE
 CR-CRUMB
 GR-GRANULAR
 SBK-SUBANGULAR BLOCKY
 ABK-ANGULAR BLOCKY
 PL-PLATY
 PR-PRISMATIC

MINERALOGY
 SLIGHTLY EXPANSIVE
 EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

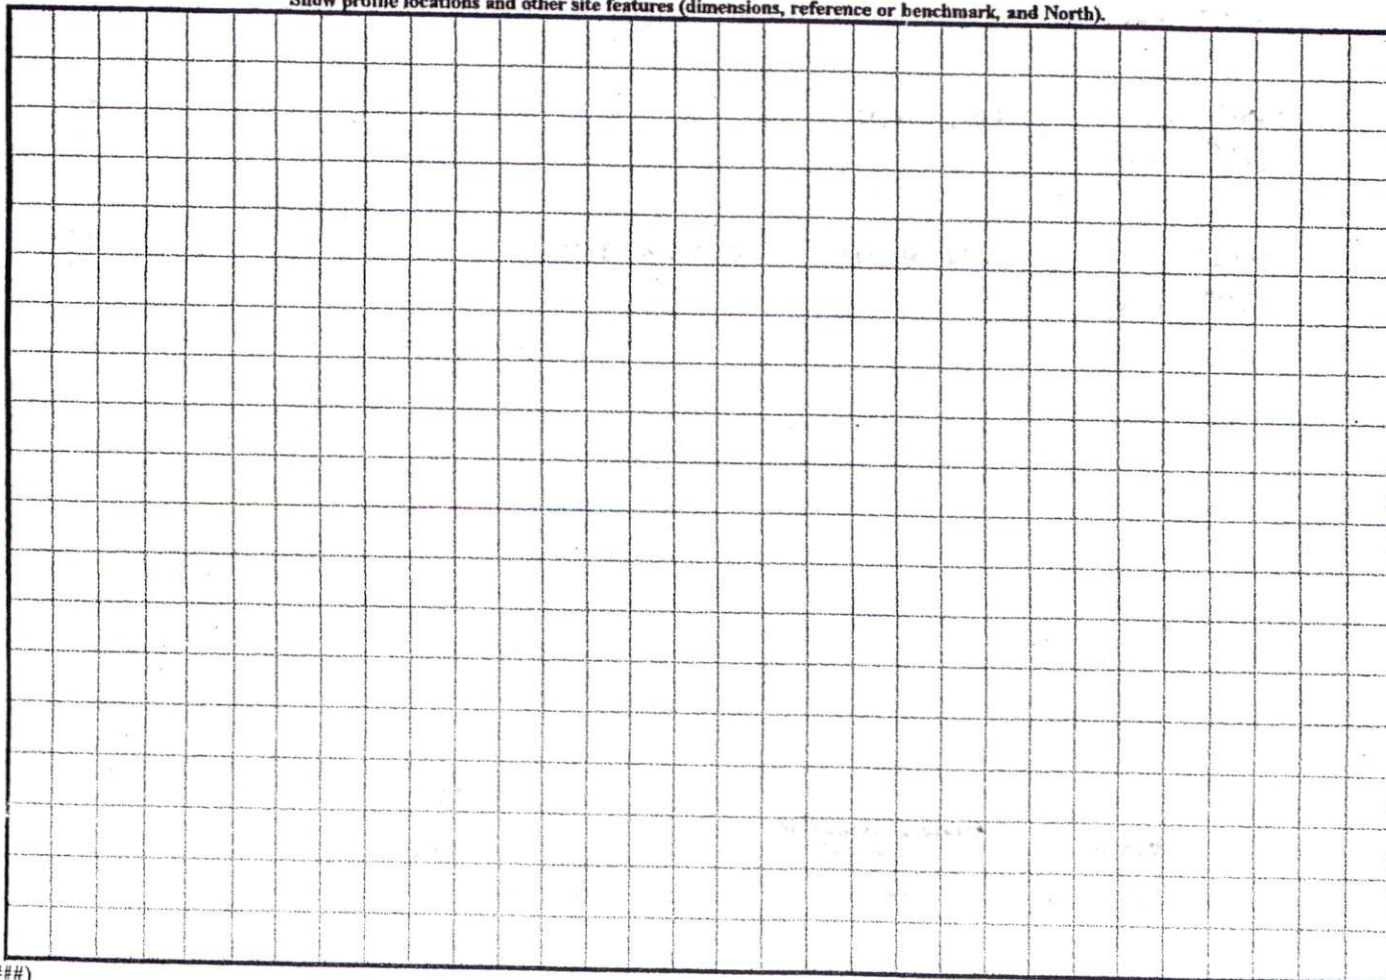

AREA OF A
SELS OF
MUNICIPALITY
LAND
FITTING PARCEL
W
HER
THE
NATION OF
E
DAY OF

SITE PLAN APPROVAL
DISTRICT None USE DWMT
#BEDROOMS 2
Date 10/2/00 Zoning Administrator [Signature]

12.32 ACRES
INCLUDING RAILROAD R/W
AND EASEMENT

[Signature]
Billy Blodgett

FEDERAL PAPERBOARD COMPANY INC.

the
this plan
uilding
or
he land
tt

[Signature]
Megan Anderson
Johnston

J.B. GIBBS, HELEN J. MELVIN
& POLLY M. OETTINGER

SCALE
TIE LINE

