

HTE# 05-50013095R

IMPROVEMENT PERMIT 22319

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Johnny Wayne Shirley New Installation Septic Tank Repair
 Property Location: SR# 1245 S. Hill Nitrification Line Expansion
 Subdivision Beagle Run Lot # 5
 Tax ID# _____ Quadrant # _____
 Number of Bedrooms Proposed: 3 (28x66) 360 gpd Lot Size: .55 ac

Basement with Plumbing: Garage:
 Water Supply: Well Public Community
 Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____
 Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons


Subsurface Drainage Field No. of ditches 1 exact length 300 ft. width of ditches 3 ft. depth of ditches 18 in.

French Drain Required: _____ Linear feet

Date: 10-14-05
 PERMIT EXPIRES 5 YEARS FROM ABOVE DATE

This permit is subject to revocation if site plans or intended use change.

Signed: J. L. ...
 Environmental Health Specialist

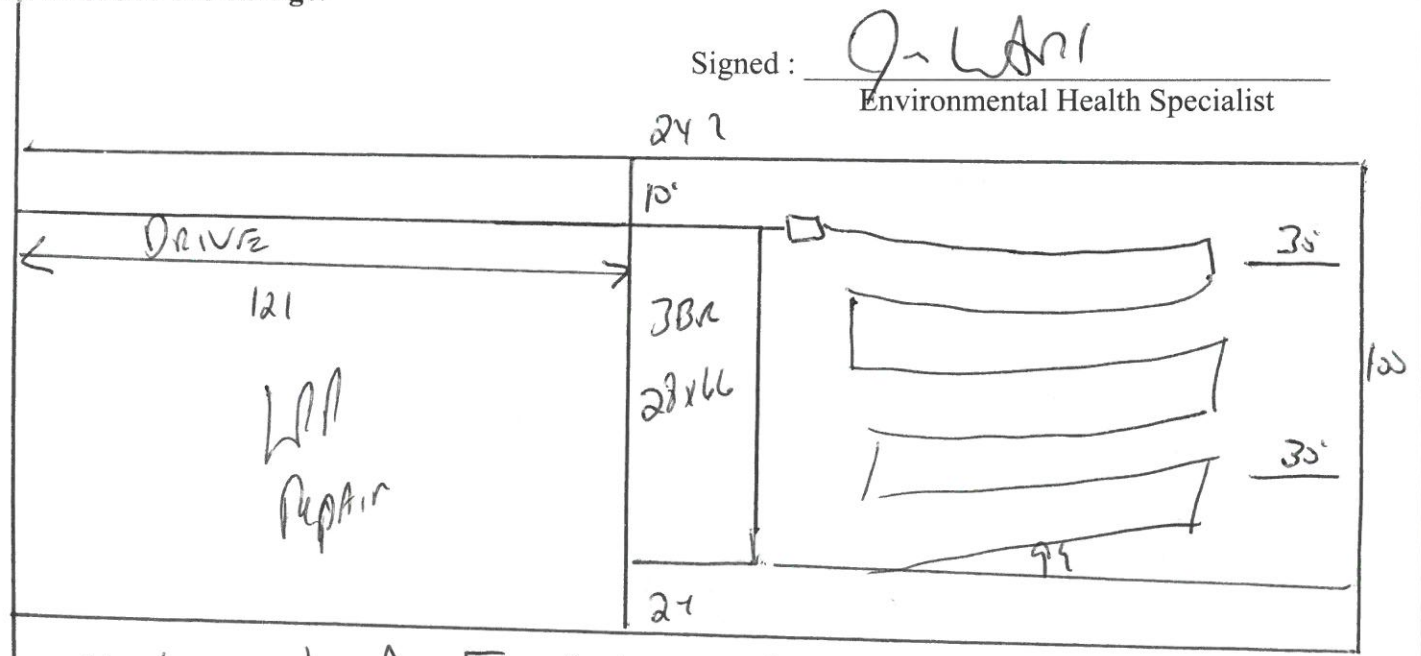

Meet onsite for Final layout 242
 STUB out Plumbing shallow (Ground level or higher)

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 22317. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Johnny Wayne Shinker
Name

Telephone #

Address

1295

Property Location SR#

Road Name

Beagle Run
Subdivision

5
Lot #

3 (28x66) 20 sq ft
Bedrooms Proposed

10.55 Ac
Lot Size

TYPE OF SYSTEM

- New Installation [] Repair Septic Tank Nitrification Lines
 Conventional [] Other _____

[] Basement [] With Plumbing [] Without Plumbing

Water Supply: [] Well Public Water Supply Minimum Well Setback: 50 Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 1 Length of lines 300 Ft.

Width of ditches 3 ft. Depth of ditches 18 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Jon West RS
Signature of Authorized Agent for Harnett County

10-14-05
Date