

PERMIT # 25224

Operation Permit☒ New Installation ☒ Septic Tank ☐ Repair ☒ Nitrification Line ☐ Expansion

PROPERTY LOCATION: 1270

Name: (owner) Douglas Ayers

SUBDIVISION Johnny Faircloth

LOT # 3

System Installer: Terry Maples

Registration #

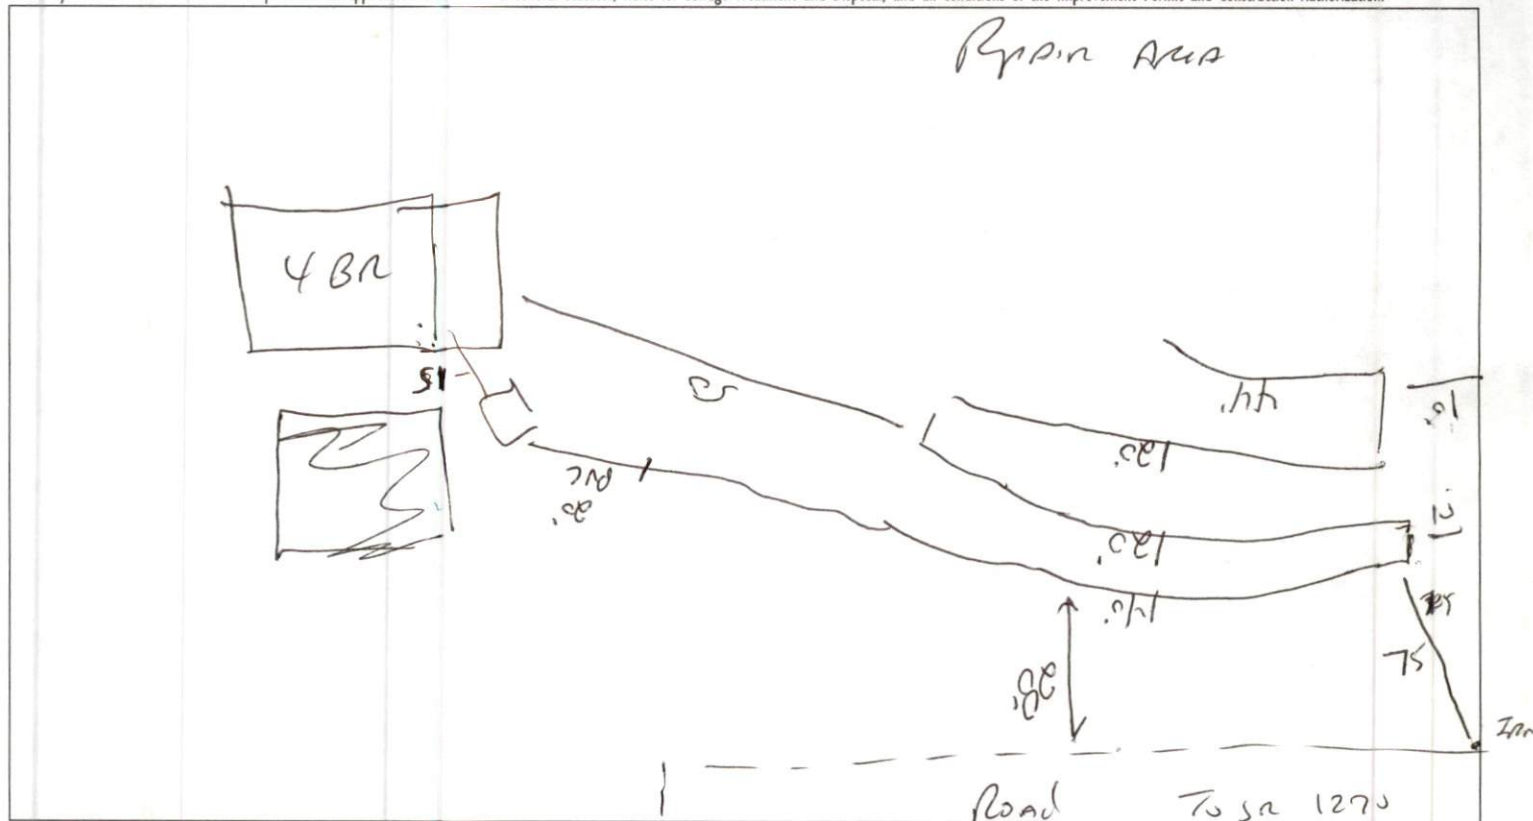
Basement with plumbing: ☐ Garage ☐ Number of BedroomsType of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well 150 feet

System Type: Quick 4 III Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

**PERMIT CONDITIONS:**

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other:

Subsurface system operator required? Yes ☐ No ☐

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation:

V. Other:

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other Quick 4Subsurface No. of exact length
Drainage Field ditches 1 of each ditch 410 feet

French Drain Required: Linear feet

Septic Tank: 1000 gallons Pump Tank: gallons

width of depth of
ditches 3 feet ditches 18 inches

Authorized State Agent

Joe Woods

Date 02.17.09